

DAMMON ENGINEERING, INC.

CHIEF ENGINEER EMMETT DAMMON, P.E.

CHIEF ARCHITECT ROBERT WILTSE

554 OLD SPANISH TRAIL SLIDELL, LA. 70458 OFFICE: 985-649-5832 FAX: 985-641-5950

WEBSITE: WWW.DAMMONENGINEERING.COM EMAIL: DAMMONENG@BELLSOUTH.NET

ARCHITECTURE ENGINEERING STUDIES PLANNING INVESTIGATION EXPERT WITNESS

LA QUINTA INN & SUITES

SPORTSMAN PARK LOT 14 CABLE'S PARKWAY GONZALES LOUISIANA

PANEL SCHEDULES

REV: SCALE: AS NOTED JOB#: 2141 DATE: 07-03-12 SHEET 33 E-4 OF 36

PANEL P1-1 ELECTRICAL ROOM. VOLTAGE: 208/120V, 200A, 3Ø, 4W LOAD CENTER. LOCATION: ELECTRICAL ROOM. ENCLOSURE: SURFACE MOUNTED EQUIPMENT GRD BAR WITH BOLT-ON BREAKERS. FEEDER SOURCE: ENTERGY.

PANEL P1-4 ELECTRICAL ROOM. VOLTAGE: 208/120V, 200A, 3Ø, 4W LOAD CENTER. LOCATION: ELECTRICAL ROOM. ENCLOSURE: SURFACE MOUNTED EQUIPMENT GRD BAR WITH BOLT-ON BREAKERS. FEEDER SOURCE: ENTERGY.

NEW PANEL: L-1 ELECTRICAL ROOM. VOLTAGE: 208/120V, 200A, 3Ø, 4W LOAD CENTER. LOCATION: ELECTRICAL ROOM. ENCLOSURE: SURFACE MOUNTED EQUIPMENT GRD BAR WITH BOLT-ON BREAKERS. FEEDER SOURCE: MDP.

NEW PANEL: L-4 ELECTRICAL ROOM. VOLTAGE: 208/120V, 200A, 3Ø, 4W LOAD CENTER. LOCATION: ELECTRICAL ROOM. ENCLOSURE: SURFACE MOUNTED EQUIPMENT GRD BAR WITH BOLT-ON BREAKERS. FEEDER SOURCE: MDP.

PANEL P1-2 ELECTRICAL ROOM. VOLTAGE: 208/120V, 200A, 3Ø, 4W LOAD CENTER. LOCATION: ELECTRICAL ROOM. ENCLOSURE: SURFACE MOUNTED EQUIPMENT GRD BAR WITH BOLT-ON BREAKERS. FEEDER SOURCE: ENTERGY.

PANEL P1-5 ELECTRICAL ROOM. VOLTAGE: 208/120V, 200A, 3Ø, 4W POWER PANEL. LOCATION: ELECTRICAL ROOM. ENCLOSURE: SURFACE MOUNTED EQUIPMENT GRD BAR WITH BOLT-ON BREAKERS. FEEDER SOURCE: ENTERGY.


NEW PANEL: L-2 ELECTRICAL ROOM. VOLTAGE: 208/120V, 200A, 3Ø, 4W LOAD CENTER. LOCATION: ELECTRICAL ROOM. ENCLOSURE: SURFACE MOUNTED EQUIPMENT GRD BAR WITH BOLT-ON BREAKERS. FEEDER SOURCE: MDP.

NEW PANEL: L-3 ELECTRICAL ROOM. VOLTAGE: 208/120V, 200A, 3Ø, 4W LOAD CENTER. LOCATION: ELECTRICAL ROOM. ENCLOSURE: SURFACE MOUNTED EQUIPMENT GRD BAR WITH BOLT-ON BREAKERS. FEEDER SOURCE: MDP.

PANEL P1-3 ELECTRICAL ROOM. VOLTAGE: 208/120V, 200A, 3Ø, 4W LOAD CENTER. LOCATION: ELECTRICAL ROOM. ENCLOSURE: SURFACE MOUNTED EQUIPMENT GRD BAR WITH BOLT-ON BREAKERS. FEEDER SOURCE: ENTERGY.

PANEL P1-6 ELECTRICAL ROOM. VOLTAGE: 208/120V, 200A, 3Ø, 4W POWER PANEL. LOCATION: ELECTRICAL ROOM. ENCLOSURE: SURFACE MOUNTED EQUIPMENT GRD BAR WITH BOLT-ON BREAKERS. FEEDER SOURCE: ENTERGY.

NEW PANEL: L-3 ELECTRICAL ROOM. VOLTAGE: 208/120V, 200A, 3Ø, 4W LOAD CENTER. LOCATION: ELECTRICAL ROOM. ENCLOSURE: SURFACE MOUNTED EQUIPMENT GRD BAR WITH BOLT-ON BREAKERS. FEEDER SOURCE: MDP.

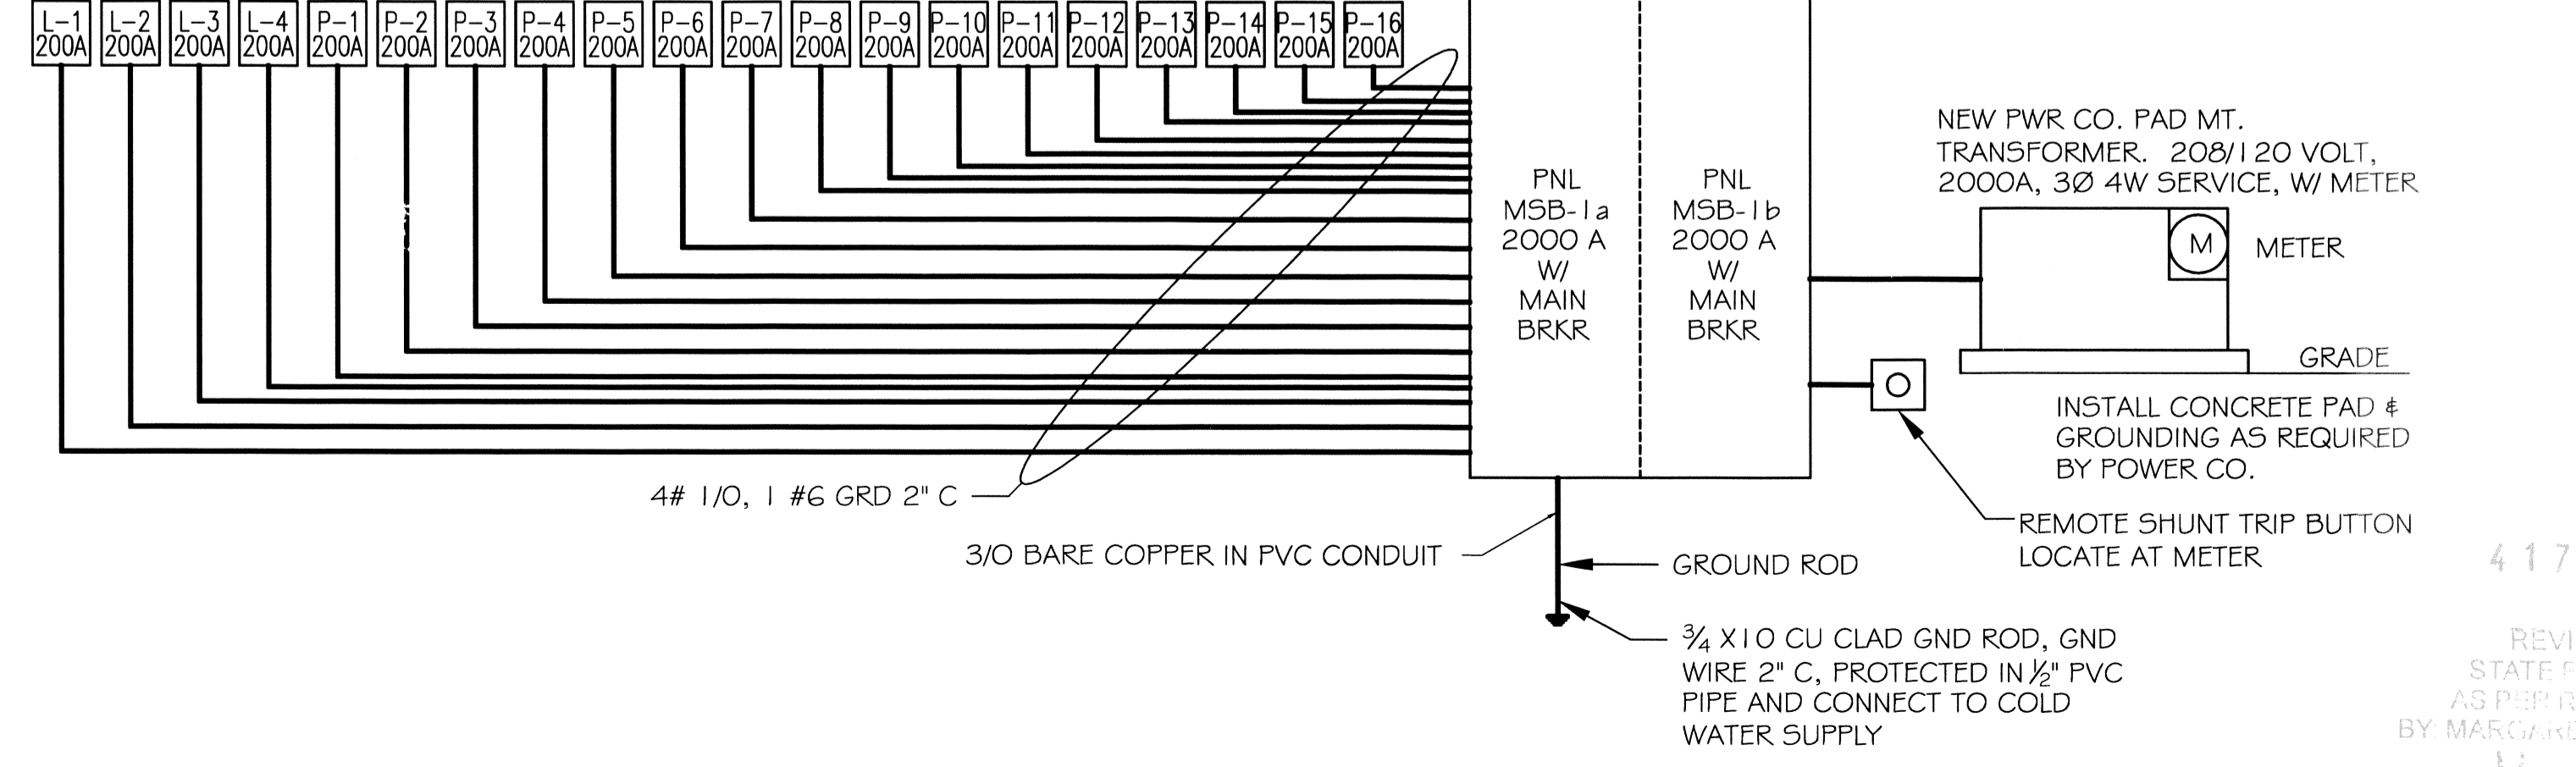

ELECTRICAL ONE LINE DIAGRAM N.T.S.

REVIEWED FOR STATE FIRE MARSHAL AS PER REVISED LETTER BY MARGARET WILTZ ARCHITECT