

STIPULATION FOR REUSE
 THESE DRAWINGS ARE PREPARED FOR
 USE ON A SPECIFIC SITE AT
 CONTINGUOUSLY WITH ITS ISSUE
 DATE. ANY REUSE OF THESE
 DRAWINGS FOR USE ON A DIFFERENT
 PROJECT SITE OR AT A LATER DATE
 WITHOUT THE WRITTEN CONSENT OF
 HARRISON FRENCH & ASSOCIATES, LTD.
 IS STRICTLY PROHIBITED. ANY
 UNAUTHORIZED REUSE OF THESE
 DRAWINGS IS AT THE USER'S SOLE
 RISK AND HFA AND ITS CONTRACTORS
 SHALL BE RELEASED FROM ALL
 LIABILITY AND MAY BE CONSIDERED TO
 BE PROVIDING PROFESSIONAL SERVICES
 UNDER A SEPARATE CONTRACT.

Loves
 STORE NUMBER: 860
 I-59, EXIT 1
 NICHOLSON, MS 39463
 JOB NUMBER: 03-22-30003

ISSUE BLOCK

NO.	DATE	DESCRIPTION


CHECKED BY: LST
 DRAWN BY: CRM
 DOCUMENT DATE: 02/06/23

LINGSHEN TSAO
 LICENSED PROFESSIONAL
 ENGINEER
 STATE OF MISSISSIPPI
 20847

 2023.02.06 14:08:07-06:00'

FOUNDATION
 PLAN

SHEET:
S101

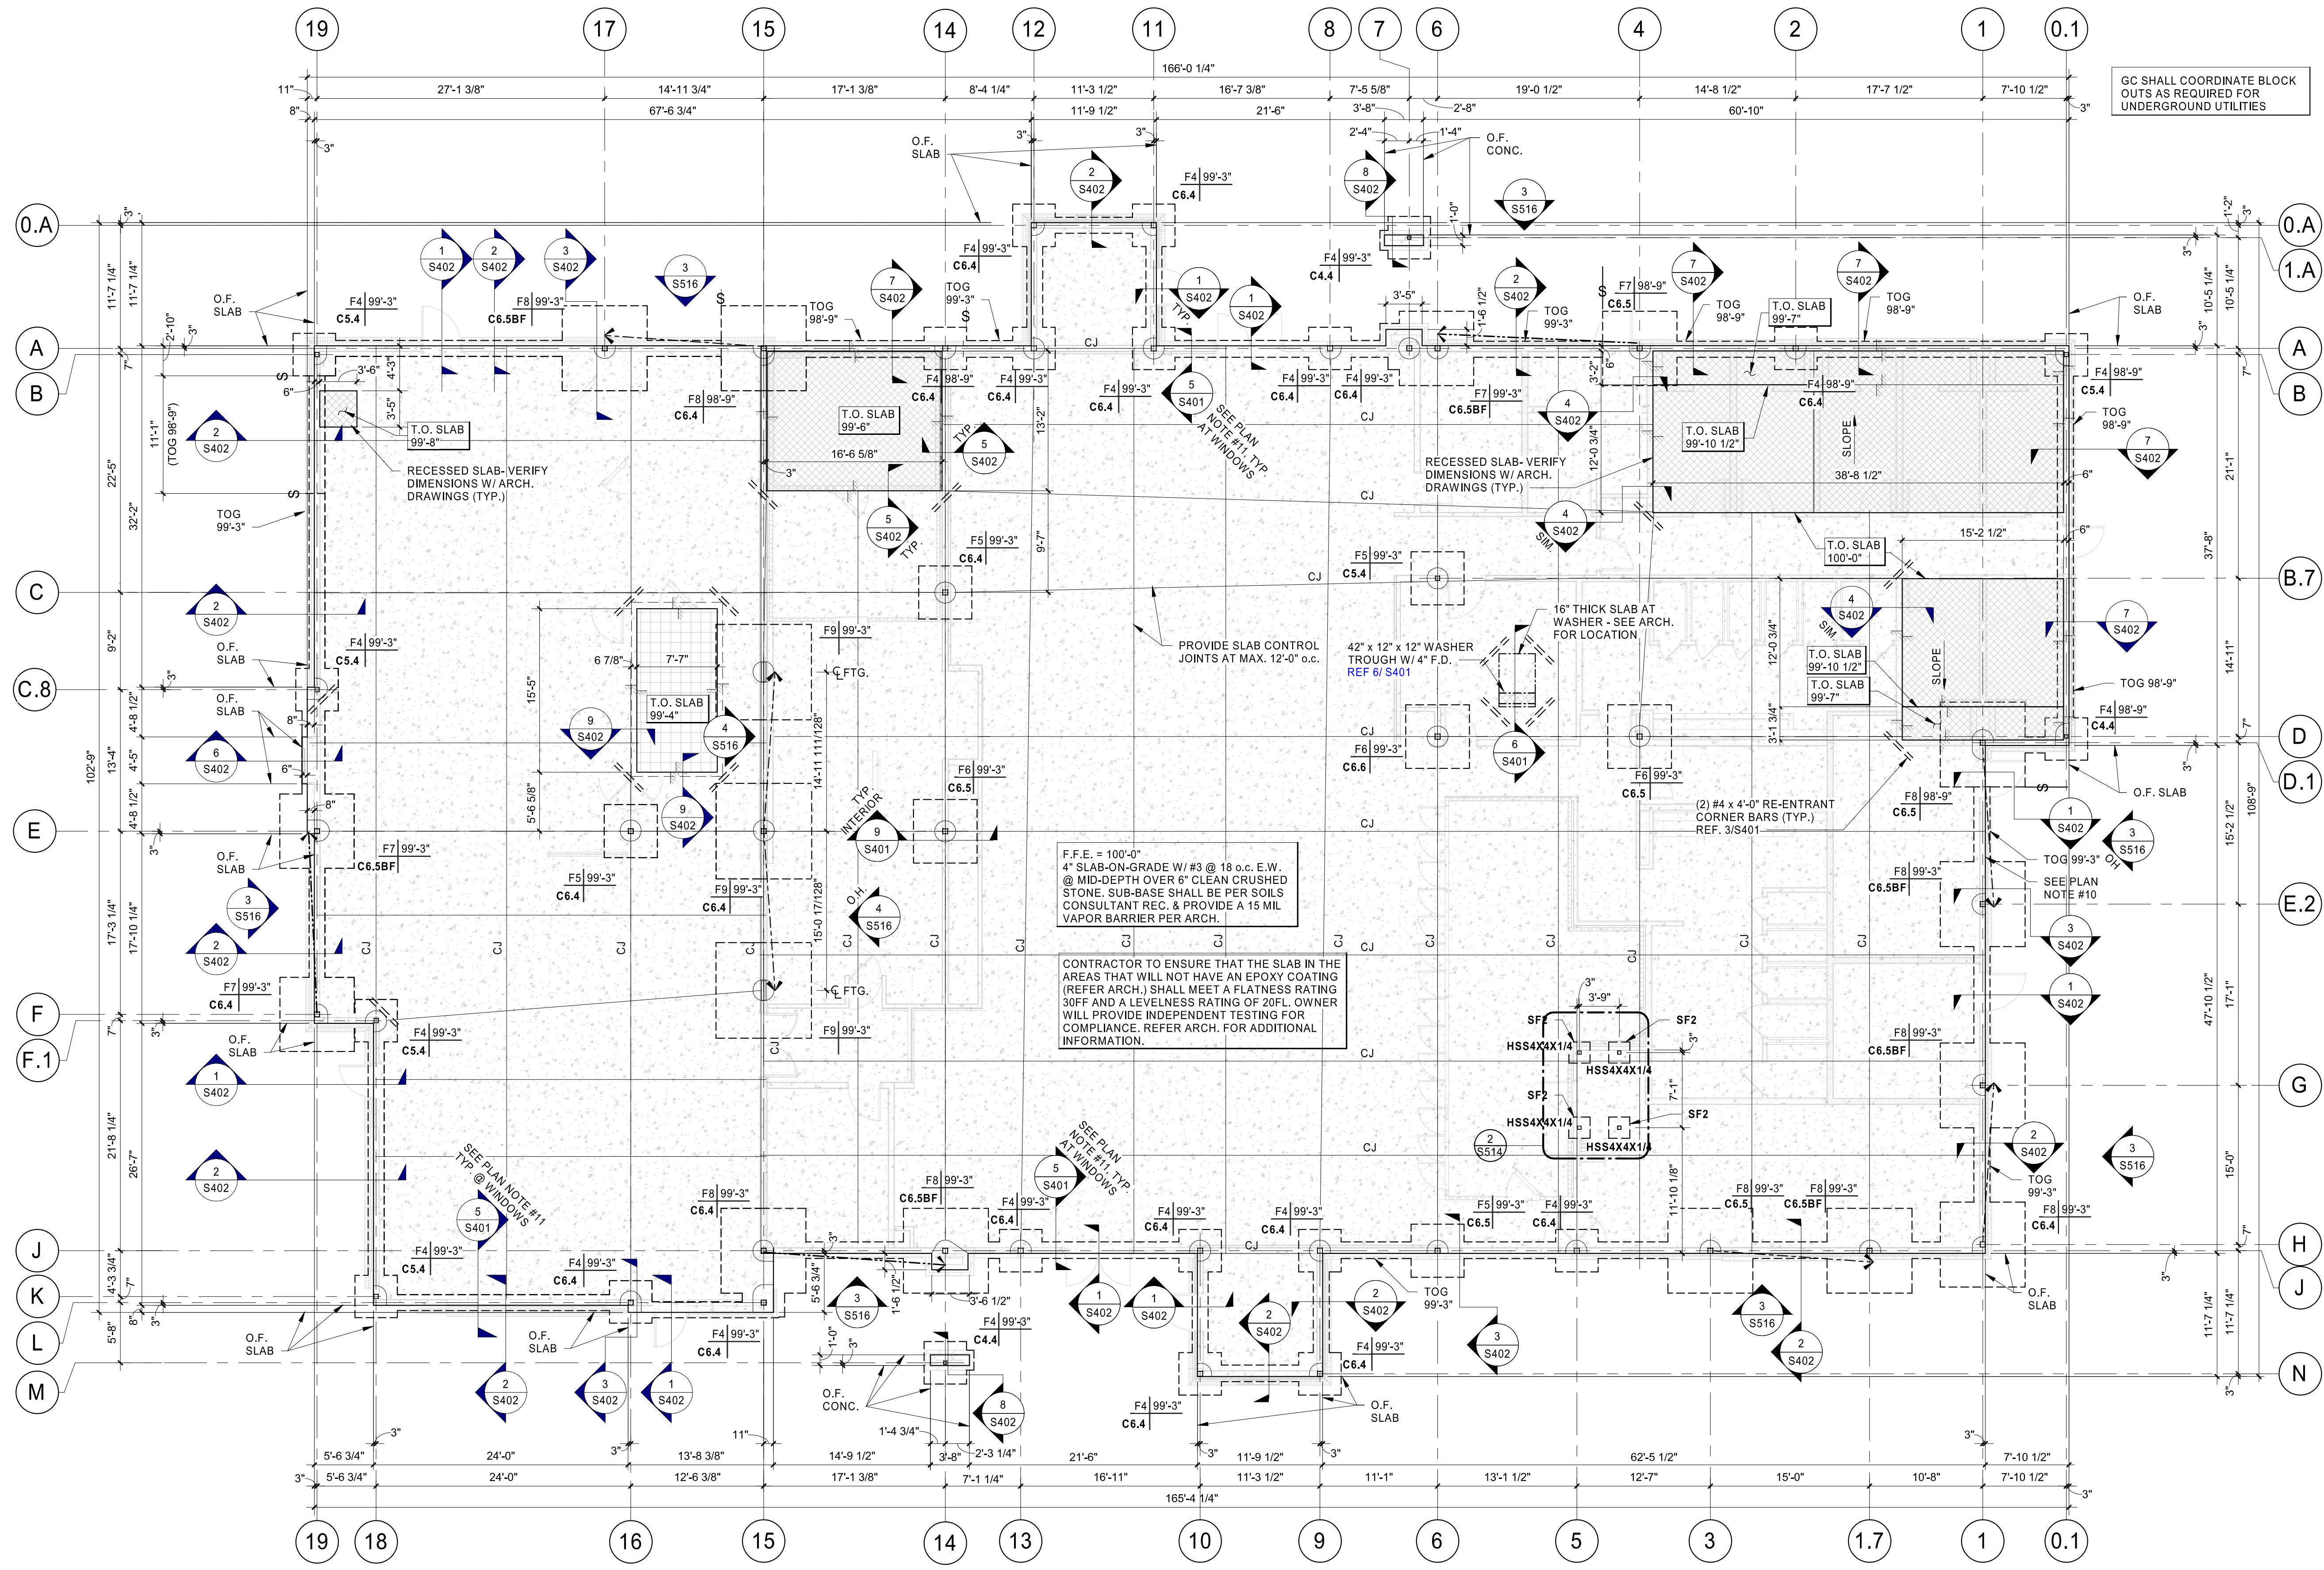


GC SHALL COORDINATE BLOCK
 OUTS AS REQUIRED FOR
 UNDERGROUND UTILITIES

F.F.E. = 100'-0"
 4" SLAB-ON-GRADE W/ #3 @ 18" o.c. E.W.
 @ MID-DEPTH OVER 6" CLEAN CRUSHED
 STONE. SUB-BASE SHALL BE PER SOILS
 CONSULTANT REC. & PROVIDE A 15 MIL
 VAPOR BARRIER PER ARCH.

CONTRACTOR TO ENSURE THAT THE SLAB IN THE
 AREAS THAT WILL NOT HAVE AN EPOXY COATING
 (REFER ARCH.) SHALL MEET A FLATNESS RATING
 30FF AND A LEVELNESS RATING OF 20FL. OWNER
 WILL PROVIDE INDEPENDENT TESTING FOR
 COMPLIANCE. REFER ARCH. FOR ADDITIONAL
 INFORMATION.

COORDINATE LOCATIONS OF PLUMBING LINES W/ PLUMBER
 PRIOR TO POURING FOOTINGS & SLAB-ON-GRADE.



1 OVERALL FOUNDATION PLAN
 1/8" = 1'-0"

LEGEND:

- FOOTING MARK (SEE FTG. SCHEDULE ON THIS SHEET)
- TOP OF FOOTING ELEVATION
- COLUMN MARK (SEE COL. SCHEDULE ON SHEET S121)
- DENOTES OUTSIDE FACE
- DENOTES TOP OF GRADE BEAM ELEVATION
- DENOTES SLOPED SLAB
- DENOTES LIMITS OF RECESSED 4" SLAB-ON-GRADE (SEE PLAN NOTE #1)
- DENOTES SLAB ELEVATION CHANGE
- DENOTES THICKENED SLAB
- DENOTES FOOTING STEP REF. 4/S401
- DENOTES LOCATION OF DIAGONAL BRACING REF. 3/S516

PLAN NOTES:

1. 4" SLAB-ON-GRADE CONSTRUCTION: 4" CONCRETE SLAB REINFORCED W/ #3 @ 18" EA. WAY AT MID-DEPTH ON STEGO 15 MIL CLASS A VAPOR BARRIER OVER 6" LAYER OF CLEAN CRUSHED STONE.
2. SEE DWG. S002 FOR GENERAL NOTES & TYPICAL DETAILS.
3. SEE ARCH. PLUMBING DWGS. FOR EXACT LOCATIONS OF ALL FLOOR DRAINS & SLOPED SLABS.
4. ALL ELEVATIONS BASED ON FINISH FLOOR EL. 100'-0". ACTUAL FINISH FLOOR ELEVATION 38.00' (COORDINATE WITH CIVIL DWGS).
5. ALL TOP OF GRADE BEAM ELEVATION (TOG EL.) 99'-3" (U.N.O.).
6. "CJ" DENOTES CONTROL JOINT (REF. 1/S401).
7. "CSJ" DENOTES CONSTRUCTION JOINT (REF. 2/S401).
8. SEE ARCH./CIVIL DWGS. FOR DIMENSIONS NOT SHOWN.
9. COORDINATE DOOR LOCATIONS WITH ARCH. DWGS..
10. CONNECTION POINT FOR CONCRETE ENCASED GROUNDING ELECTRODE. EXTEND #30 BARE CONDUCTOR 20'-0" AT BOTTOM OF FOUNDATION WITH MINIMUM OF 2" COVERAGE. SLEEVE CONDUCTOR UP THROUGH CONCRETE WITH 3" SCHEDULE 80 PVC CONDUIT.
11. PROVIDE WALL STUD SUPPORT CLIP BELOW THE WINDOW SILL (REF. 5/S401)

FOOTING SCHEDULE

FOOTING MARK	FOOTING SIZE B x L x t	REINFORCING	REMARKS
F4	4'-0" x 4'-0" x 2'-0"	(5) #5 EA. WAY TOP & BOTTOM	-----
F5	5'-0" x 5'-0" x 2'-0"	(6) #5 EA. WAY TOP & BOTTOM	-----
F6	6'-0" x 6'-0" x 2'-0"	(7) #5 EA. WAY TOP & BOTTOM	-----
F7	7'-0" x 7'-0" x 2'-6"	(8) #6 EA. WAY TOP & BOTTOM	-----
F8	8'-0" x 8'-0" x 2'-6"	(9) #6 EA. WAY TOP & BOTTOM	-----
F9	9'-0" x 9'-0" x 2'-6"	(10) #6 EA. WAY TOP & BOTTOM	-----
SF2	2'-0" x 2'-0" x 1'-3"	(4) #5 EA. WAY TOP & BOTTOM	-----

2/16/2023 1:46:30 PM
 C:\Users\lfrank\OneDrive\Documents\2023 Files\Projects\03-22-30003\MS_S101_F1_Foundation Plan.dwg
 2/16/23 1:46:30 PM