

STIPULATION FOR REUSE
 THESE DRAWINGS ARE PREPARED FOR
 USE ON A SPECIFIC SITE AT
 THE LOCATION AND DATE SPECIFIED
 CONTINGENT UPON THE ISSUANCE
 OF A PERMIT BY THE LOCAL
 AUTHORITY. THESE DRAWINGS ARE
 NOT TO BE REUSED FOR ANY OTHER
 PROJECT, SITE OR AT A LATER TIME
 WITHOUT THE WRITTEN CONSENT OF
 HARRISON FRENCH & ASSOCIATES,
 A PROFESSIONAL ENGINEERING
 FIRM. ANY REUSE OF THESE DRAWINGS
 WITHOUT THE WRITTEN CONSENT OF
 HARRISON FRENCH & ASSOCIATES
 IS PROHIBITED AND MAY BE
 CONSIDERED A VIOLATION OF THE
 PROFESSIONAL ENGINEERING
 BOARD OF ARKANSAS RULES AND
 REGULATIONS.

Loves
 STORE NUMBER: 860
 I-59, EXIT 1
 NICHOLSON, MS 39466
 JOB NUMBER: 03-23-30009
 TIER 1 180

ISSUE BLOCK

CHECKED BY: CAR
 DRAWN BY: SED
 DOCUMENT DATE: 2/7/2023
 PROTO: TIER 1 180
 PROTO CYCLE: Q4 - 2022





ROOF POWER PLAN

SHEET: **E421**

KEYNOTES

26.400	PROVIDE ALL INTERLOCKING BETWEEN EVAPORATOR AND CONDENSER FOR A COMPLETE AND OPERATIONAL SYSTEM AS REQUIRED.
26.407	EQUIPMENT DISCONNECT SWITCHES SHALL BE SUPPLIED AND PREWIRED FOR CONNECTION TO COOLER/FREEZER/STORAGE PACKAGE. ELECTRICAL CONTRACTOR SHALL MAKE ALL FINAL CONNECTIONS. E.C. SHALL COORDINATE CIRCUIT BREAKER WITH MANUFACTURER FOR PROPER FEEDER SIZING TO PANELBOARD.
26.436	PROVIDE CIRCUITRY FOR ELECTRIC DEFROST FROM CONDENSING UNIT TO FREEZER EVAPORATORS. REF ENLARGED POWER PLAN FOR CIRCUIT REQUIREMENTS.
26.440	REFER TO MANUFACTURERS REQUIREMENTS FOR ICE MACHINE WIRING. CONNECT TO INTERIOR EQUIPMENT.
26.449	STUB UP ELECTRICAL FOR RTU INSIDE UNIT CURB AND CONNECT UNIT AT DISCONNECT. CONNECT DUCT SMOKE DETECTOR TO FIRE ALARM CONTROL PANEL AND WIRE FOR UNIT SHUTDOWN UPON ACTIVATION. REFER TO MECHANICAL EQUIPMENT CONNECTION SCHEDULE FOR RTU CONNECTION REQUIREMENTS. DISCONNECT IS FIELD INSTALLED AND FIELD WIRED. GFCI RECEPTACLE IS FACTORY INSTALLED AND SHALL BE FIELD WIRED. REFERENCE FIELD MOUNTING OF ROOFTOP UNIT DISCONNECT DETAIL.
26.493	E.C. SHALL MAKE ALL CONNECTIONS BETWEEN THE OUTDOOR UNIT (HP) AND INDOOR UNIT(S) (DFC) OF THE MINI-SPLIT SYSTEMS.

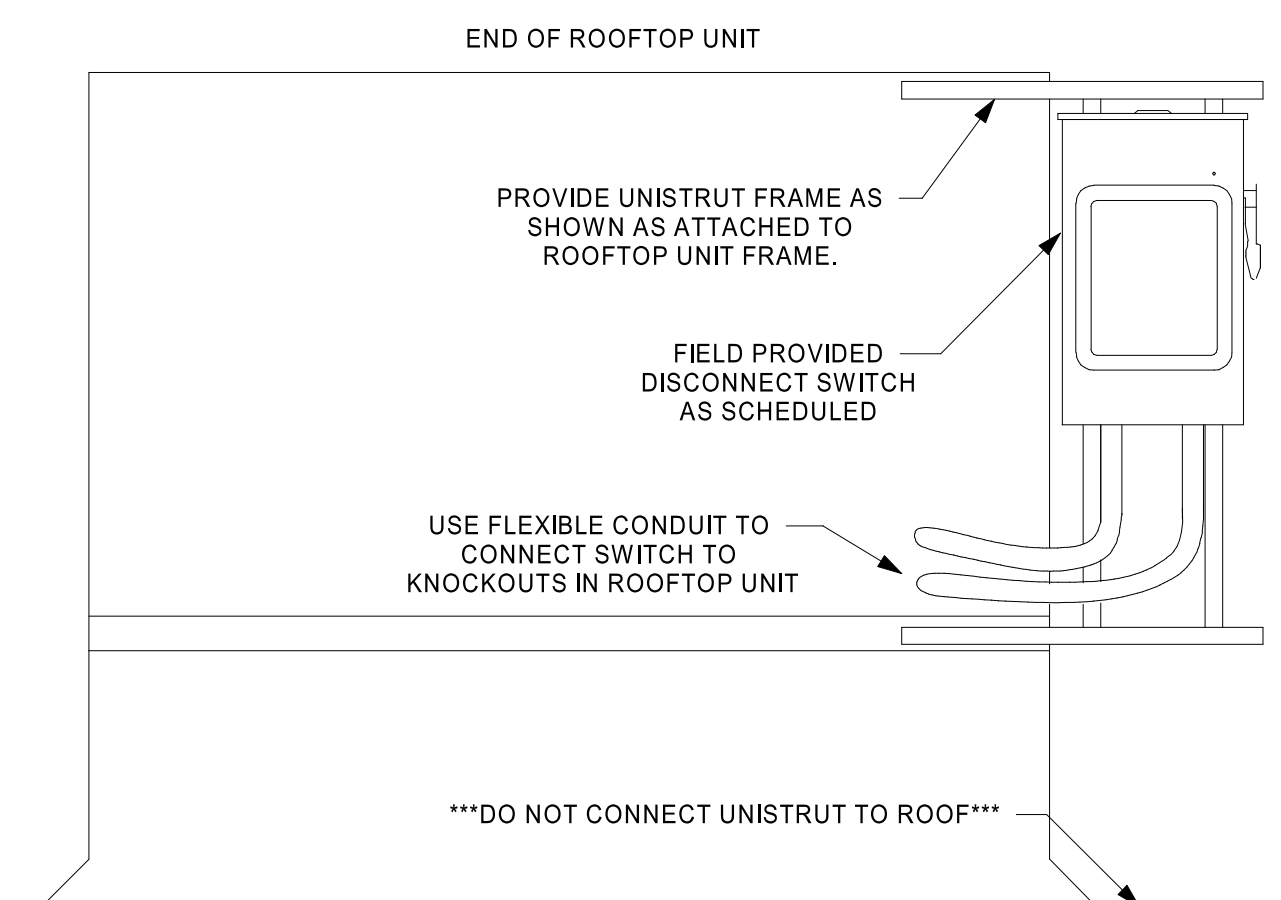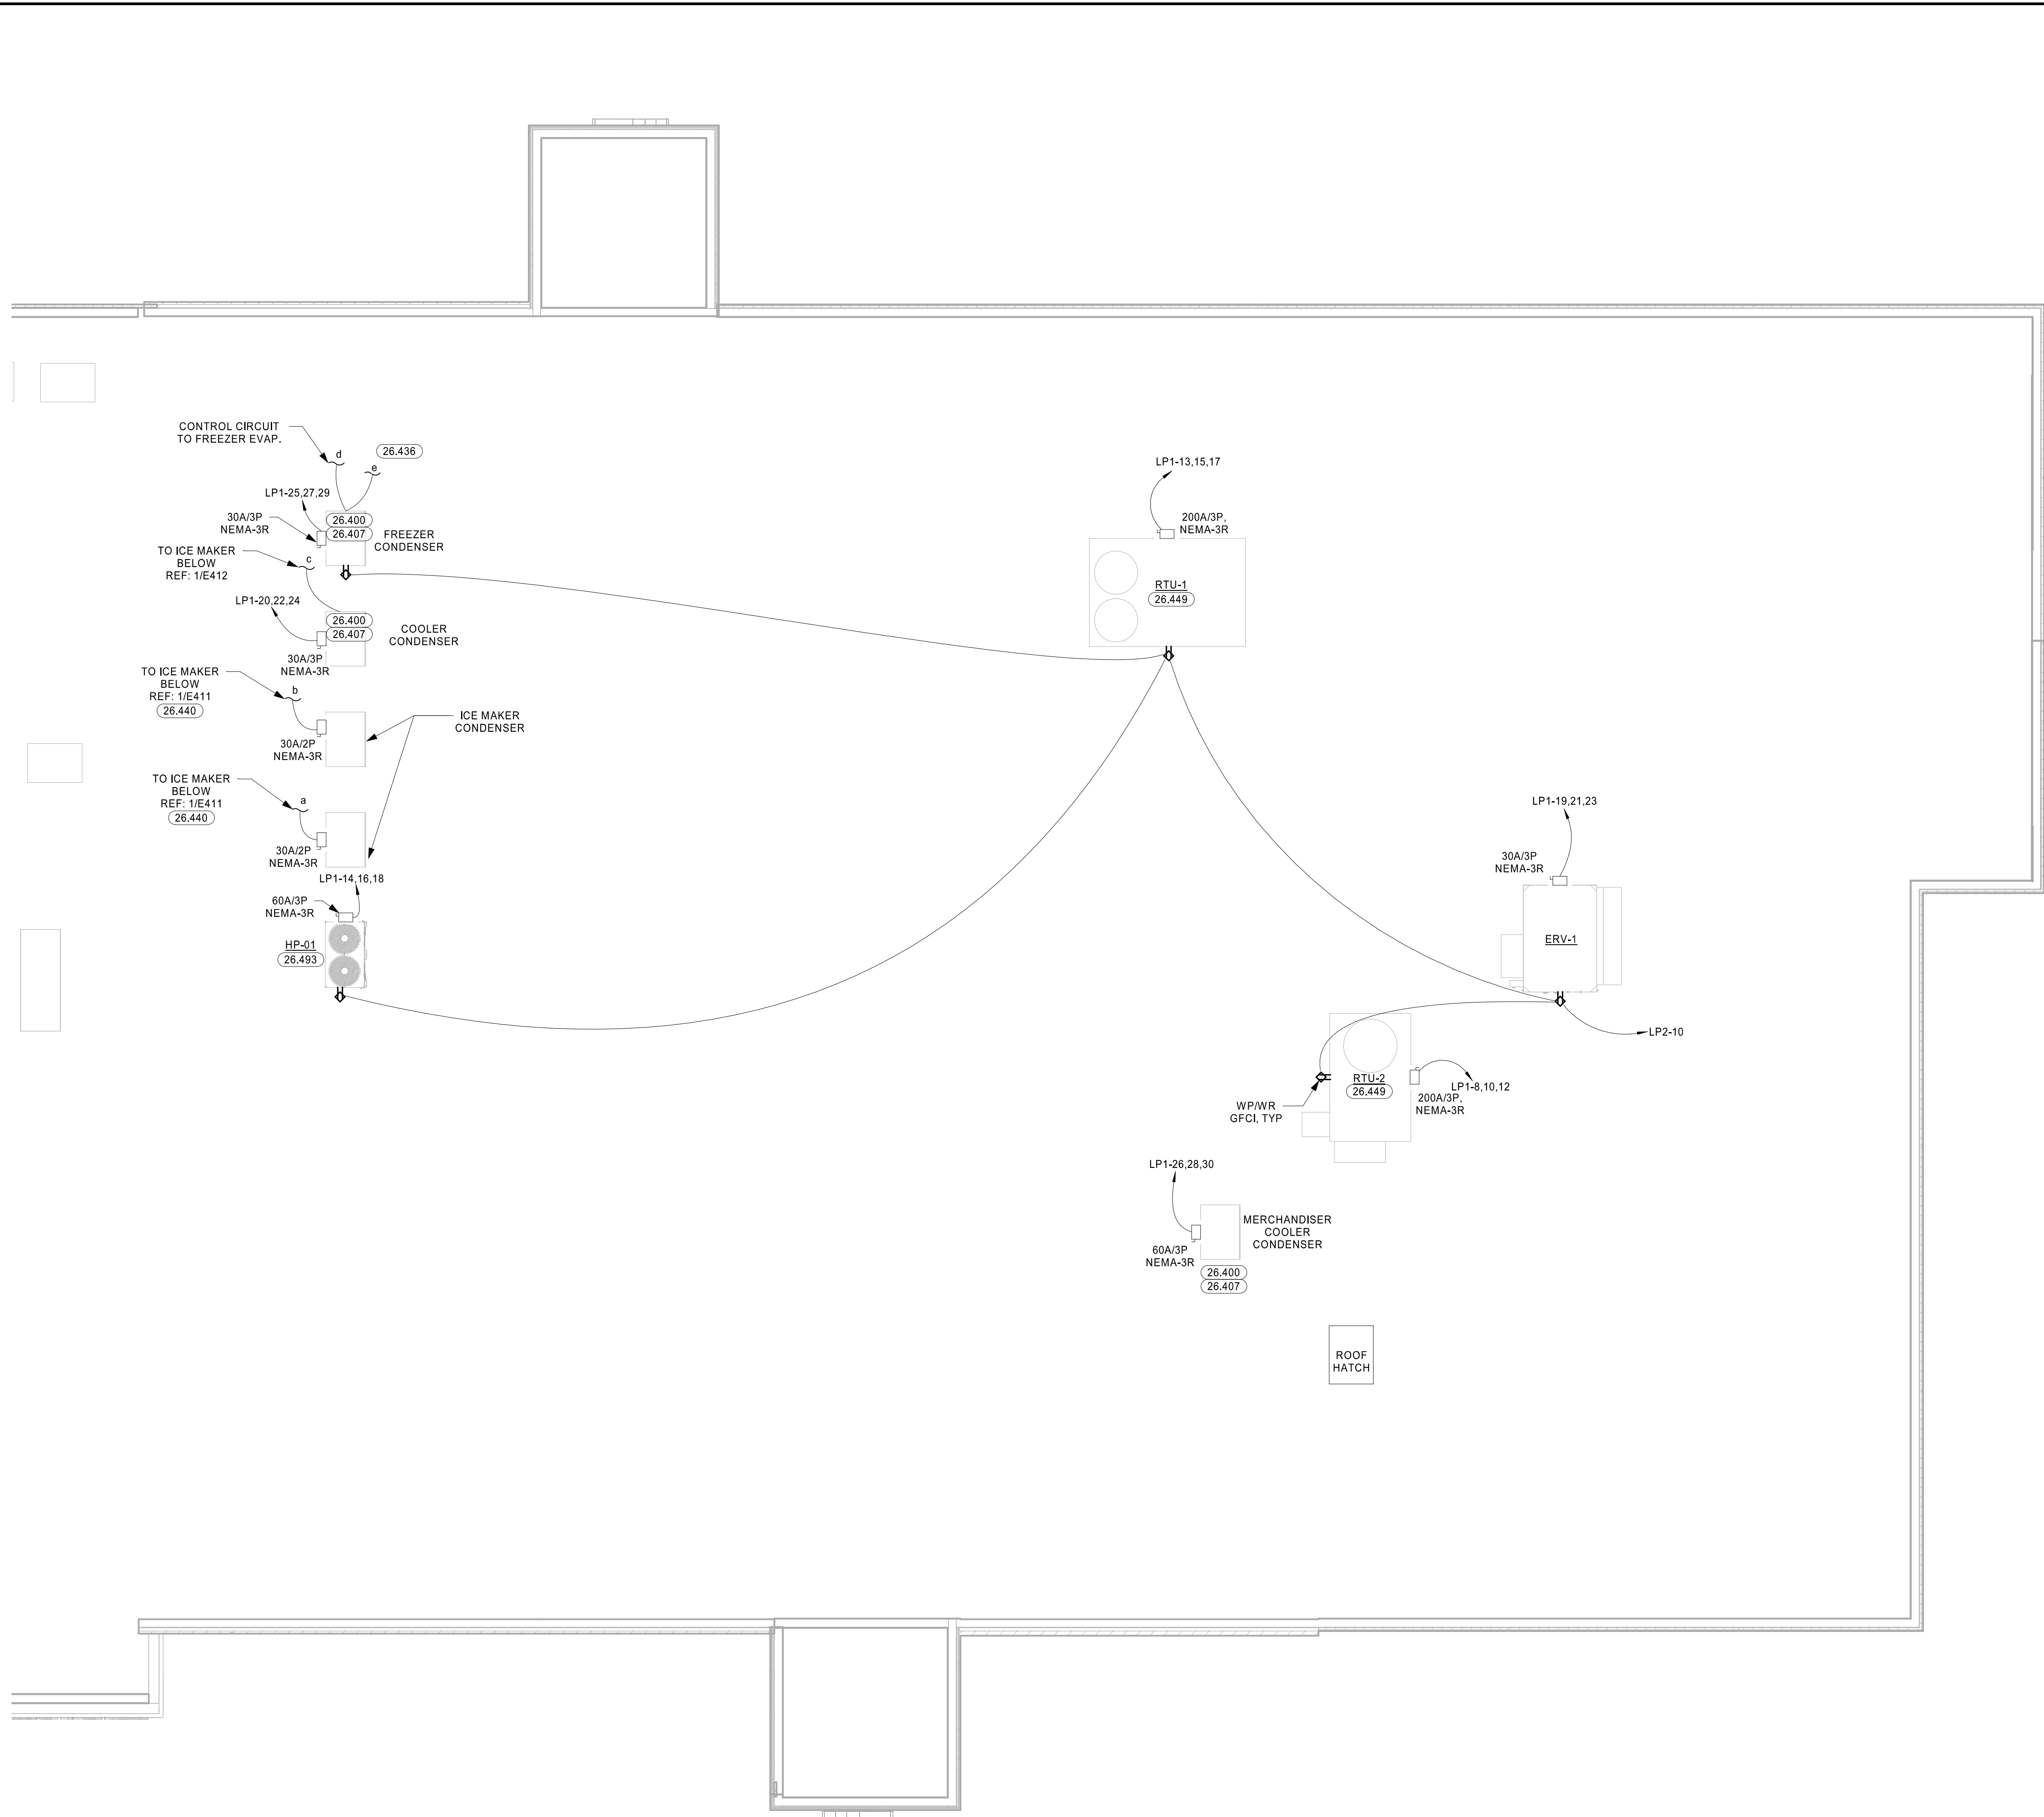

1 ROOF POWER PLAN
 3/16" = 1'-0"

2 FIELD MOUNTING OF ROOFTOP UNIT DISCONNECT
 NTS

03/20/23 1:16:44 PM
 C:\Users\jfrancis\Documents\2023 Revit Projects\Loves_Architects_MS_MP_T2_180_LP1_HFA_Scan_Dwg\Sheet.rvt
 4702421-ROOF POWER PLAN