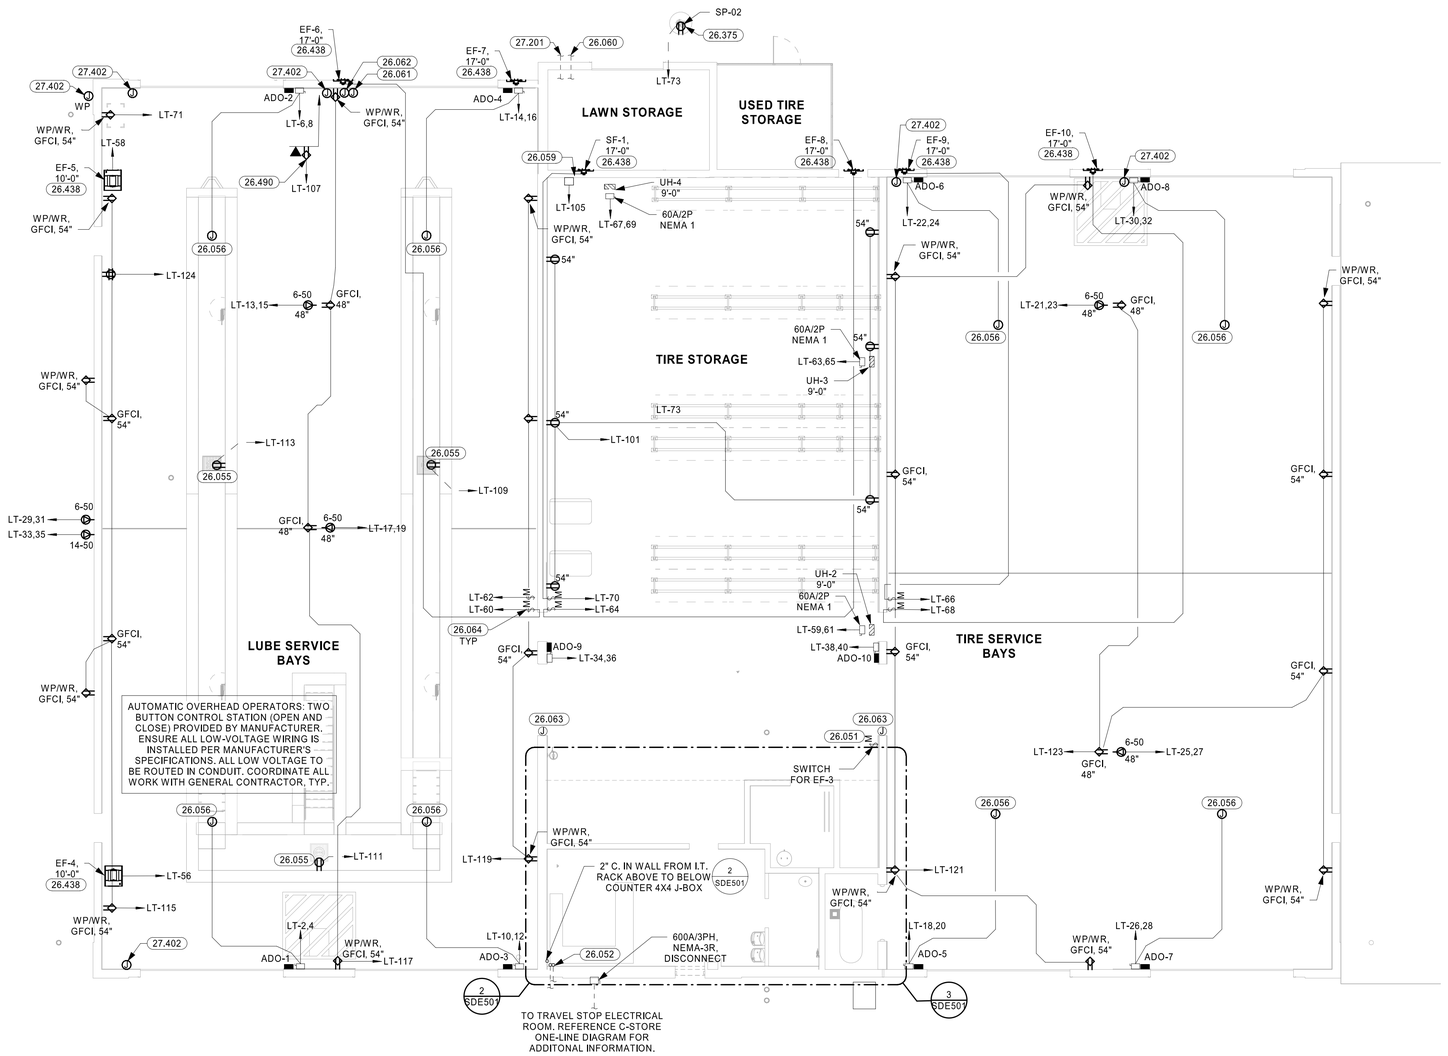

1 POWER PLAN
1/8" = 1'-0"

KEYNOTES

26.051	LABEL WALL SWITCH WITH "MEZZANINE FAN" ON WALL PLATE. LOCATE NEXT TO LIGHTING SWITCHES
26.052	(2) 2" INCOMING PHONE & DATA CONDUITS. PROVIDE (9) CAT5 CABLES IN ONE CONDUIT WITH 25' OF SLACK ON EACH END. PROVIDE A PULLSTRING IN THE OTHER CONDUIT. SEE SITE PLAN FOR ROUTING.
26.055	INSTALL A 120V DUPLEX RECEPTACLE WITH TOP AT 16" ABOVE BOTTOM OF OIL PIT FOR SUMP PUMP. ROUTE CIRCUIT THROUGH LUBE PIT CONTROL RELAY. REFERENECE LUBE PIT CONTROL RELAY DETAIL FOR ADDITIONAL INFORMATION.
26.056	INSTALL SWITCHES OR OTHER DEVICES AS REQUIRED FOR A COMPLETE DOOR OPENER INSTALLATION. MOUNT SWITCH BOX AT 54" AFF WITH CONDUIT TO 10'-0" AFF.
26.059	INCON FUEL MONITORING PANEL. COORDINATE LOCATION WITH FUEL CONTRACTOR.
26.060	ELECTRICAL CONTRACTOR SHALL STUB-OUT CONDUITS 10'-0" FROM BUILDING FOR THE FOLLOWING OIL TANK FIELD EQUIPMENT: * TANK FIELD LIQUID SENSORS AND LEVEL PROBES * REMOTE FILL SUMP * OVERFILL ALARM & ACKNOWLEDGEMENT SWITCH CONTROL. COORDINATE QUANTITIES AND LOCATIONS WITH OIL DRAWINGS AND CONTRACTOR. EXTENSION OF THESE CONDUITS BY FUEL CONTRACTOR.
26.061	USED OIL CONTROL SWITCH. REFERENCE OIL DRAWINGS FOR ADDITIONAL INFORMATION.
26.062	ACKNOWLEDGEMENT SWITCH WITH AUDIBLE OVERFILL ALARM. REFERENCE OIL DRAWINGS FOR ADDITIONAL INFORMATION.
26.063	ELECTRICAL CONTRACTOR SHALL PROVIDE 24VDC POWER FROM FIRE ALARM CONTROL PANEL USING LISTED FIRE ALARM WIRING TO AUTOMATIC FIRE DOOR CLOSING DEVICE PROVIDED BY OTHERS. VERIFY EXACT LOCATION WITH DOOR MANUFACTURER'S DRAWINGS.
26.064	LABEL EACH SWITCH COVERPLATE USING CLEAR THERMAL TRANSFER (ELECTRIC DYMO) LABELS WITH 1/8" HIGH LETTERS.
26.375	PROVIDE (2) 3/4" CONDUITS TO FOUNDATION DRAIN SUMP PUMP. (1) FOR SUMP PUMP POWER, (1) FOR ALARM WIRING ROUTE TO INCON FUEL MONITOR PANEL. REFERENCE SUMP DETAIL ON PLUMBING SHEETS FOR ADDITIONAL INFORMATION.
26.438	EXHAUST FAN WITH FACTORY INSTALLED DISCONNECT. ELECTRICAL CONTRACTOR TO PROVIDE CIRCUITRY TO DISCONNECT.
26.490	DOUBLE GANG BOX MOUNTED AT 48" FOR DIAGNOSTICS STATION. ROUTE 1" GRC CONDUIT WITH PULL STRING FROM I.T. RACK LOCATED ON MEZZANINE TO DOUBLE GANG BOX FOR DATA CABLES. PROVIDE SEPARATE CONDUIT FOR POWER TO GFCI RECEPTACLE.
27.201	EXTEND (1) 1" CONDUIT WITH PULL ROPE FROM THIS LOCATION TO THE OIL WATER SEPARATOR ON SITE FOR ALARM WIRING. REFERENCE SITE FUEL EQUIPMENT PLAN FOR LOCATION.
27.402	JUNCTION BOX MOUNTED AT 17'-0" FOR SECURITY CAMERA. ROUTE 1" CONDUIT WITH PULL STRING FROM I.T. RACK LOCATED ON MEZZANINE TO JUNCTION BOX FOR LOW VOLTAGE WIRING.

HFA
HARRISON FRENCH & ASSOCIATES, LTD
t 479.273.7780
1705 S. Walton Blvd., Suite 3
Bentonville, Arkansas 72712
www.hfa-ae.com

STIPULATION FOR REUSE
THIS DRAWING WAS PREPARED FOR USE ON THE PROJECT AT 4 NICHOLSON, MS
THIS DRAWING WORKS X WITH ITS ISSUE DATE ON 2/7/2023 AND IT IS NOT SUITABLE FOR REUSE ON ANOTHER PROJECT SITE OR AT A LATER TIME.
ANY REUSE, FOR EXAMPLE ON ANOTHER PROJECT OR EXAMPLE ON ANOTHER PROJECT WITHOUT LICENSED ARCHITECTS AND ENGINEERS, REPRODUCTION OF THIS DRAWING FOR REUSE WITHOUT WRITTEN CONSENT IS UNAUTHORIZED AND MAY BE CONTRARY TO LAW.

Love's

STORE NUMBER: 860
I-59, EXIT 1
NICHOLSON, MS 39466

JOB NUMBER: 03-23-30009
SPEEDCO_4 BAY

ISSUE BLOCK

CHECKED BY:	CAR
DRAWN BY:	SED
DOCUMENT DATE:	2/7/2023
PROTO:	SPEEDCO_4 BAY
PROTO CYCLE:	Q4 - 2022

JAIME CASTANEDA
LICENSED PROFESSIONAL
ENGINEER
28109
ARKANSAS
2023.02.07 14:24:59-06'00'

POWER PLAN

SHEET:
SDE401

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT HIMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBLITY OF PERFORMING HIS WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.

2/7/2023 12:32:31 PM
C:\Users\chris.richardson\Documents\2021 Revit Projects\Loves_Nicholson_MS_MEP_SPEEDCO_4B_r21_HFA Chris.Richardson.rvt
#19-SDE401-POWER PLAN