

COAST ENGINEERING SERVICES

985-882-8001
800-641-3690
Fax 985-882-1534

INVOICE

NO.: 13-ES-0084

FROM ENGRG: 7/16/2013

CUSTOMER: McMath Construction

ARCHITECT/PD: Joseph A. Day & Associates

PROJECT: Caserta Res.

LOT/ ADDRESS: Cleveland St.

CITY: Covington

PARISH: St. Tammany

WORK PERFORMED: Structural Engineering

TOTAL:

\$2,200.00

DUE UPON RECEIPT

Make Check Payable To Coast Concrete Services, Inc.

REP: JD

GENERAL NOTES

FRAMING DETAILS

GENERAL

- A. NO FIELD SUPERVISION PROVIDED UNDER THIS SEAL.
- B. NO ADMINISTRATION PROVIDED UNDER THIS SEAL.
- C. ALL WORK/MATERIAL SHALL CONFORM TO LOCAL, STATE AND FEDERAL CODES.
- D. REVIEW & SEAL OF PLANS BY THE ENGINEER IS FOR THE INTENT OF OBTAINING BUILDING PERMIT. ALL CONSTRUCTION SHALL MEET THE REQUIREMENTS OF THE CODES LISTED BELOW.
- E. NOT ALL SPECIFICATIONS ARE EXPRESSLY LISTED ON OUR PLANS; THEREFORE, IT IS THE RESPONSIBILITY OF INDIVIDUAL BUILDERS AND/OR CONTRACTORS TO COMPLY WITH ALL LISTED CODES.
- F. IN THE EVENT OF ANY DISCREPANCIES BETWEEN THESE NOTES & THE ARCHITECTURAL DWGS. THESE NOTES SHALL GOVERN.

DESIGN CRITERIA

CODES: 2006 INTERNATIONAL RESIDENTIAL CODE
2005 WOOD FRAME CONSTRUCTION MANUAL
ASCE 7-05
NATIONAL DESIGN SPECIFICATIONS FOR WOOD CONSTRUCTION BY THE NFPA

NOTE: ENVIRONMENTAL PROVISIONS OF THE BUILDING CODE REQUIREMENTS ARE MINIMUM REQUIREMENTS AND ARE INTENDED TO INSURE LIFE SAFETY, NOT PREVENT STRUCTURAL DAMAGE.

LOADS

LIVE LOADS: ATTICS, UNINHABITABLE ----- = 10 PSF
ATTICS ----- = 20 PSF
ROOFS ----- = 20 PSF
RESIDENTIAL FLOORS ----- = 40 PSF

WIND LOADS: BASIC WIND SPEED, V = 115 MPH
BUILDING CLASSIFICATION = II
IMPORTANCE FACTOR, I = 1.0
ENCLOSED BUILDING
INTERNAL PRESSURE COEFFICIENT, GcPi = ± 0.18

SITE WORK

- A. SHALL BE PER APPENDIX J OF THE INTERNATIONAL BUILDING CODE.
- B. SHALL BE PER REQUIREMENTS OF FOUNDATION DRAWING BY COAST CONCRETE SERVICES.
- C. GRADE LOT FOR PROPER DRAINAGE AWAY FROM THE HOUSE.
- D. CONTRACTOR SHALL COMPLY WITH ALL FILL REQUIREMENTS, INCLUDING PERCENT COMPACTION OF DESIGN ENGINEER AND OF LOCAL AUTHORITIES.
- E. U.N.O. FILL TO BE COMPACTED IN 6" LIFTS TO 95% OF ITS STANDARD PROCTOR DENSITY.

ENGINEERED WOOD BEAMS & JOISTS

- A. SUPPORT LAMINATED BEAMS/BUILT-UP BEAMS WITH A MINIMUM 3-STUD COLUMN EACH END.
- B. PROVIDE CMST14 STRAPS AT ENDS OF BEAMS SUBJECT TO UPLIFT LOADING.
- C. CONTRACTOR SHALL SUBMIT SHOP DRAWINGS FOR ALL ENGINEERED BEAMS/JOISTS SHOWING ALL REQUIRED CONNECTORS, BLOCKING AND SUPPORT REQUIREMENTS FOR APPROVAL.

MISCELLANEOUS

- 1. THE PROPERTY ADDRESS SHALL BE ATTACHED TO THE BUILDING IN SUCH A POSITION AS TO BE PLAINLY VISIBLE FROM THE STREET IN FRONT OF THE PROPERTY.

ELECTRICAL

- A. ALL ELECTRICAL WORK/MATERIALS SHALL CONFORM TO LOCAL, STATE AND FEDERAL CODES.
- B. OWNER AND BUILDER SHALL COORDINATE LOCATIONS OF APPLIANCES, SWITCHES, OUTLETS, THERMOSTATS, CIRCUIT BREAKER BOX, ETC.
- C. SMOKE DETECTORS REQUIRED AT ALL BEDROOMS AND/OR ADJACENT HALLWAYS

CONCRETE & MASONRY

- A. ALL CONCRETE SHALL ATTAIN A MINIMUM COMPRESSIVE STRENGTH OF 3,000 PSI AT 28 DAYS.
- B. FOUNDATION DESIGN SHALL BE BY COAST CONCRETE SERVICES (UNLESS A SEALED FOUNDATION PLAN IS INCLUDED IN THIS SET).
- C. ALL BRICKWORK SHALL CONFORM TO BRICK INDUSTRY ASSOCIATION STANDARDS & THE BUILDING CODE.
- D. VERTICAL EXPANSION JOINTS IN BRICK VENEER WALLS SHALL BE SPACES AT 30 FEET MAX.
- E. TIES SHALL BE SPACED A MAXIMUM OF 16" O.C. BOTH WAYS. ALL TIES MUST BE EMBEDDED AT LEAST 1 1/2" INTO THE BRICK VENEER WITH A MINIMUM MORTAR COVER OF 5/8" TO THE OUTSIDE FACE OF THE WALL. THEY MUST BE SECURELY ATTACHED TO THE STUDS THROUGH THE SHEATHING, NOT TO THE SHEATHING ALONE. AROUND THE PERIMETER OF OPENINGS, ADDITIONAL TIES SHOULD BE INSTALLED AND SPACES AT A MAXIMUM OF 3' O.C. WITHIN 12" OF THE OPENING.
- F. BRICK IS USUALLY SELECTED ON THE BASIS OF THEIR APPEARANCE WHICH INCLUDES COLOR, TEXTURE AND SIZE. TO ASSURE QUALITY, BRICK UNITS SHOULD CONFORM TO ONE OF THE FOLLOWING: ASTM C216 SPECIFICATION FOR FACING BRICK, ASTM C652 SPECIFICATION FOR HOLLOW BRICK, ASTM C1405 SPECIFICATION FOR GLAZED BRICK (SINGLE-FIRED, SOLID UNITS) OR ATSM C126 SPECIFICATION FOR CERAMIC GLAZED STRUCTURAL CLAY FACING TILE, FACING BRICK AND SOLID MASONRY UNITS. ALL BRICK UNITS SHOULD BE OF GRADE SW. THE USE OF SALVAGED BRICK IS NOT RECOMMENDED SINCE SUCH BRICK MAY NOT BOND PROPERLY WITH MORTAR AND MAY BE LESS DURABLE.
- G. UNIT MASONRY MORTAR SHALL CONFORM TO ASTM C270 SPECIFICATIONS. MORTAR PLAYS AN IMPORTANT ROLE IN THE FLEXURAL STRENGTH OF A BRICK VENEER WYTHE. TESTS OF FULLSCALE WALLS INDICATE THAT THE BOND BETWEEN MORTAR AND BRICK UNITS IS THE MOST IMPORTANT SINGLE FACTOR AFFECTING WALL STRENGTH WHEN RESISTING HORIZONTAL JOINT CRACKING. THE BUILDER SHOULD SELECT THE LOWEST COMPRESSIVE UNIT STRENGTH MORTAR THAT IS COMPATIBLE WITH THE BRICK USED ON THE PROJECT. FOR MORE INFORMATION, REFER TO TECHNICAL NOTES 8 SERIES BY THE BRICK INDUSTRY ASSOCIATION.
- H. WEEPHOLES SHALL BE PROVIDED IN THE OUTSIDE WYTHE OF MASONRY WALLS @ A MAX. SPACING OF 33" O.C. PER R703.7.6.
- I. THE MAX. UNSUPPORTED HEIGHT OF MASONRY PEIRS SHALL NOT EXCEED TEN TIMES THEIR LEAST DIMENSION PER R606.5.

UPLIFT ANCHORS

- A. ALL ANCHOR BOLTS SHALL BE ASTM A307 BOLTS WITH STANDARD HOOKS AND SHALL HAVE A MINIMUM EMBEDMENT OF 7". EACH BOLT SHALL HAVE A 3"x3"x1/8" WASHER.
- EXTERIOR OPTIONS
 - 1: 5/8" A.B. @ 24" O.C. & WITHIN 12" OF EACH BLDG. CORNER
 - 2: SIMPSON MASA ANCHORS @ 24" O.C.
- B. INTERIOR SHEAR WALLS - 5/8" A.B. @ 4'-0" O.C.
- NOTE: SEE PLAN & DETAILS FOR ADDITIONAL ANCHORS REQUIRED AT SHEAR WALLS.

WOOD

- A. STRUCTURAL TIMBER WITH THE EXCEPTION OF STUDS AND TOP PLATES SHALL BE #2 SOUTHERN YELLOW PINE (SYP) WITH A 19% MAXIMUM MOISTURE CONTENT.
- B. ALL LUMBER IN CONTACT WITH EARTH, CONCRETE AND/OR MASONRY SHALL BE TREATED MIN. 0.40 PCA.
- C. FLOOR, ATTIC AND ROOF FRAMING SHALL BE AS PER PLAN OR SIZED ACCORDING TO REQUIREMENTS NOT TO EXCEED MAXIMUM SPAN TABLES OF SOUTHERN FOREST PRODUCTS ASSOCIATION'S LATEST ISSUE. PROVIDE BRIDGING WHERE SHOWN OR WHEN JOISTS EXCEED 8' SPAN. PROVIDE DOUBLE FLOOR JOISTS UNDER BEARING WALLS OR A BEAM IS REQUIRED. INSTALL 3 STUDS UNDER EACH BEARING POINT OF BEAM STUDS TO BE FASTENED TOGETHER WITH .120x3" (8d) NAILS @ 4" O.C. & WITHIN 3" OF EACH END OF STUDS.

WOOD CONNECTORS

- A. SHALL BE GALVANIZED MATERIAL AND IN ACCORDANCE WITH THE FASTENING SCHEDULE OF THE GOVERNING BUILDING CODE. ADDITIONAL CORROSION PROTECTION MAY BE REQUIRED WHEN CONNECTING HEAVILY TREATED WOOD FRAMING. CONTRACTOR TO VERIFY.
- B. UPLIFT CONNECTORS SHALL BE PROVIDED FOR A CONTINUOUS LOAD PATH FROM FOUNDATION TO RAFTER. CONNECTORS ARE IN ADDITION TO BUILDING CODE NAILING REQUIREMENTS.
- C. CONNECTORS SHALL BE INSTALLED WITH THE MAXIMUM NUMBER OF FASTENERS PER THE MANUFACTURER'S RECOMMENDATIONS AND SPECIFICATIONS UNLESS SPECIFICALLY NOTED OTHERWISE.
- D. TOP PLATE SPLICE SHALL BE WITHIN THE MIDDLE THIRD OF THE WALL SECTION AND SHALL BE A MINIMUM LENGTH OF 48". CONNECT WITH 16d NAILS @ 3" O.C. OR 2 ROWS OF 8d WIRE NAILS @ 3" O.C.
- E. JOIST HANGER DEPTH SHALL BE AT LEAST 60% OF JOIST DEPTH. SEE SIMPSON LUS & HUS TABLES.

SHEATHING

- A. USE 7/16" APA EXPOSURE 1 RATED SHEATHING ON ALL EXTERIOR WALLS, SHEAR WALLS, AND ROOF. PLYWOOD IS AN ACCEPTABLE ALTERNATE FOR APA EXPOSURE 1 RATED SHEATHING.
- B. ROOF SHEATHING SHALL BE FASTENED WITH 8d RING SHANK NAILS @ 12" O.C. AT ALL INTERMEDIATE FRAMING MEMBERS. USE 8d RING SHANK NAILS WITHIN 5'-0" OF ROOF EDGES. SPACE NAILS @ 4" O.C. WITHIN 5'-0" OF GABLE END WALLS, ROOF EDGES, HIPPS, & VALLEYS.
- C. FLOOR SHEATHING TO BE APA RATED, 3/4" THICK MINIMUM C-D TONGUE & GROOVE GLUE & NAIL TO FLOOR JOISTS WITH 8d COMMON NAILS @ 6" O.C. AT EDGES & 12" O.C. AT INTERMEDIATE JOISTS. 3 STUDS UNDER EACH BEARING POINT OF BEAM STUDS TO BE FASTENED TOGETHER WITH .120x3 (8d) WIRE NAILS @ 4" O.C. & WITHIN 3" OF EACH END OF STUDS. ENSURE TIGHT FIT AT TOP & BOTTOM.
- D. NAILING PATTERN FOR NON-SHEAR WALL SHEATHING:
 - 8d NAILS @ 8" O.C. @ ALL EDGES/PERIMETER
 - 8d NAILS @ 12" O.C. @ ALL INTERIOR STUDS.
- E. SEE SHEAR WALL DETAIL FOR FURTHER INFORMATION.

THERMAL & MOISTURE PROTECTION

- A. ALL THERMAL/MOISTURE PROTECTION WORK/MATERIALS SHALL CONFORM TO LOCAL, STATE AND FEDERAL CODES.
- B. CONTRACTOR SHALL PROVIDE THE FOLLOWING MINIMUM INSULATION (AS APPLICABLE)
 - i. WALLS: R-13 BATT (2x4 WALL), R-19 BATT (2x6 WALL)
 - ii. CEILING, STANDARD: R-30 BLOWN
 - iii. CEILING, VAULTED: R-19 BATT
 - iv. FLOORS (2-STORY SPACES ONLY): R-19 BATT
 - v. FLOORS (CRAWL SPACE UNDER FLOOR): R-19 BATT, OR EQUIVALENT RIGID BOARD INSULATION
- C. ROOFING MATERIAL SHALL BE PER OWNER/BUILDER AGREEMENT & SHALL MEET WIND SPEED CRITERIA SHOWN ON THIS DRAWING. INSTALL ROOFING PER MANUFACTURER'S SPECIFICATIONS & RECOMMENDATIONS
- D. SIDING MATERIAL SHALL BE PER OWNER/BUILDER AGREEMENT & SHALL MEET WIND SPEED CRITERIA SHOWN ON THIS DRAWING. INSTALL ROOFING PER MANUFACTURER'S SPECIFICATIONS & RECOMMENDATIONS

STEEL


- A. ALL REINFORCING STEEL SHALL BE ASTM A615 GR.60. ALL WELDED WIRE REINFORCEMENT SHALL BE ASTM A185 IN FLAT SHEETS
- B. ALL UNEXPOSED STEEL SHALL BE SHOP PAINTED (IN ACCORDANCE WITH AISC STANDARDS) OR GALVANIZED.
- C. LINTEL SIZES (FOR BRICK VENEER) ASTM A36 STEEL:
 - 0' TO 4' OPENINGS: L4x3-1/2x3/8
 - >4' TO 6' OPENINGS: L5x3-1/2x3/8
 - >6' TO 8' OPENINGS: L6x3-1/2x3/8
 - >8' TO 10' OPENINGS: L7x4x1/2
 - >10' TO 12' OPENINGS: L8x4x1/2
 - >12' TO 16' OPENINGS: L9x4x5/8
- D. LINTELS SHALL HAVE AT LEAST 8" BEARING ON BRICK WALL ON BOTH SIDES OF OPENINGS.
- E. ALL BOLTS SHALL BE ASTM A307 HOT DIP GALVANIZED MATERIAL
- F. METAL ROOFING (IF APPLICABLE) SHALL BE PER OWNER & MEET THE WIND REQUIREMENTS OF THIS DRAWING & GOVERNING BUILDING CODES.
- G. ALL PLATES SHALL BE ASTM A36 (IF APPLICABLE)
- H. ALL STEEL PIPES SHALL BE ASTM A53, TYPE-S (SEAMLESS) GRADE B (Fy=35 KSI), U.N.O (IF APPLICABLE)

DOOR & WINDOWS

- A. ALL WINDOWS SHALL MEET SECTION R301.2.1.2. GLAZING SHALL MEET THE SPECIFIED REQUIREMENTS OR THE CONTRACTOR SHALL PROVIDE 7/16" MINIMUM PLYWOOD PANELS FOR ALL WINDOWS OR SHALL PROVIDE SHUTTERS ON ALL WINDOWS THAT MEET THE REQUIREMENT OF R301.2.1.2.
- B. CONTRACTOR SHALL PROVIDE "SECURE DOOR" BRACING SYSTEM FOR GARAGE DOORS INSTALLED PER MANUFACTURER'S SPECIFICATION'S AND RECOMMENDATIONS.
- C. ALL EXTERIOR DOORS AND WINDOWS AND ROOF TRUSSES SHALL BE DESIGNED AND INSTALLED TO WITHSTAND DESIGN WIND LOADS BASED ON ASCE 7-05.
- D. ALL WINDOWS TO HAVE A MAXIMUM U-FACTOR OF 0.75 & A SOLAR HEAT GAIN COEFFICIENT RATING OF 0.40.


MECHANICAL

- A. ALL HVAC WORK/MATERIALS SHALL CONFORM TO LOCAL, STATE AND FEDERAL CODES.
- B. HVAC SYSTEM SHALL BE CONSTRUCTED IN ACCORDANCE WITH SECTION 101:7-2 OF THE LIFE SAFETY CODE.
- C. OWNER SHALL RETAIN A LICENSED MECHANICAL CONTRACTOR TO VERIFY HVAC SYSTEM SHOWN WILL WORK SATISFACTORILY.
- D. ALL PLUMBING WORK/MATERIALS SHALL CONFORM TO LOCAL, STATE AND FEDERAL CODES.

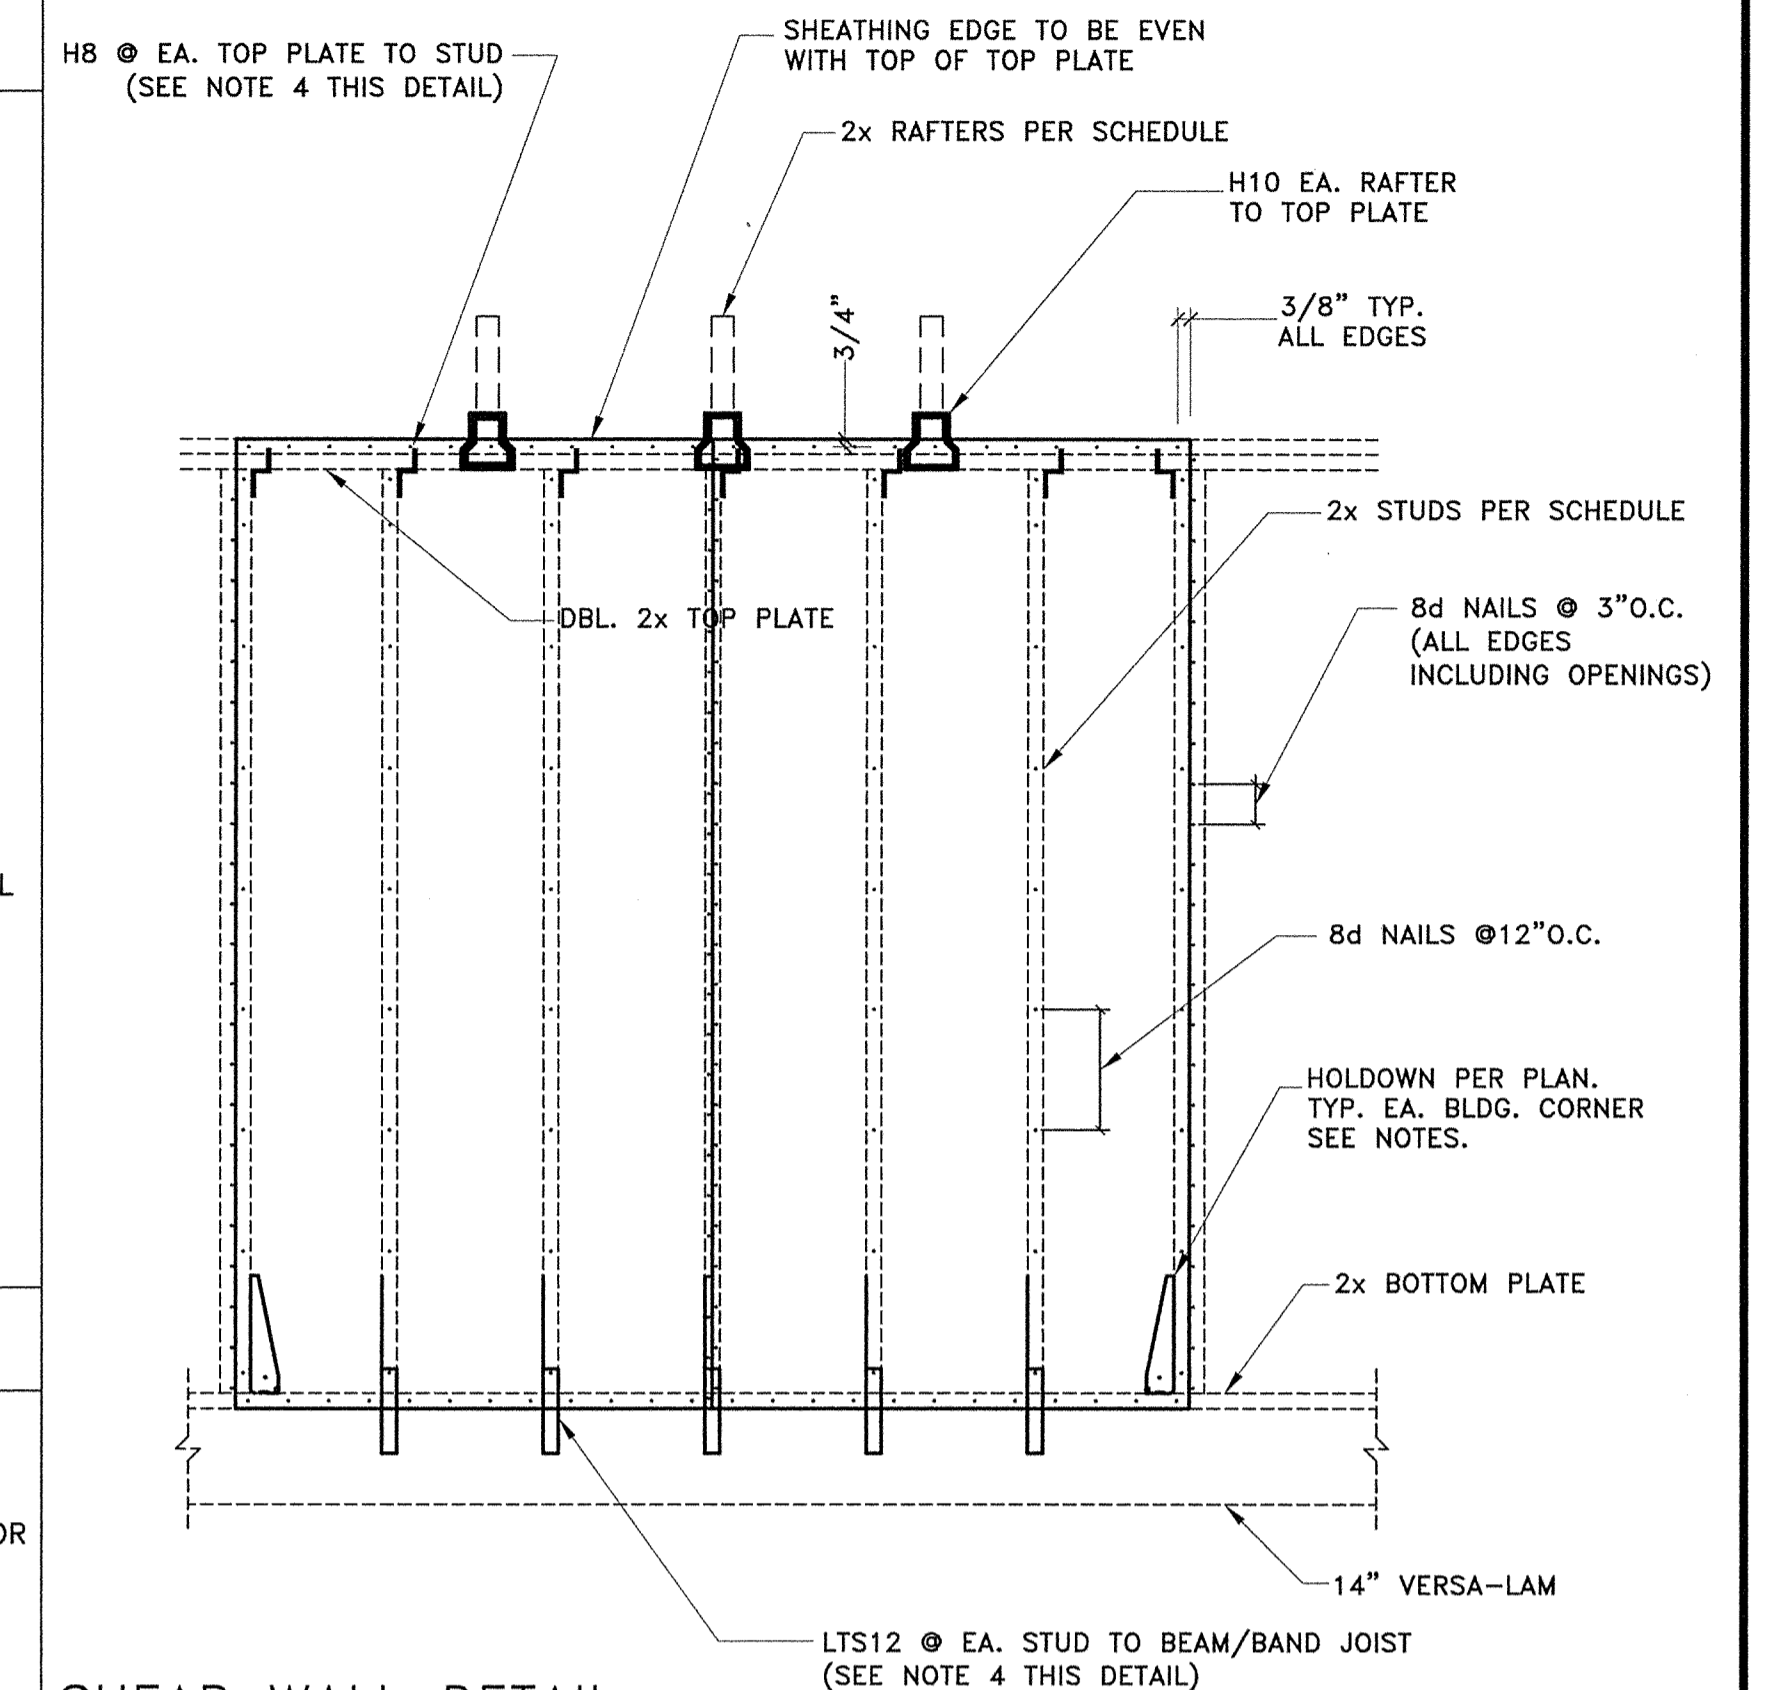

SHEAR WALL DETAIL

- NOTES: 1) ALL EXT. WALLS SHALL BE SHEATHED.
2) ALL CONNECTORS MUST BE INSTALLED ON THE EXT. (SAME SIDE AS SHEATHING) PRIOR TO SHEATHING INSTALLATION. SHEATHING NAILS SHALL NOT PENETRATE CONNECTOR.
3) SHEATHING PANELS MUST BE INSTALLED VERTICALLY.
4) TOP PLATE TO STUD & STUD TO BEAM/BAND JOISTS CONNECTORS NOT REQUIRED WHEN CONTINUOUS SHEATHING IS INSTALLED PER ABOVE SPECIFICATIONS.
5) 7/16" APA SHEATHING EXPOSURE 1 PANELS TO BE CONT. (MIN. 1-1/2" PLATE LAP) FROM SOLE PLATE TO TOP PLATE SOLID BLOCKING AT ALL PANEL EDGES.
6) INTERIOR SHEAR WALLS SHALL FOLLOW THE SAME SPECIFICATIONS AS ABOVE WITH THE FOLLOWING EXCEPTIONS:
A) 8d NAILS @ 8" O.C. ALL EDGES
B) A SIMPSON HB SHALL BE INSTALLED AT EA. JOIST TO TOP PLATE LOCATION.
7) HOLDDOWNS ARE REQUIRED AT THE END OF EACH SEGMENTED SHEAR WALL SEGMENT OR AT THE END OF A PERFORATED SHEAR WALL. SEE THE CORNER STRAP DETAIL SHOWN BELOW.

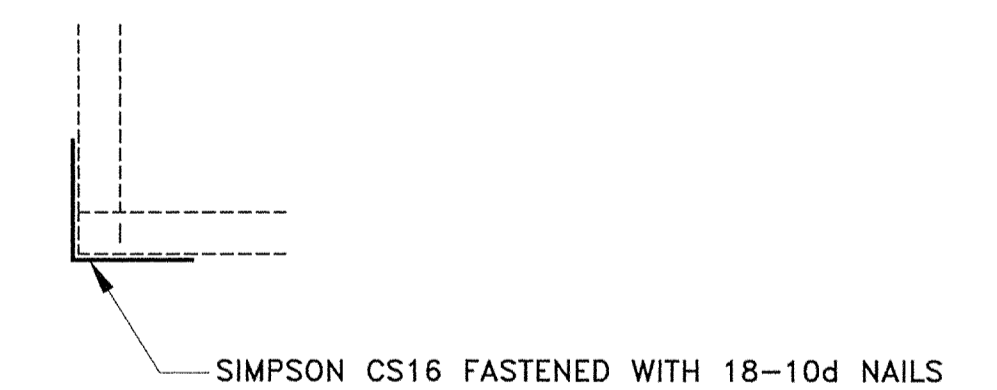

CORNER STRAP DETAIL
USE THIS DETAIL AT ALL OUTSIDE CORNERS


THESE PLANS ARE THE PROPERTY OF COAST ENGINEERING SERVICES, INC. THEY MAY NOT BE REPRODUCED OR COPIED IN ANY WAY WITHOUT THE WRITTEN CONSENT OF COAST ENGINEERING SERVICES, INC.
COAST ENGINEERING SERVICES IS A DIVISION OF COAST CONCRETE SERVICES, INC.

McMath Construction
Caserta Residence
Cleveland St.
St. Tammany Parish
Covington, Louisiana

COAST ENGINEERING SERVICES
29072 Krenzel Road, Lacomb, LA 70445
800-641-3690, 985-882-8001, Fax 985-882-1534

Date:	Sq. Ft.:	Ckd. By:	Drawn By:	Project Number:
07/16/13	N/A	JD	MD	13-ES-0084

Sheet Description: General Notes
Sheet Number: S-1 of 7

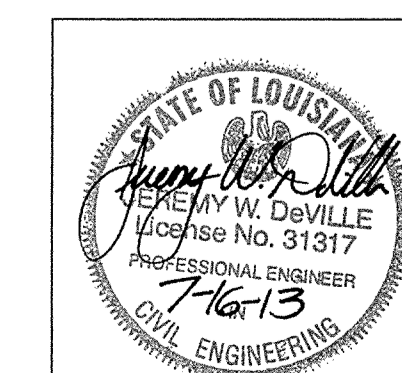


EXTERIOR WALL SCHEDULE			
BASIC WIND SPEED	WALL HEIGHT	STUD SIZE	STUD SPACING
V ≤ 120 mph	≤ 12'-0"	2"x4"	16" O.C.
	12'-0" - 16'-0"	2"x6"	16" O.C.
	16'-0" - 18'-0"	2"x6"	12" O.C.
120 mph ≤ V ≤ 140 mph	≤ 11'-0"	2"x4"	16" O.C.
	11'-0" - 15'-0"	2"x6"	16" O.C.
	15'-0" - 18'-0"	2"x6"	12" O.C.

RAFTER SCHEDULE	
SPAN FT	RAFTER SIZE (AT 24" O.C.)
UP TO 6'-0"	2x4
6'-1" TO 9'-0"	2x6
9'-1" TO 12'-0"	2x8
12'-0" TO 15'-0" MAX	2x8 W/2x6 VERT. SUPPORTS AT 48" O.C.


ALL RIDGE BOARDS USED SHALL BE NO. 2 SP W/DEPTHS 2" GREATER THAN RAFTERS WHERE OVER-FRAMING IS NOT SYMMETRICAL BOTH SIDES (AS SHOWN ABOVE). RIDGES SHALL BE VERTICAL SUPPORTED W/ 2x6 AT 48" O.C.

CEILING JOIST SCHEDULE		
(FOR UNHABITABLE ATTICS, LL = 20 PSF)		
SPAN	JOIST SIZE	SPACING
12'-0"	2x6	16" O.C.
15'-3"	2x8	16" O.C.
18'-1"	2x10	16" O.C.
20'-11"	2x10	12" O.C.


FLOOR JOIST SCHEDULE		
(LL = 40 PSF)		
SPAN	JOIST SIZE	SPACING
14'-0"	2x10	16" O.C.
16'-2"	2x10	12" O.C.
16'-6"	2x12	16" O.C.
19'-1"	2x12	12" O.C.

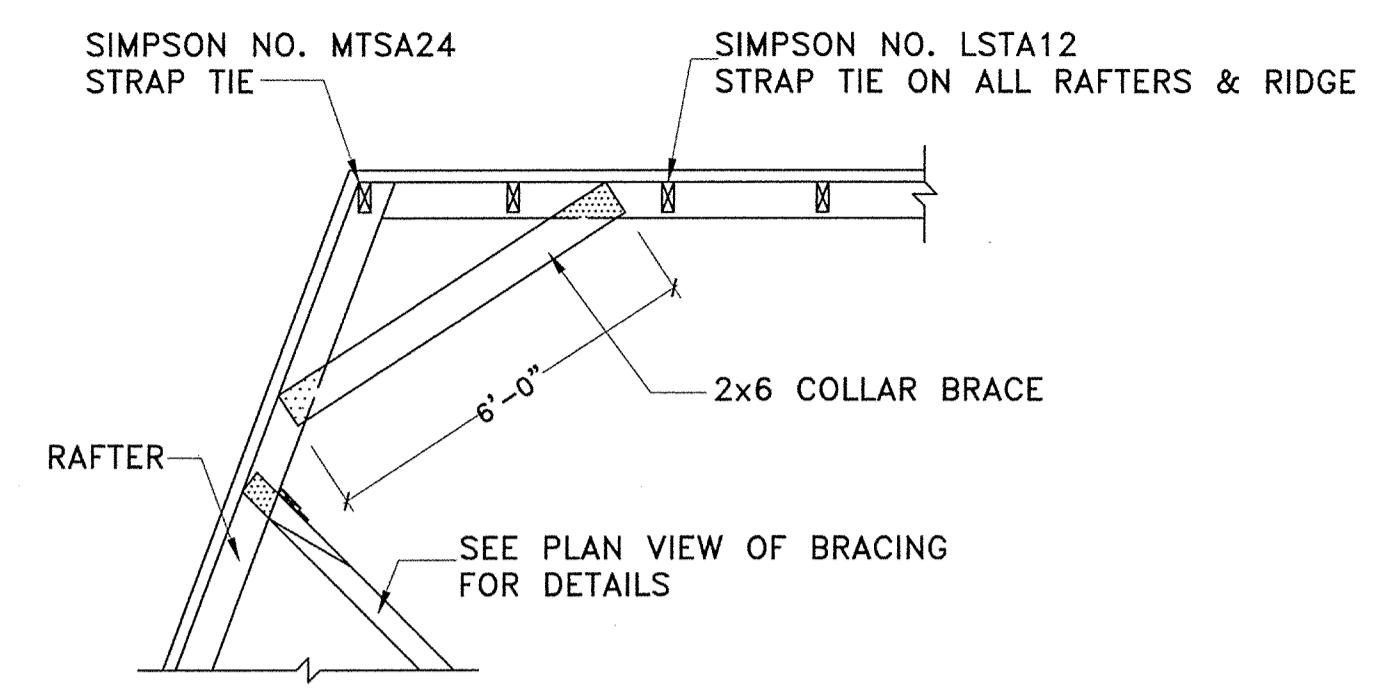


TYPICAL FRAMING AT HIP ROOF

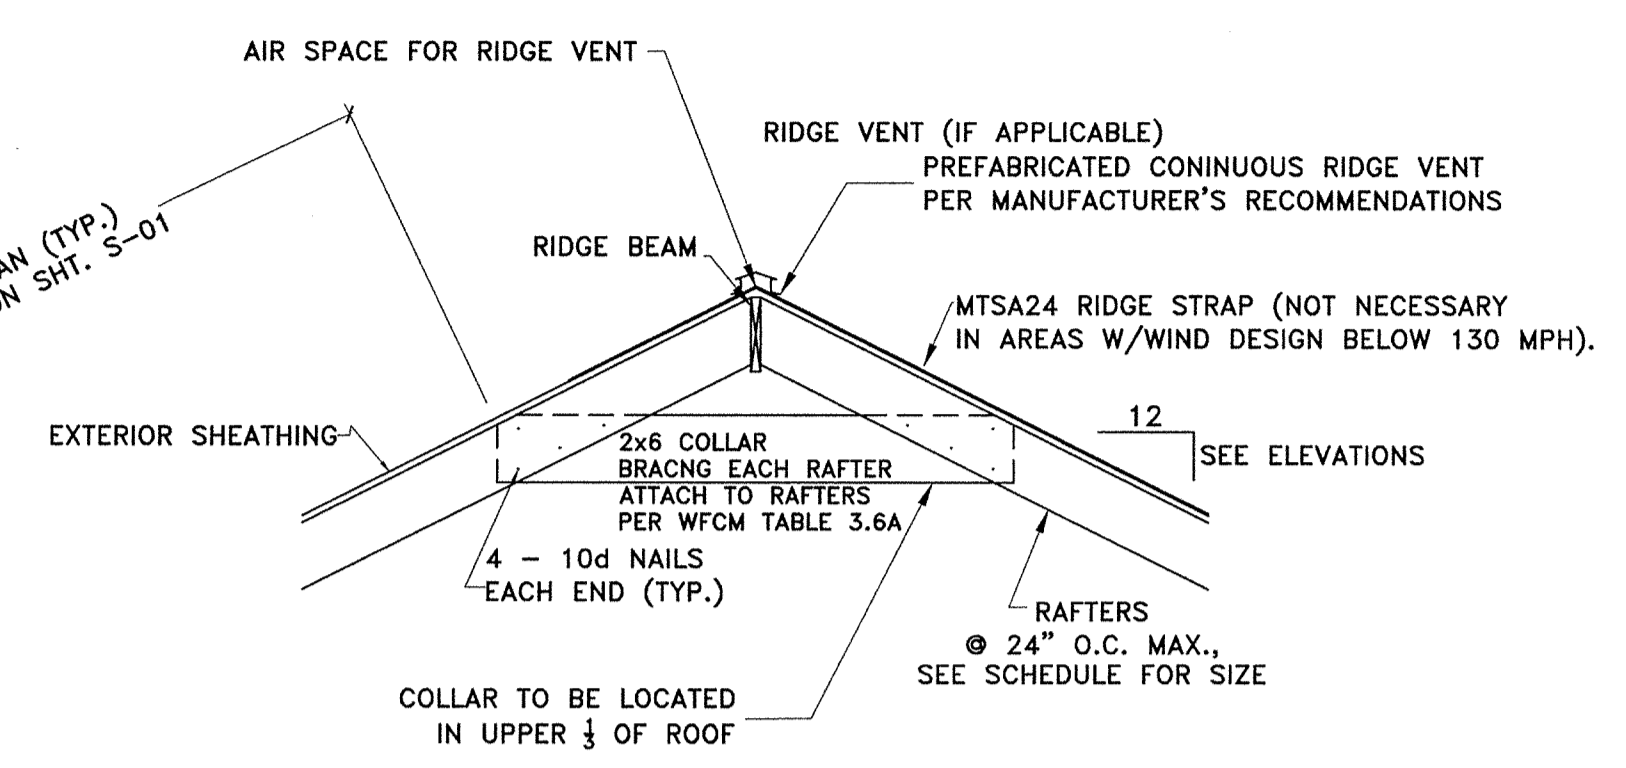


*NOTE:
 1. IN LIEU OF COLLARS @ EACH RAFTER SIMPSON MTA24 STRAP MAY BE USED AND COLLARS SPACED @ 48" O.C. MAX.
 2. ROOF COVERING NOT SHOWN FOR CLARITY

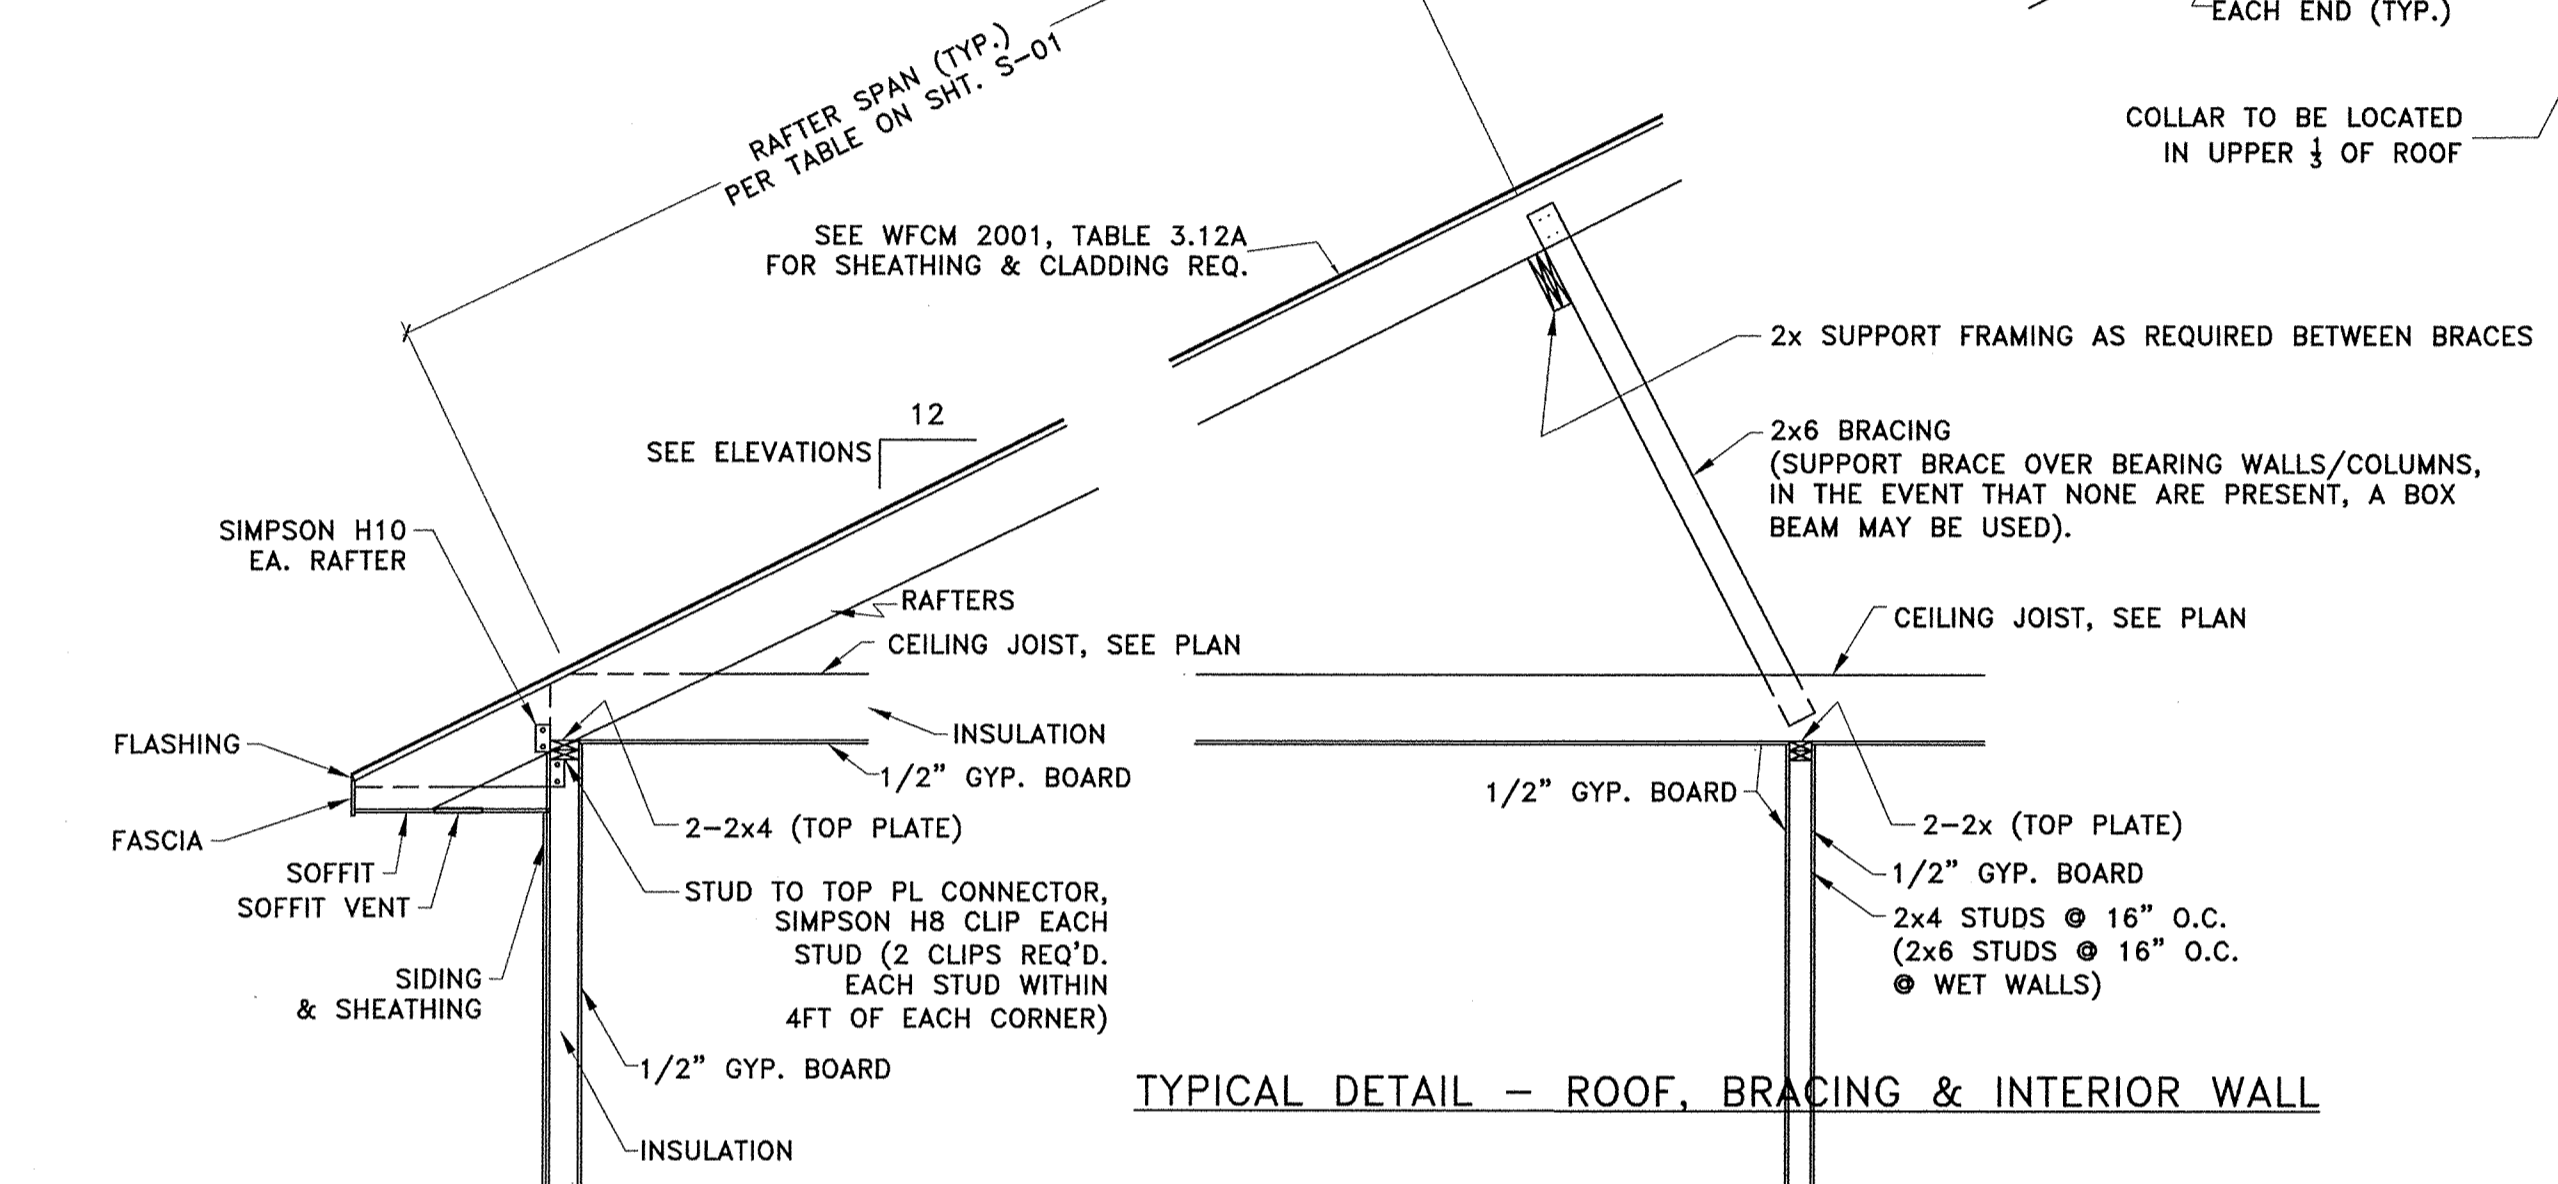

TYPICAL DETAIL - ROOF, BRACING & INTERIOR WALL

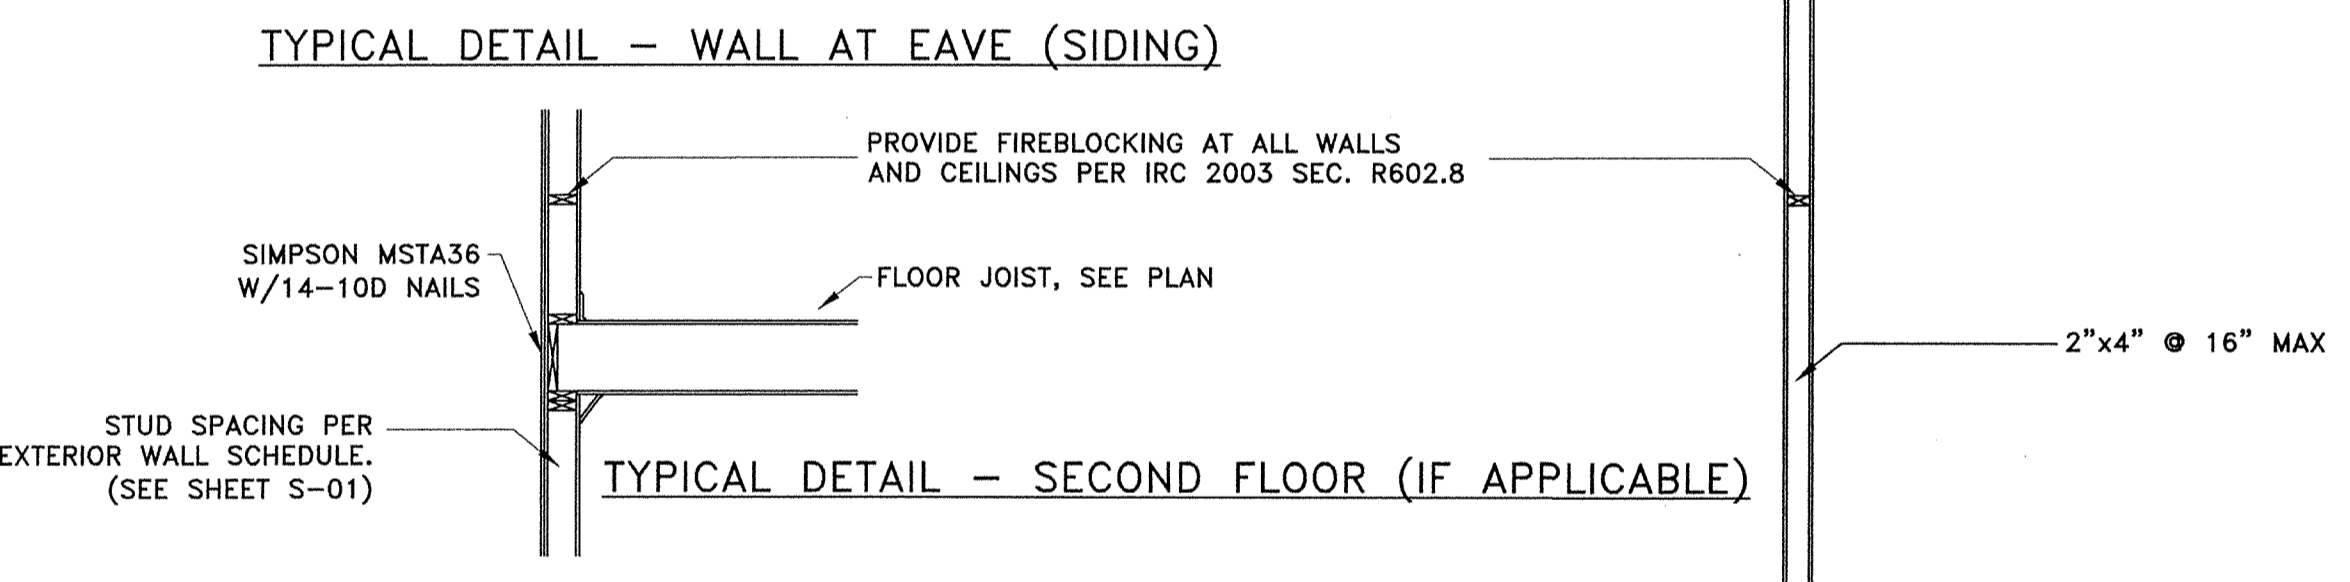


TYPICAL DETAIL - WALL AT EAVE (SIDING)

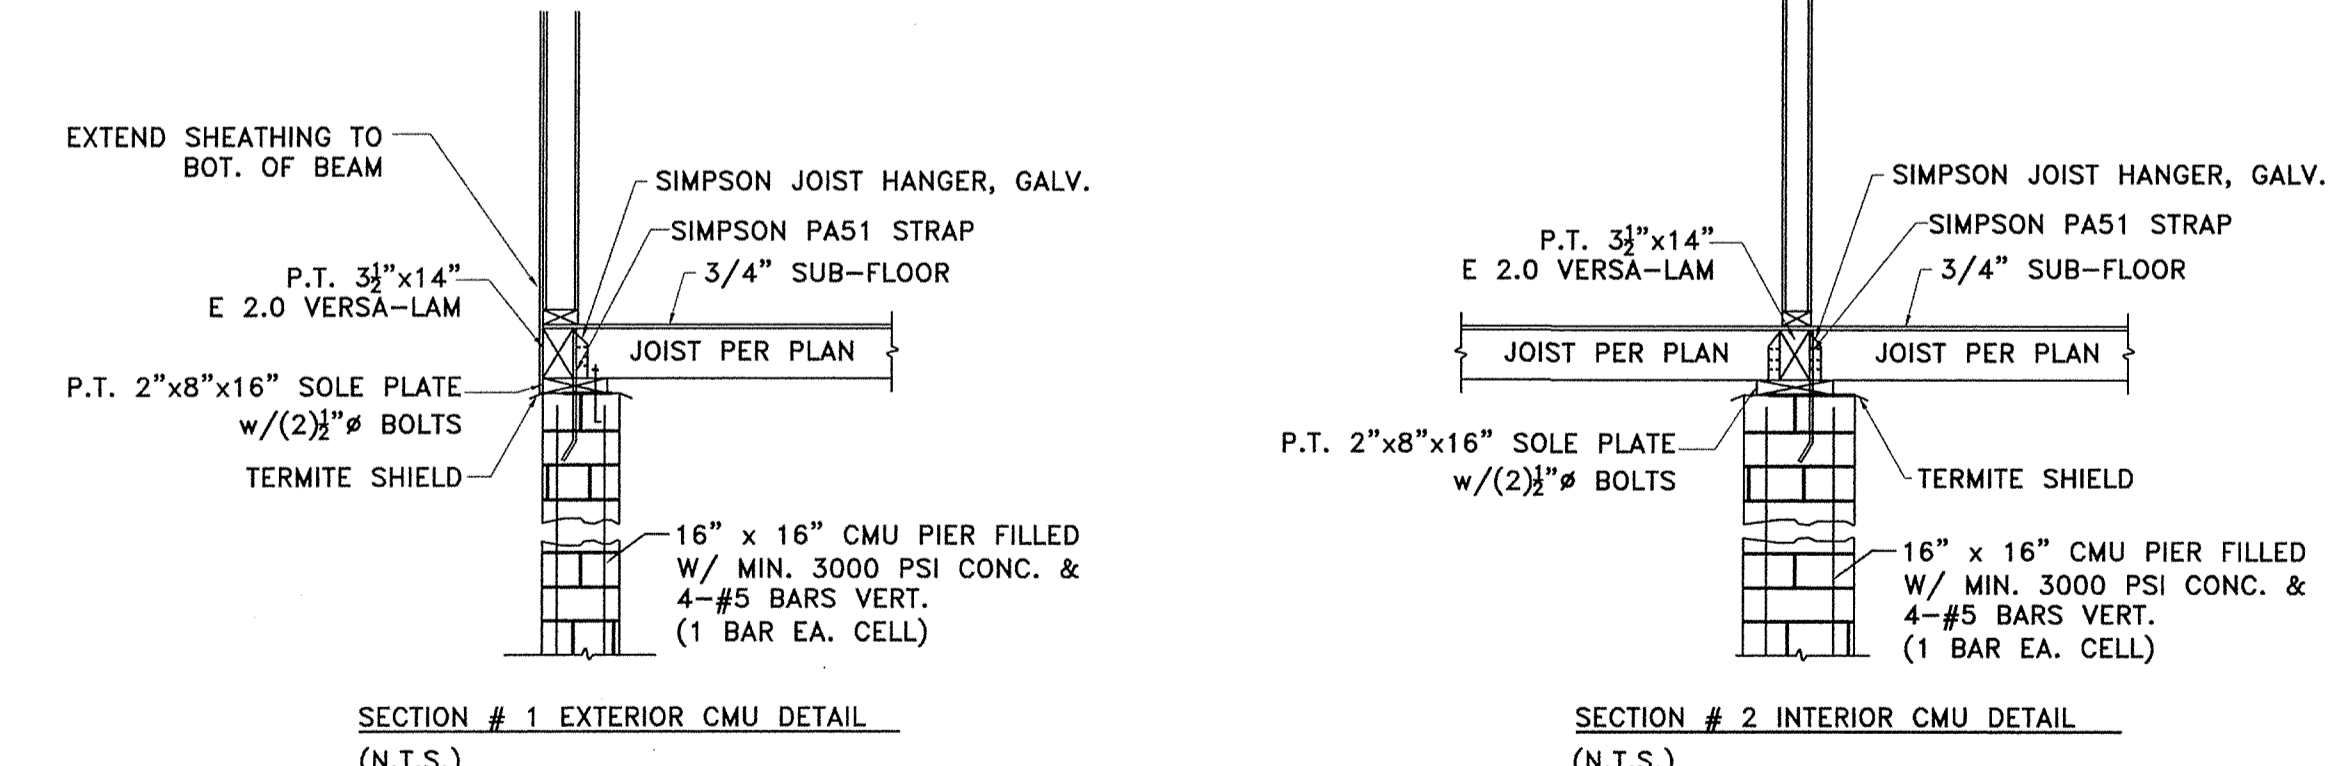


SECTION # 1 EXTERIOR CMU DETAIL (N.T.S.)


SECTION # 2 INTERIOR CMU DETAIL (N.T.S.)

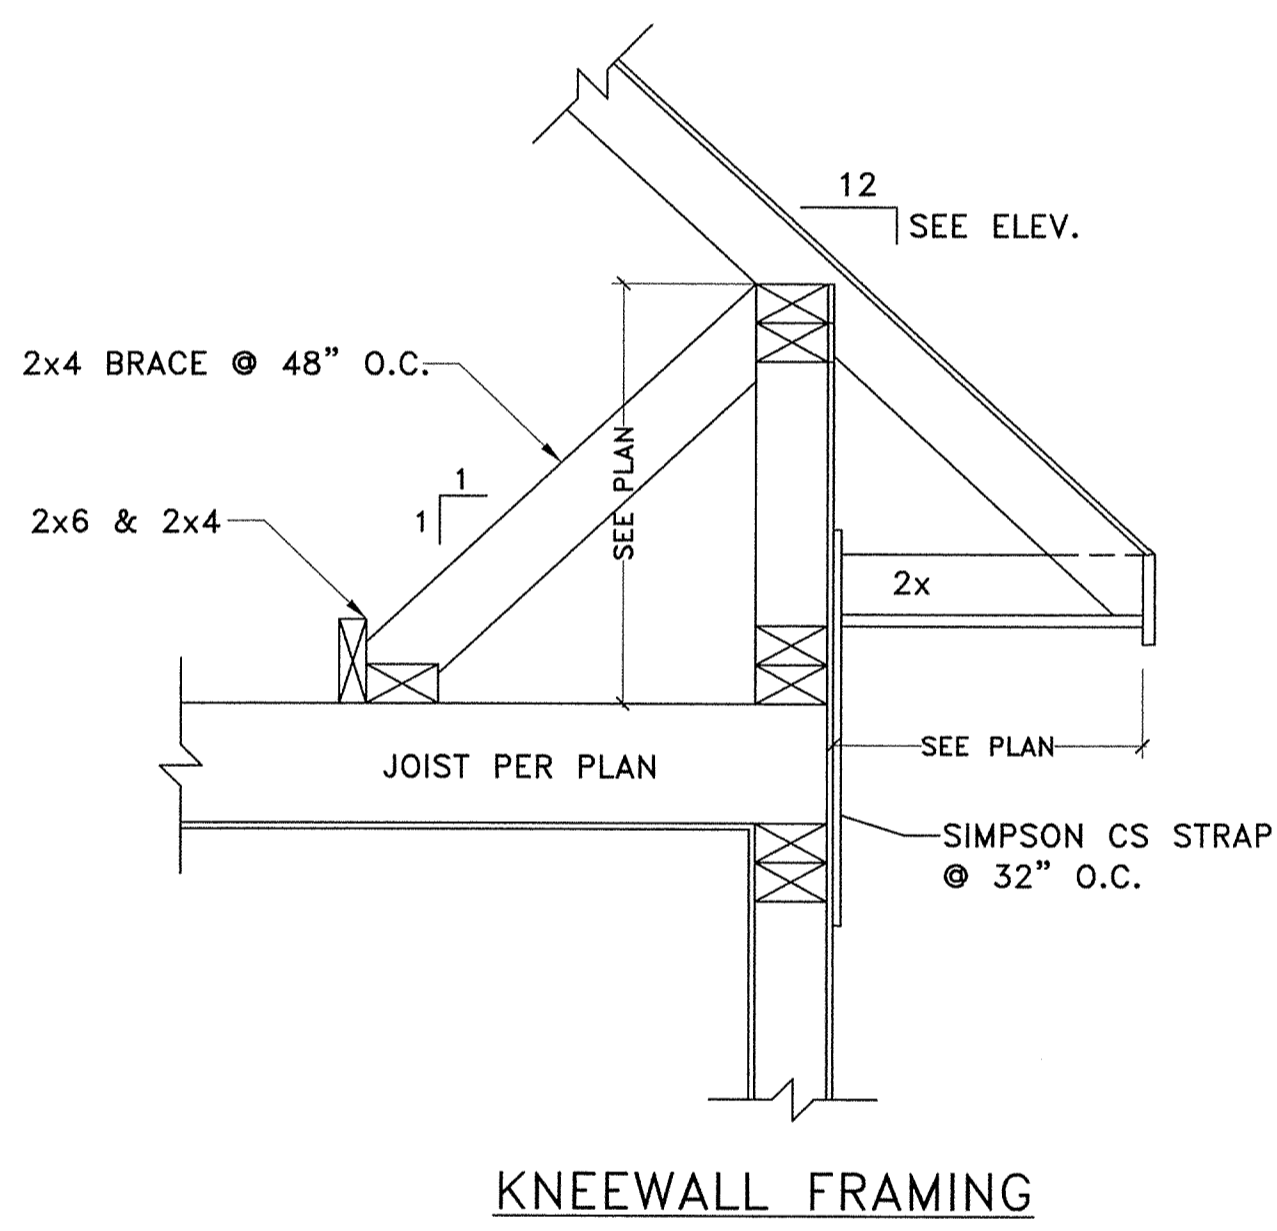


KNEEWALL FRAMING

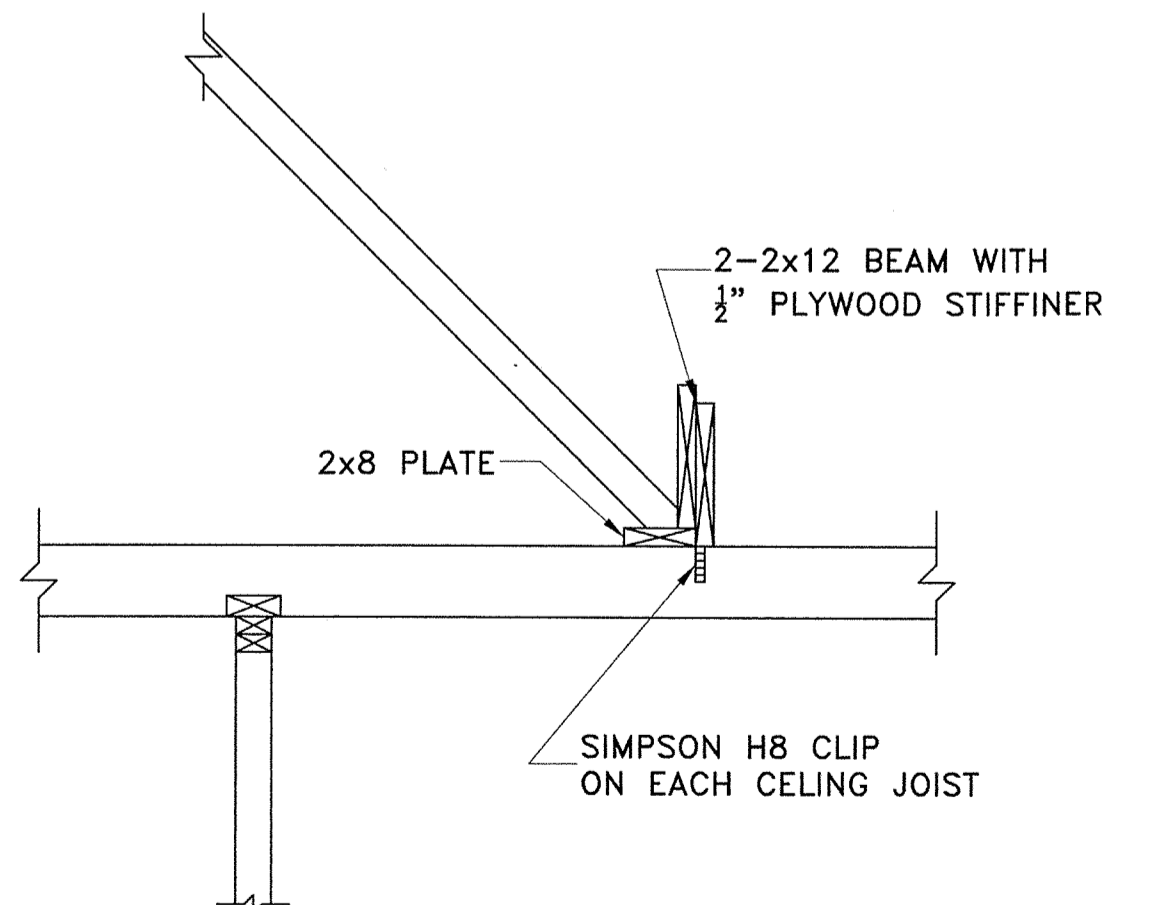

ROOF BRACING WHERE STRONG BACK IS REQUIRED

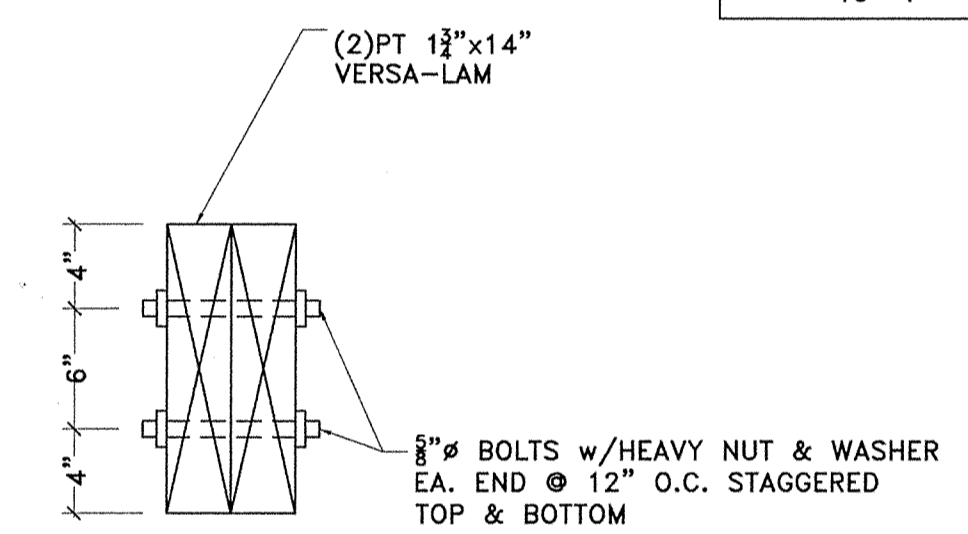


FLITCH BEAM - END VIEW

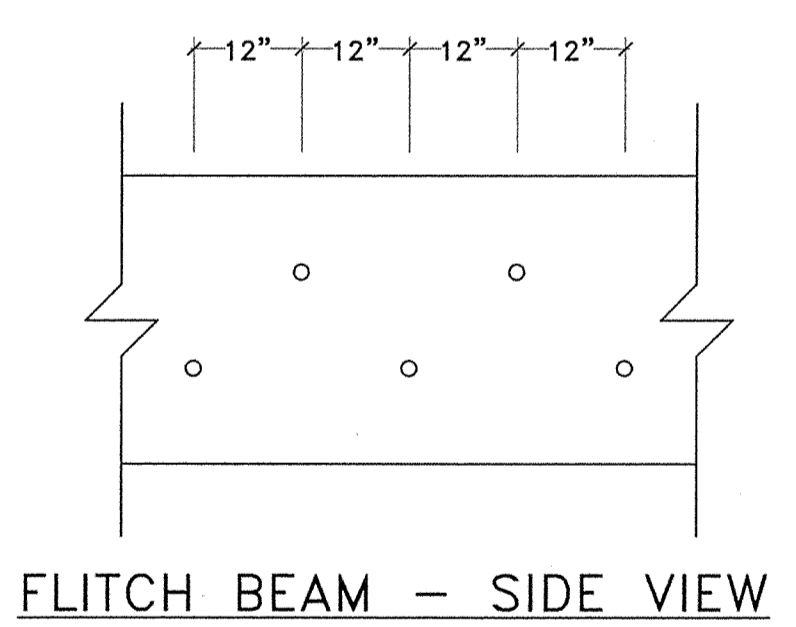

FLITCH BEAM - SIDE VIEW

THESE PLANS ARE THE PROPERTY OF COAST ENGINEERING SERVICES, INC. THEY MAY NOT BE REPRODUCED OR COPIED IN ANY WAY WITHOUT THE WRITTEN CONSENT OF COAST ENGINEERING SERVICES, INC.
 COAST ENGINEERING SERVICES IS A DIVISION OF COAST CONCRETE SERVICES, INC.


McMath Construction
 Caserta Residence
 -
 Cleveland St.
 St. Tammany Parish
 Covington, Louisiana

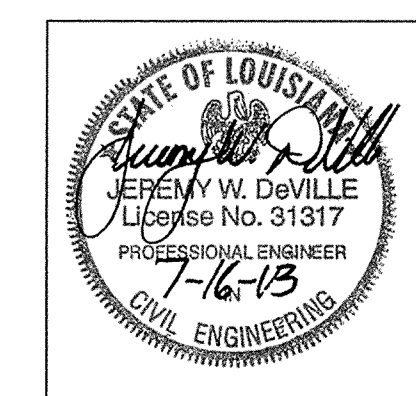


COAST ENGINEERING SERVICES
 29072 Krenfel Road, Lacombe, LA 70445
 800-641-3690, 985-882-8001, Fax 985-882-1534

Date:	Sq. Ft.:	Ckd. By:	Drawn By:	Project Number:
07/16/13	N/A	JD	MD	13-ES-0084


Sheet Description: General Notes
 Sheet Number: S-2 of 7

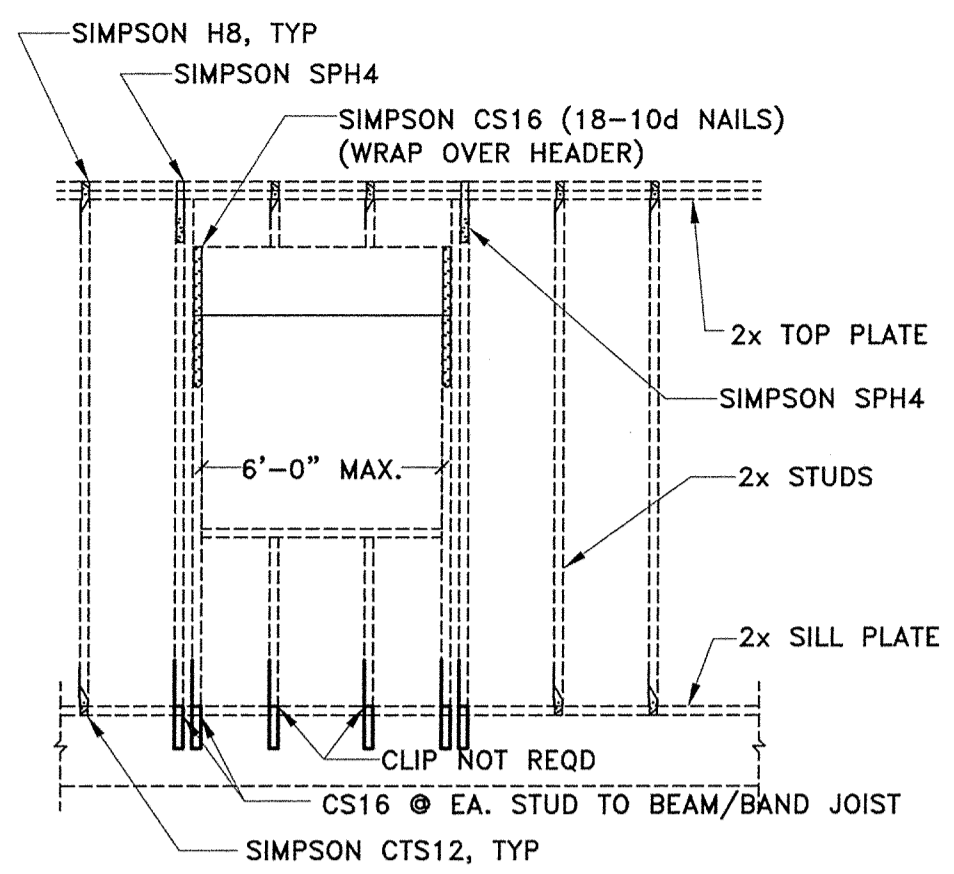


TYPICAL WINDOW OPENING DETAIL
 ALL EXTERIOR WALLS SHALL TO BE SHEATHED, NOT SHOWN. SEE SHEAR WALL DETAIL FOR INFO NOT SHOWN. RAFTERS AND ANCHOR BOLTS NOT SHOWN FOR CLARITY. CLIPS SHOWN ARE BASED UPON WINDOW LOCATION WITHIN 4FT FROM CORNER

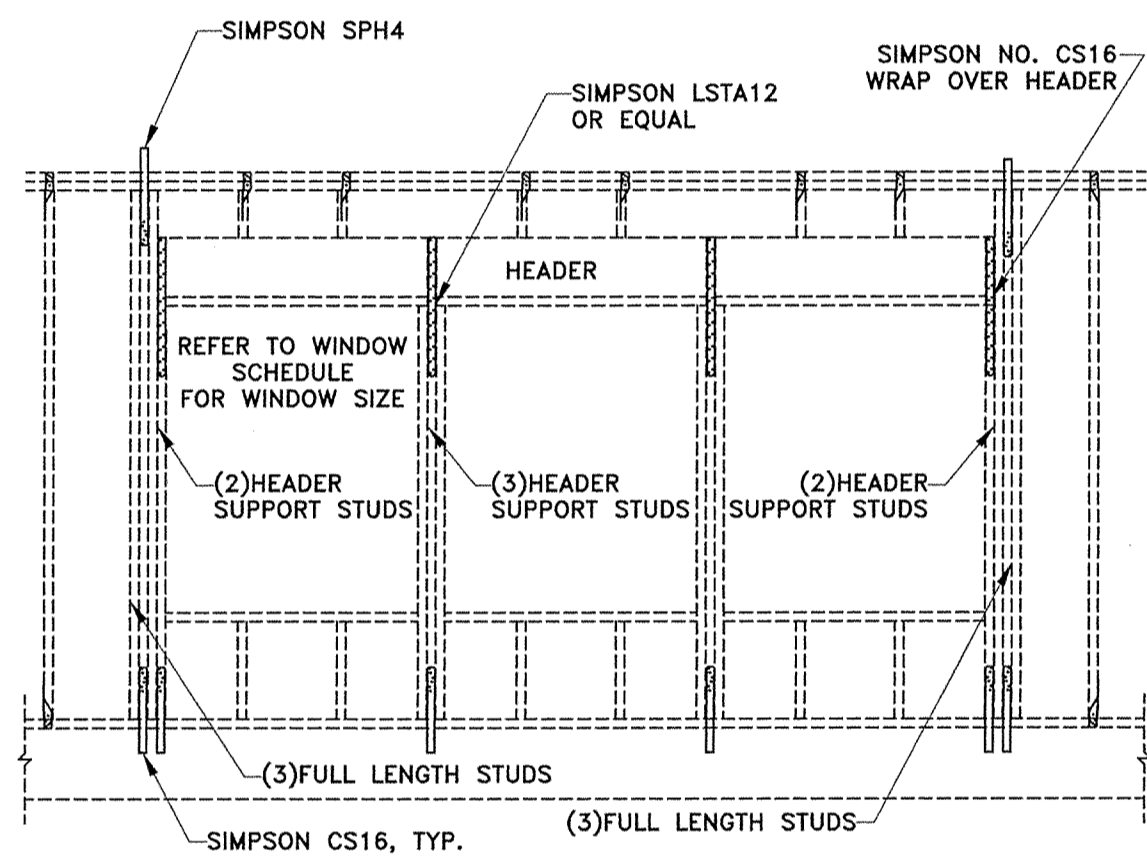

TYPICAL FRAMING AT MULTIPLE WINDOWS

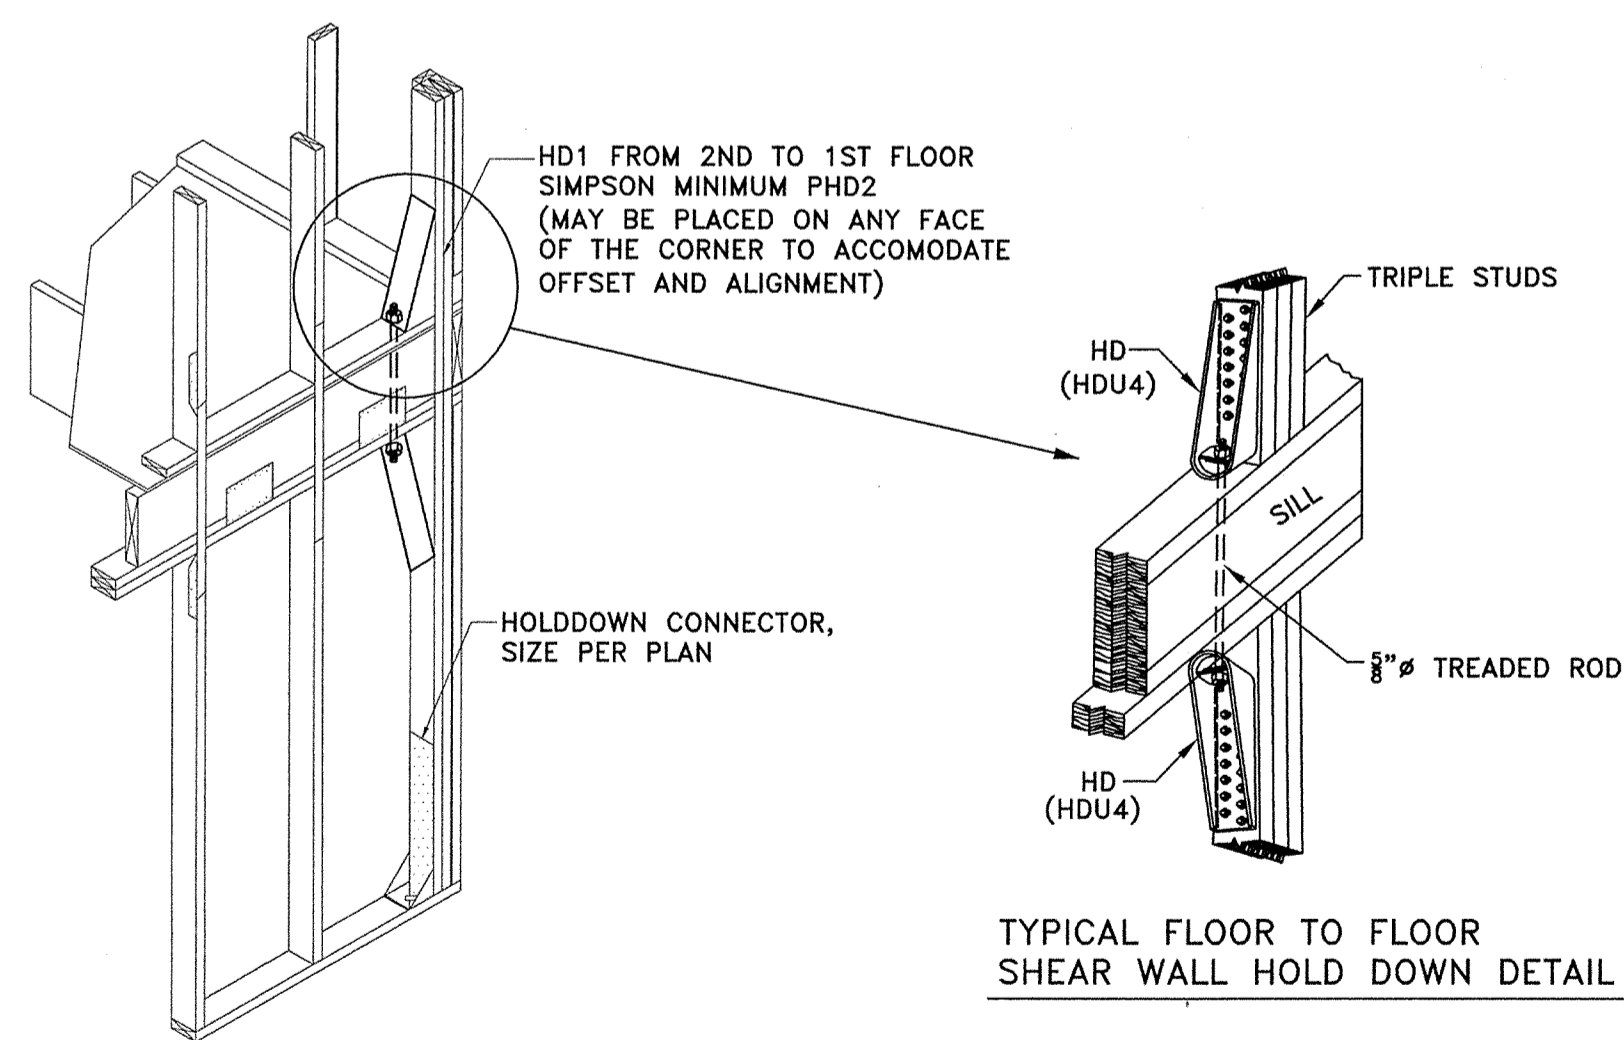


2-STORY HD1 TO 2ND FLOOR HOLDDOWN AT SHEAR WALL CORNERS

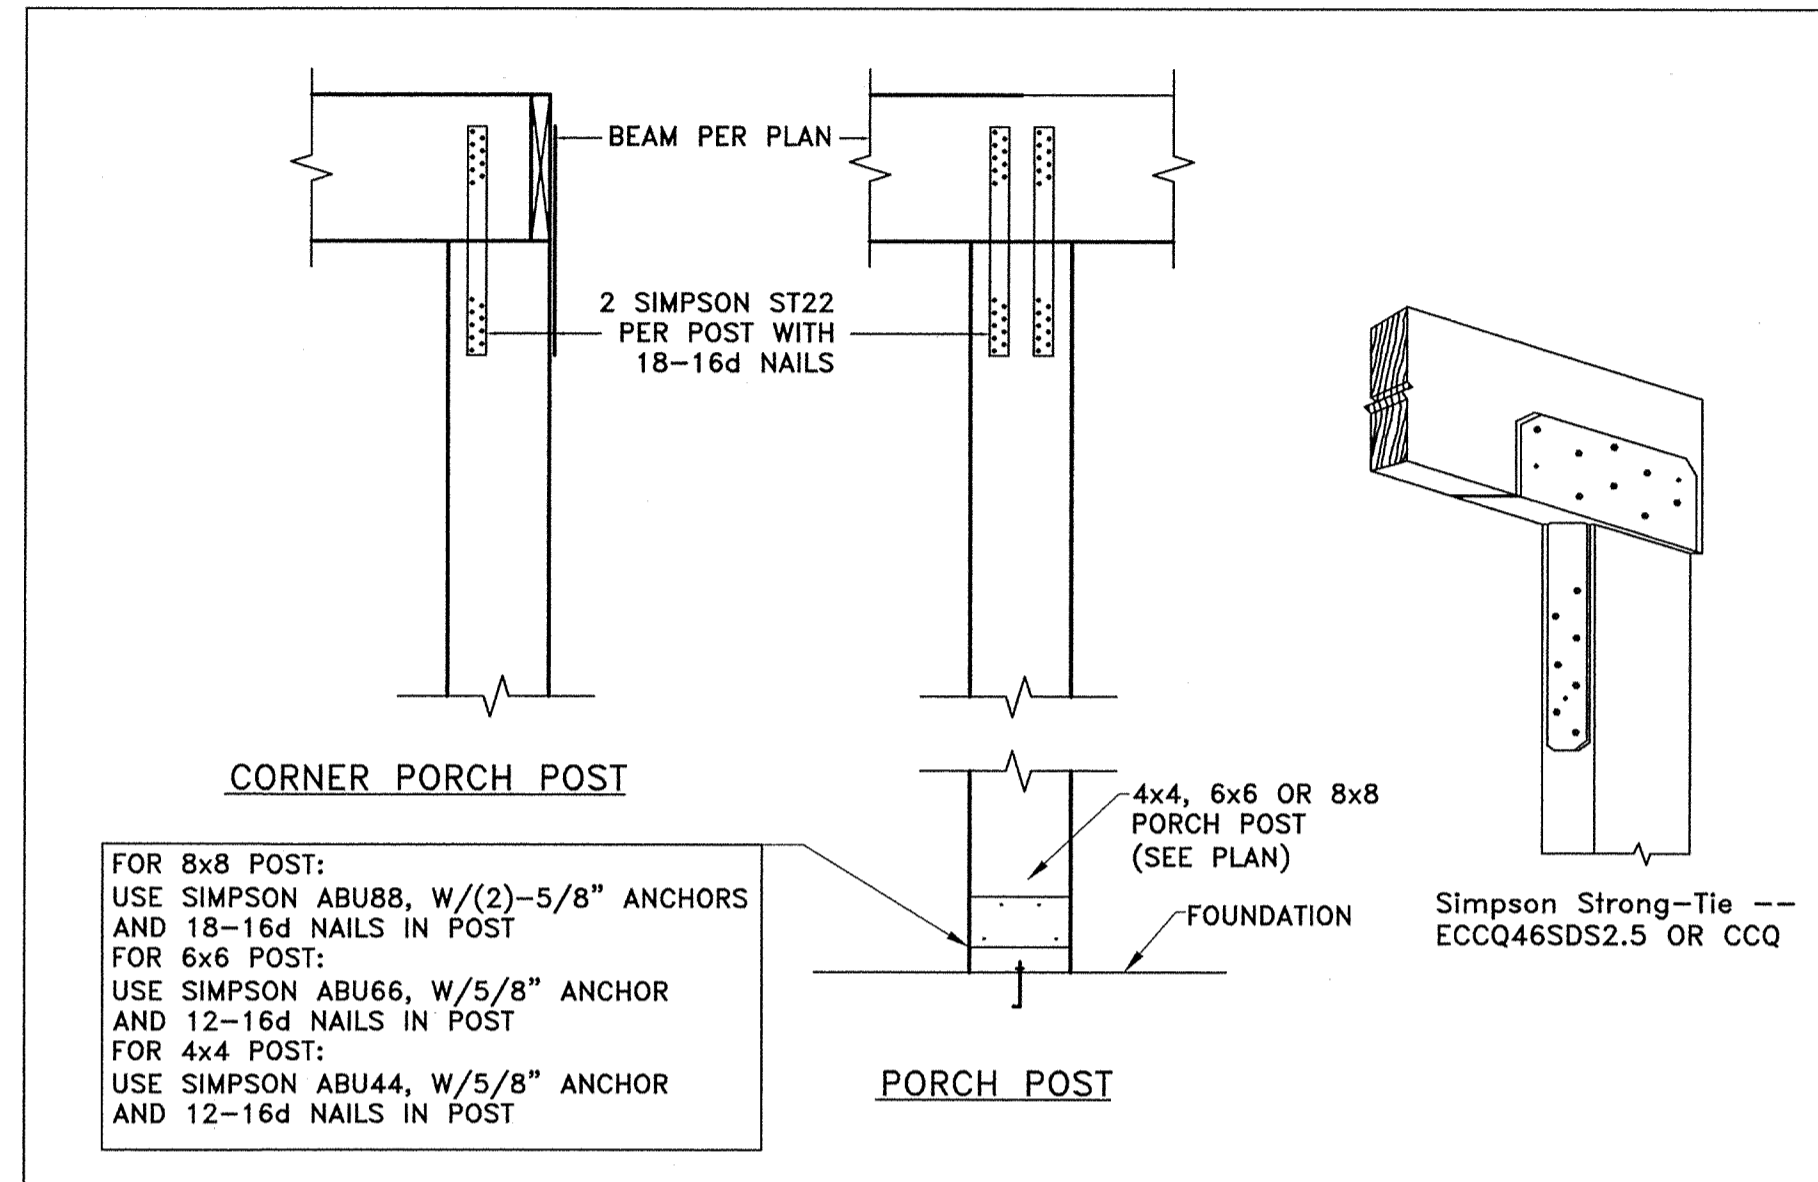


CORNER PORCH POST


PORCH POST

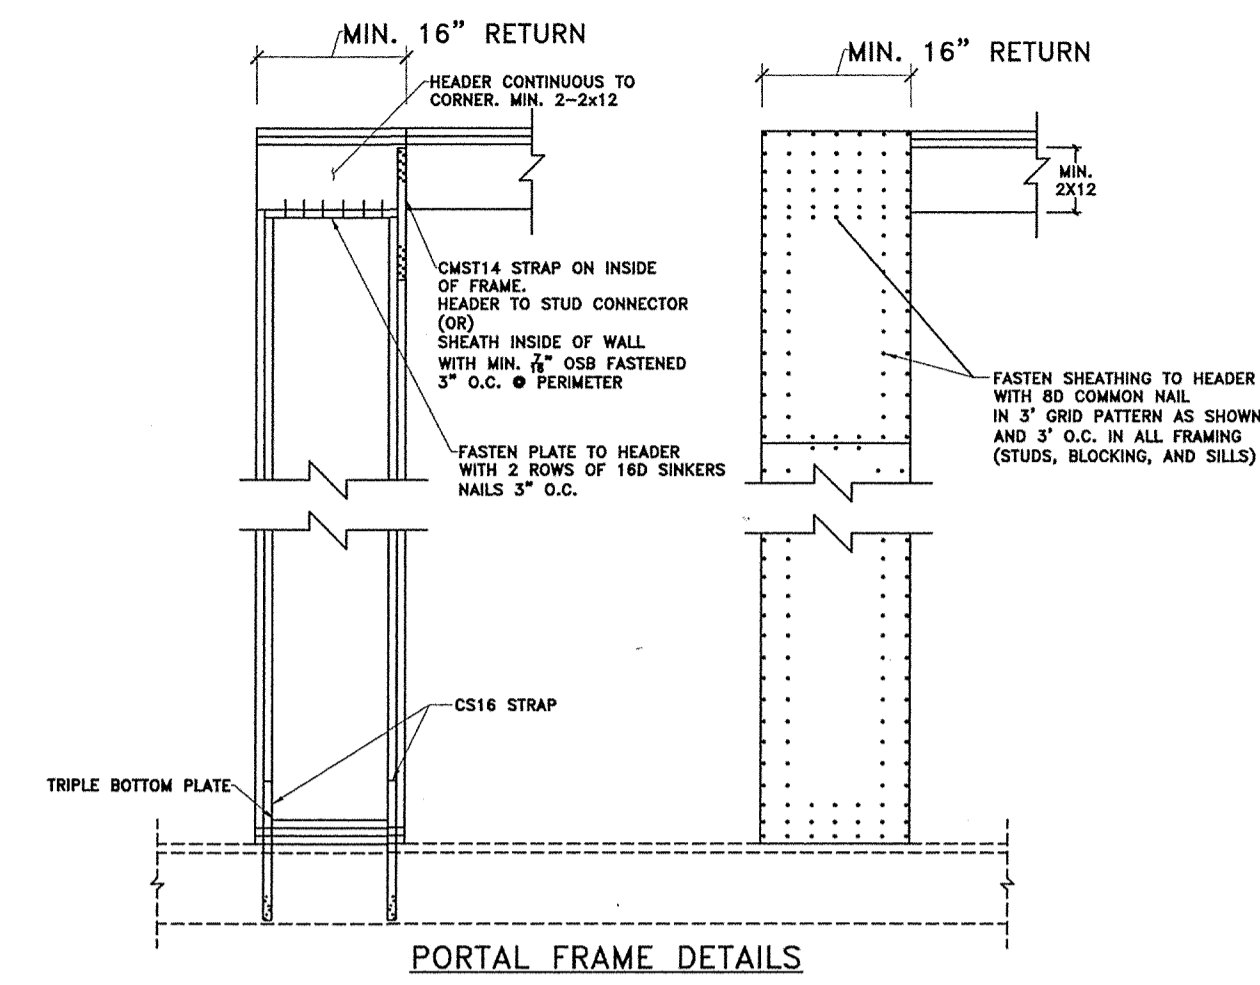


PORTAL FRAME DETAILS

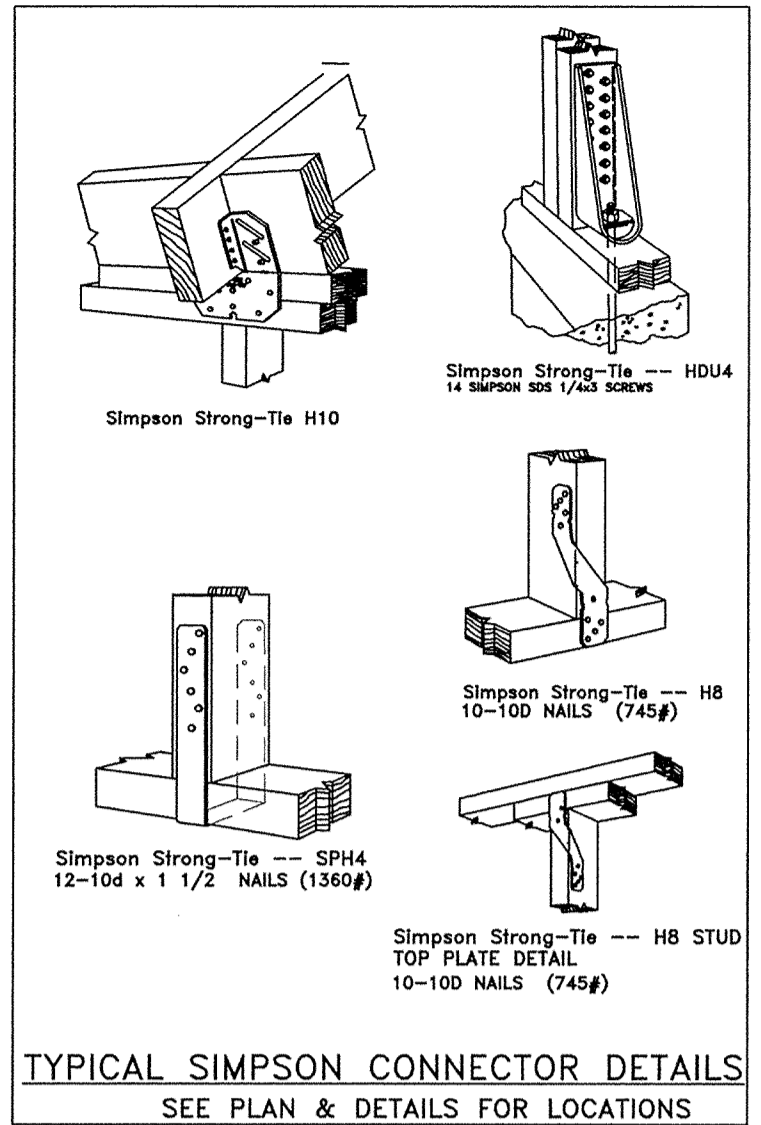


TYPICAL SIMPSON CONNECTOR DETAILS
 SEE PLAN & DETAILS FOR LOCATIONS

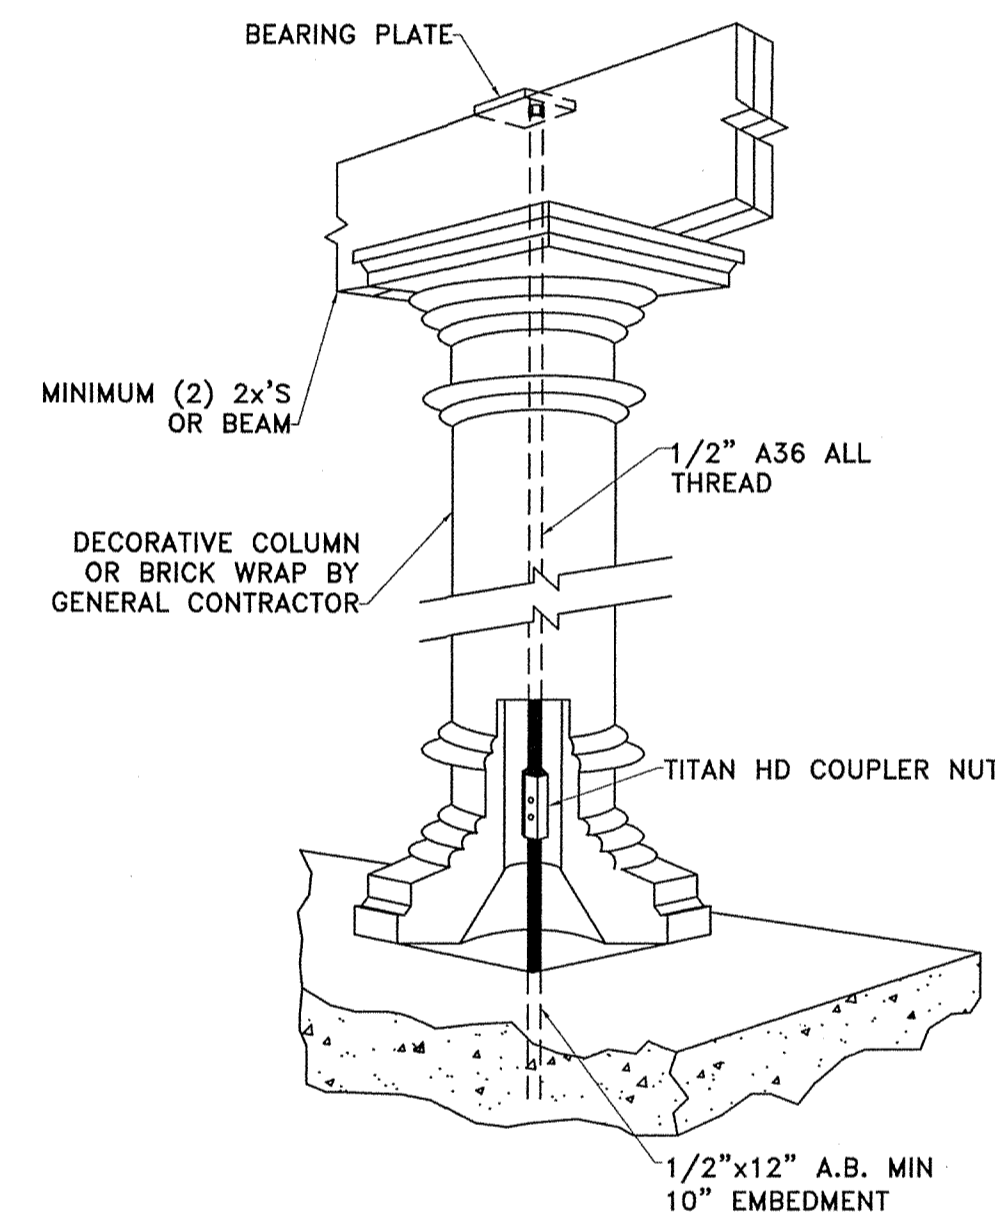

HOLLOW COL. UPLIFT CONNECTION
 NOTE: ABOVE DETAIL IS FOR LOAD BEARING HOLLOW COLUMNS.

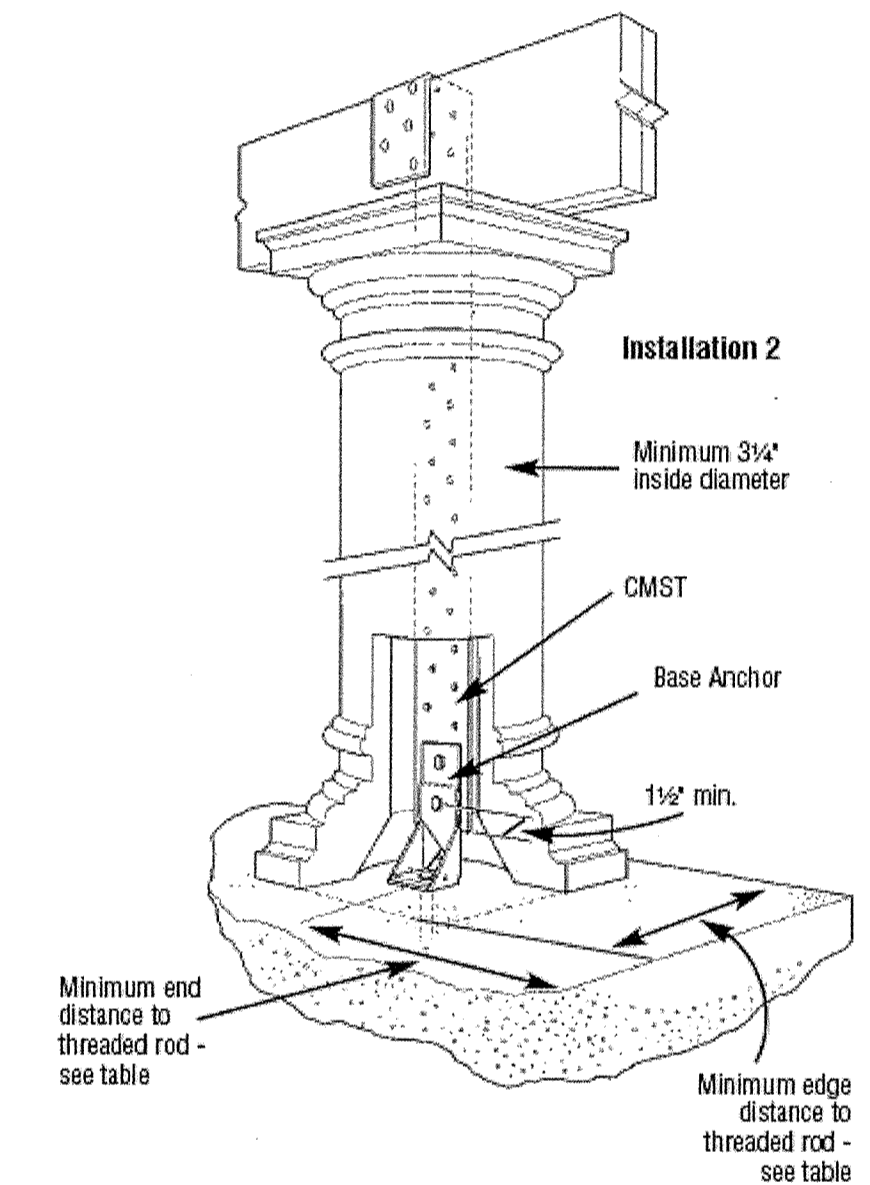


HOLLOW COL. UPLIFT CONNECTION
 PER SIMPSON TECHNICAL BULLETIN, INSTALLATION NO. 2
 NOTE: ABOVE DETAIL IS FOR LOAD BEARING HOLLOW COLUMNS. NON-LOAD BEARING HOLLOW COLUMNS SHALL HAVE A 6X6 POST AND SIMPSON ABU66 BASE AND SIMPSON AC69 CAP

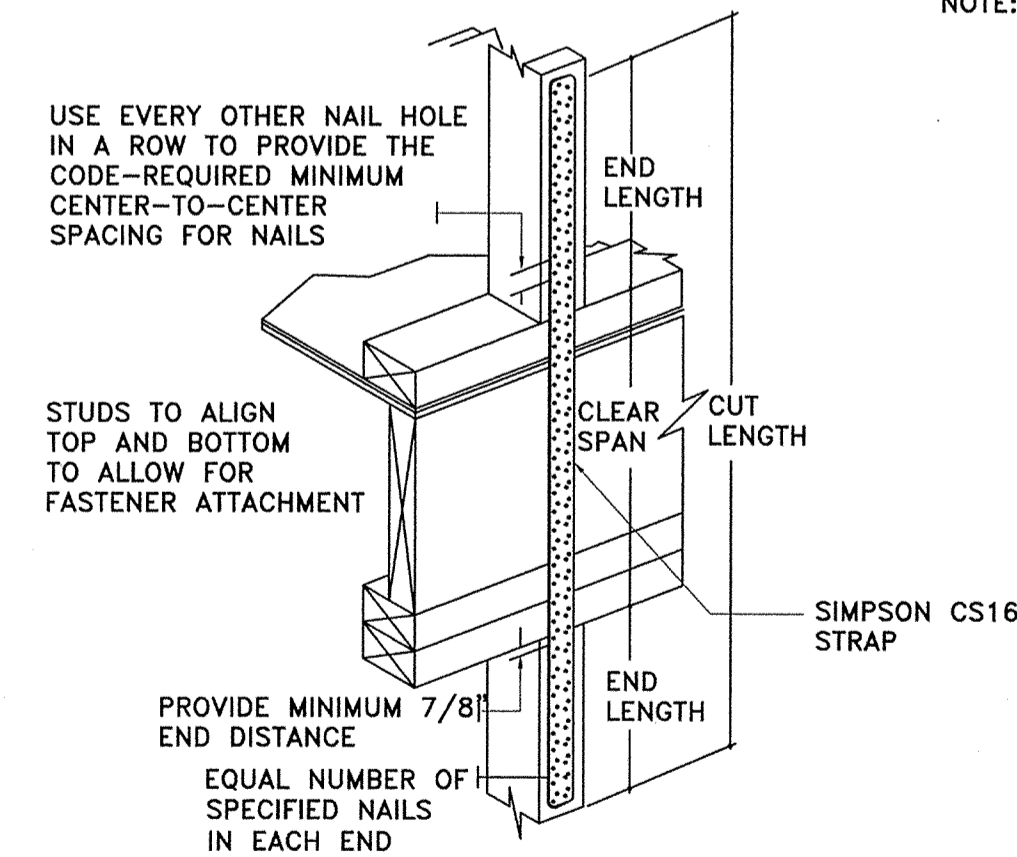

FLOOR TO FLOOR HOLD DOWN
 AT ALL STUDS BETWEEN 1ST & 2ND FLOOR

THESE PLANS ARE THE PROPERTY OF COAST ENGINEERING SERVICES, INC. THEY MAY NOT BE REPRODUCED OR COPIED IN ANY WAY WITHOUT THE WRITTEN CONSENT OF COAST ENGINEERING SERVICES, INC.
 COAST ENGINEERING SERVICES IS A DIVISION OF COAST CONCRETE SERVICES, INC.

McMath Construction
 Caserta Residence
 -
 Cleveland St.
 St. Tammany Parish
 Covington, Louisiana

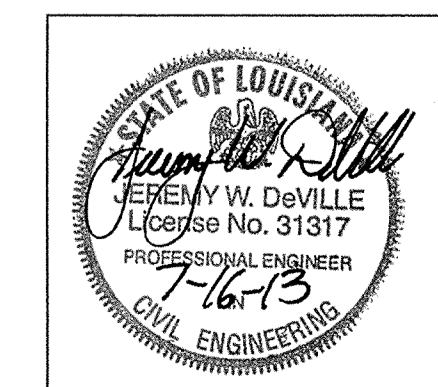


COAST ENGINEERING SERVICES
 29072 Kreniel Road, Lacombe, LA 70445
 800-641-3690, 985-882-8001, Fax 985-882-1534

Date: 07/16/13 Sq. Ft. N/A Ckd. By JD Drawn By MD Project Number 13-ES-0084

Sheet Description General Notes Sheet Number S-3 of 7

CEILING JOISTS SCHEDULE

- A = 2"x6" @ 16" O.C.
- B = 2"x8" @ 16" O.C.
- C = 2"x10" @ 16" O.C.
- D = 2"x10" @ 12" O.C.
- E = 2"x12" @ 16" O.C.
- F = 2"x12" @ 12" O.C.
- G = 16" BCI 60s 2.0 FLOOR JOISTS @ 16" O.C.

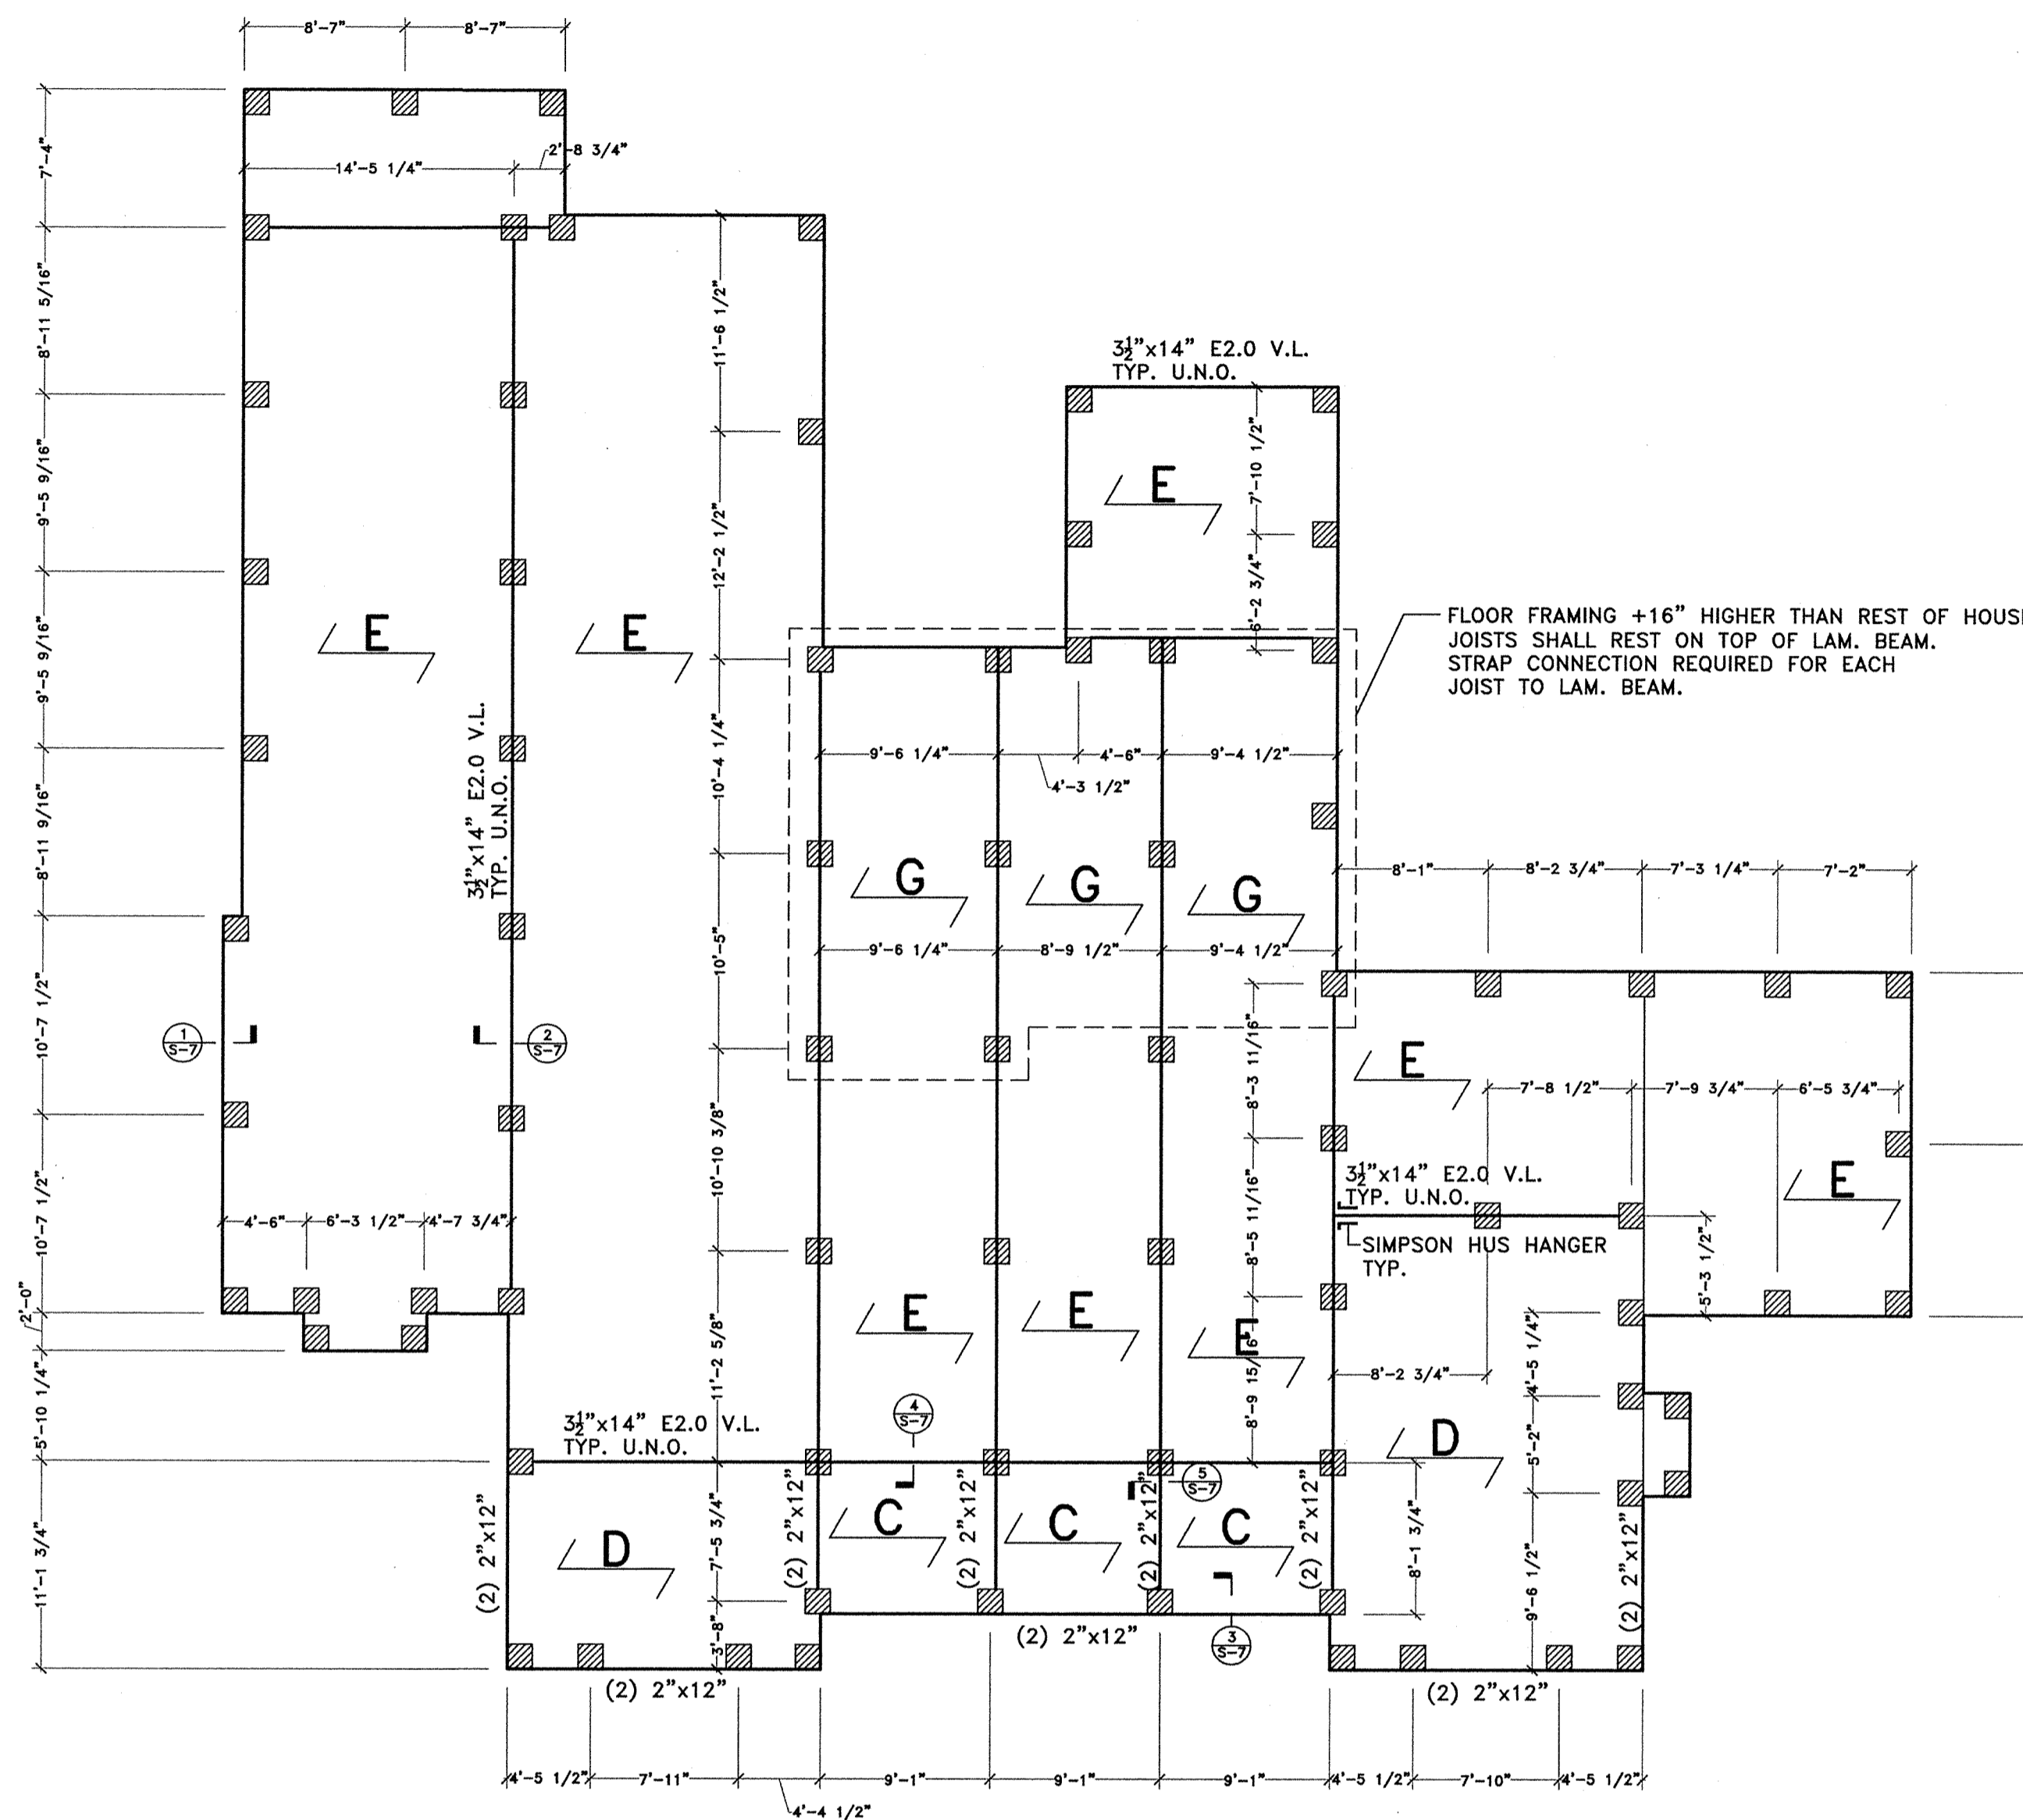


1st FLOOR FRAMING PLAN

1/8"=1'-0"

TIMBER FRAMING NOTES

1. Bridging required between floor joists not to exceed 8' span.
2. Double floor joists required under all load bearing walls.
3. All anchor straps and hangers to be galvanized. Install according to manufacturer's specifications. All joists & beam connections require hangers.
4. All framing lumber to be #2 SYPKD or better.
5. All lumber exposed to weather to be naturally durable or pressure treated.
6. Strictly follow all connection manufacturers details & recommendations.
7. Provide blocking for 1st floor framing per requirements of joist manufacturer and/or IRC 2009. Provide solid blocking at all joists at points of support.
8. All timber framing below B.F.E. to be treated lumber.
9. Slope porches away from house.
10. Field treat all cut ends, notches, & bored holes in preservative treated lumber.

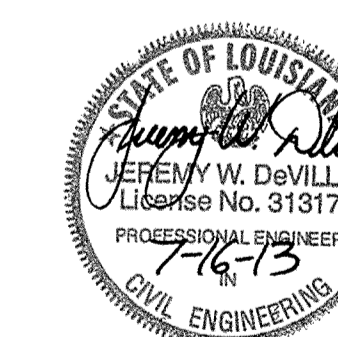

REV	DESCRIPTION	DATE	BY

McMath Construction
Caserta Residence
Cleveland St.
St. Tammany Parish
Covington, Louisiana



29072 Krentel Road, Lacombe, LA 70445
800-641-3690, 985-882-8001, Fax 985-882-1534

Date:	Sq. Ft.:	Ckd. By:	Drawn By:	Project Number:
07/16/13	N/A	JD	MD	13-ES-0084

Sheet Description	Sheet Number
Framing Plan	S-5 of 7


CEILING JOISTS SCHEDULE

- A = 2"x6" @ 16" O.C.
- B = 2"x8" @ 16" O.C.
- C = 2"x10" @ 16" O.C.
- D = 2"x10" @ 12" O.C.
- E = 2"x12" @ 16" O.C.
- F = 2"x12" @ 12" O.C.


HOLD DOWN SCHEDULE

- HD 1 = SIMPSON HDU4
- HD 2 = SIMPSON HDU5
- HD 3 = SIMPSON STHD14
- HD 4 = SIMPSON DOUBLE HDU4

V.L. = VERSA-LAM BEAM

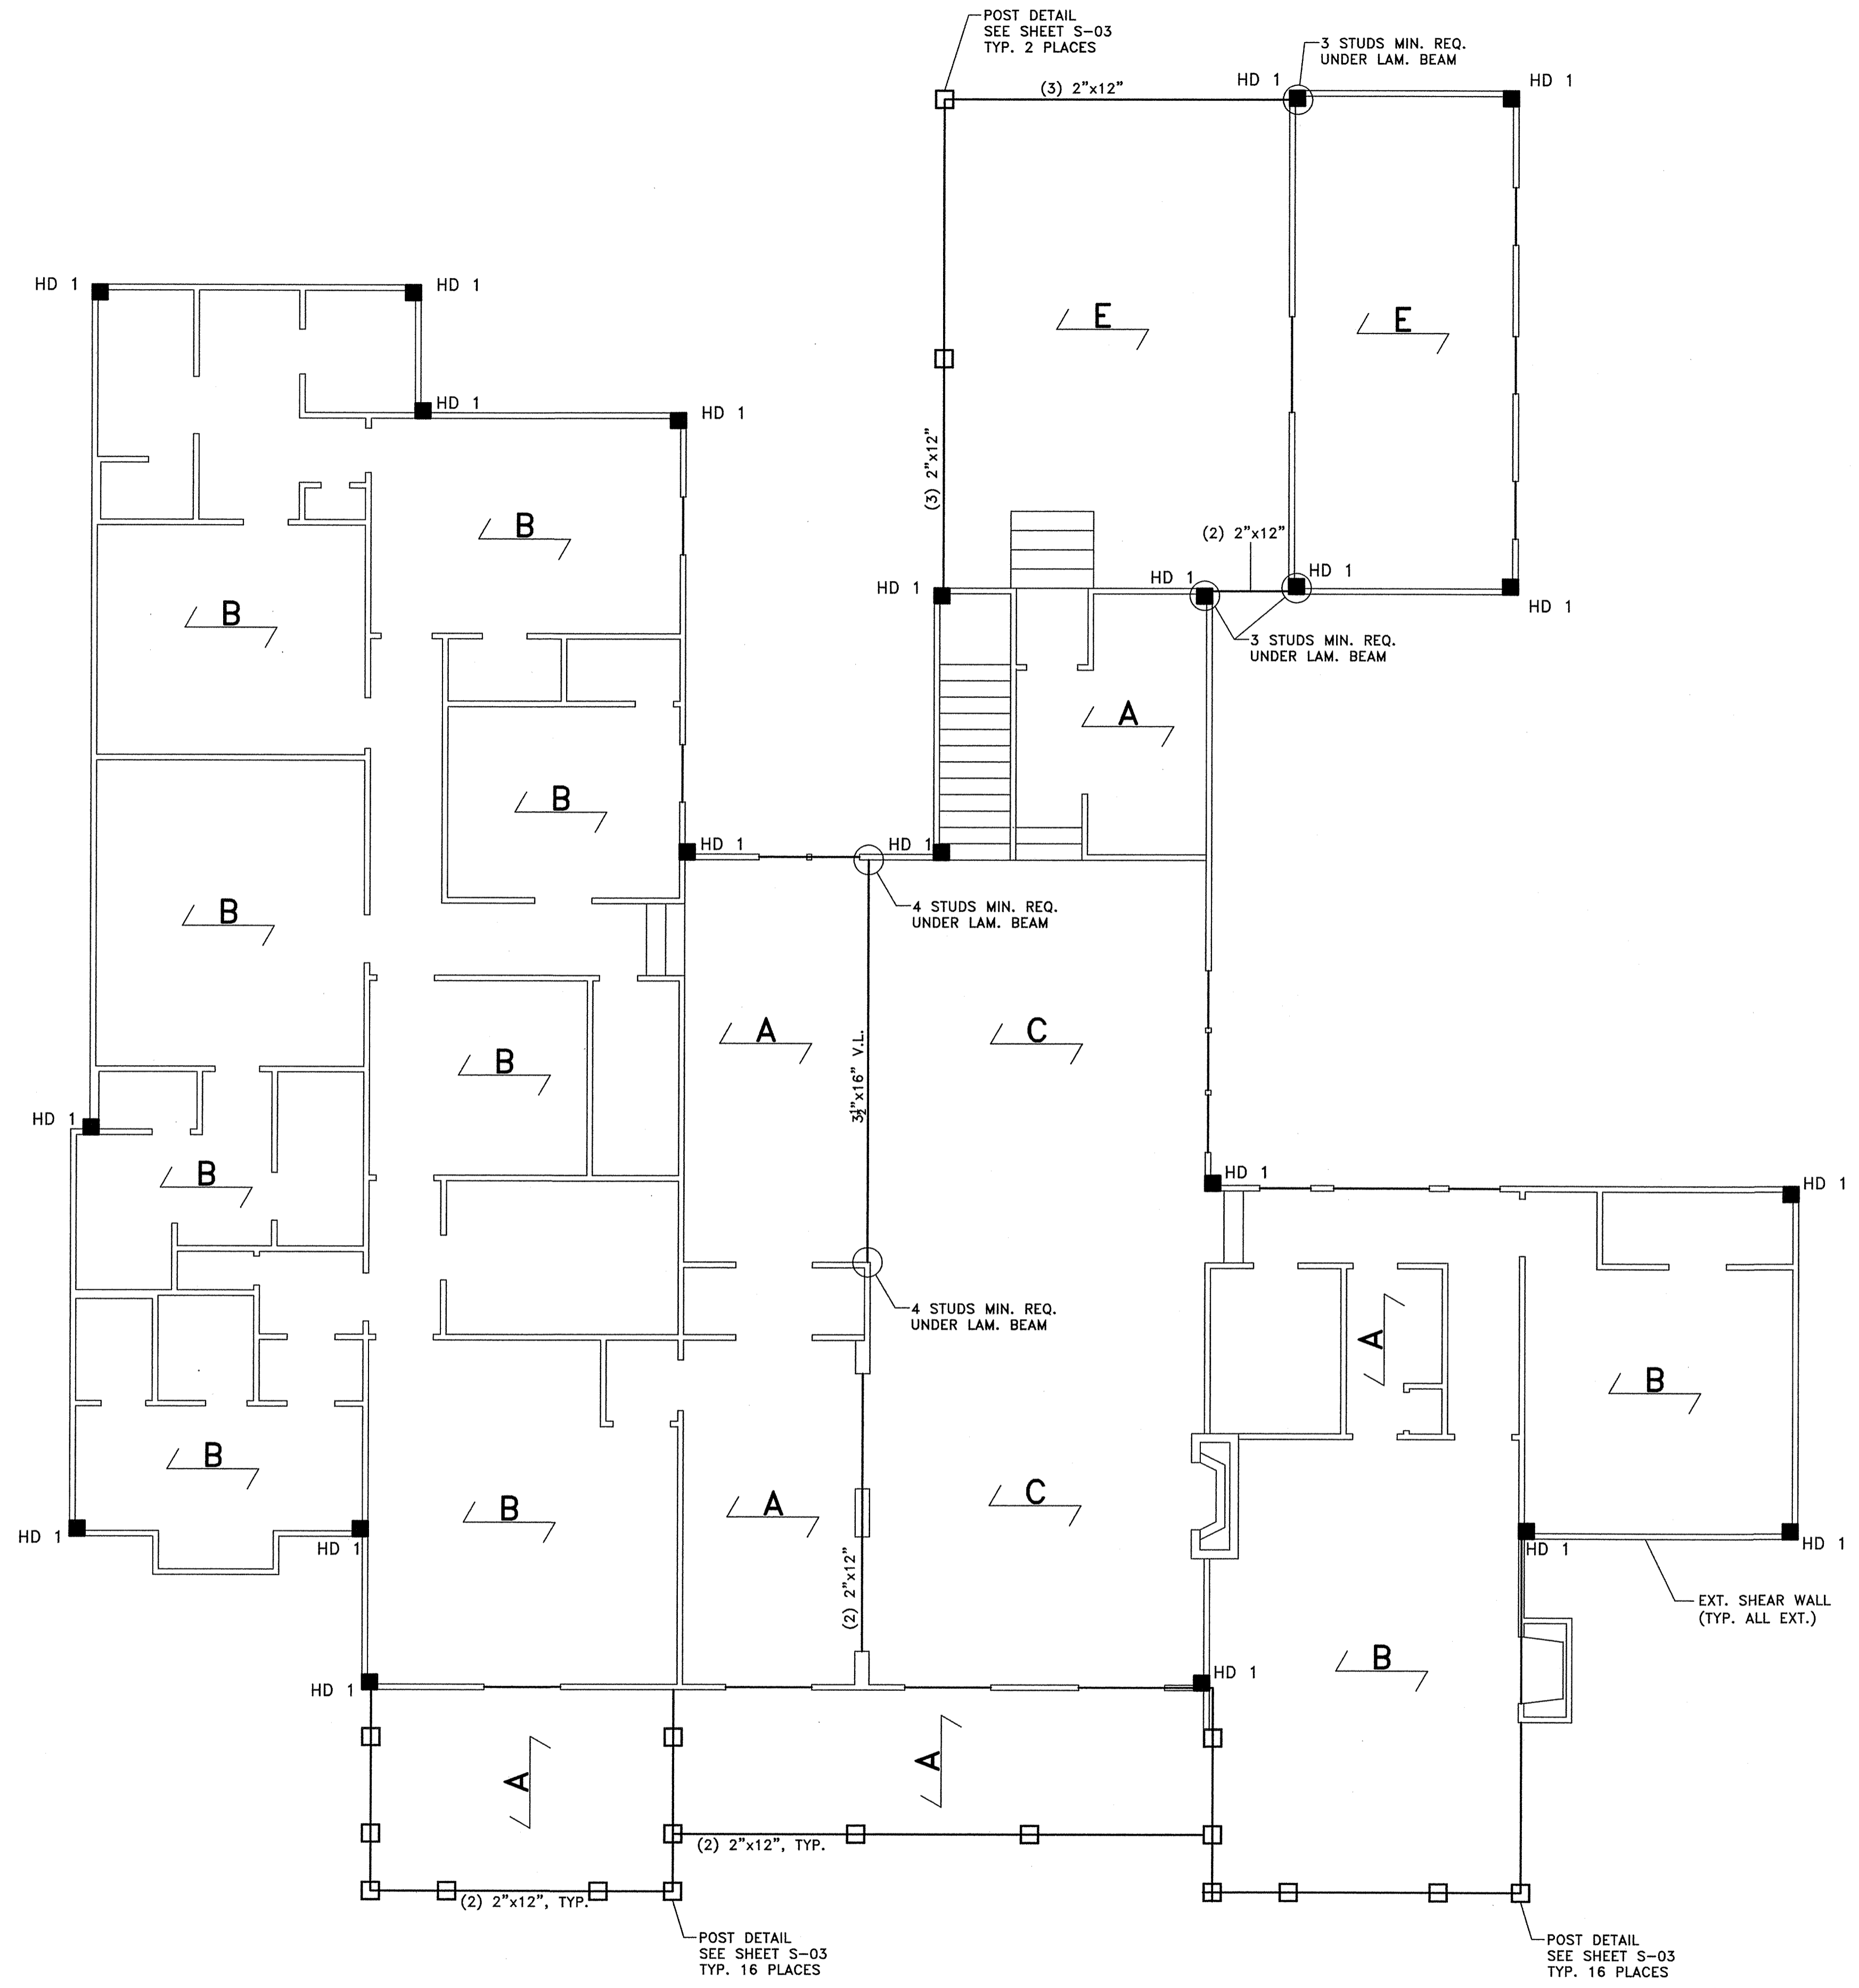


1st FLOOR CEILING FRAMING PLAN

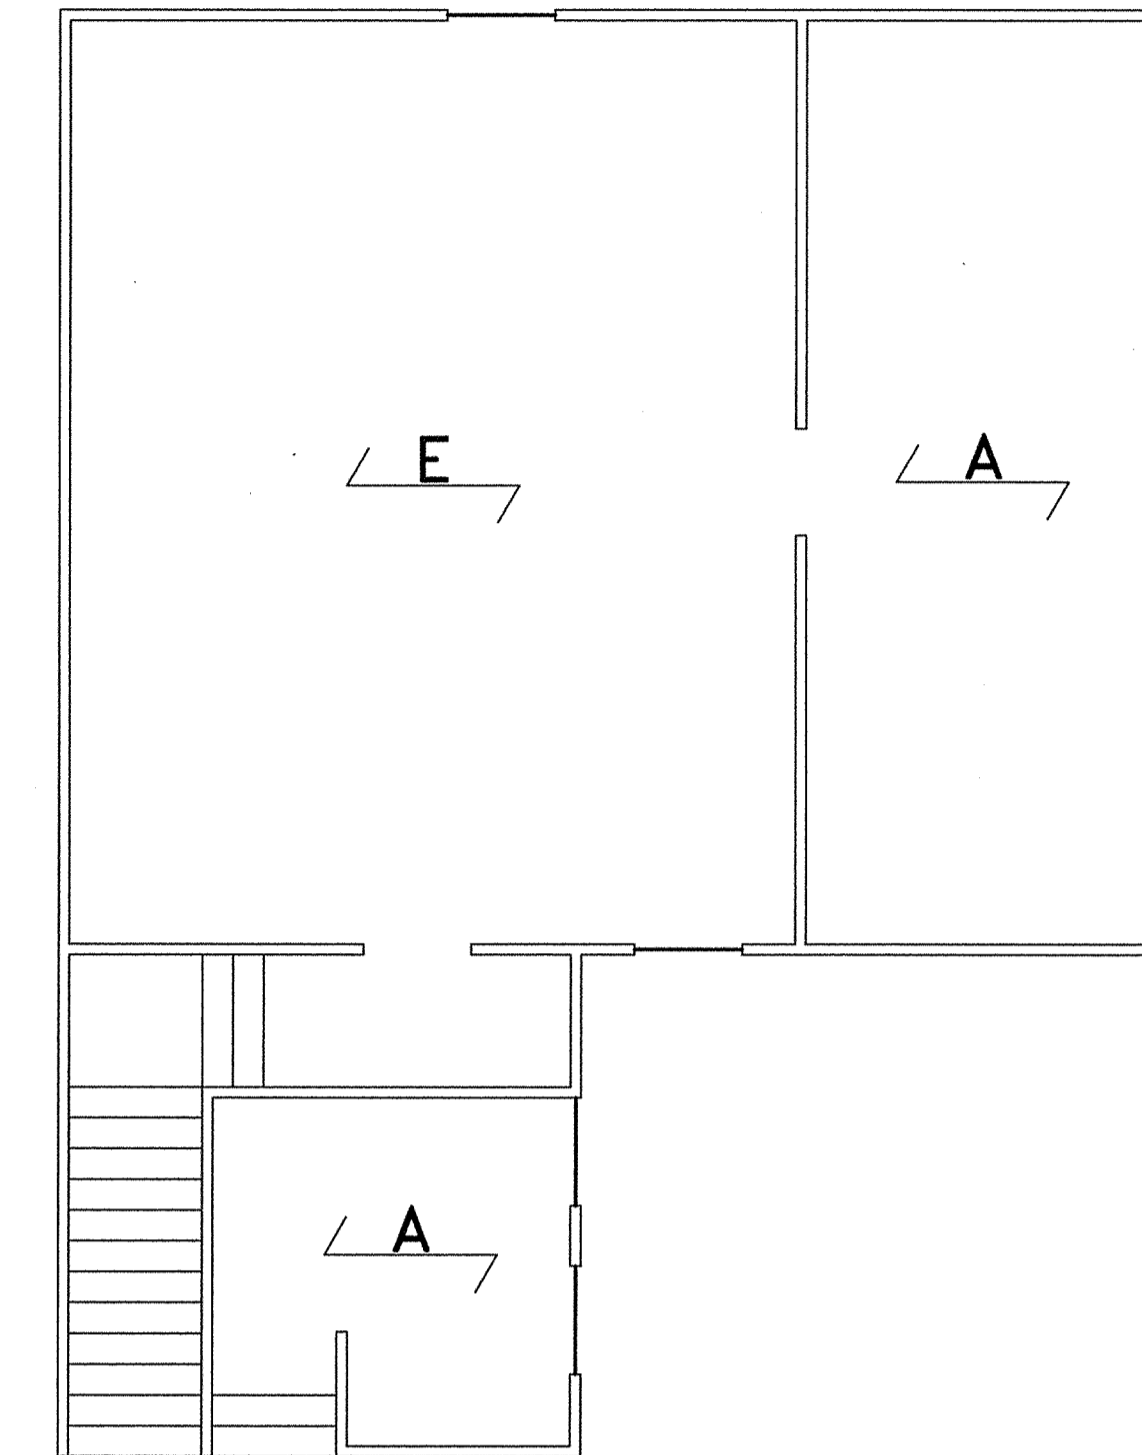

2nd FLOOR CEILING FRAMING PLAN

SEE GENERAL NOTES

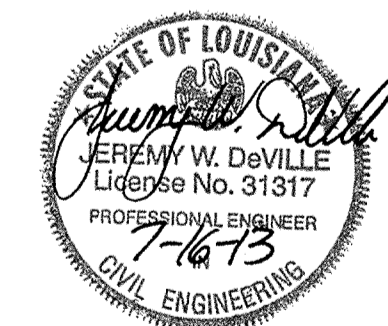


REV	DESCRIPTION	DATE	BY

McMath Construction
Caserta Residence
Cleveland St.
St. Tammany Parish
Covington, Louisiana


COAST ENGINEERING SERVICES
29072 Krentel Road, Lacombe, LA 70445
800-641-3690, 985-882-8001, Fax 985-882-1534

Date:	Sq. Ft.:	Ckd. By:	Drawn By:	Project Number:
07/16/13	N/A	JD	MD	13-ES-0084


Sheet Description:	Sheet Number:
Framing Plans	S-6 of 7

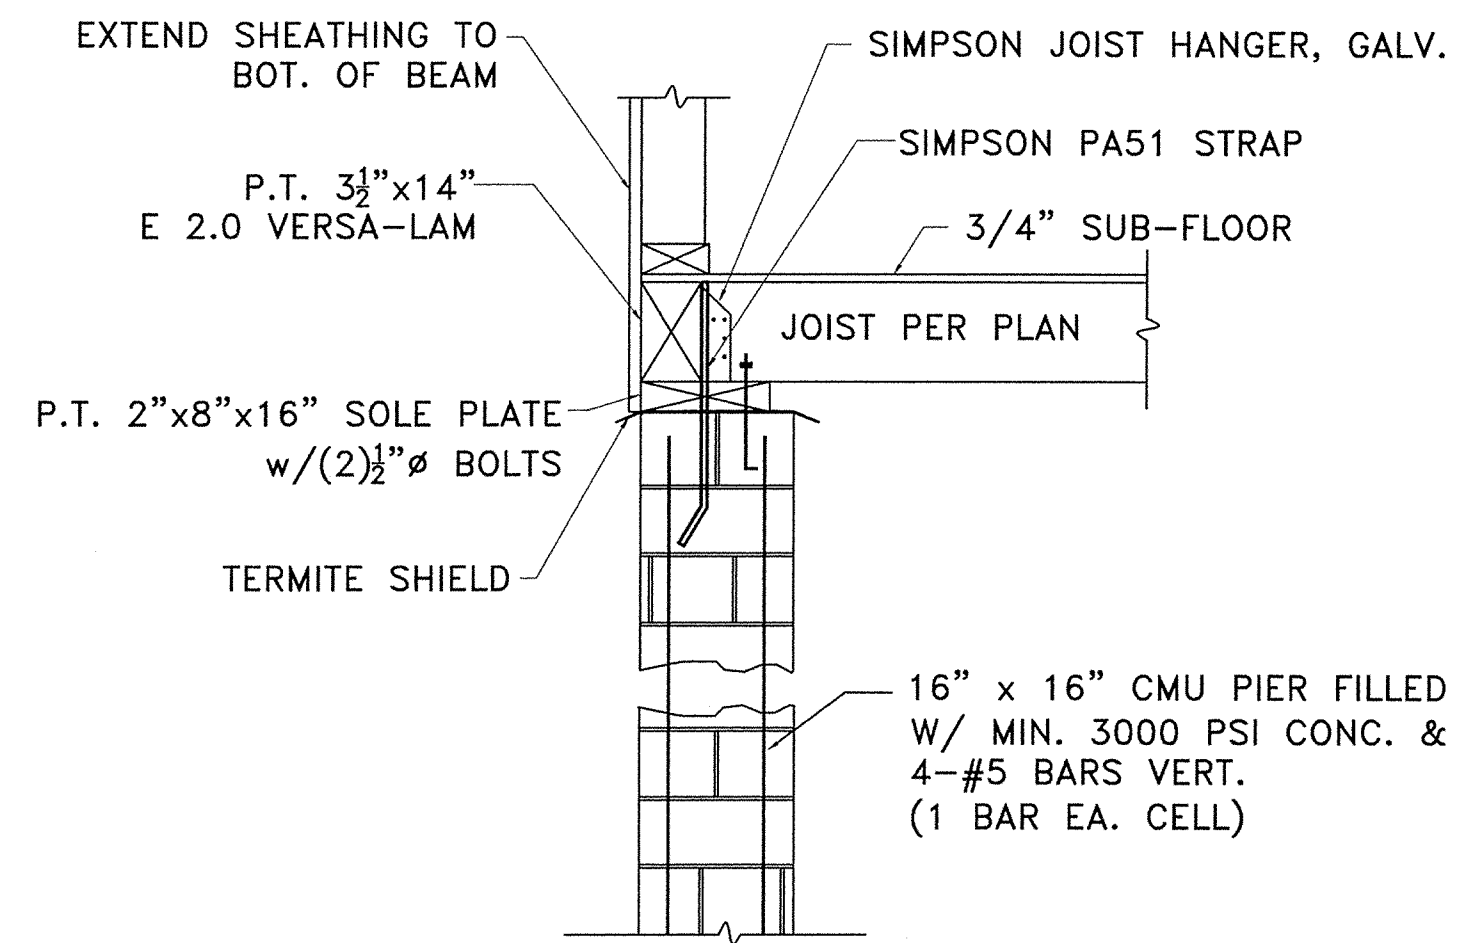


SECTION # 1 EXTERIOR CMU DETAIL
(N.T.S.)

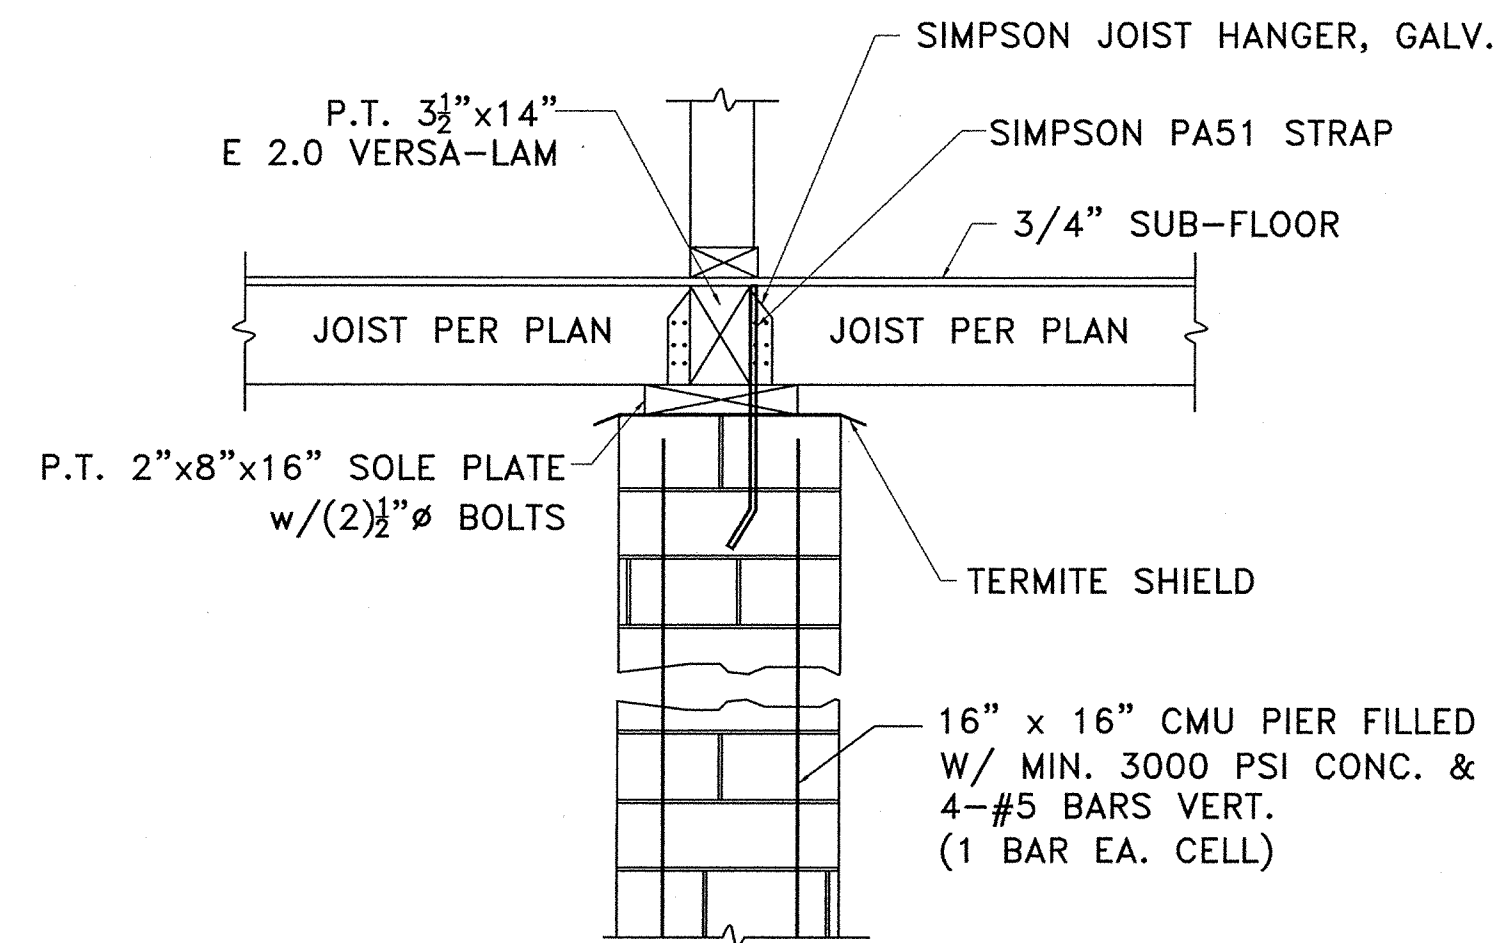


SECTION # 2 INTERIOR CMU DETAIL
(N.T.S.)

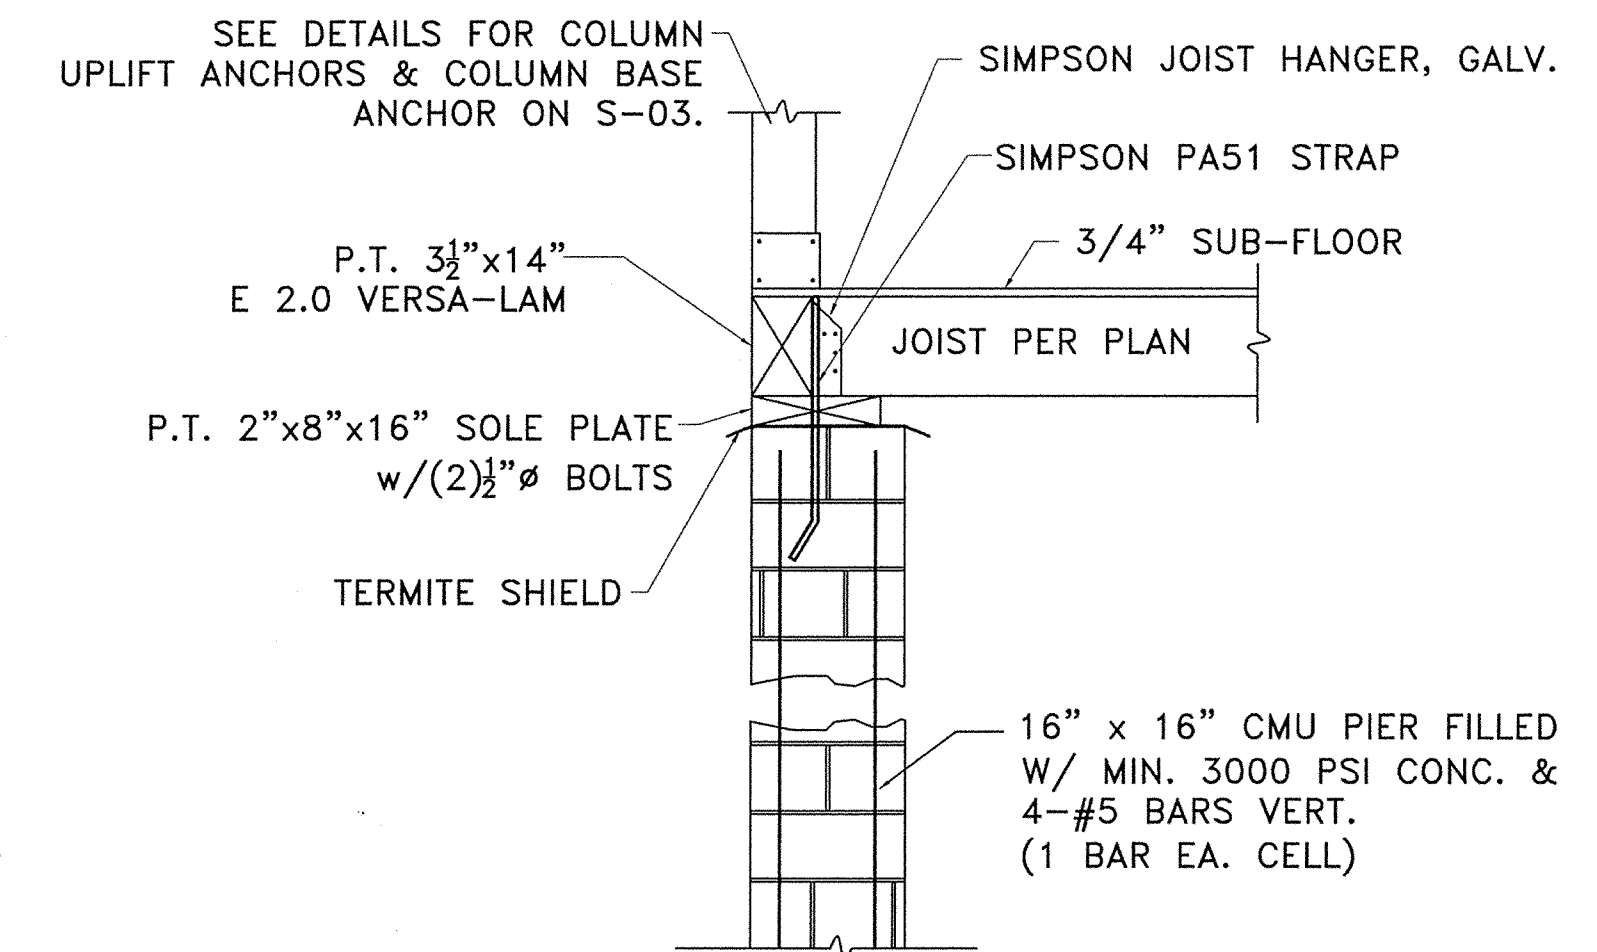

SECTION # 3 EXTERIOR CMU DETAIL
(N.T.S.)

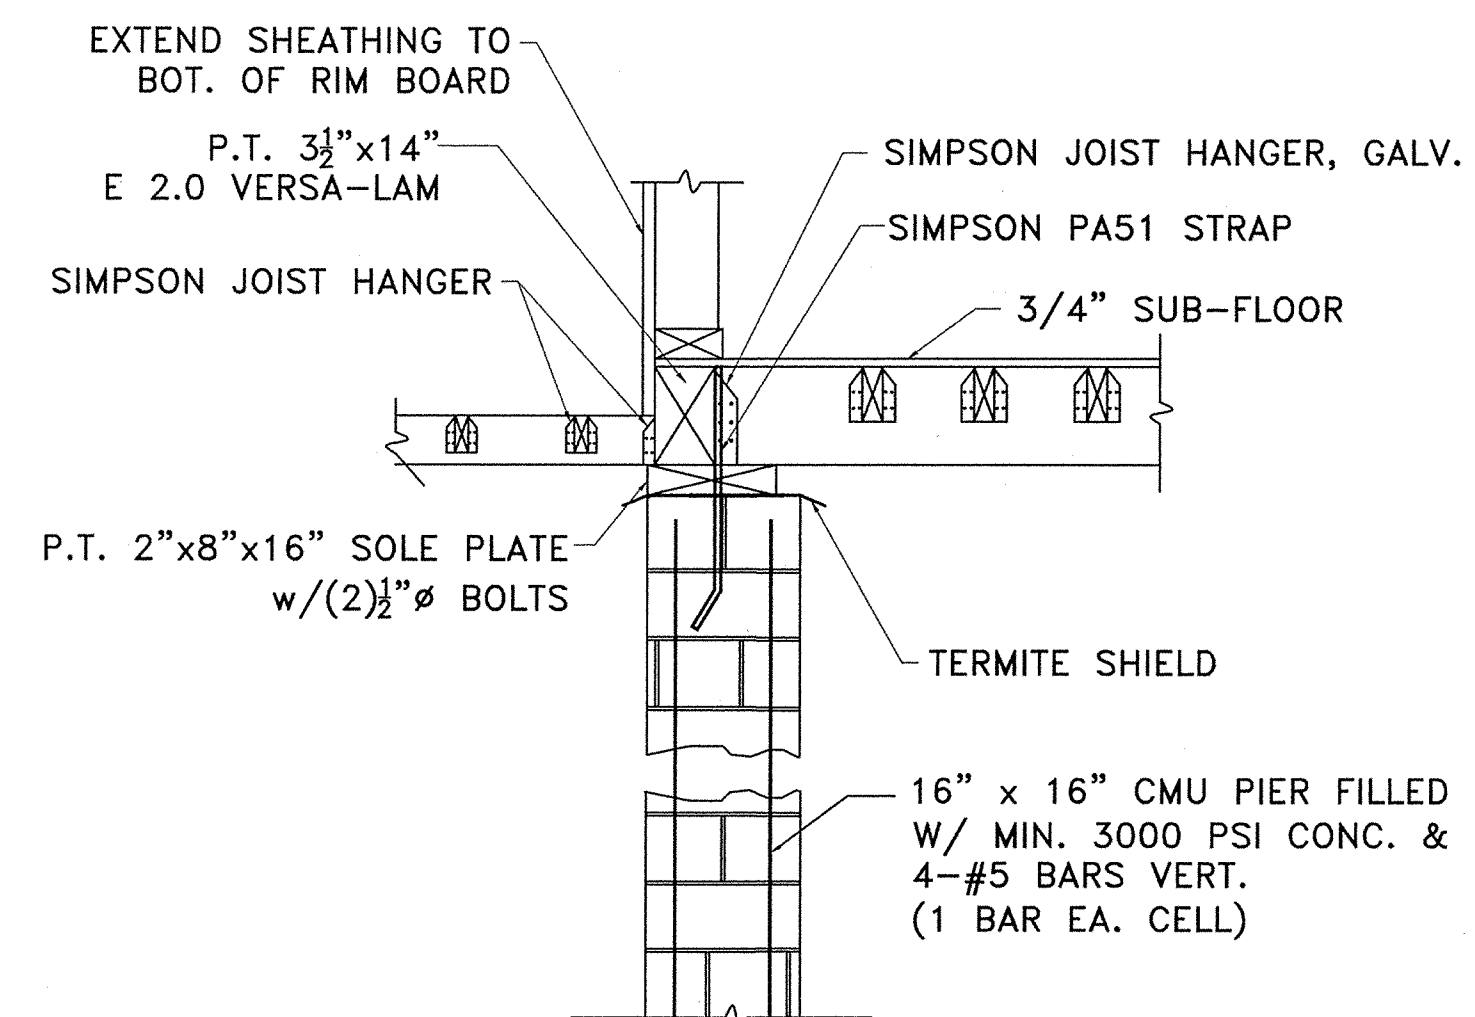

SECTION # 4 EXTERIOR CMU DETAIL @ PORCH
(N.T.S.)

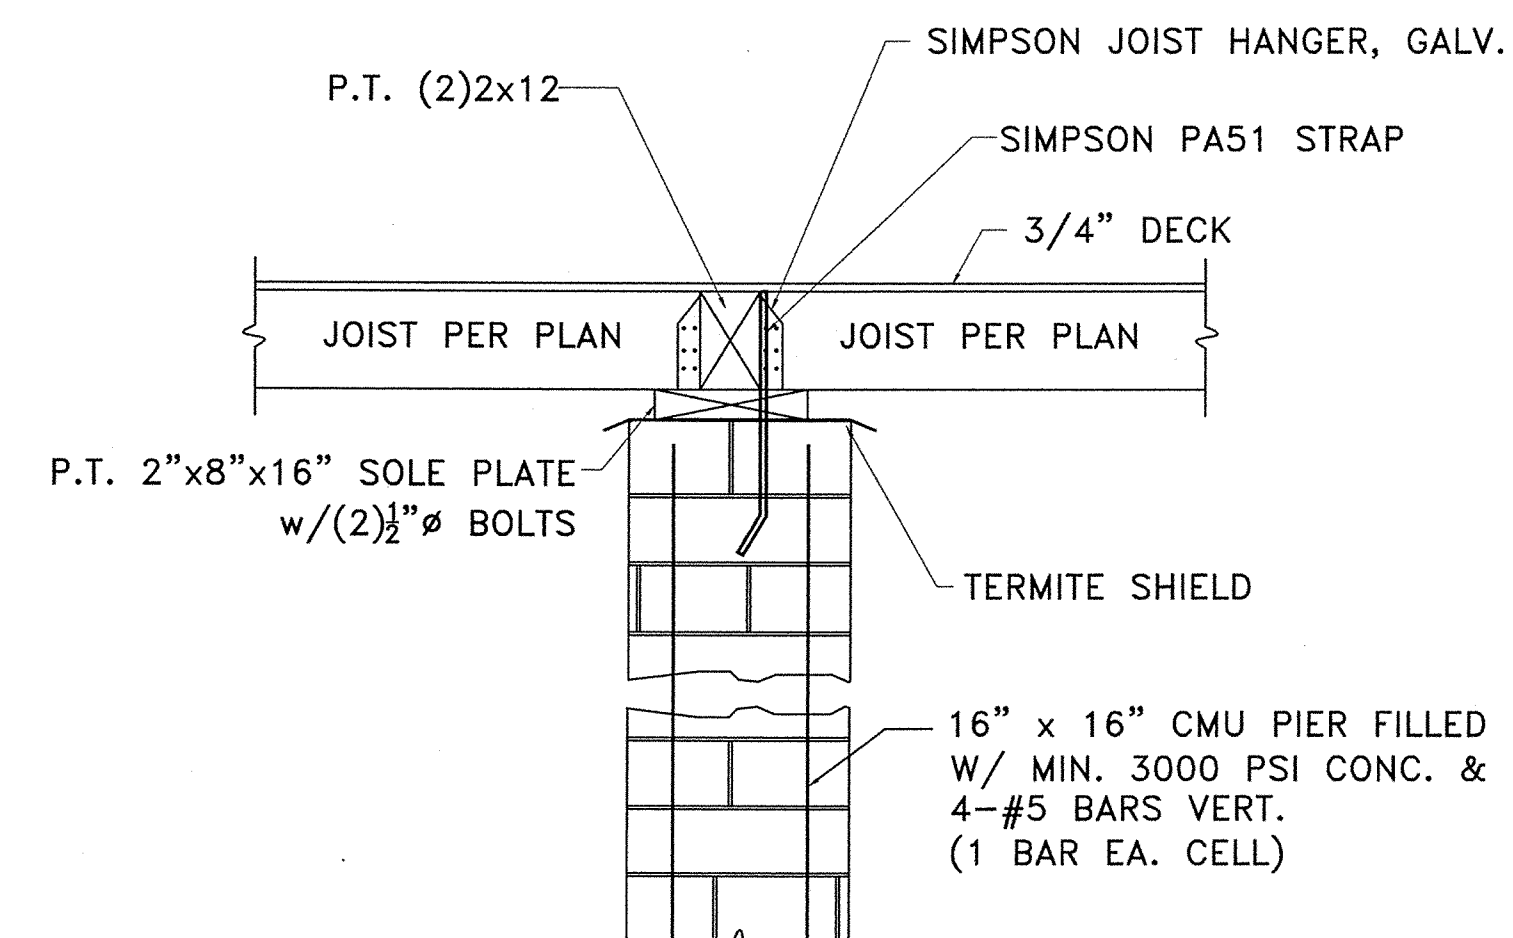

SECTION # 5 INTERIOR CMU DETAIL AT PORCH
(N.T.S.)



REV	DESCRIPTION	DATE	BY

McMath Construction
Caserta Residence
Cleveland St.
St. Tammany Parish
Covington, Louisiana

COAST ENGINEERING SERVICES
29072 Krenfel Road, Lacombe, LA 70445
800-641-3690, 985-882-8001, Fax 985-882-1534

Date:	Sq. Ft.:	Ckd. By:	Drawn By:	Project Number:
07/16/13	N/A	JD	MD	13-ES-0084

Sheet Description:	Sheet Number:
Details	S-7 of 7