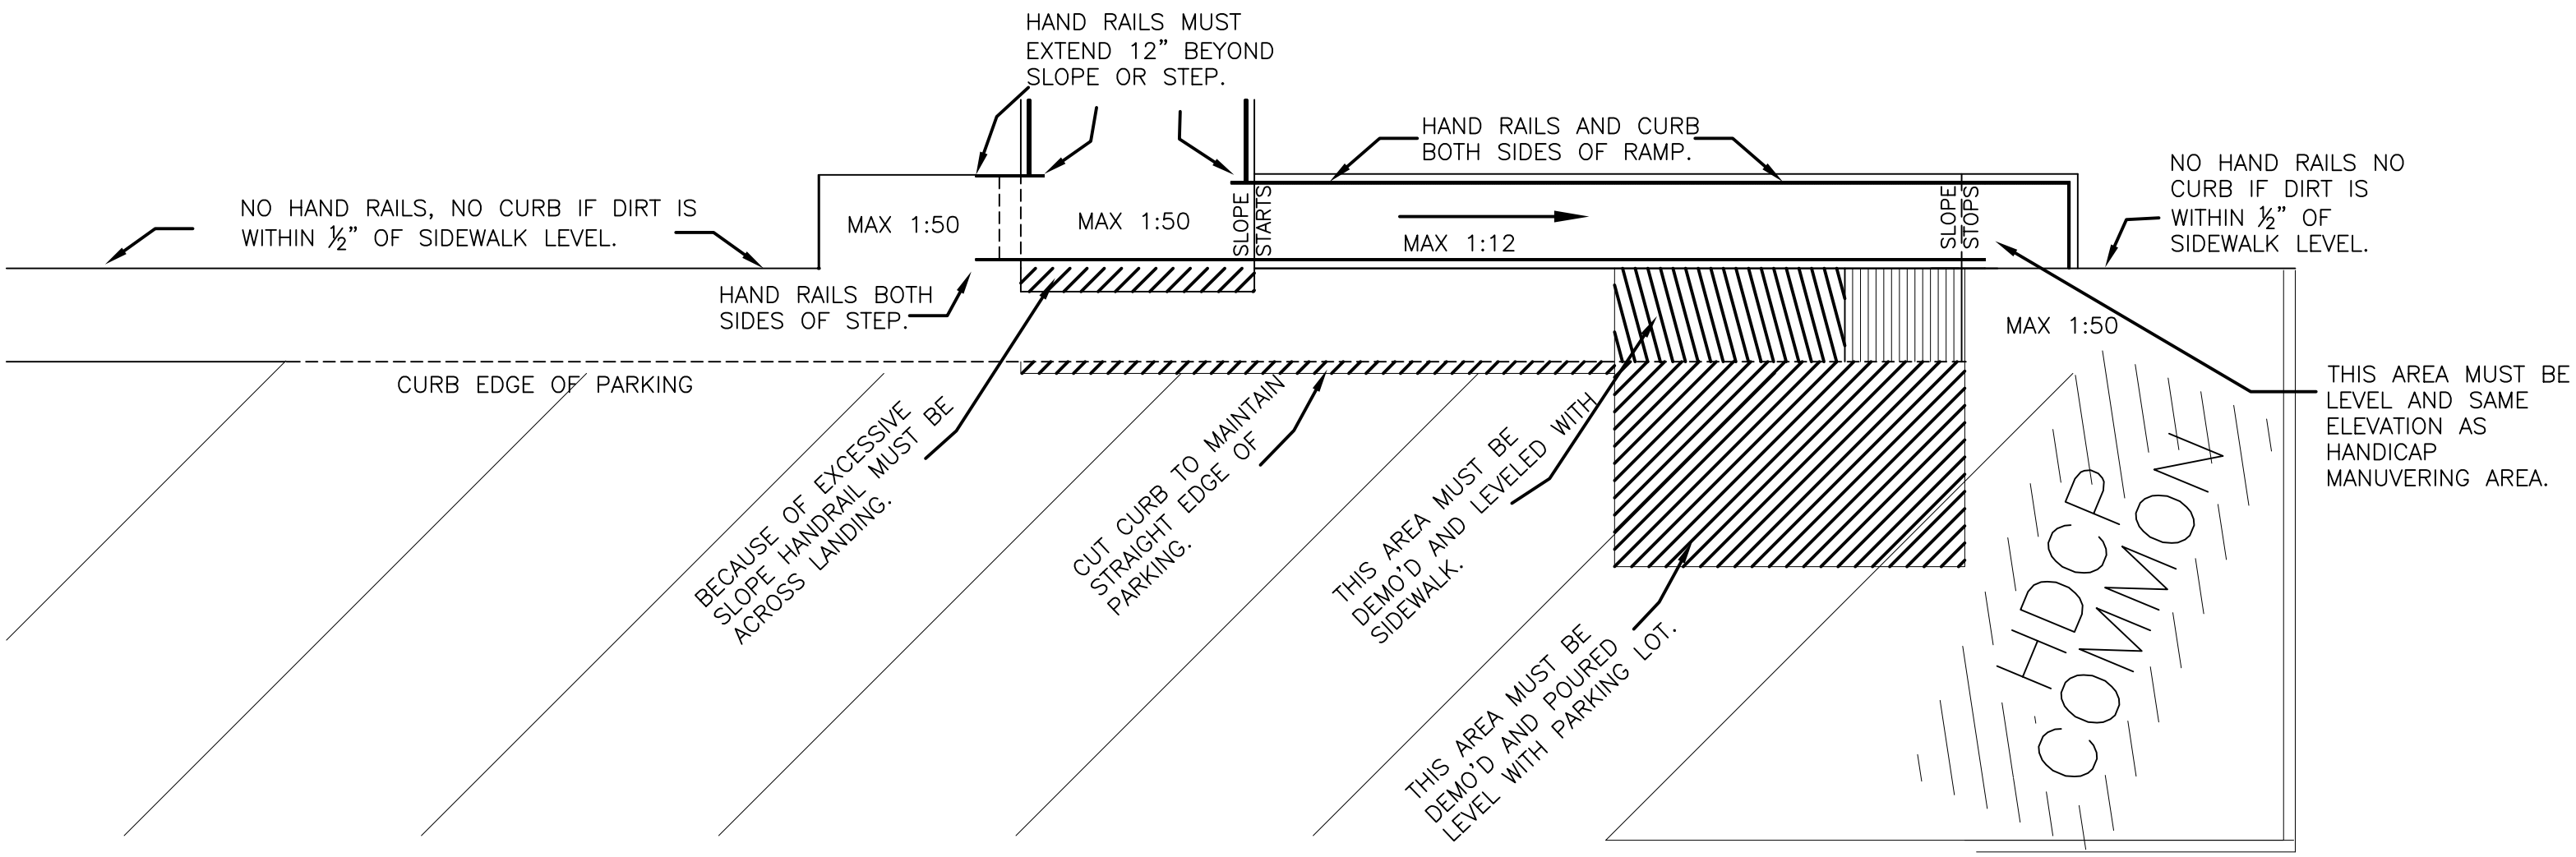
HAND RAILS MUST EXTEND 12" BEYOND SLOPE OR STEP.
HAND RAILS AND CURB BOTH SIDES OF RAMP.
NO HAND RAILS, NO CURB IF DIRT IS WITHIN ½" OF SIDEWALK LEVEL.
MAX 1:50
MAX 1:50
SLOPE STARTS
MAX 1:12
SLOPE STOPS
NO HAND RAILS NO CURB IF DIRT IS WITHIN ½" OF SIDEWALK LEVEL.
HAND RAILS BOTH SIDES OF STEP.
MAX 1:50
CURB EDGE OF PARKING
THIS AREA MUST BE LEVEL AND SAME ELEVATION AS HANDICAP MANUVERING AREA.
BECAUSE OF EXCESSIVE SLOPE HANDRAIL MUST BE ACROSS LANDING.
CUT CURB TO MAINTAIN STRAIGHT EDGE OF PARKING.
THIS AREA MUST BE DEMO'D AND LEVELED WITH SIDEWALK.
THIS AREA MUST BE DEMO'D AND POURED LEVEL WITH PARKING LOT.
HDCP COMMON