GA FILE NO. WP 1072 GENERIC

ONE LAYER 5/8" TYPE X GYPSUM WALLBOARD OR GYPSUM VENEER BASE APPLIED PARALLEL OR AT RIGHT ANGLES TO EACH SIDE OF 3-5/8" STEEL STUDS 24" O.C. WITH 1" TYPE S DRYWALL SCREWS 8" O.C. AT VERTICAL JOINTS AND 12" O.C. AT FLOOR AND CEILING RUNNERS AND INTERMEDIATE STUDS.

JOINTS STAGGERED 24" ON EACH SIDE AND ON OPPOSITE SIDES. SOUND TEERED WITH 3-1/2" GLASS FIBER FRICTION FIT IN STUD SPACE. (NON-LOAD BEARING)

1 HOUR FIRE 46 TO 49 STC SOUND

THICKNESS: 4-7/8"
APPROX. WEIGHT: 6 PSF
FIRE TEST:
SEE WP 1200
(TW WP-45, 6-19-80);
OSU T-1770, 2-81;
ULC 79T494, 79T500, 79T497,
5-12-81, ULC DESIGN W415)
SOUND TEST:
NRCC 810-NW, 2-3-81

GENERAL NOTES

1. INSULATION AND INSULATION ASSEMBLIES SHALL MEET THE REQUIREMENTS OF SECTION 719.
   A. CONCEALED INSULATION SHALL HAVE A FLAME SPREAD OF 0-25 AND SMOKE DEVELOPED INDEX OF 0-450. EXCEPT THAT IN COMBUSTIBLE (WOOD FRAME) CONSTRUCTION.
   B. FACING SHALL COMPLY WITH IBC 2006.
2. PROVIDE 5'x5' LANDINGS, LEVEL WITH FINISHED FLOOR, OUTSIDE EXTERIOR DOORS. THRESHOLDS SHALL BE NOT MORE THAN 1/2" IN HEIGHT AND SHALL BE BEVELED IF MORE THAT 1/4".
3. DIMENSIONS ARE TO CENTERLINE, FACE OF STUDS, CENTER OF COLUMNS, OR FACE OF VENEER.
4. CONTRACTOR TO VERIFY ALL SITE CONDITIONS, BUILDING LOCATIONS, AND DIMENSIONS PRIOR TO CONSTRUCTION.
5. MATERIALS SHALL BE NEW AND U.L. LISTED.
6. NO WORK SHALL BE CONCEALED UNTIL APPROVED BY LOCAL INSPECTORS.
7. CONSTRUCTION SHALL COMPLY WITH ALL PARISH, STATE, AND LOCAL CODES.
8. CONTRACTOR TO GUARANTEE WORK FOR ONE YEAR.
9. CONTRACTOR SHALL FURNISH WATER AND POWER FROM EXISTING SOURCES.
10. EXTERIOR CAULKING SHALL BE THIOKAL CAULK.
11. PAINT GRADE TO SHALL BE SHERWIN WILLIAMS OR EQUIVALENT. ALL WORK TO RECEIVE 3 COATS. COLOR SELECTION BY OWNER.
12. PROVIDE CLEANUP ON A REGULAR BASIS. NO TRASH STORED IN BUILDING.
13. ALL BATT INSULATION SHALL HAVE A CLASS "A" (0-25) FLAME SPREAD IN COMPLIANCE WITH APPLICABLE CODE.
14. USE 6" STUDS, OR 4" STAGGERED STUDS AT ALL PLUMBING WALLS.
15. PROVIDE GALVANIZED METAL PAN WITH DRAIN AT WATER HEATER LOCATION.
16. ALL CORNERS SHALL BE PROPERLY BRACED FOR WIND LOADS. A 48" SHEATHING SHALL BE PROVIDED EVERY 20 FEET OF WALL LENGTH.
17. FLOORING SHALL BE NON-SLIP.
18. INTERIOR LOCKS ON DOORS IN MEANS OF EGRESS SHALL NOT REQUIRE THE USE OF A KEY, SPECIAL KNOWLEDGE, OR SPECIAL DEVICE TO OPEN IN THE DIRECTION OF EGRESS. ALL DOORS SHALL HAVE LEVER TYPE HANDLES.
19. INTERIOR WALLS AND CEILINGS SHALL HAVE A FLAME SPREAD OF 0-200 AND A SMOKE DEVELOPMENT RATING OF 0-450.
20. ALL WORK SHALL COMPLY WITH THE LATEST EDITION OF ALL LOCAL, STATE, AND NATIONAL CODES COVERING THE TYPE OF WORK BEING PERFORMED.
21. PROVIDE PORTABLE FIRE EXTINGUISHERS IN ACCORDANCE WITH NFPA 101. SEE APPENDIX "E" OF NFPA 101 FOR DISTRIBUTION OF EXTINGUISHERS.
22. ALL FIRE WALLS SHALL EXTEND TIGHT TO ROOF SHEATHING, AND BE SEALED WITH AN APPROVED FIRE CAULK.
23. ALL ELECTRICAL, MECHANICAL, AND PLUMBING MATERIALS PENETRATING FIRE WALLS SHALL BE FIRE CAULKED. (PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM-E814.)
24. SERVICE COUNTER SHALL HAVE A HCP ACCESSIBLE WRITING SURFACE, MAX. 36" FROM F.F. (ADAAG MANUAL 1998, PG 135)

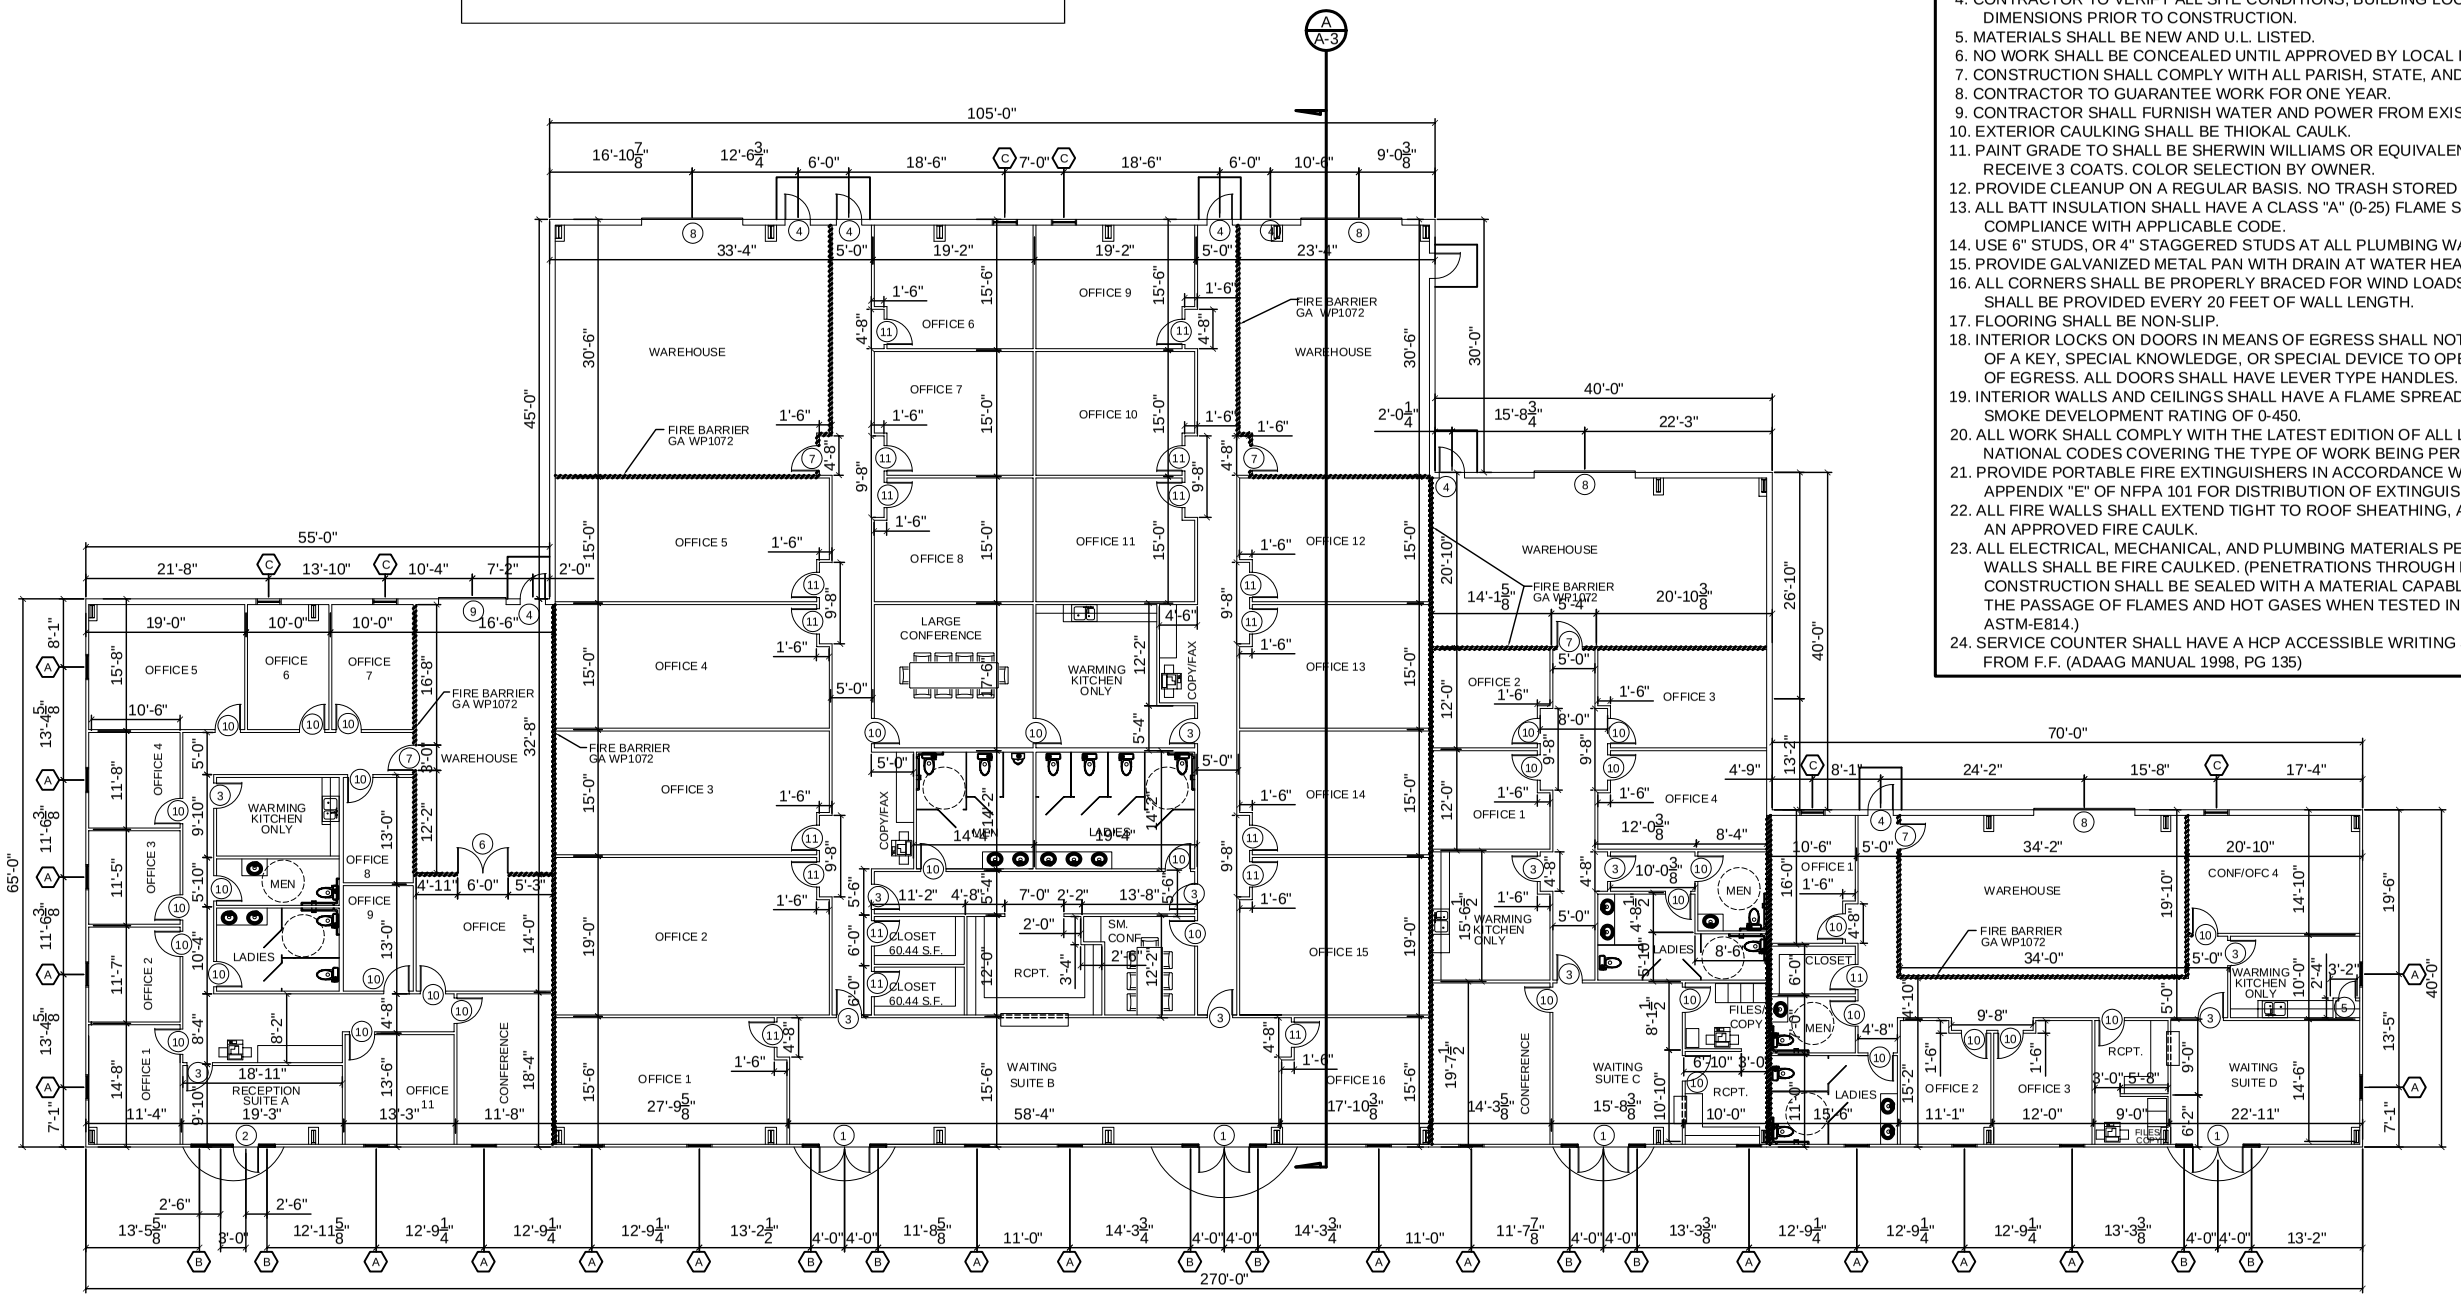

FLOOR PLAN
SCALE: 3/32"=1'-0"

FINISH SCHEDULE

NAME	FLOOR: CARPET	FLOOR: CONCRETE	FLOOR: VCT	FLOOR: NONE	BASE: CERAMIC TILE	BASE: RUBBER WALL BASE	BASE: WOOD BASE	BASE: NONE	WALLS: CERAMIC TILE	WALLS: GYPSUM BOARD	WALLS: NONE	CEILING: 2'x2' LAY IN PANEL S.	CEILING: GYPSUM BOARD	CEILING: NONE	REMARKS
OFFICES			O			O				O			O		CEILING HEIGHT 9'
WAREHOUSES	O					O				O			O		CEILING HEIGHT 9'
OWNER TO SELECT STYLE, COLOR, AND BRAND															

WINDOW SCHEDULE (X)

	WINDOW	TYPE: FIXED	TYPE: S. HUNG	TYPE: D. HUNG	TYPE: HORIZ. SLIDE	FRAME: STEEL	FRAME: ALUMINUM	FRAME: WOOD	GLASS: TINTED	GLASS: PLAIN	GLASS: TEMPERED	GLASS: WIRE GLASS	LITES: NONE	LITES: 2/2	LITES: 4/4	LITES: 6/6	LITES: 8/8	ACCESSORIES: ALARM	ACCESSORIES: SCREEN	ACCESSORIES: SHUTTER	ACCESSORIES: NONE	REMARKS
A	3/0x5/6	O					O			O			O								O	16" TRSM. ABV.
B	2/0x7/0	O					O			O			O								O	
C	3/0x6/6	O					O			O			O								O	

DOOR & HARDWARE SCHEDULE (X)

	DOOR	TYPE: SOLID WOOD	TYPE: HOLLOW METAL	TYPE: ALUM/GLASS	TYPE: STOREFRONT	TYPE: ROLL UP	FRAME: STEEL	FRAME: ALUMINUM	FRAME: WOOD	FRAME: CASED OPENING	HINGE: DBL. SWING	HINGE: BUTT 1-1/2 PR	HINGE: BURGLERPRF	LOCK: SLIDING	LOCK: PASSAGE	LOCK: PRIVACY	LOCK: DEADBOLT	LOCK: KEYED HANDLE	ACCESSORIES: PUSH PULL	ACCESSORIES: PANIC BAR	ACCESSORIES: THRESHOLD	ACCESSORIES: WEATHERSTRIP	ACCESSORIES: DOOR STOP	ACCESSORIES: ALARM	ACCESSORIES: VIEW GLASS	ACCESSORIES: CLOSER	REMARKS
1	PR. 6/0x7/0				O			O				O							O	O	O	O	O			O	W/ 16" TRSM. ABV.
2	3/0x7/0				O			O				O							O	O	O	O	O			O	
3	3/0x7/0	O					O					O			O											O	
4	3/0x7/0		O				O					O					O		O	O	O	O				O	EXTERIOR
5	2/0x7/0	O					O					O															
6	PR. 6/0x7/0		O				O					O			O											O	1 HR RATED
7	3/0x7/0	O					O					O						O								O	1 HR RATED
8	12/0x12/0				O																						ROLL UP DOOR
9	8/0x10/0				O																						ROLL UP DOOR
10	3/0x7/0	O					O					O				O										O	
11	3/0x7/0	O					O					O						O								O	

DAMMON ENGINEERING, INC.
EMMETT DAMMON

ARCHITECT
ROBERT SOLLBERGER

1095 FLORIDA AVENUE
SLIDELL, LA. 70458
985-649-5832

WEBSITE:
WWW.DAMMONENGINEERING.COM

EMAIL:
DAMMONENG@BELLSOUTH.NET

ARCHITECTURE
ENGINEERING
STUDIES
PLANNING
INVESTIGATION
EXPERT WITNESS

NEW OFFICE BUILDING

PLATFORM CRANE
POWELL DRIVE
SLIDELL, LA

FLOOR PLAN

REV:

SCALE: AS NOTED
JOB#: 1898
DATE: 10-8-07
SHEET 9

A-1

OF 25