


**ROOF SHEATHING NAILING ZONES**

1. ROOF SHEATHING SHALL BE A MINIMUM OF 3/16" EXPOSURE 1 WOOD STRUCTURAL PANELS INSTALLED IN ACCORDANCE WITH FIGURE BELOW RIGHT.
2. LONG DIMENSION SHALL BE PERPENDICULAR TO FRAMING AND END JOINTS SHALL BE STAGGERED.
3. ROOF UNDERLAYMENT SHALL BE A MINIMUM 15lb TAR PAPER.
4. ASPHALT SHINGLES SHALL HAVE A MINIMUM OF 6 FASTENERS PER SHINGLE.

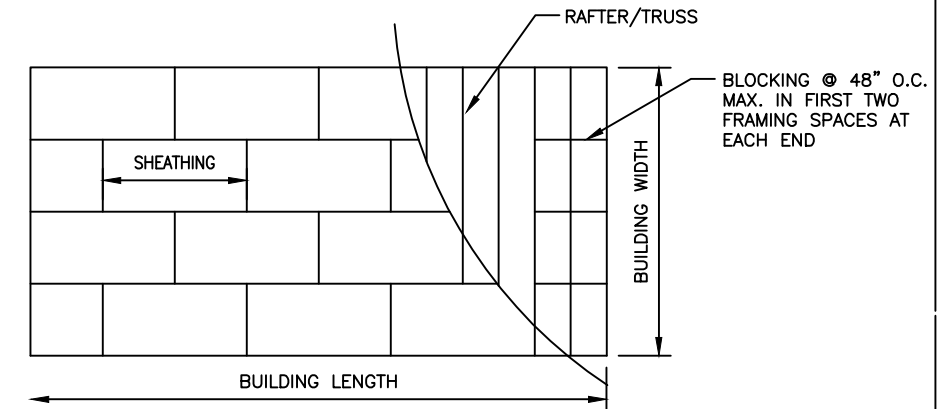

**ROOF SHEATHING LAYOUT & ENDWALL ROOF BRACING**

ROOF SHEATHING NAILING PATTERN		
ZONE	EDGES	INTERIOR
1	6" O.C.	12" O.C.
2	6" O.C.	6" O.C.
3	6" O.C.	6" O.C.