

**DAMMON**  
ENGINEERING, INC.

CHIEF ENGINEER  
EMMETT  
DAMMON, P.E.  
CHIEF ARCHITECT  
ROBERT  
WILTSE

554 OLD SPANISH TRAIL  
SUITE L, LA, 70458  
OFFICE: 985-648-5832  
FAX: 985-641-5950

WEBSITE:  
WWW.DAMMONENGINEERING.COM  
EMAIL:  
DAMMONENG@BELLSOUTH.NET

ARCHITECTURE  
ENGINEERING  
STUDIES  
PLANNING  
INVESTIGATION  
EXPERT WITNESS

CRAZY  
BUFFETT  
1100 ROBERT ROAD  
SUITE L, LA  
70458

NEW EXHAUST  
HOOD,  
GRIDDLE &  
CHAR-BROILER

REV:

SCALE: AS NOTED

JOB#:


DATE: 07-09-12

SHEET

A-1

OF


HOOD INFORMATION TABLE							
MODEL	LGTH	W	H	FILTERS	TOTAL CFM	DUCT OPENING	FAN RECOMMEND
RSH54B-120-24M	10'	48"	120"	24"	5	4000	288 SQ. IN.
							B01-194
							5-15 3/4 HP

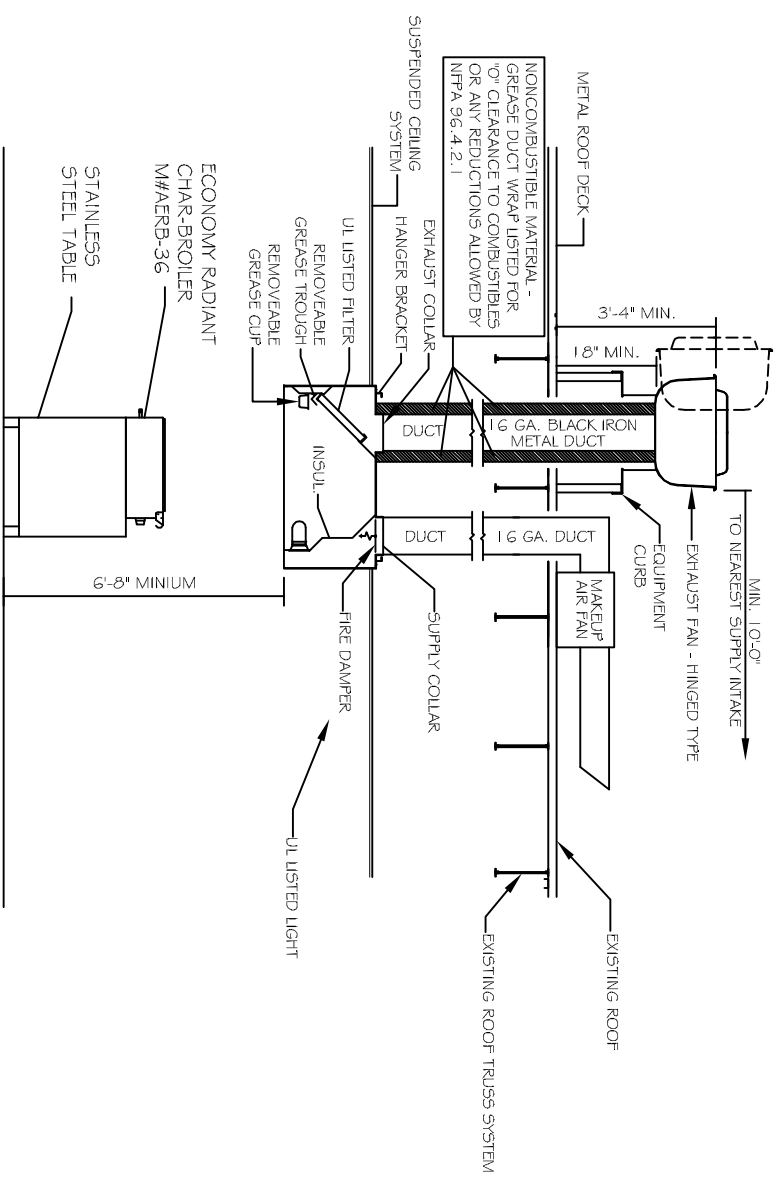

TYPICAL HOOD & DUCT INSTALLATION  
W/CLEARANCE REDUCTION MATERIALS TO PROTECT COMBUSTIBLES  
NOT TO SCALE

**KITCHEN HOOD SYSTEM NOTES**


- DRAWINGS ARE DRAWN DIAGRAMATIC. FIELD VERIFY ALL RELATED EXISTING CONDUITS & WIRING SIZES, LOCATIONS, GAS ROUTES, AND CONDITIONS PRIOR TO INSTALLATION OF HOOD.
- REFERENCE SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.
- SUBCONTRACTOR TO SUBMIT SHOP DRAWINGS AND REVIEW PACKAGE SUITABLE FOR FIRE MARSHAL KITCHEN HOOD CHEMICAL FIRE SUPPRESSION SYSTEM REVIEW.
- PROVIDE GAS SHUTOFF VALVE FOR ALL EQUIPMENT UNDER HOOD CONNECTED TO HOOD EXHAUST SYSTEM.
- PROVIDE SHUNT TRIP BREAKERS FOR ALL EQUIPMENT UNDER HOOD CONNECTED TO HOOD EXHAUST SYSTEM.

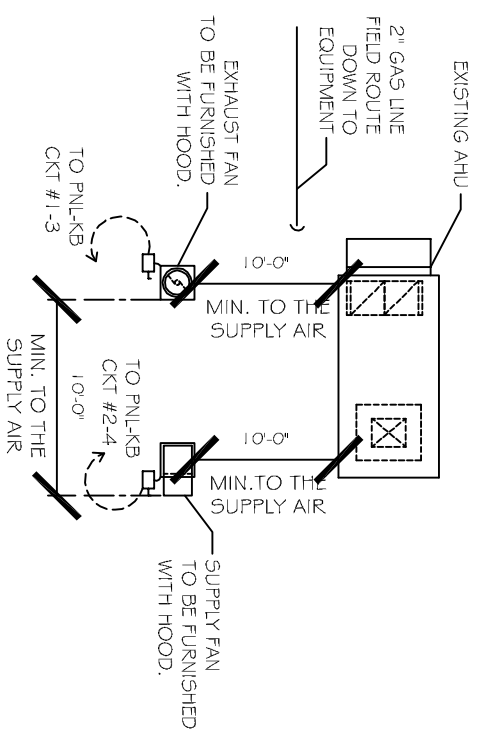

**ELECTRICAL PARTIAL-ROOF PLAN**

N.T.S.

EXISTING CERAMIC TILE ON MTL STUD FRAMED WALL TO REMAIN.

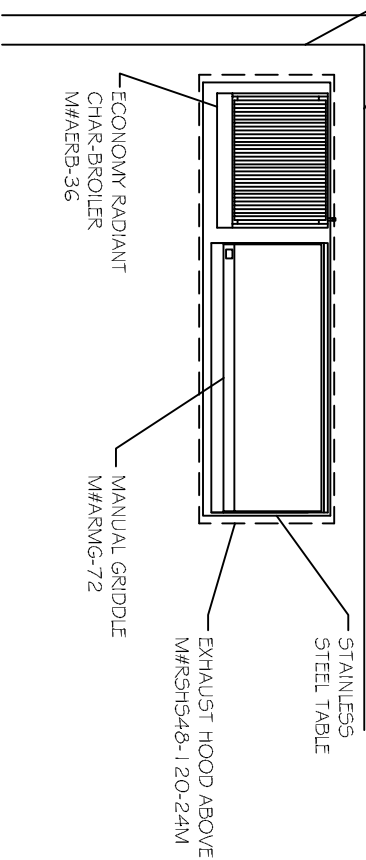

**PARTIAL PLAN VIEW OF COOKING EQUIPMENT**

N.T.S.