


REVISIONS

REV #	DATE	BY:

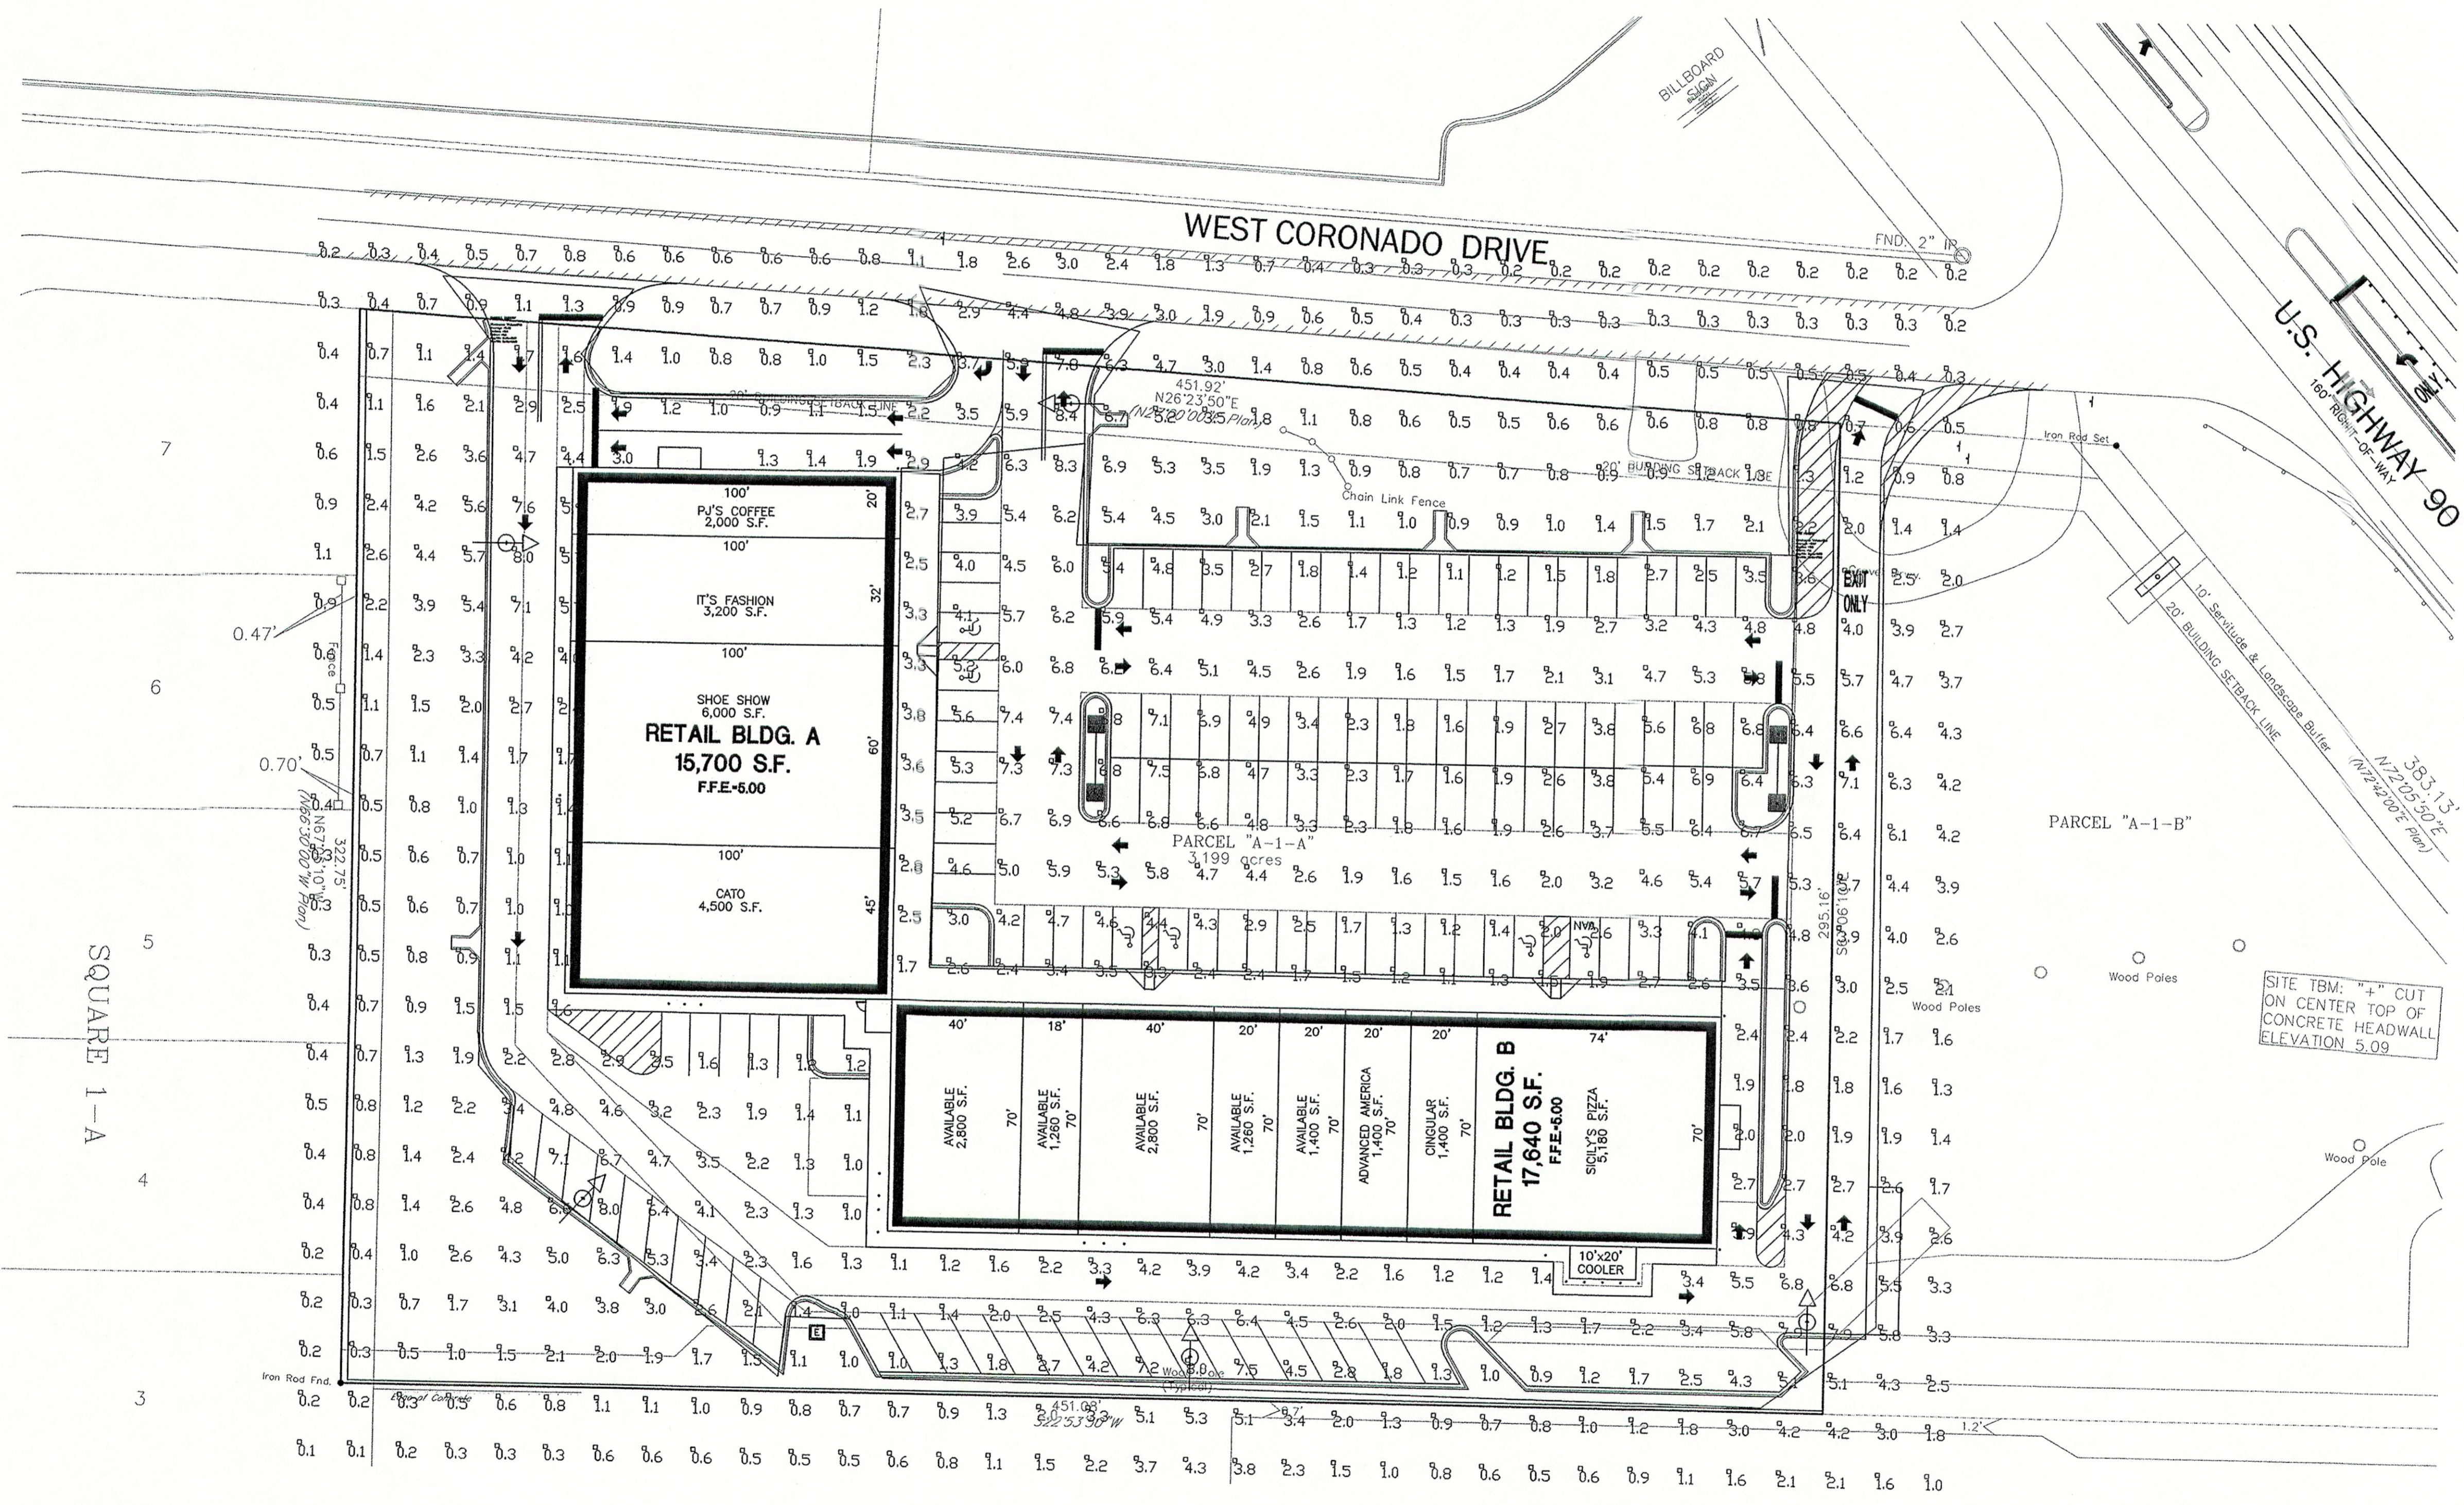

BASED ON THE INFORMATION PROVIDED, ALL DIMENSIONS AND LUMINAIRE LOCATIONS SHOWN REPRESENT RECOMMENDED POSITIONS. THE ENGINEER AND/OR ARCHITECT MUST DETERMINE APPLICABILITY OF THE LAYOUT TO EXISTING OR FUTURE FIELD CONDITIONS.

THIS LIGHTING PATTERN REPRESENTS ILLUMINATION LEVELS CALCULATED FROM LABORATORY DATA TAKEN UNDER CONTROLLED CONDITIONS UTILIZING CURRENT INDUSTRY STANDARD LAMP RATINGS IN ACCORDANCE WITH ILLUMINATING ENGINEERING SOCIETY APPROVED METHODS. ACTUAL PERFORMANCE OF ANY MANUFACTURER'S LUMINAIRE MAY VARY DUE TO VARIATION IN ELECTRICAL VOLTAGE, TOLERANCE IN LAMPS AND OTHER VARIABLE FIELD CONDITIONS.

Statistical Area Summary

Label	Avg	Max	Min	Avg/Min	Max/Min
OVERALL SUMMARY	3.48	8.4	0.6	5.80	14.00
MAIN PARKING	3.87	8.3	1.1	3.52	7.55

Luminaire Schedule

Symbol	Qty	Label	Arrangement	Lumens	LLF	Description
⊕	2	A	D180°	110000	0.750	WLS-VR-L-5-1000-MHR-CT 30' POLE 3' BASE
⊕	5	B	SINGLE	110000	0.750	WLS-VR-L-3-1000-MHR-CT 30' POLE 3' BASE

BOUTTE, LA

WLS LIGHTING SYSTEMS

WLS-5232

DATE - 8/9/07

SCALE 1"=30'

800-633-8711

PM: BRETT

BY: J.P.

SHEET 1 OF 1