


APPROVED

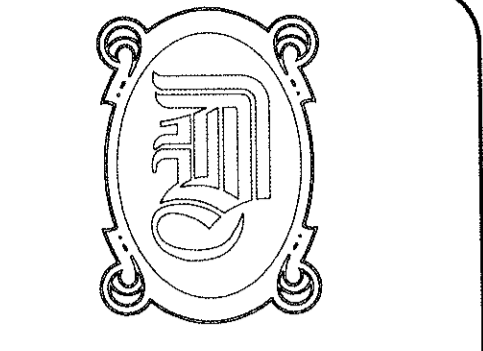

DAMMON ENGINEERING, INC.

EMMETT DAMMON

ARCHITECT ROBERT WILTSE

1095 FLORIDA AVENUE
SLIDELL, LA. 70458
985-649-5832

WEBSITE:
WWW.DAMMONENGINEERING.COM


EMAIL:
DAMMONENG@BELLSOUTH.NET

ARCHITECTURE
ENGINEERING
STUDIES
PLANNING
INVESTIGATION
EXPERT WITNESS

**MARCO'S PIZZA
TENANT BUILDOUT**

532 GAUSE BLVD
SLIDELL, LA
70458

MECHANICAL DETAILS

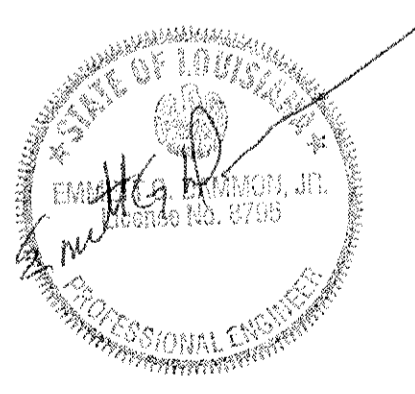

SCALE: AS NOTED


JOB#: 2083

DATE: 11-10-10


SHEET 6

M-2

OF 11

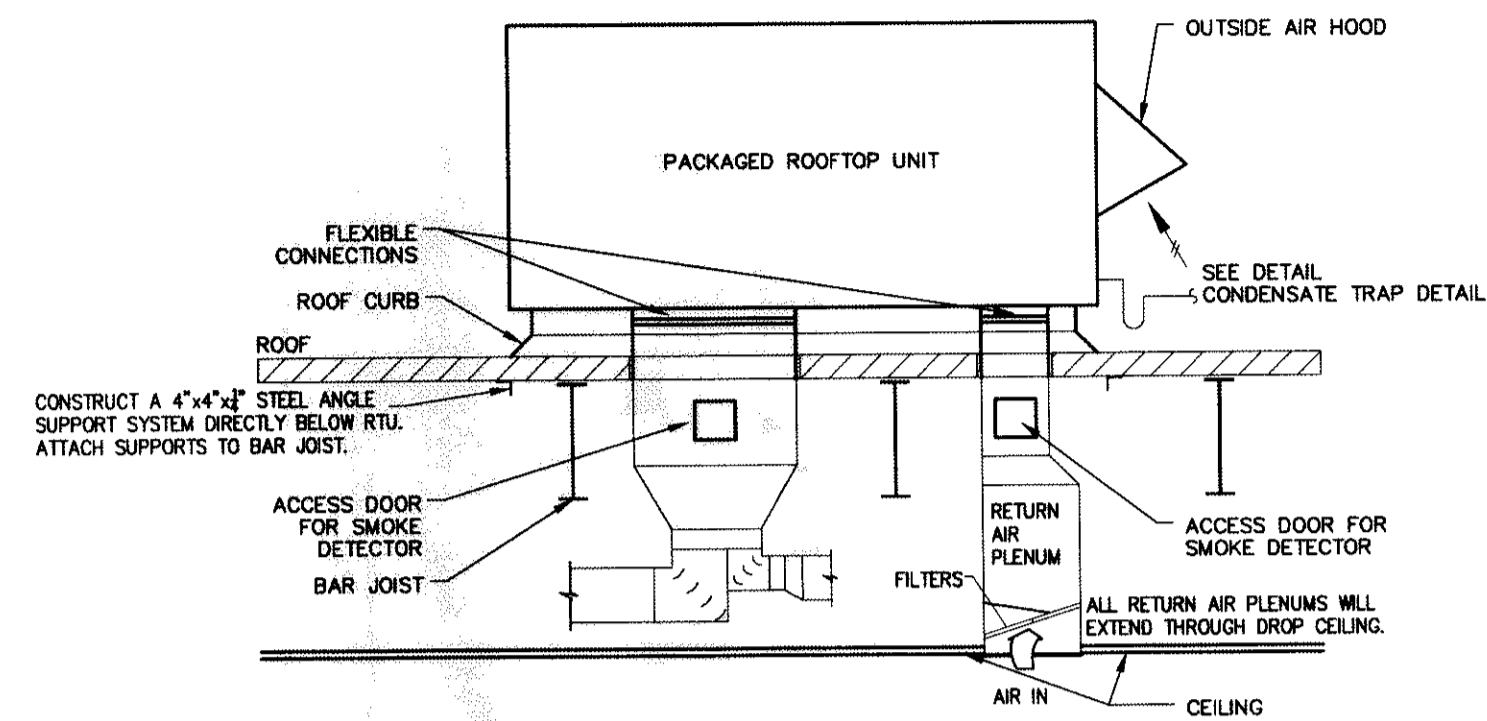


TYPICAL ROOFTOP UNIT DETAIL
NOT TO SCALE

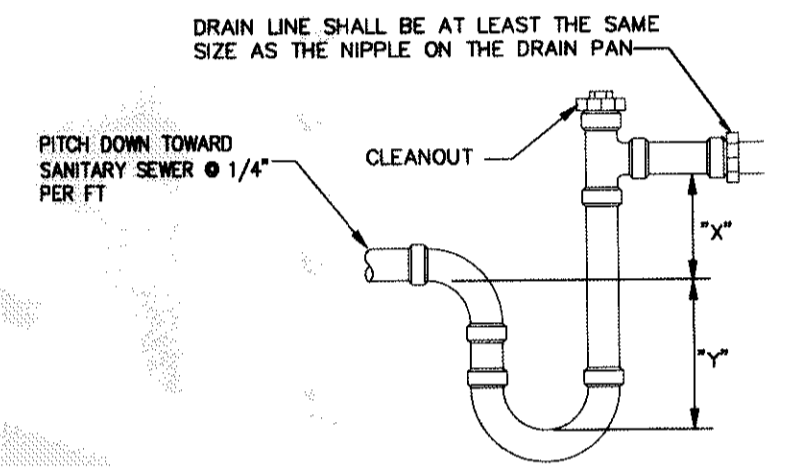


NOTES:
LENGTHS "X" AND "Y" SHALL BE DETERMINED BY ROOFTOP UNIT EQUIPMENT BASED ON TOTAL STATIC PRESSURE.
"X" AND "Y" SHALL BE EQUAL TO MINIMUM 1/2 TOTAL UNIT STATIC PRESSURE.
ALL CONDENSATE PIPING SHALL BE SLOPED AT 1/4" PER FOOT

CONDENSATE TRAP DETAIL
NOT TO SCALE

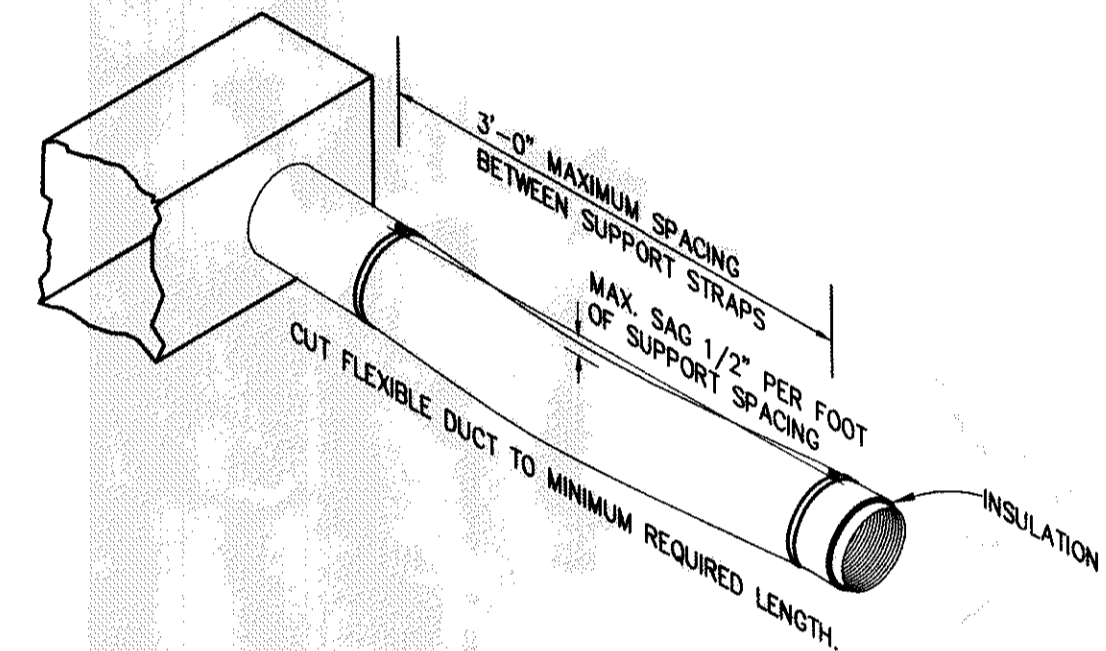


FLEX DUCT SUPPORT DETAIL
NOT TO SCALE

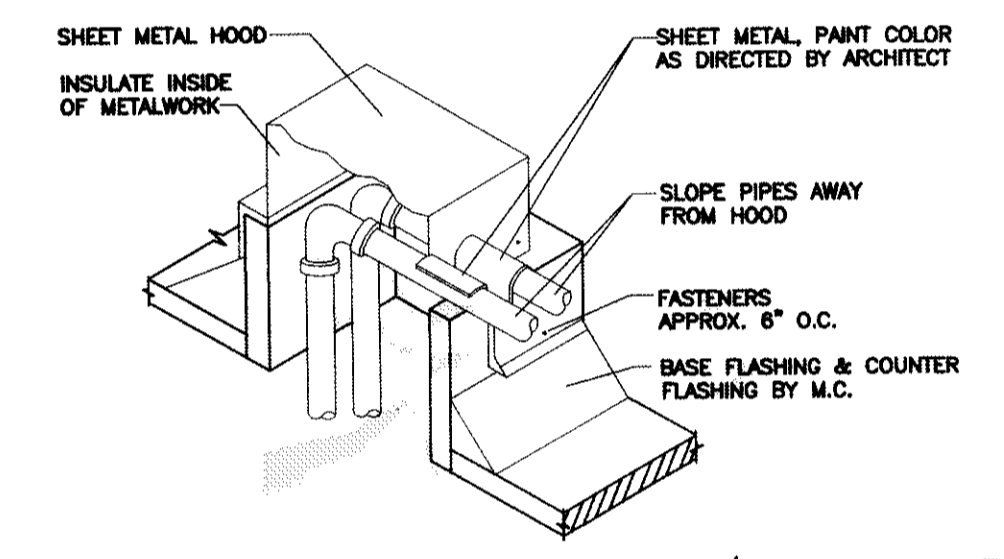


REFRIGERANT LINE/CONDUIT PIPE CURB DETAIL
NOT TO SCALE


NOTE: MECHANICAL CONTRACTOR SHALL FURNISH AND INSTALL PIPE CURB. COORDINATE SIZE OF CURB WITH ELECTRICAL CONTRACTOR SO AS TO PROVIDE ADEQUATE CLEARANCE FOR NEW AND FUTURE REFRIGERANT LINES AND CONDUIT.

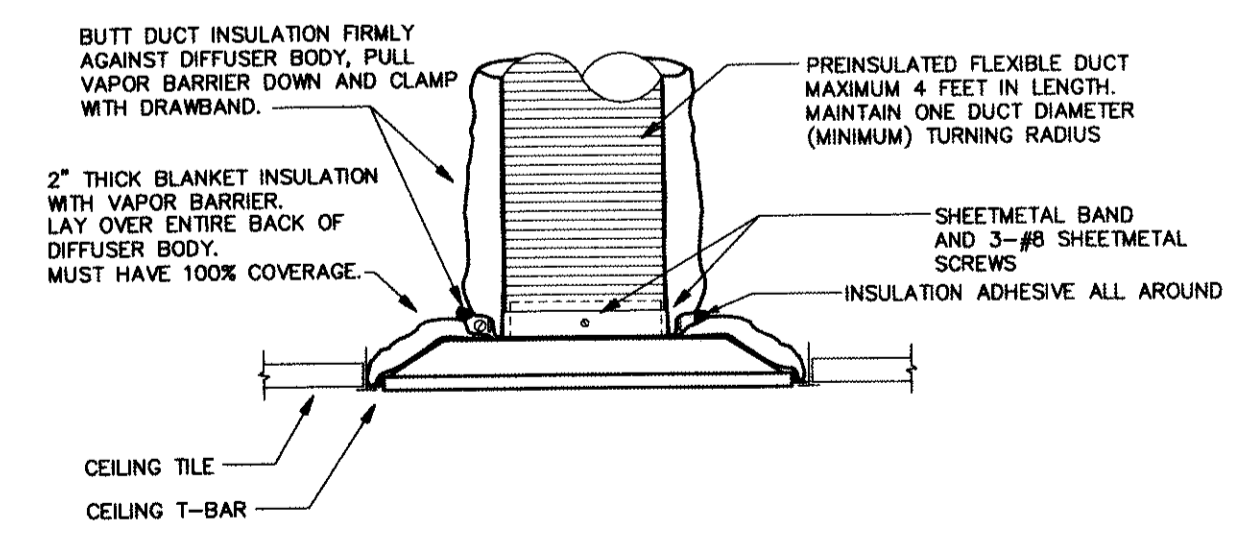

LAY IN DIFFUSER DETAIL
NOT TO SCALE

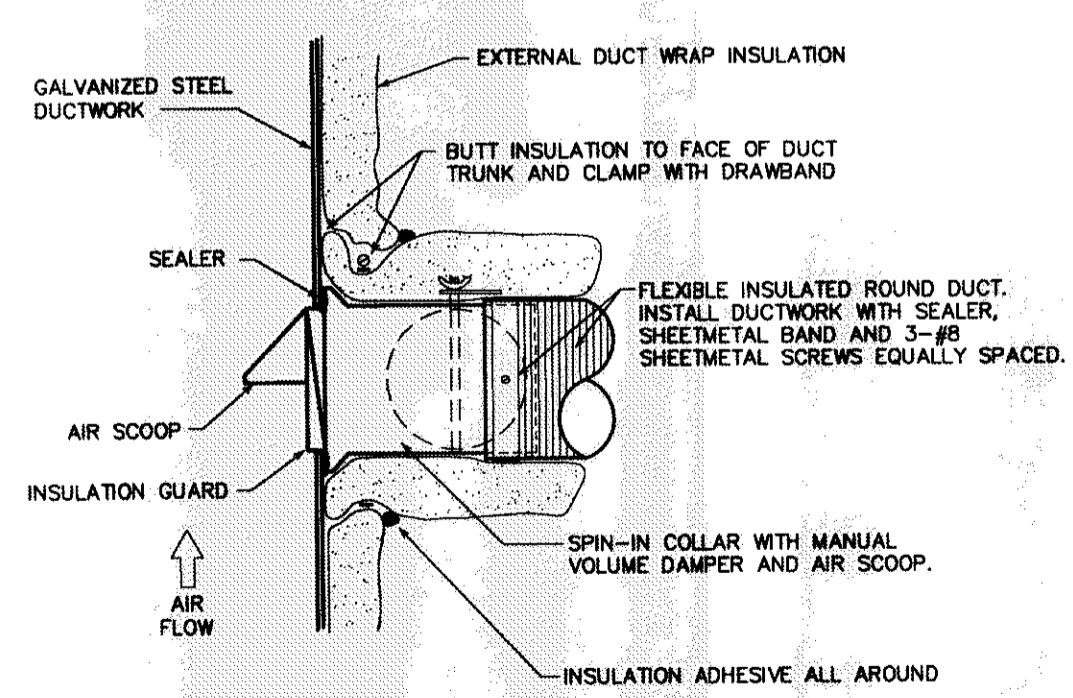

ROUND DUCT SPIN-IN DETAIL
NOT TO SCALE

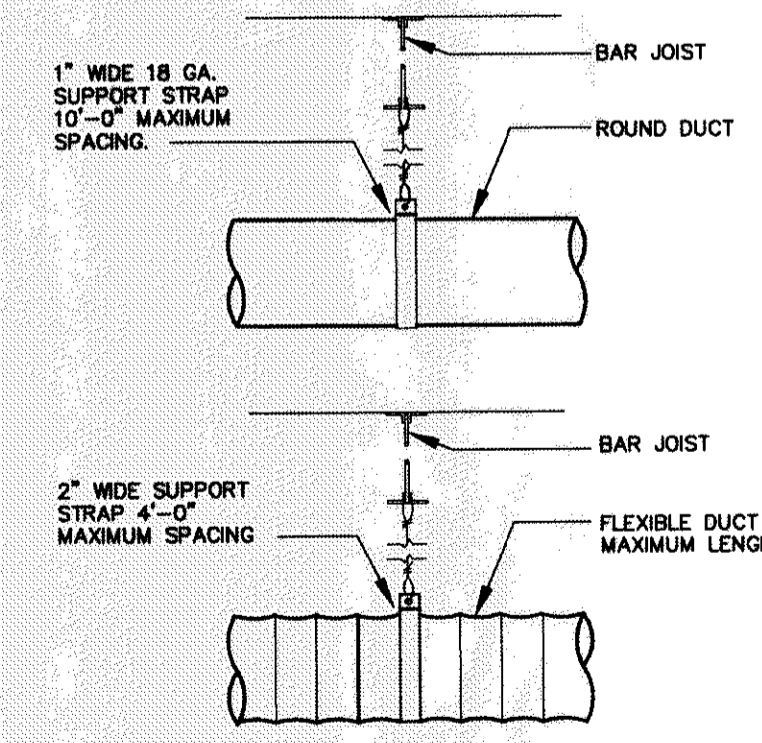

DUCT SUPPORT DETAIL
NOT TO SCALE