

DAMMON ENGINEERING, INC.
EMMETT DAMMON

ARCHITECT
ROBERT WILTSE

1095 FLORIDA AVENUE
SLIDELL, LA. 70456
985-649-5832

WEBSITE: WWW.DAMMONENGINEERING.COM

EMAIL: DAMMONENG@BELL.SOUTH.NET

ARCHITECTURE
ENGINEERING
STUDIES
PLANNING
INVESTIGATION
EXPERT WITNESS

MARCO'S PIZZA TENANT BUILDOUT

4638 Hwy. 22
Mandeville
Louisiana
70471-2820

MECHANICAL PLAN

SCALE: AS NOTED

JOB#: 2107


DATE: 5-25-11

SHEET 5

M-1

OF 11

H.V.A.C. SYMBOLS LEGEND

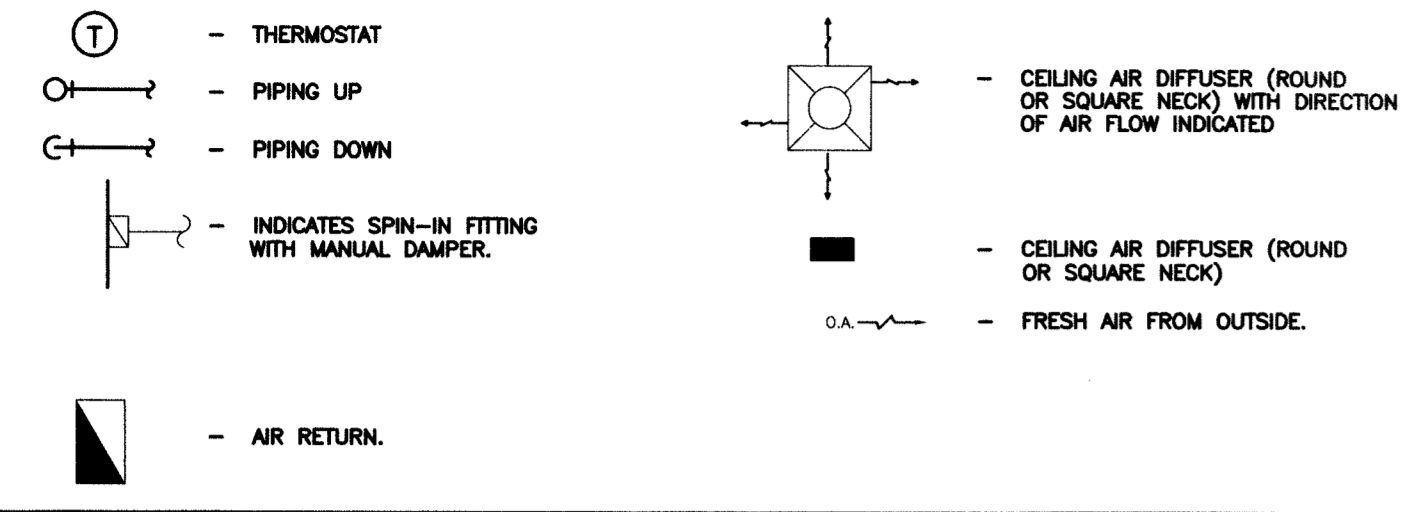

CONDENSING UNIT SCHEDULE

NO.	TOTAL BTU	ELECTRICAL			COMMENTS
		VOLTAGE	MCA	CKT BRKR	
1	72,000 6 TON	208V, 3Ø	25.8	MDP #2,4,6	*
2	120,000 10 TON	208V, 3Ø	58.8	MDP #1,3,5	

* EXISTING UNIT, PROVIDE NORMAL STARTUP SERVICING. UNITS ARE NEW AND UNTESTED.

A.H.U. SCHEDULE

NO.	TOTAL BTU	CFM	O.A.	HEAT	ELECTRICAL			COMMENTS
					VOLTAGE	MCA	CKT BRKR	
1	6 TON	2,400	400	17KW	208V, 3Ø	59.0	PNL P #2,4,6	*
2	10 TON	4,000	600	16KW	208V, 3Ø	51.1	PNL Q #2,4,6	

* EXISTING UNIT, PROVIDE NORMAL STARTUP SERVICING. UNITS ARE NEW AND UNTESTED.

AIR BALANCE SCHEDULE

ITEM	O.A.	R.A.	S.A.	E.A.	PRESSURE
AHU-1	400	2000	2400	----	+400
AHU-2	600	3400	4000	----	+600
SF - 1	2310	----	2310	----	+2310
EF - 1	----	----	----	----	-100
EF - 2	----	----	----	----	-3300
TOTALS	3310	5400	8710	-3400	-90

EXHAUST FAN SCHEDULE

MARK	MFR.	MODEL	SERVICE	CFM	S.P.	HP	VOLTAGE
EF - 1	COOK	GC-140	TOILET EXHAUST	100	0.25"	1/6	120V / 1Ø / 4.4A
EF - 2	LARKIN	XRUB-180	OVEN EXHAUST	3300	0.625"	3/4	230V / 1Ø / 6.9A
SF - 1	LARKIN	ARS-12	OVEN INTAKE	2310	0.50"	1/2	115V / 1Ø / 9.8A

SF - 1 AND EF - 2 TO BE BALANCED TO CFM REQUIRED AND SHALL BE INTERLOCKED TO RUN SIMULTANEOUSLY. PROVIDE START/STOP SWITCH.
NOTE: SUPPLY FAN SF-1 AND EXHAUST FAN EF-2 TO BE PROVIDED BY MIDWEST PIZZA EQUIPMENT.

H.V.A.C. GENERAL NOTES :

- ALL SUPPLY, RETURN DUCTS AND OUTSIDE AIR DUCTS INSIDE BUILDING SHALL BE INSULATED EXTERNALLY WITH 1 1/2" THICK FIBERGLASS WITH A DENSITY OF 1.5 POUNDS PER CUBIC FOOT AND BE COMPLETE WITH VAPOR BARRIER JACKET. ALL DUCT INSULATION, TAPE COVERINGS, AND FLEXIBLE CONNECTORS SHALL HAVE A FLAME SPREAD RATING OF 25 OR LESS AND A SMOKE DEVELOPED RATING OF 50 OR LESS IN ACCORDANCE WITH ASTM E84. ALL SA,RA,OA, DUCT INSULATION SHALL HAVE A MINIMUM "R" VALUE EQUAL OR GREATER THAN "R-5". ALL INSULATION SHALL MEET REQUIREMENTS OF STATE AND LOCAL CODES AND MECHANICAL CODES.
- ALL FLEXIBLE DUCTS SHALL BE METAL FLEX CLASS 1 TYPE 500 AIR DUCT AND SHALL BE U.L. LISTED AND HAVE 1" THICK FIBERGLASS INSULATION ENCASED IN A VAPOR BARRIER OF SEAMLESS, NON-COMBUSTIBLE, CO-POLYMER PLASTIC.
- ALL FLEXIBLE DUCTS SHALL BE CONNECTED TO TRUNK OR BRANCH DUCTS WITH A MINIMUM OF THREE SHEET METAL SCREWS AT EACH CONNECTION AND BE TAPED TO PROVIDE AN AIR TIGHT SEAL. MAXIMUM LENGTH OF FLEXIBLE DUCT SHALL BE 5'-0". REFER TO DETAIL.
- FLEXIBLE DUCT HANGER STRIPS SHALL BE MINIMUM 2" WIDE BY 22 GAUGE GALVANIZED METAL.
- ALL DUCTWORK SHALL BE INSTALLED IN ACCORDANCE WITH THE MOST RECENT PUBLISHED SMACNA STANDARDS FOR LOW-VELOCITY, LOW-PRESSURE DUCTS.
- ALL CONTROL WIRING SHALL BE FURNISHED AND INSTALLED BY H.V.A.C. CONTRACTOR.
- THERMOSTATS SHALL BE HONEYWELL T-7300Q7300 B1008 OR EQUAL WITH SHIELDED CABLE. ALL THERMOSTATS AND LOW VOLTAGE WIRING SHALL BE FURNISHED AND INSTALLED BY MECHANICAL CONTRACTOR.
- HOOD EXHAUST AND SUPPLY FANS SHALL BE FURNISHED WITH BIRD SCREENS. DISCONNECT SWITCHES AND HINGED BASE ON EXHAUST FAN.
- H.V.A.C. CONTRACTOR SHALL INSTALL EXHAUST FAN AND FURNISH AND INSTALL COMPLETE EXHAUST DUCT SYSTEM. DUCTS SHALL BE INSULATED WITH MINERAL WOOL AND COVERED WITH 20 GA. STAINLESS STEEL COVER WHERE EXPOSED.
- MIDWEST PIZZA EQUIPMENT TO FURNISH SUPPLY FAN AND CURB. MECHANICAL CONTRACTOR TO INSTALL SUPPLY FAN, CURB, AND DUCT SYSTEM COMPLETE.
- PROVIDE NEOPRENE FLEXIBLE CONNECTIONS AT SUPPLY AND RETURN DUCT CONNECTIONS ON H.V.A.C. UNITS.
- H.V.A.C. CONTRACTOR SHALL BALANCE H.V.A.C. SYSTEM TO AIR QUANTITIES INDICATED. PROVIDE TYPED WRITTEN REPORT TO OWNER UPON COMPLETION.
- CONTRACTOR SHALL VISIT SITE PRIOR TO SUBMITTING BID TO VERIFY ALL EXISTING CONDITIONS.
- CONTRACTOR SHALL FIELD VERIFY DUCT CLEARANCE/SPACE FOR ROUTING DUCTS PRIOR TO SUBMITTING BID. CONTRACTOR MAY ALTER DUCT SIZING TO ACCOMMODATE CLEARANCES ABOVE CEILINGS, BUT MUST MAINTAIN SAME EFFECTIVE DUCT AREA.
- ALL WORK SHALL BE FURNISHED AND INSTALLED TO COMPLY WITH ALL STATE AND LOCAL CODES.
- M.C. SHALL PROVIDE ALL REQUIRED DUCT TRANSITIONS FROM PIZZA OVEN HOOD CONNECTIONS TO SUPPLY AIR AND EXHAUST AIR DUCT SIZES INDICATED.
- MECHANICAL CONTRACTOR SHALL PROVIDE A5-BUILT DRAWINGS TO GENERAL CONTRACTOR PRIOR TO FINAL PAYMENT.
- SMOKE DETECTORS FOR FAN SHUT-DOWN WHERE REQUIRED BY MECHANICAL CODE SHALL BE FURNISHED AND INSTALLED BY THE MECHANICAL CONTRACTOR.
- ALL ROOF MOUNTED HVAC EQUIPMENT INCLUDING COOLER CONDENSING UNITS SHALL BE HELD A MINIMUM OF 1'-0" FROM THE EDGE OF ROOF.
- ALL HOOD AND HOOD EXHAUST DUCT SUPPORTS AND HANGERS TO BE SECURED BY NON-COMBUSTIBLE SUPPORTS AND INSTALLED PER SMACNA STANDARDS AND NFPA 96.
- TYPE 1 HOOD EXHAUST DUCT SHALL BE MINIMUM OF 1/6 GAUGE AND TYPE 2 HOOD EXHAUST DUCT SHALL BE MINIMUM OF 24 GAUGE WELDED CARBON STEEL PER SMACNA STANDARDS.
- SHEET METAL SARRAOVEA DUCTWORK SHALL COMPLY WITH THE FOLLOWING GAUGES:

DIMENSION OF LONGEST SIDE	DUCT DIAMETER	SHEET METAL GAUGES
THRU 12"	0"-12"	26
13" TO 30"	13" TO 18"	24
- ALL JOINTS, LONGITUDINAL AND TRANSVERSE SEAMS, AND CONNECTIONS IN DUCTWORK MUST BE SECURELY SEALED USING WELDMENTS; MECHANICAL FASTENERS WITH SEALS, GASKETS, OR MASTICS; MESH AND MASTIC SEALING SYSTEMS; OR TAPES. TAPES AND MASTICS MUST BE LISTED AND LABELED IN ACCORDANCE WITH UL 181A OR UL 181B.
- MECHANICAL FASTENERS AND SEALS, MASTICS, OR GASKETS MUST BE USED WHEN CONNECTING DUCTS TO FANS OR OTHER AIR DISTRIBUTION EQUIPMENT, INCLUDING MULTIPLE-ZONE.
- OPERATION AND MAINTENANCE DOCUMENTATION MUST BE PROVIDED TO THE OWNER THAT INCLUDES AT LEAST THE FOLLOWING INFORMATION: a) EQUIPMENT CAPACITY (INPUT AND OUTPUT) AND REQUIRED MAINTENANCE ACTIONS. b) EQUIPMENT OPERATION AND MAINTENANCE MANUALS. c) HVAC SYSTEM CONTROL MAINTENANCE AND CALIBRATION INFORMATION, INCLUDING WIRING DIAGRAMS, SCHEMATICS, AND CONTROL DRAWINGS, AT CONTROL DEVICES, OR, FOR DIGITAL CONTROL SYSTEMS, IN PROGRAMMING COMMENTS. d) COMPLETE NARRATIVE OF HOW EACH SYSTEM IS INTENDED TO OPERATE.
- EACH SUPPLY AIR OUTLET OR DIFFUSER MUST HAVE ITS OWN BALANCING DEVICE. ACCEPTABLE BALANCING DEVICES INCLUDE ADJUSTABLE DAMPERS LOCATED WITHIN THE DUCTWORK, TERMINAL DEVICES, AND SUPPLY AIR DIFFUSERS.

H.V.A.C. KEY NOTES

- PROVIDE RETURN AIR FILTER GRILLES IN CEILING; PROVIDE DUCT TRANSITION FROM R.A. AT AHU TO SHEET METAL R.A. PLENUM.
- CONDENSING UNIT AT REAR OF BUILDING FOR WALK-IN COOLER. CONTRACTOR TO PROVIDE SLAB FOR MOUNTING UNIT.
- CONDENSATE DRAIN TO SANITARY SEWER P.C. (TYPICAL).
- SUPPORT HOOD SYSTEM WITH 2EA. L4x6x3/8" ANGLES SPANNING A MINIMUM OF 6 Z-CHANNELS.
- 21"X10" E.A. DUCT UP TO EF-2 ON ROOF. HOLD 10'-0" FROM O.A. INTAKES.
- 18"X18" S.A. DUCT UP TO SUPPLY FAN (SF-1) ON ROOF.
- DASHED LINE INDICATES EXHAUST FAN/SUPPLY FAN ON ROOF. REF. DWG M-2 FOR ADDITIONAL INFORMATION.
- INTAKE TO BE A MINIMUM OF 10'-0" FROM EXHAUST.
- THE EXHAUST OUTLET SHALL ALWAYS BE LOCATED AT THE REAR OF THE HOOD AND THE SUPPLY AIR INLET SHALL BE LOCATED AT THE SIDES OF THE HOOD. ACCOMMODATE THIS. CONTRACTOR SHALL PROVIDE OFFSETS IN THE SUPPLY AIR DUCT WHERE REQUIRED.
- MECHANICAL CONTRACTOR SHALL COORDINATE THERMOSTAT MOUNTING LOCATION WITH CONTRACTOR INSTALLING EQUIPMENT IN THIS AREA. THERMOSTAT SHALL NOT BE LOCATED NEAR EQUIPMENT WHICH PRODUCES HEAT OR HUMIDITY. TYPICAL FOR ALL.
- O.A. INTAKE HOOD SHALL BE A MINIMUM OF 10'-0" FROM ANY EXHAUST, GAS OR PLUMBING VENT.
- MECHANICAL CONTRACTOR SHALL INSTALL COMPRESSOR AND EVAPORATOR AND MAKE FINAL CONNECTIONS.
- G.C. TO CONSTRUCT A MAINTENANCE PLATFORM ON TOP OF COOLER FOR THE MAINTENANCE OF EXISTING 6 TON AHU.
- EXISTING EXHAUST FANS IN RESTROOMS.
- STRAP OR ANCHOR UNIT ACCORDING TO THE MANUFACTURE'S RECOMMENDATION FOR 130 MPH WINDS WITH A 30 SECOND GUST.
- SUPPORT HVAC WITH 2EA. L4x6x3/8" ANGLES SPANNING A MINIMUM OF 6 Z-CHANNELS.

RETURN / SUPPLY AIR DIFFUSER SCHEDULE

ITEM	MFR.	TYPE	MODEL	SIZE	NECK SIZE
A	TITUS	SUPPLY	300RL	8" X 8"	6"
B	TITUS	SUPPLY	300RL	8" X 10"	6"
C	TITUS	SUPPLY	TMS	24" X 24"	6"
D	TITUS	SUPPLY	TMS	24" X 24"	8"
E	TITUS	SUPPLY	TMS	24" X 24"	10"
F	TITUS	RETURN	50F-A	24" X 48"	-


- NOTE:
- DIFFUSERS SHALL HAVE OPPOSED BLADE DAMPERS.
 - DIFFUSERS SHALL FIT 24" X 24" LAY - IN CEILING GRID.
 - DIFFUSERS SHALL BE LOUVER FACE TYPE, WITH BAKED ENAMEL FINISH EXCEPT FOR PERFORATED DIFFUSERS IN KITCHEN AREA.
 - DIFFUSERS/ GRILLES SHALL BE EQUAL TO ANEMOSTAT, CARNES, METALARE, TITUS
 - RA GRILLES TO BE ALUMINUM, EGG-CRATE TYPE, 1/2"X1/2" SPACING WITH WHITE FINISH.

RESPONSIBILITY NOTES

- ROOF OPENINGS FOR H.V.A.C. EQUIPMENT AND RELATED WORK SHALL BE THE RESPONSIBILITY OF THE H.V.A.C. SUBCONTRACTOR. HE SHALL NOTIFY THE LANDLORD'S ROOFER FOR THE WORK TO MAINTAIN THE ROOF BOND.
- THE H.V.A.C. SUBCONTRACTOR SHALL IDENTIFY ALL ROOF MOUNTED H.V.A.C. EQUIPMENT AND APPURTENANCES WITH #1 HIGH PAINTED STENCILED STAKE NAME ON ALL SIDES OF THIS EQUIPMENT.
- IF DRAWINGS CALL FOR THE REUSE OF EXISTING EQUIPMENT, THE TENANT'S GENERAL CONTRACTOR SHALL VERIFY THAT ALL SUCH EQUIPMENT IS IN PROPER WORKING ORDER, OR TAKE THE NECESSARY STEPS TO ACCOMPLISH SUCH. IF REPAIRS ARE REQUIRED, USE THE EQUIPMENT AND HARDWARE AS SPECIFIED IN THESE SCHEDULES OR AS CALLED OUT ON THE SPECIFICATIONS ON THIS SHEET. ALL SUCH ITEMS MUST MEET ALL GOVERNING CODES AND STANDARDS OF PRACTICE.

MECHANICAL NOTES:

- CONTRACTORS AND SUB-CONTRACTORS SHALL CAREFULLY REVIEW THE CONSTRUCTION DOCUMENTS. INFORMATION REGARDING THE COMPLETE WORK IS DISPERSED THROUGHOUT THE DOCUMENT SET AND CANNOT BE ACCURATELY DETERMINED WITHOUT REFERENCE TO THE COMPLETE DOCUMENT SET.
- ALL WORK SHALL COMPLY WITH STATE AND LOCAL CODE REQUIREMENTS AS APPROVED AND AMENDED BY THE GOVERNING CITY. PURCHASE ALL PERMITS ASSOCIATED WITH THE WORK. OBTAIN ALL INSPECTIONS REQUIRED BY CODE.
- MECHANICAL CONTRACTOR SHALL USE THE LANDLORD ROOFING CONTRACTOR FOR ALL PENETRATIONS.
- USE OF COMBUSTIBLE MATERIALS IS NOT ALLOWED IN THE RETURN AIR PLENUM. MATERIALS USED IN THE PLENUM SHALL HAVE FLAME SPREAD RATING NOT TO EXCEED 25, AND SMOKE DEVELOPED RATING NOT TO 50 WHEN TESTED IN ACCORDANCE WITH ASTM E 84. ALL EXPOSED WIRING IN THE PLENUM SHALL BE PLENUM RATED.
- CONTRACT LANDLORD APPROVED ROOFING CONTRACTOR TO FLASH AND SEAL ROOF PENETRATIONS TO MAINTAIN ROOFING WARRANTY.
- ALL ROOF PENETRATIONS MUST BE APPROVED BY THE LANDLORD PRIOR TO INSTALLATION.
- EXPOSED DUCTWORK TO BE GALVANIZED SHEET METAL PER SMACNA STANDARDS. LINE WITH NEOPRENE COATED 1.0", 1.5 POUNDS PER CUBIC FOOT DUCT INSULATION.
- ROUND FLEXIBLE DUCT TO BE UL-181, CLASS I, AIR DUCT MATERIALS.
- DUCT SIZES SHOWN ARE CLEAR INSIDE DIMENSIONS.
- IN ALL SYSTEMS OVER 2,000 CFM AND LESS THAN 15,000 CFM, SMOKE DETECTORS SHALL BE INSTALLED IN ACCORDANCE WITH NFPA 72E IN THE RETURN DUCT DOWNSTREAM OF THE AIR HANDLING UNIT AND ALL FILTERS, TO AUTOMATICALLY STOP THE FAN.
- PROVIDE U.L. LISTED 125 F FIRESTAT IN RETURN AIR OF EACH SYSTEM UNDER 2,000 CFM TO SHUT DOWN FAN IN THE EVENT OF FIRE.
- PROVIDE U.L. RATED FIRE DAMPERS WHERE REQUIRED AT ALL DUCT PENETRATIONS OF FIRE-RATED ASSEMBLIES AND WHERE REQUIRED BY CODE, INCLUDING OUTSIDE AIR INTAKES.
- ALL AIR HANDLING SYSTEMS TO BE BALANCED TO ASSURE PROPER AIR FLOWS PER PLANS.
- EXHAUST FAN EQUAL TO BROAN MODEL NO. 100 CF, OR EQUAL. FAN SHALL BE CONTROLLED BY SWITCH ON WALL AT LIGHT SWITCH. PROVIDE BACK DRAFT DAMPER.
- PROVIDE AND INSTALL WATER PROOF GRILLE VENT ON ROOF FOR TOILET EXHAUST.
- ALL ELECTRICAL, MECHANICAL AND PLUMBING PENETRATING FIRE PARTITIONS SHALL BE FIRE CAULKED. (PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM-E814.)

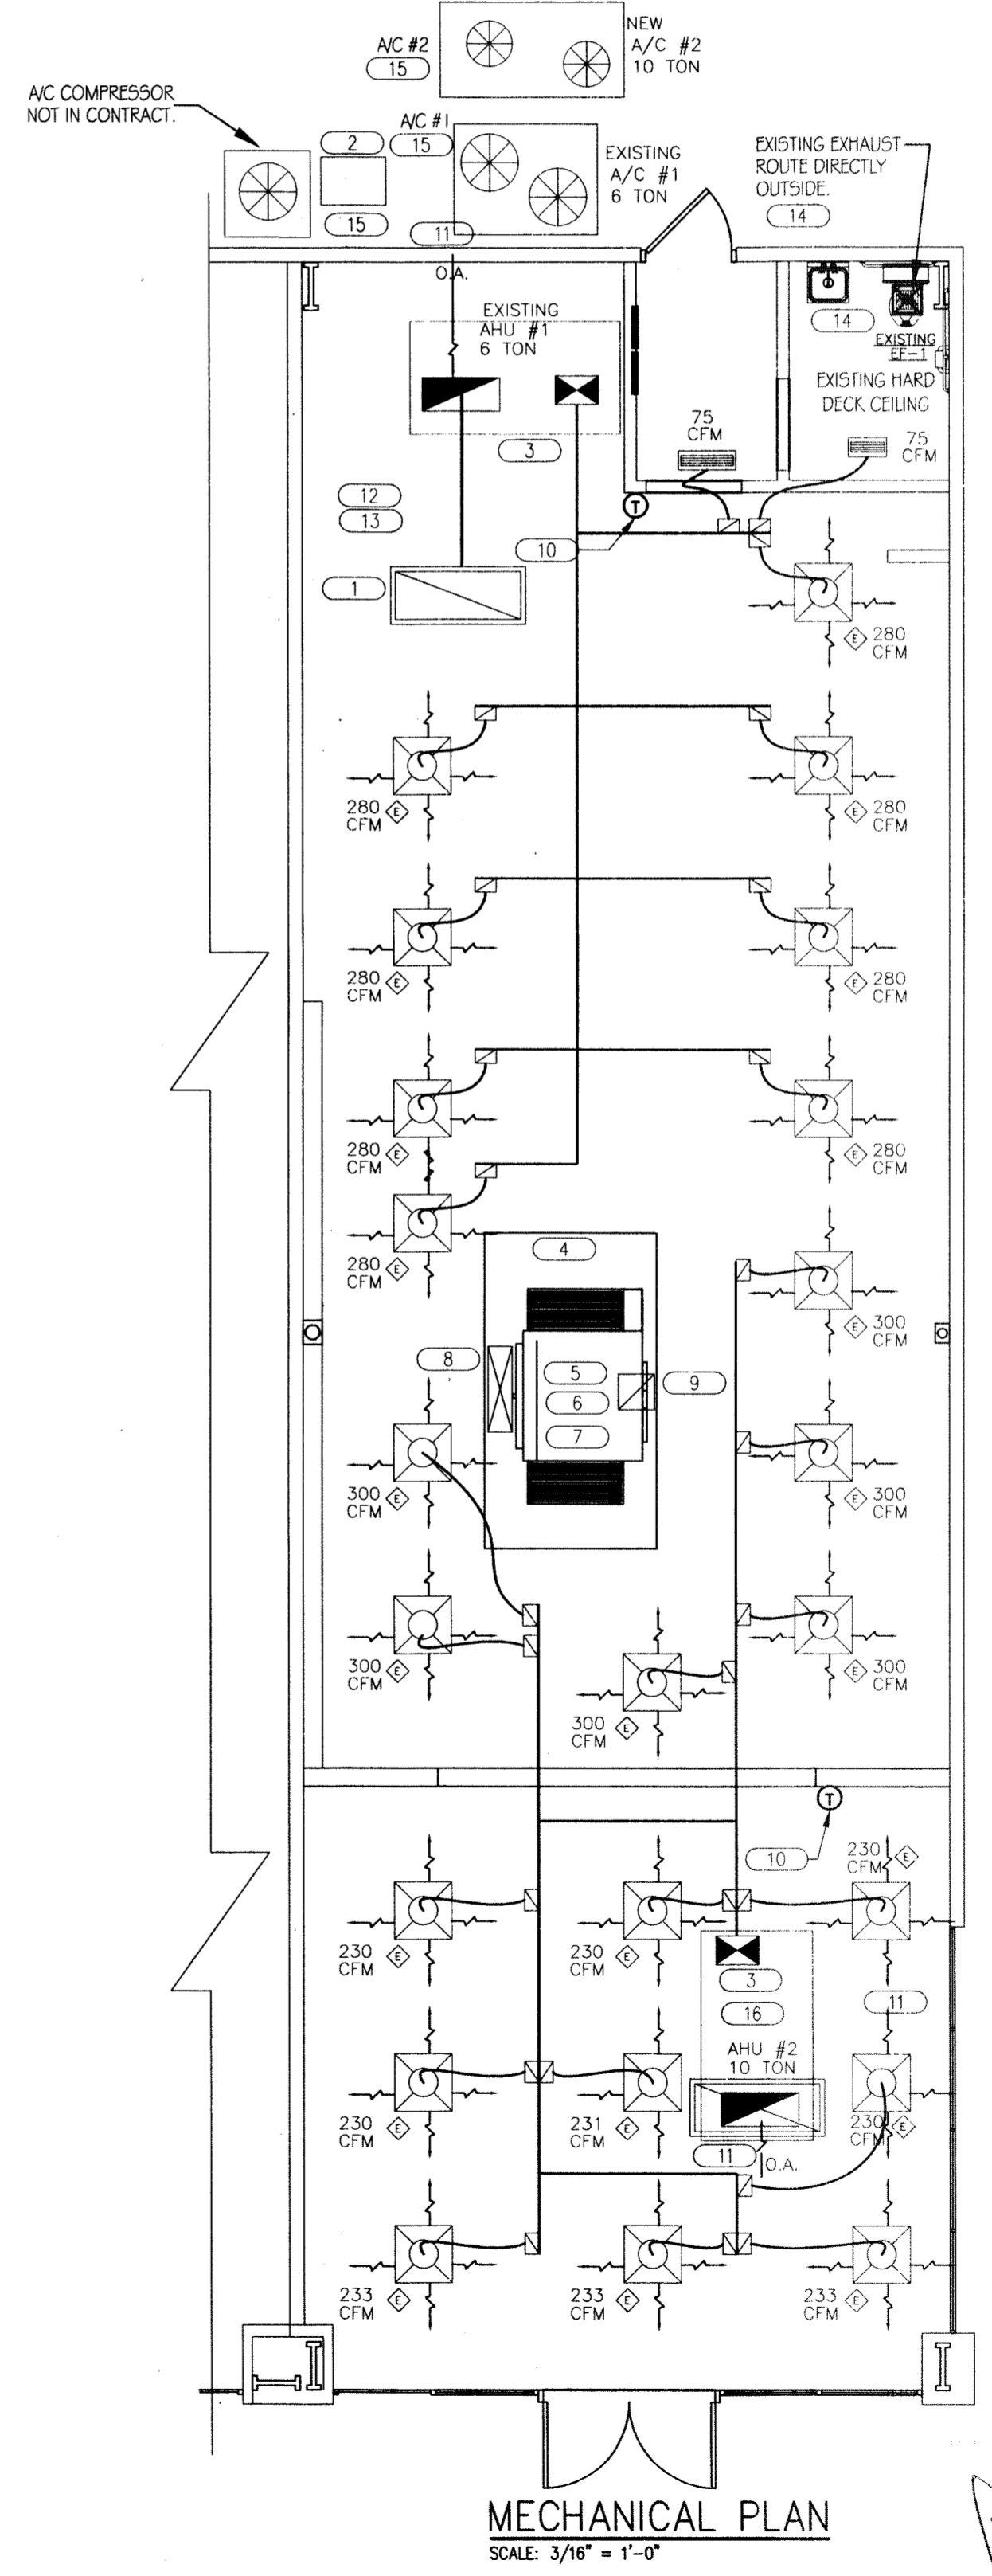

MECHANICAL PLAN
SCALE: 3/16" = 1'-0"