

UPLIFT CONNECTIONS- 130MPH WINDS EXP. "B"						
CONNECTION	FRAMING SPACING (in.)	ROOF SPAN (ft.)	U	L	S	NUM. OF 8d COM. NAILS OR 10d BOX NAILS IN EA. END OF 1-1/4"x20 GA. STRAP
ROOF ASSEMBLY TO WALL ASSEMBLY	16" O.C.	17	386	246	109R	4
WALL ASSEMBLY TO WALL ASSEMBLY	16" O.C.	17	386	246	109R	4
WALL ASSEMBLY TO FOUNDATION	16" O.C.	17	170	185	436	4

JACK STUD REQUIREMENTS-FOR INTERIOR LOADBEARING WALLS												
HEADER SUPPORTING	HEADER SPAN (ft.)	ROOF SPAN (ft.)										
		12 FEET				24 FEET				36 FEET		
		3'	4.5'	5'	6.5'	3'	4.5'	5'	6.5'	3'	4.5'	5'
NO. JACK STUDS REQ.												
ROOF AND CEILING	2	1	1	1	1	1	1	1	1	1	1	1
	4	1	1	1	1	1	1	1	1	1	1	1
	6	1	1	1	1	1	1	1	1	2	1	1
	8	1	1	1	1	2	1	1	1	2	2	2
	10	1	1	1	1	2	2	1	1	3	2	2
	12	1	1	1	1	2	2	2	1	3	2	2
	14	2	1	1	1	3	2	2	2	4	3	2
16	2	1	1	1	3	2	2	2	4	3	2	
ROOF, CEILING, AND 1 CENTER BEARING FLR.	2	1	1	1	1	1	1	1	1	2	1	1
	4	1	1	1	1	2	1	1	3	2	2	2
	6	2	1	1	1	3	2	2	2	4	3	2
	8	2	2	1	1	3	2	2	2	5	3	3
	10	2	2	2	1	4	3	3	2	6	4	4
	12	3	2	2	2	5	3	3	3	7	5	4
	14	3	2	2	2	5	4	3	3	8	5	4
16	4	3	2	2	6	4	4	3	9	6	5	

HEADER SPANS-FOR INT. LOADBEARING WALLS				
HEADER SUPPORTING	SIZE	BLDG. WIDTH (ft.)		
		12	24	36
SPANS (ft.-in.)				
ONE FLOOR (CENTER BEARING)	(2)x4S	4'-4"	3'-1"	2'-6"
	(2)x6S	6'-5"	4'-6"	3'-0"
	(2)x8S	8'-1"	5'-9"	4'-0"
	(2)x10S	9'-11"	7'-0"	5'-9"
	(2)x12S	11'-6"	8'-1"	6'-7"
	(3)x8S	10'-2"	7'-2"	5'-10"
	(3)x10S	12'-5"	8'-9"	7'-2"
	(3)x12S	14'-4"	10'-2"	8'-3"
2 FLOORS ONLY (CENTER BEARING)	(4)x8S	11'-6"	8'-3"	6'-9"
	(4)x10S	14'-4"	10'-1"	8'-3"
	(4)x12S	17'-11"	11'-9"	9'-7"
	(2)x4S	2'-10"	2'-11"	1'-8"
	(2)x6S	4'-2"	3'-11"	2'-6"
	(2)x8S	5'-4"	3'-11"	3'-3"
	(2)x10S	6'-6"	4'-9"	3'-11"
	(2)x12S	7'-6"	5'-6"	4'-7"
(3)x8S	6'-8"	4'-10"	4'-0"	
(3)x10S	8'-1"	6'-0"	4'-11"	
(3)x12S	9'-5"	6'-11"	5'-9"	
(4)x8S	7'-8"	5'-8"	4'-8"	
(4)x10S	9'-4"	6'-10"	5'-8"	
(4)x12S	10'-10"	8'-0"	6'-7"	

HEADER SPANS-EXPOSURE B FOR EXTERIOR LOADBEARING WALLS		
HEADER SIZE	SPAN	NO. FULL HGT. STUDS REQ. AT EA. END
(2)x4S	4'-7"	2
(2)x6S	5'-6"	2
(2)x8S	6'-11"	3
(2)x10S	6'-9"	3
(2)x12S	7'-11"	3
(3)x8S	7'-5"	3
(3)x10S	8'-3"	3
(3)x12S	8'-8"	3
(4)x8S	8'-7"	3
(4)x10S	9'-6"	3
(4)x12S	10'-0"	4

THERMAL COMPONENT CRITERIA (U-FACTOR AND R-VALUE)					
MAX. GLAZING U-FACTOR	MINIMUM INSULATION R-VALUE				
	CEILINGS	WALLS	FLOORS	BASEMENT WALLS	CRAWL SPACE WALLS
.75	R-26	R-13	R-11	R-5	R-5

OPENING PROTECTION FROM WINDBORNE DEBRIS FASTENING SCHEDULE FOR WOOD STRUCTURAL PANELS			
FASTENER TYPE	FASTENER SPACING		
	PANEL SPAN ≤ 4 FOOT	4 FOOT PANEL SPAN ≤ 6 FOOT	6 FOOT PANEL SPAN ≤ 8 FOOT
2-1/2" #6 WOOD SCREWS	16"	12"	9"
2-1/2" #8 WOOD SCREWS	16"	16"	12"

SILL or BOTTOM PLATE TO FND. CONNECTIONS RESISTING UPLIFT LOADS- 130MPH WINDS EXP. "B"			
BOTTOM PLATE TO FND. ANCHOR BOLT CONNECTION RESISTING	FOUNDATION SUPPORTING	MAX. ANCHOR BOLT SPACING (in.)	
		8' END ZONES	INTERIOR ZONES
UPLIFT LOADS	1-3 STORIES	28	33

ROOF SHEATH. OR CLAD. REQ. FOR WIND LOAD-EXP. B			
SHEATHING LOCATION	RAFTER/TRUSS SPAC.	E F	
		MAX. NAIL SPAC. FOR 8d COM. NAILS OR 10d BOX NAILS (INCHES, O.C.)	
INTERIOR ZONE	12" O.C.	6	12
	16" O.C.	6	12
	24" O.C.	6	12
PERIMETER EDGE ZONE	12" O.C.	6	12
	16" O.C.	6	6
	24" O.C.	6	6

JACK STUD REQ.-EXP. B FOR EXT. LOADBEARING WALLS					
HEADER SUPPORTING	HEADER SPAN (ft.)	HEADER WIDTH NO. JACK STUDS REQ.			
		3'	4.5'	5'	6.5'
ROOF AND CEILING	2	1	1	1	1
	4	1	1	1	1
	6	2	1	2	2
	8	2	2	2	2
	10	3	2	2	2
	12	3	2	2	2
	14	4	3	2	2
ROOF, CEILING, AND 1 CENTER BEARING FLR.	2	1	1	1	1
	4	2	1	1	1
	6	2	2	2	1
	8	3	2	2	3
	10	4	3	2	2
	12	4	3	3	2
	14	5	3	3	3

WALL SHEATH. OR CLAD. REQ. FOR WIND LOAD-EXP. B			
SHEATHING LOCATION	STUD SPAC.	E F	
		MAX. NAIL SPAC. FOR 8d COM. NAILS OR 10d BOX NAILS (INCHES, O.C.)	
INTERIOR ZONE	12" O.C.	6	12
	16" O.C.	6	12
PERIMETER EDGE ZONE	12" O.C.	6	12
	16" O.C.	6	12

WINDOWS IN BUILDINGS LOCATED IN WIND BORNE DEBRIS REGIONS SHALL HAVE GLAZED OPENINGS PROTECTED FROM WINDBORNE DEBRIS. WOOD STRUCTURAL PANELS WITH A MIN. THICKNESS OF 7/16" AND A MAX. SPAN OF 8 FEET SHALL BE PERMITTED FOR OPENING PROTECTION IN ONE AND TWO STORY BUILDINGS. PANELS SHALL BE PRECUT TO COVER THE GLAZED OPENINGS WITH ATTACHMENT HARDWARE PROVIDED.

NOTE: CONTRACTOR TO PROVIDE LABELED PLYWOOD CUTOUTS WITH HARDWARE FOR ALL WINDOW AND DOOR OPENING PROTECTION.

HEADER NAILING SCHEDULE			
DESCRIPTION	NUM. OF COM. NAILS	NUM. OF BOX NAILS	SPACING
HEAD. TO HEAD. (FACE-NAILED)	8d	10d	6" O.C. EDGES/ 12" O.C. FIELD

SILL or BOTTOM PLATE TO FND. CONNECTIONS RESISTING SHEAR LOADS- 130MPH WINDS EXP. "B"			
BOTTOM PLATE TO FND. ANCHOR BOLT CONNECTION RESISTING	FOUNDATION SUPPORTING	MAX. ANCHOR BOLT SPACING (in.)	
		1/2" ANC. BOLTS	5/8" ANC. BOLTS
SHEAR LOADS	1-3 STORIES	30	45

ROOF UNDERLAYMENT APPLICATION

FOR ROOF SLOPES FROM TWO UNITS VERTICAL IN 12 UNITS HORIZONTAL (17-PERCENT SLOPE), UP TO FOUR UNITS VERTICAL IN 12 UNITS HORIZ. (33-PERCENT SLOPE), UNDERLAYMENT SHALL BE TWO LAYERS APPLIED IN THE FOLLOWING MANNER:

APPLY A 1/8 INCH STRIP OF UNDERLAYMENT FELT PARALLEL WITH AND STARTING AT THE EAVES, FASTENED SUFFICIENTLY TO HOLD IN PLACE. STARTING AT THE EAVE, APPLY 36 INCH WIDE SHEETS OF UNDERLAYMENT, OVERLAPPING SUCCESSIVE SHEETS 19 INCHES, AND FASTENED SUFFICIENTLY TO HOLD IN PLACE.

FOR ROOF SLOPES OF FOUR UNITS VERTICAL IN 12 UNITS HORIZONTAL (33-PERCENT SLOPE) OR GREATER, UNDERLAYMENT SHALL BE ONE LAYER APPLIED IN THE FOLLOWING MANNER:

UNDERLAYMENT SHALL BE APPLIED SHINGLE FASHION, PARELLEL TO AND STARTING FROM THE EAVE AND LAPPED 2 INCHES, FASTENED SUFFICIENTLY TO HOLD IN PLACE. END LAPS SHALL BE OFFSET BY 6 FEET.

SHINGLE APPLICATION/FASTENING

ASPHALT STRIP SHINGLES SHALL HAVE A MINIMUM OF SIX FASTENERS PER SHINGLE WHERE THE ROOF IS IN ONE OF THE FOLLOWING CATEGORIES:

- THE BASIC WIND SPEED IS 110 MPH OR GREATER AND THE EAVE IS 20 FEET OR HIGHER ABOVE GRADE.
- THE BASIC WIND SPEED IS 120 MPH OR GREATER.
- SPECIAL WIND ZONES.

UPLIFT CONNECTIONS

ROOF ASSEMBLY TO WALL ASSEMBLY:

UPLIFT CONNECTIONS SHALL BE FROM RAFTER OR TRUSS TO WALL STUD. WHEN RAFTERS OR TRUSSES ARE NOT LOCATED DIRECTLY ABOVE STUDS, RAFTERS SHALL BE ATTACHED TO THE WALL PLATE AND THE WALL TOP PLATE SHALL BE ATTACHED TO THE WALL STUD WITH UPLIFT CONNECTIONS. UPLIFT CONNECTIONS SHALL BE IN ACCORDANCE WITH TABLE.

WALL ASSEMBLY TO WALL ASSEMBLY:







STORY TO STORY UPLIFT CONNECTIONS FROM UPPER STORY WALL STUD TO LOWER STORY WALL STUD. WHEN UPPER STORY WALL STUDS ARE NOT LOCATED DIRECTLY ABOVE LOWER WALL STUDS, THE STUDS SHALL BE ATTACHED TO A COMMON MEMBER IN THE FLOOR ASSEMBLY BY UPLIFT CONNECTIONS. UPLIFT CONNECTIONS SHALL BE IN ACCORDANCE WITH TABLE.

WALL ASSEMBLY TO FOUNDATION:


FIRST FLOOR WALL STUDS SHALL BE CONNECTED TO THE FOUNDATION, SILL, PLATE, OR BOTTOM PLATE. A MINIMUM OF A 1-1/4" x 20 GA. ASTM A653 GRADE 33 STEEL STRAP SHALL BE NAILED TO THE WALL STUDS AND HAVE A MINIMUM EMBEDMENT OF 7 INCHES IN CONCRETE FOUNDATIONS AND SLABS-ON-GRADE, 15 INCHES IN MASONRY BLOCK FOUNDATIONS, OR BE LAPPED UNDER THE BOTTOM PLATE, 3 INCH SQUARE WASHERS SHALL BE USED ON THE ANCHOR BOLTS AND ANCHOR BOLT SPACINGS SHALL NOT EXCEED THE REQUIREMENTS. STEEL STRAPS EMBEDDED IN OR IN CONTACT WITH SLAB-ON-GRADE OR MASONRY BLOCK FOUNDATIONS SHALL BE HOT-DIPPED GALV. AFTER FABRICATION, OR MANUF. FROM G185 OR 2450 GALV. STL. CONNECTIONS SHALL BE IN ACCORDANCE WITH TABLE.

HOLDDOWNS

HOLDDOWNS ARE REQUIRED AT THE END OF EACH SEGMENTED SHEARWALL SEGMENT OR AT EACH END OF A PERFORATED SHEARWALL. WHEN FULL HEIGHT SHEARWALL SEGMENTS MEET AT A CORNER, A SINGLE HOLDDOWN SHALL BE PERMITTED TO BE USED TO RESIST THE OVERTURNING FORCES IN BOTH DIRECTIONS WHEN THE CORNER FRAMING IN THE ADJOINING WALLS IS FASTENED TOGETHER TO TRANSFER THE UPLIFT LOAD. SEE CORNER HOLDDOWN DETAIL.

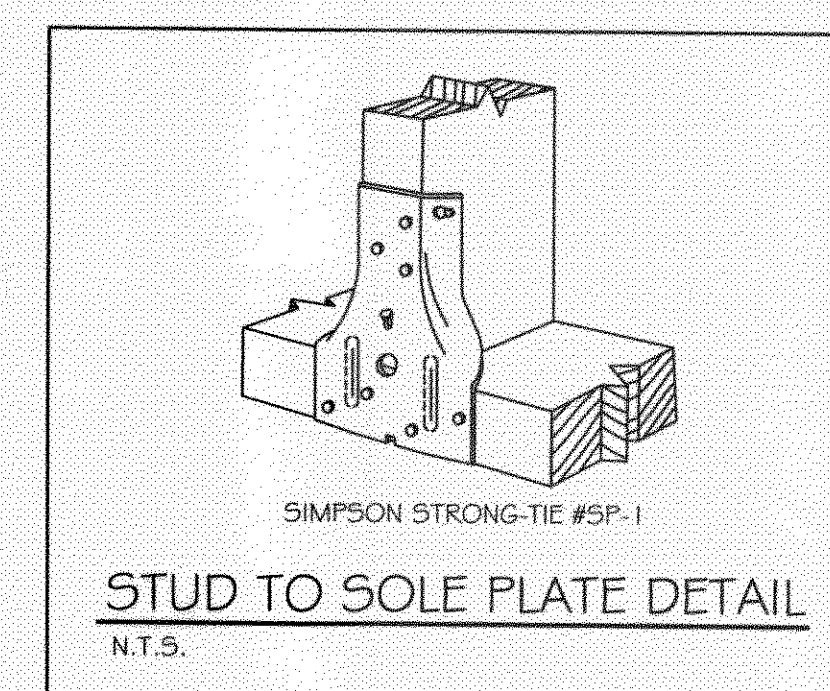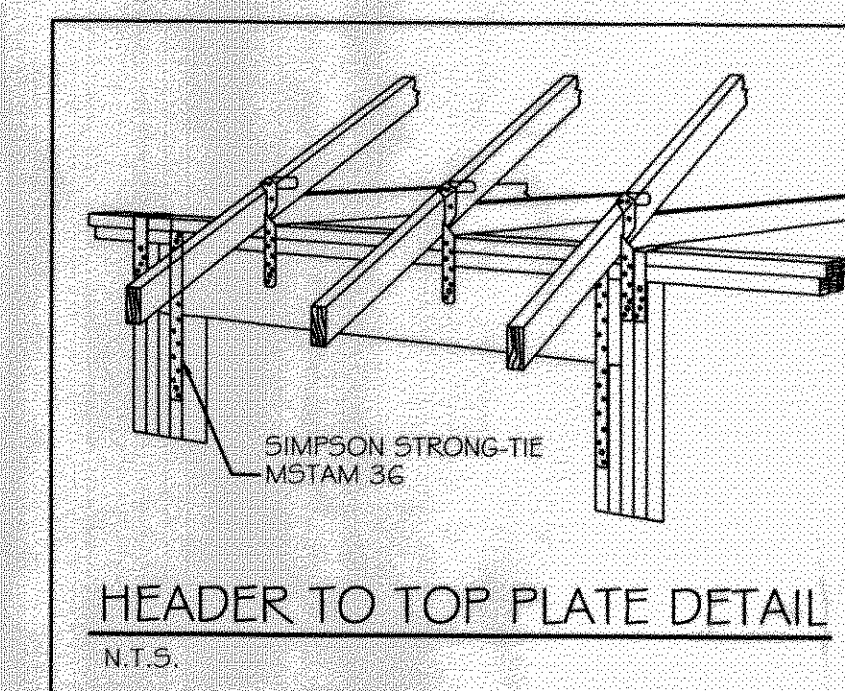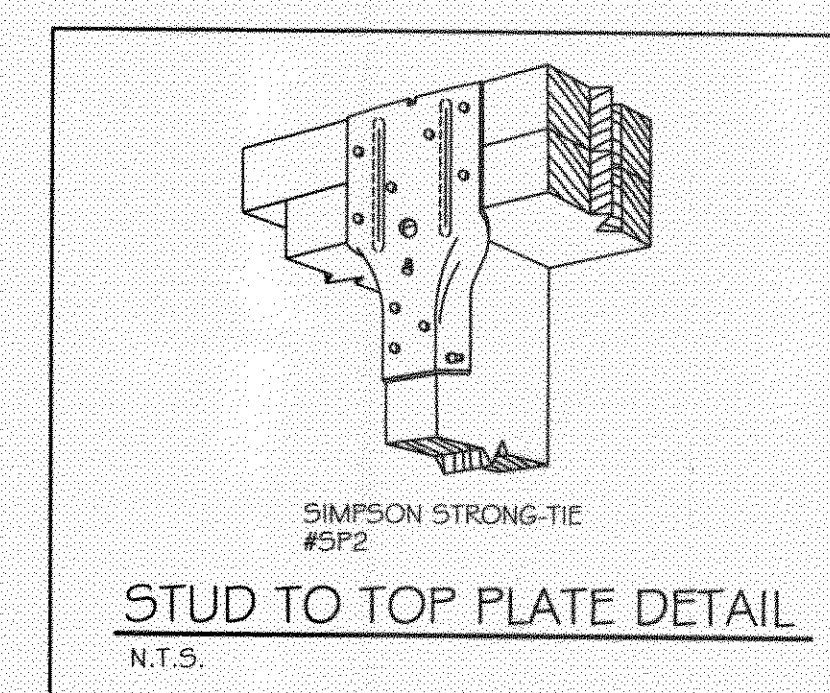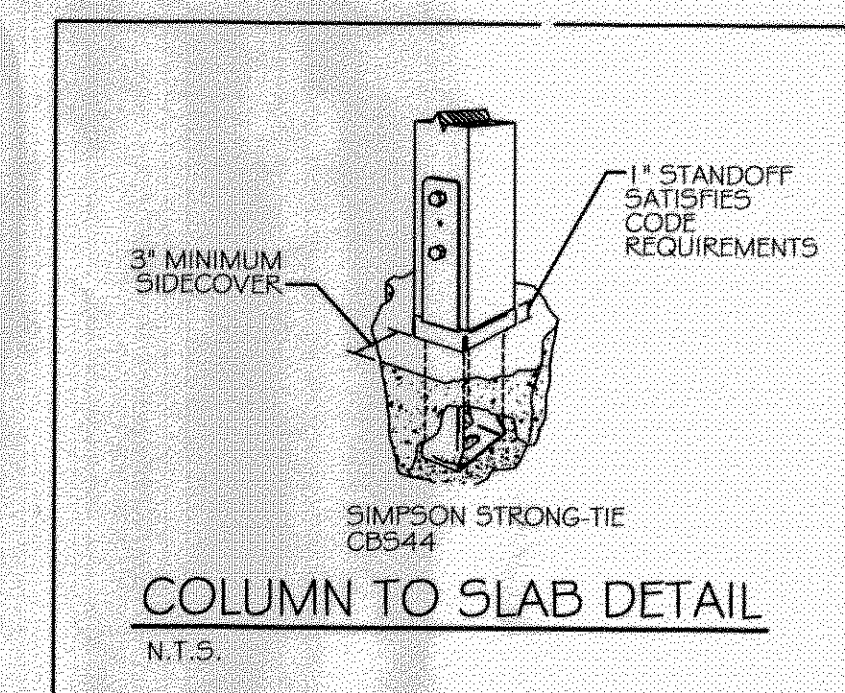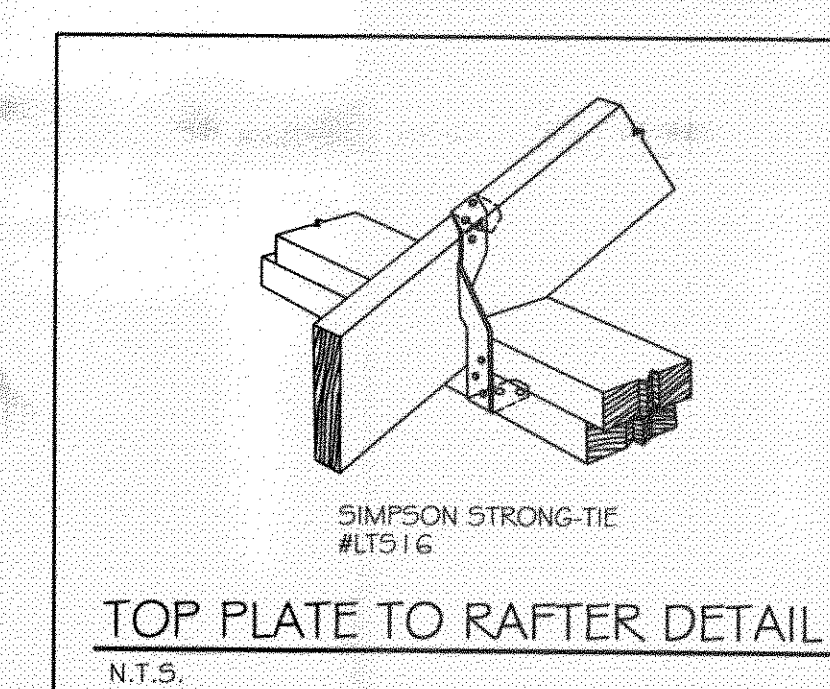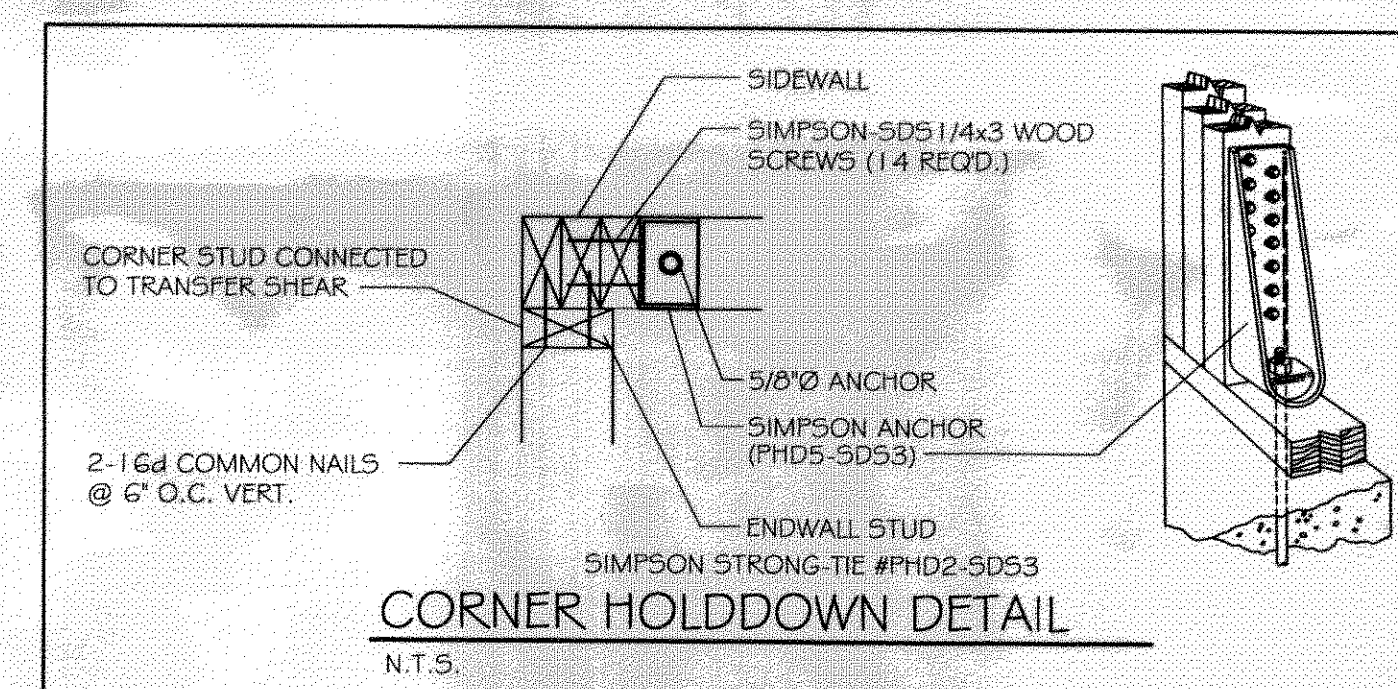

371441
REVIEWED FOR
STATE FIRE MARSHAL
AS PER REVIEW LETTER
BY: WILLIAM D. JONES, ARCHITECT, CBO
William D. Jones

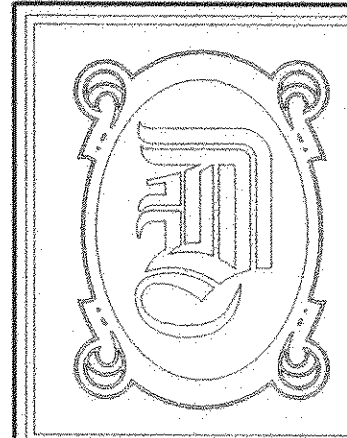

DAMMON ENGINEERING, INC.

CHIEF ENGINEER
EMMETT DAMMON, P.E.

CHIEF ARCHITECT
ROBERT WILTSE

1095 FLORIDA AVENUE
SUDELL, LA. 70458
OFFICE: 985-649-5832
FAX: 985-641-5950

WEBSITE:
WWW.DAMMONENGINEERING.COM


EMAIL:
DAMMONENG@BELLSOUTH.NET

ARCHITECTURE
ENGINEERING
STUDIES
PLANNING
INVESTIGATION
EXPERT WITNESS

NEW CREMATION AND EMBALMING FACILITY

HONAKER FUNERAL HOME
TERRY TRANCHINA
1751 W. GAUSE BLVD
SLIDELL, LA

FRAMING NOTES & DETAILS

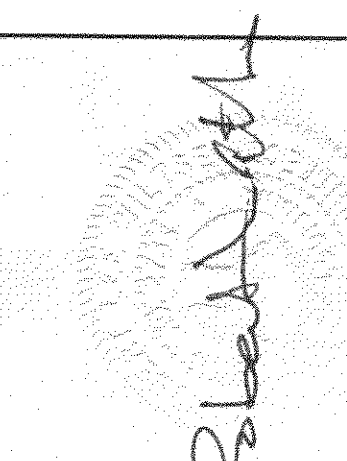

REV: 12-04-09

SCALE: AS NOTED

JOB#: 1999

DATE: 6-9-09

SHEET 13

A-7

OF 19