

HONAKER FUNERAL HOME


NEW CREMATORY AND EMBALMING FACILITY

1751 WEST GAUSE BLVD.
SLIDELL, LA

HONAKER FUNERAL HOME
TERRY TRANCHINA
1751 W. GAUSE BLVD.
SLIDELL, LA

DATE: 6-9-09
JOB NO. 1999

DAMMON ENGINEERING, INC.
OFFICE: (985) 649-5832
FAX: (985) 641-5950
1095 FLORIDA AVE.
SLIDELL, LA 70458
WEBSITE: WWW.DAMMONENGINEERING.COM
EMAIL: DAMMONENG@BELLSOUTH.NET

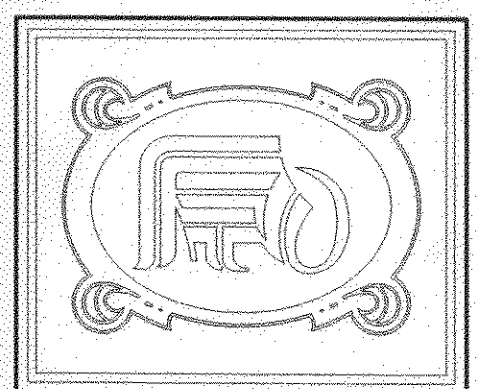

SHEET 1
OF 19

BUILDING USE DESCRIPTION

THIS BUILDING SHALL BE USED FOR THE EMBALMING, CREMATION, AND/OR FUNERAL PREPARATION OF HUMAN CORPSES.

INTERNATIONAL BUILDING CODE 2006 REQUIREMENTS

OCCUPANCY CLASSIFICATION:
FACTORY, GROUP F-1 (SEC 306.2)

OCCUPANT LOAD: (TBL 1004.1.1)
INDUSTRIAL = 100 GROSS s.f. / OCCUPANT
2,100 s.f. = 21 OCCUPANTS
TOTAL OCCUPANT LOAD = 21

EXIT ACCESS REQUIREMENTS: (SEC 1015/1016)
1 EXIT REQUIRED FOR LESS THAN 49 OCCUPANTS IN FACTORY OCCUPANCY (TBL 1015.1) (3 EXITS PROVIDED)
EXIT ACCESS TRAVEL DISTANCE = MAX. 200' UNSPRINKLED
EXIT ACCESS TRAVEL DISTANCE = MAX. 250' SPRINKLED

ALLOWABLE HEIGHT AND BLDG. AREA: (TBL 503)
FACTORY F-1 = 8,500 s.f. / 1 STORY ALLOWED, THIS PROJECT 1 STORY 2,100 s.f.

CONSTRUCTION CLASSIFICATION: (SEC 602.5)
TYPE VB

FIRE RESISTANCE RATING REQUIREMENTS FOR BLDG. ELEMENTS: (TBL 601)
STRUCTURAL FRAME = 0 HRS.
BEARING WALLS (INTERIOR AND EXTERIOR) = 0 HRS.
NON-BEARING WALLS = 0 HRS.
FLOOR CONSTRUCTION = 0 HRS.
ROOF CONSTRUCTION = 0 HRS.


FIRE RESISTANCE RATING REQUIREMENTS FOR EXTERIOR WALLS: (TBL 602)
30' < X = 0 HR.

AUTOMATIC SPRINKLER SYSTEM REQUIREMENTS: (SEC 903)
THIS BLDG. DOES NOT REQUIRE AN AUTOMATIC SPRINKLER SYSTEM PER SECTION 903.2.3.

FIRE ALARM SYSTEM REQUIREMENTS: (SEC 907)
THIS BLDG. DOES NOT REQUIRE A FIRE ALARM SYSTEM PER SECTION 907.2.4

CONSTRUCTION DOCUMENTS: (SEC 1603)
THIS BLDG. SHALL BE DESIGNED IN ACCORDANCE WITH IBC SECTION 1609 AS A FULLY ENCLOSED BLDG. USING THE FOLLOWING INFORMATION:
BASIC WIND SPEED (3 SECOND GUSTS) = 130 MPH (FIG 1609)
IMPORTANCE FACTOR: CATEGORY II BLDG., IE = 1.00, IS = 1.0, IW = 1.00 (TBL 1604.5)
EXPOSURE C, DETERMINATION OF WIND LOADS SHALL BE IN ACCORDANCE WITH IBC SEC 1609.4
INTERNAL PRESSURE COEFFICIENT (ASCE 7-05 FIG. 6-5): ± 0.18
MINIMUM UNIFORMLY DIST. LIVE LOAD (TBL. 1607.1): HOSPITAL / OPERATING RM. = 60 PSF
BASED ON THE SURVEY OF THIS PROPERTY BY J.V. BURKES & ASSOCIATES, INC.
LA REGISTERED LAND SURVEYOR No. 4785
F.I.R.M. COMMUNITY No. 225205 0420E, F.I.R.M. DATE: 04-21-1999
BUILDING IS NOT LOCATED IN A SPECIAL FLOOD HAZARD AREA. IT IS LOCATED IN FLOOD ZONE C. B.F.E. NA

NON-SPRINKLED
TOTAL s.f.: 2,100

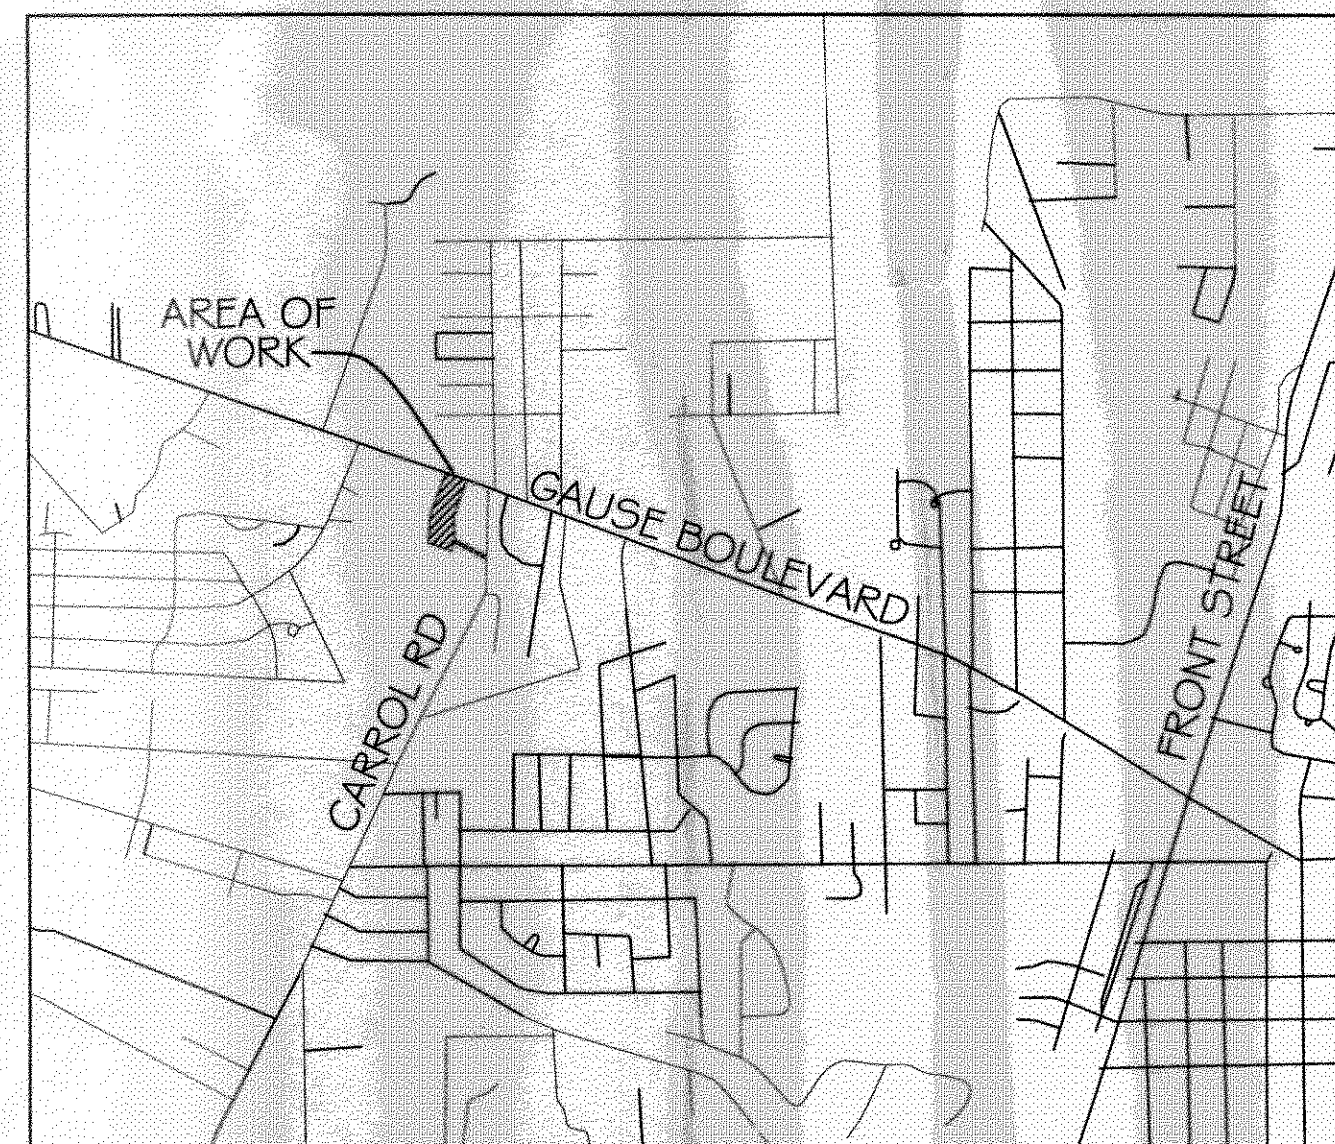

VICINITY MAP
N.T.S.

SEE ATTACHED
REVISED SHEET

INDEX OF DRAWINGS

DWG#	DRAWING NAME	REVISED
C-1	SITE PLAN	
C-2	PAVING & DRAINAGE PLAN	
C-3	UTILITIES PLAN	
C-4	PAVING NOTES AND DETAILS	
S-1	FOUNDATION PLAN	
A-1	FLOOR PLAN	
A-2	CROSS SECTION @ PREP ROOM	
A-3	CROSS SECTION @ CREMATORY	
A-4	ROOF & REFLECTED CEILING PLAN	
A-5	EXTERIOR ELEVATIONS	
A-6	EXTERIOR ELEVATIONS	
A-7	FRAMING NOTES AND DETAILS	
H-1	HANDICAP DETAILS	
H-2	HANDICAP DETAILS	
M-1	MECHANICAL PLAN	
E-1	POWER PLAN	
E-2	LIGHTING PLAN	
P-1	PLUMBING PLAN	