FILE NAME: J:_Schools Private\Pope John Paul Stitch Classroom\Current Drawings\S101 - Foundation Plan.dwg PLOT DATE & TIME: Thursday, June 20, 2024 4:29:01 PM

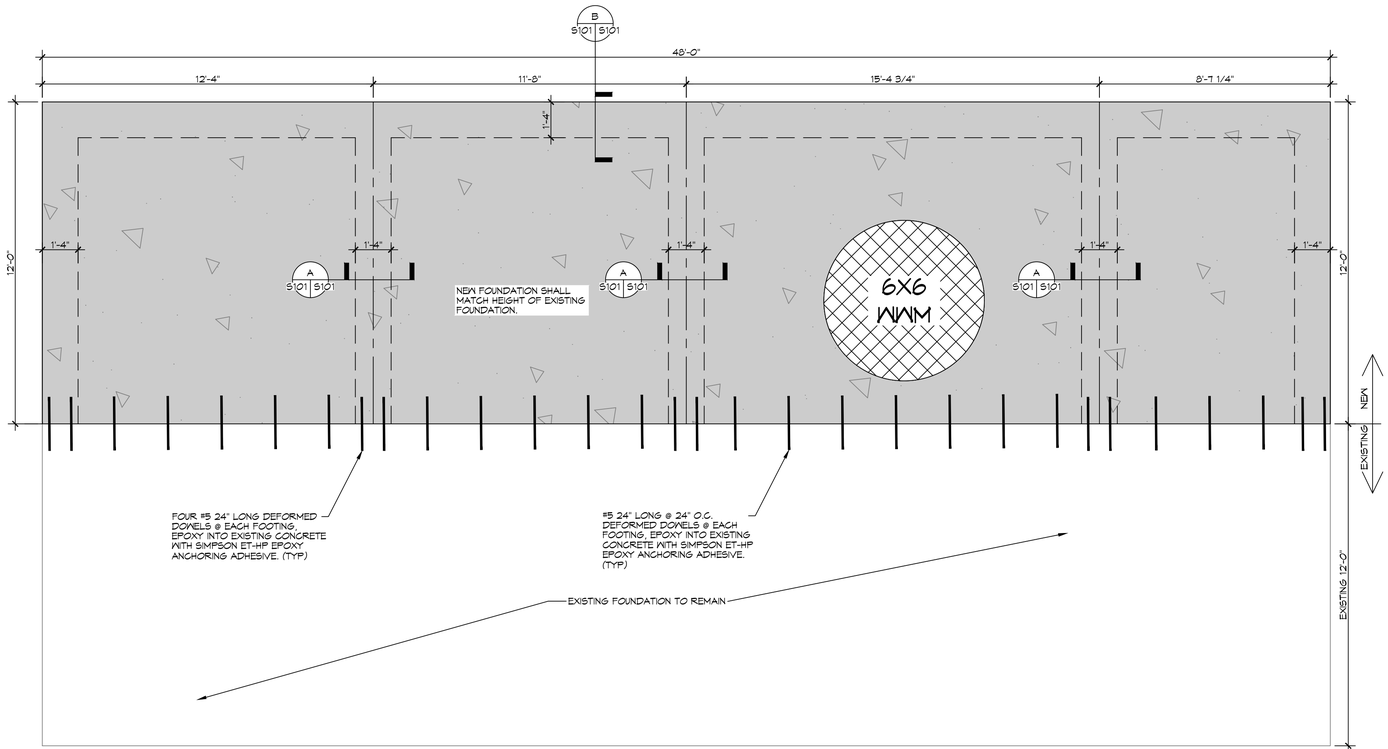

3 FOUNDATION PLAN
SCALE: 3/8"= 1'-0"

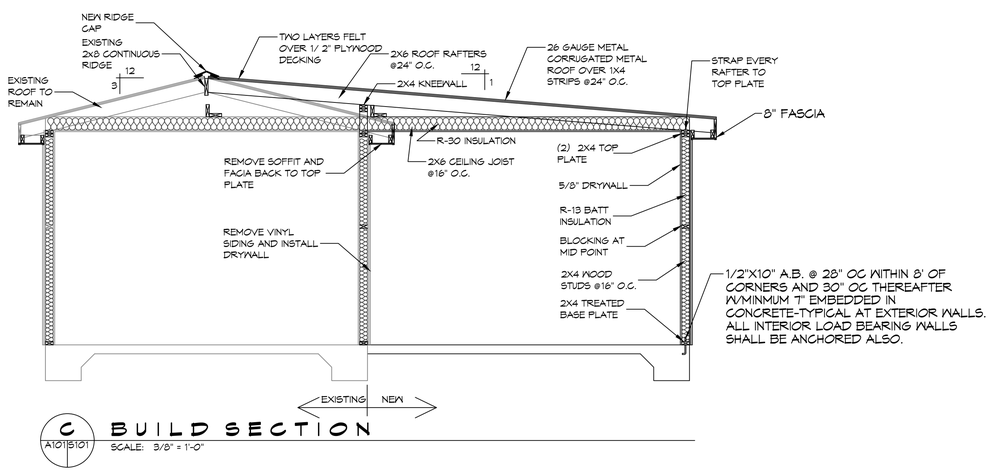

C BUILD SECTION
A101 S101
SCALE: 3/8" = 1'-0"

FOUNDATION NOTES

1. ALL DIMENSIONS ARE EDGE OF CONCRETE (EOC) TO EDGE OF CONCRETE (EOC) UNLESS NOTED OTHERWISE.
2. VERIFY ALL PLUMBING ROUGH-IN LOCATIONS ON ARCHITECTURAL DWGS.
3. CONCRETE MIX SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 4000 PSI AT 28 DAYS. CONCRETE MIX SHALL BE IN ACCORDANCE WITH ACI-318.
4. ALL CONVENTIONAL REINFORCING STEEL SHALL MEET ASTM-A615 (GRADE 60).
5. TWO LAYER OF POLYETHYLENE VAPOR BARRIER SHALL BE PLACED UNDER ALL CONCRETE. VAPOR RETARDER TO BE MINIMUM 10 MIL, THICKNESS; ASTM E 1745 CLASS A, PERMEANCE LESS THAN 0.01 PERMS, EQUAL TO STEGO INDUSTRIES STEGO WRAP, ECOSHIELD-E 15 MIL BY EPRO, OR IRONBAR 15 BY FLATIRON FILMS. PROVIDE APPROPRIATE ACCESSORIES FOR A COMPLETE SYSTEM.
6. ALL MESH SHALL BE SECURELY SUPPORTED TO PREVENT BOTH VERTICAL AND HORIZONTAL MOVEMENT DURING CONCRETE PLACEMENT.
7. THE CONTRACTOR SHALL VERIFY ALL DROPS, OFFSETS, BRICK LEDGES, DIMENSIONS AND CONFIGURATIONS. CONTRACTOR MUST BE RESPONSIBLE FOR SAME. SEE ARCHITECTURAL DRAWINGS.
8. FILL, AS A MINIMUM QUALITY, SHALL BE 40% CLAY AND 60% SANDY MIXTURE, PLACED IN 6" LIFTS AND COMPACTED TO A MINIMUM OF 95% STANDARD PROCTOR. FOOTINGS ARE DESIGNED TO USE SOIL WITH A BEARING PRESSURE OF 2000 LBS. PER SQUARE FOOT OR MORE. IT IS RECOMMENDED THAT THE OWNER VERIFY ALLOWABLE SOIL BEARING PRESSURE CAPACITY BY CONTRACTING THE SERVICES OF A SOILS ENGINEERING COMPANY.
9. ALL SOIL BELOW SLAB SHALL RECEIVE TERMITE TREATMENT.

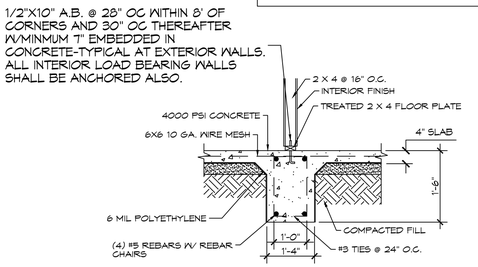

A INTERIOR GRADE BEAM
S101 S101
SCALE: N.T.S

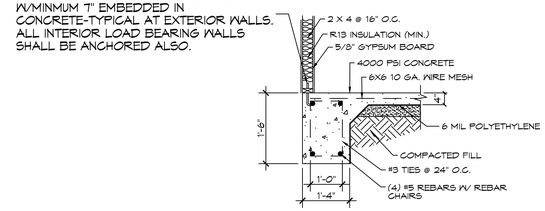

B BRICK EXTERIOR GRADE BEAM
S101 S101
SCALE: N.T.S

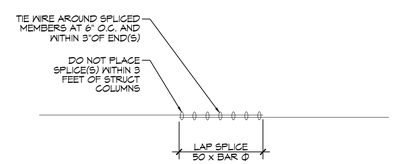

REBAR SPLICE
SCALE: 1/2" = 1' - 0"

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832
Chief Engineer: Brian Mistich, PE
Project Engineer: Trey Hall
Slidell, LA 70458

REVISIONS

#	DESCRIPTION	DATE

SEAL:

SCHOOL BUILDING
POPE JOHN PAUL II CATHOLIC HIGH SCHOOL
1901 JAGUAR DRIVE
SLIDELL, LA 70461

DRAWN BY: SCH | JOB No:
CHECKED BY: CKD | DATE: 06-17-2024

All plans, specifications and designs prepared by Dammon Engineering, Inc. are and shall remain the property of Dammon Engineering, Inc. and shall not be used in whole or in part for any work except the project for which they were prepared and developed without written consent of Dammon Engineering, Inc. Visual contact with these plans shall constitute prima facie evidence of the acceptance of these restrictions.

SHEET TITLE:
FOUNDATION PLAN

DRAWING NUMBER:
S101

SHEET No: 3 of 13