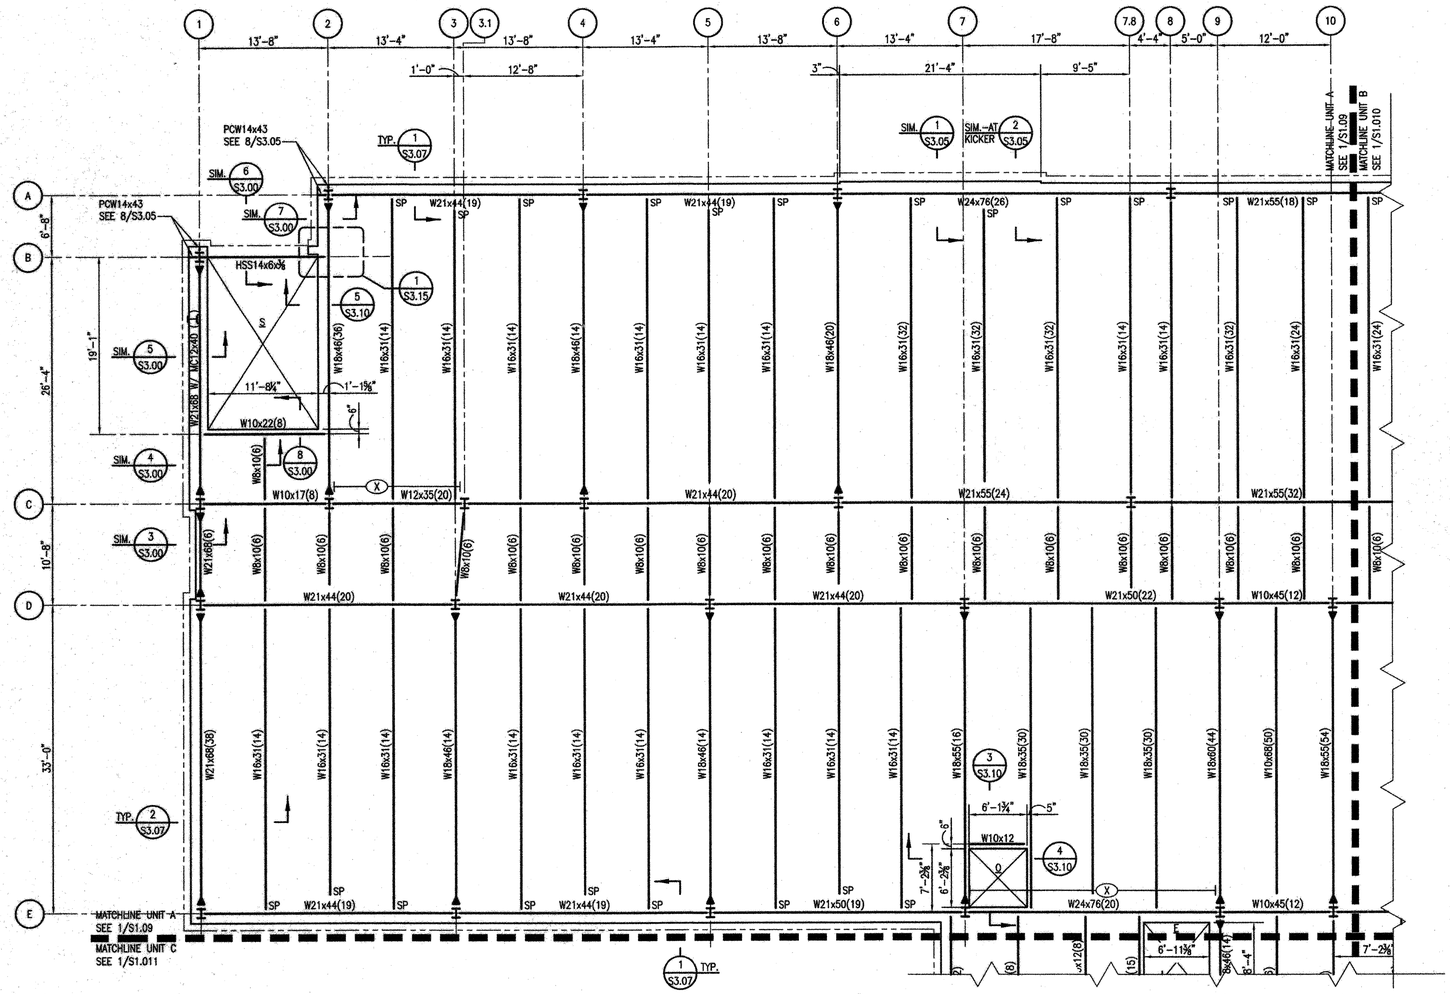

PLAN NOTES: UNLESS NOTED OTHERWISE:

1. TOP OF SLAB EL. 130'-8".
2. TOP OF STRUCTURAL STEEL EL. 130'-3¼".
3. FLOOR SYSTEM TO CONSIST OF LIGHT WEIGHT CONCRETE (115PCF, f'c=4,000 psi) ON 1½" DEEP 20 GAGE GALVANIZED COMPOSITE METAL DECKING. TOTAL THICKNESS=4¾", REINFORCE CONCRETE SLAB WITH 6x6-W1.4xW1.4 W.W.F. LOCATED 1" BELOW TOP OF SLAB.
4. – INDICATES ROOF SYSTEM TO CONSIST OF 1½" DEEP TYPE "B" 20 GAGE GALVANIZED METAL ROOF DECKING. SEE ARCHITECTURAL DRAWINGS FOR INSULATION & ROOFING ON TOP OF DECKING. TOP OF STRUCTURAL STEEL EL. 130'-3¼". SEE PLAN FOR TOP OF STEEL ELEVATIONS AT GYMNASIUM.
5. W21x44(20) – INDICATES W21X44 BEAM W/24-¾"øx3½" A.E.W.S.C. EQUALLY SPACE STUDS ALONG ℄ OF BEAM, STUDS ARE TO BE FIELD INSTALLED.
6. – INDICATES OPENING COORD. SIZE & LOCATIONS WITH ARCH./MECH. DRAWINGS SEE 1/S4.01.
7. – INDICATES AREA TO BE DEPRESSED FOR ARCH. FINISH. SEE PLAN FOR DEPTH OF RECESS. COORDINATE EXTENTS OF ALL DEPRESSIONS WITH ARCH. DRAWINGS. ALL DEPRESSIONS DEPTHS SHALL BE VERIFIED WITH THE A/E AS WELL AS WITH MANUFACTURER'S REQUIREMENTS FOR PRODUCTS TO BE INSTALLED WITHIN THOSE DEPRESSIONS, BEFORE FORMING FOR THE CONCRETE POUR BEGINS.
8. – INDICATES MOMENT CONNECTION SEE DETAILS SHT. S4.00.
9. – INDICATES WIND "X" BRACING. SEE ELEVATIONS.
   – INDICATES SINGLE STRUT WIND BRACING. SEE ELEVATIONS.
10. S16K5 – INDICATES SPECIAL JOIST CONNECTION TO COLUMN SEE 4/S4.01.
11. METAL STUDS IN EXTERIOR WALLS AT INTERIOR ZONES SHALL BE AT A MINIMUM 600S250-68 (6"x14 GA.)@16" O.C. AT CORNER ZONES SPACING SHALL BE REDUCED TO 12" O.C. WHERE 8" METAL STUD WALLS ARE INDICATED, PROVIDE AT A MINIMUM 800S162-68 (8"X14 GA.)@12". WALL TRACKS TO BE 16GA. MINIMUM TO MATCH STUD DEPTH. SEE ARCH. DRAWINGS FOR CONSTRUCTION, LOCATION AND EXTENTS. SEE ARCH. FOR ALL INTERIOR LIGHT GAGE METAL STUD WALLS.
12. SP – INDICATES SHEAR PLATE CONNECTION AT BEAM END.
    W14'S – 4-¾"ø BOLTS
    W16'S – 5-¾"ø BOLTS

1 / S1.09 PARTIAL 3RD FLOOR FRAMING PLAN 1/8"=1'-0"

N



KEY PLAN

MORPHY MAKOFSKY INCORPORATED CONSULTING ENGINEERS (504)488-1317 JOB NO. 12083

VergesRome Architects
FANNING HOWEY A Joint Venture
320 N. Carrollton Avenue, Suite 100
New Orleans, Louisiana 70119
t. 504.488.7739 f. 504.488.7743

© copyright 2012

STATE OF LOUISIANA — DONALD C. MAKOFSKY — License No. 10439 — PROFESSIONAL ENGINEER IN CIVIL ENGINEERING

DEC 07 2012

NEW 3 SECTION ELEMENTARY SCHOOL AT FISK-HOWARD SCHOOL

RECOVERY SCHOOL DISTRICT

211 S. LOPEZ STREET NEW ORLEANS, LOUISIANA 70119

DATE ISSUED:	7 DECEMBER, 2012
REVISED:	
REVISED:	
REVISED:	
REVISED:	
DRAWN BY:	WFD
CHECKED BY:	JAS

PHASE: BID DOCUMENTS

11085

TITLE: 3RD FLR. UNIT A & LOW ROOF FRAMING PLAN

SHEET: S1.09