

**NEW 3 SECTION ELEMENTARY SCHOOL
AT FISK-HOWARD SCHOOL
RECOVERY SCHOOL DISTRICT**

211 S. LOPEZ STREET NEW ORLEANS, LOUISIANA 70119

DATE ISSUED: 7 DECEMBER, 2012
REVISED:
REVISED:
REVISED:
REVISED:
DRAWN BY: WFD
CHECKED BY: JAS
PHASE:


BID DOCUMENTS

11085


TITLE:
2ND FLR. UNIT A & LOW
ROOF FRAMING PLAN

SHEET:

S1.05

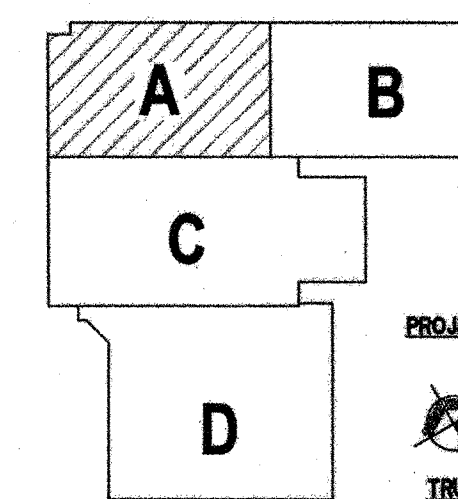

KEY PLAN

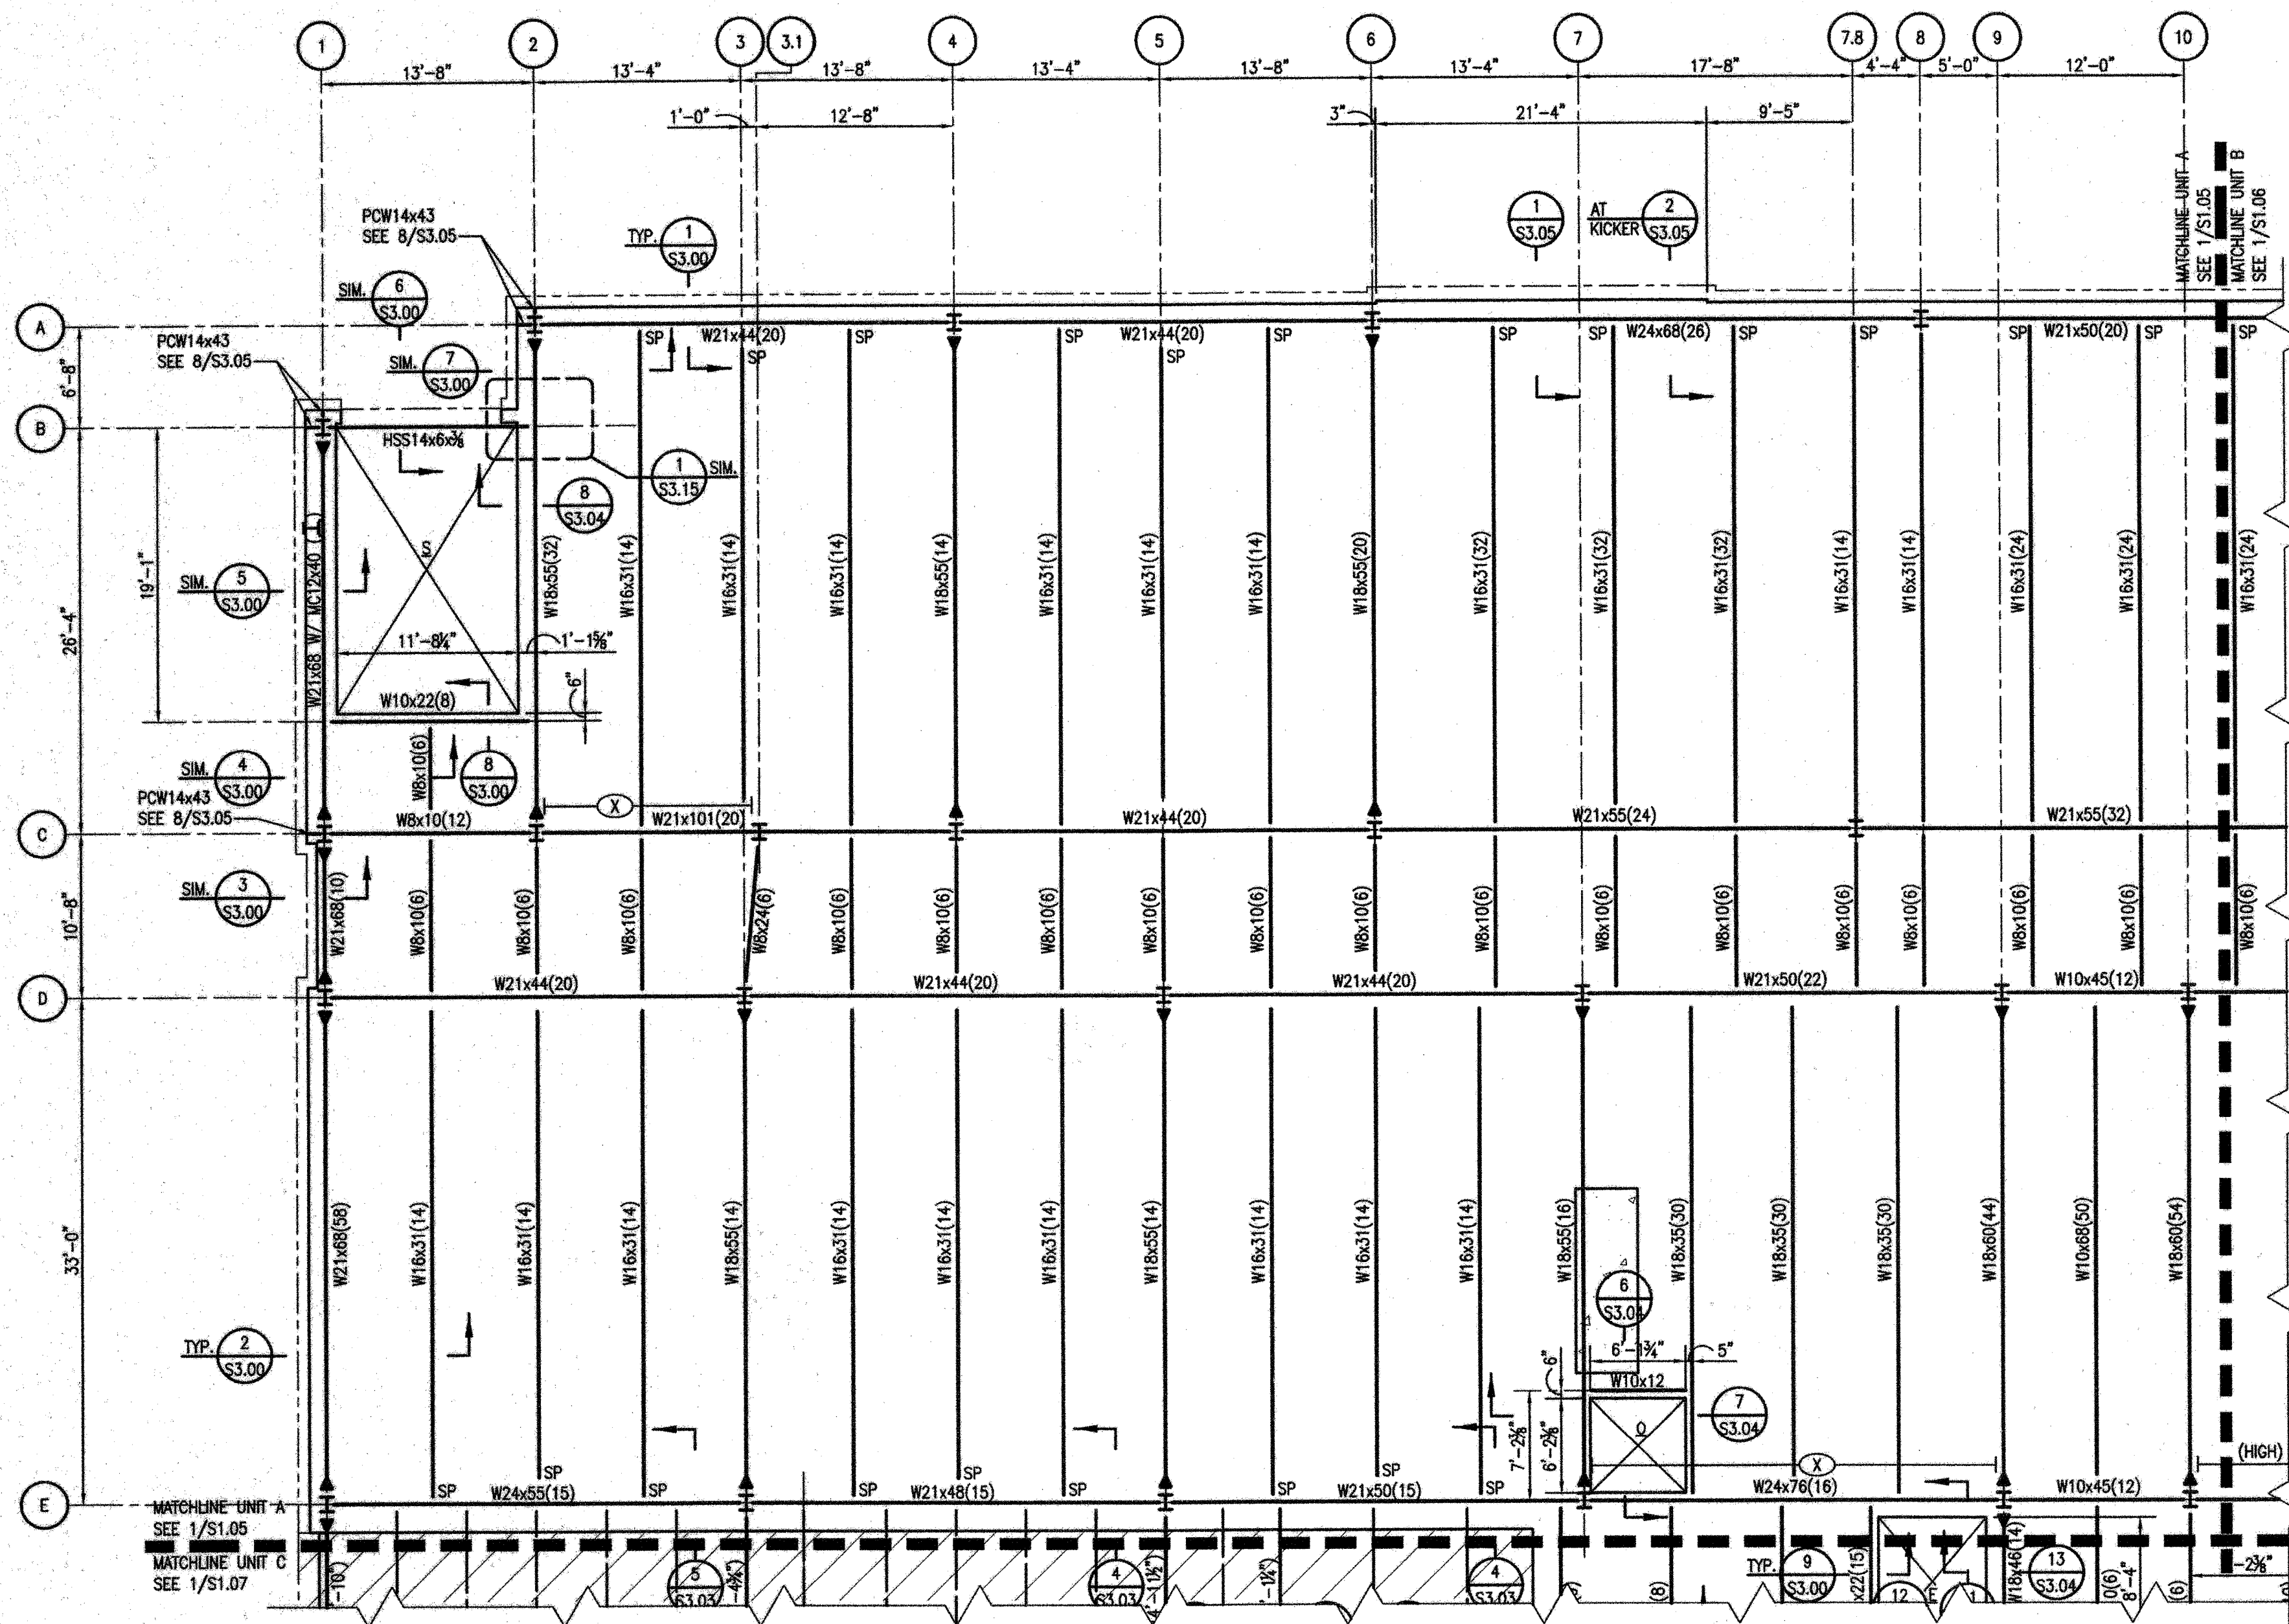

- PLAN NOTES: UNLESS NOTED OTHERWISE:**
1. TOP OF SLAB EL. 116'-0".
 2. TOP OF STRUCTURAL STEEL EL. 115'-7 1/8".
 3. FLOOR SYSTEM TO CONSIST OF LIGHT WEIGHT CONCRETE (115PCF, $f_c=4,000$ ps) ON 1/2" DEEP 20 GAGE GALVANIZED COMPOSITE METAL DECKING. TOTAL THICKNESS=4 1/2". REINFORCE CONCRETE SLAB WITH 6x6-W1.4xW1.4 W.W.F. LOCATED 1" BELOW TOP OF SLAB.
 4. - INDICATES ROOF SYSTEM TO CONSIST OF 1/2" DEEP TYPE "B" 20 GAGE GALVANIZED METAL ROOF DECKING. SEE ARCHITECTURAL DRAWINGS FOR INSULATION & ROOFING ON TOP OF DECKING. TOP OF STRUCTURAL STEEL EL. VARIES SEE PLAN.
 5. W21x44(20) - INDICATES W21X44 BEAM W/24-3/4"x3 1/2" A.E.W.S.C. EQUALLY SPACE STUDS ALONG C/L OF BEAM. STUDS ARE TO BE FIELD INSTALLED.
 6. - INDICATES OPENING COORD. SIZE & LOCATIONS WITH ARCH./MECH. DRAWINGS SEE 1/S4.01.
 7. - INDICATES AREA TO BE DEPRESSED FOR ARCH. FINISH. SEE PLAN FOR DEPTH OF RECESS. COORDINATE EXTENTS OF ALL DEPRESSIONS WITH ARCH. DRAWINGS. ALL DEPRESSIONS DEPTHS SHALL BE VERIFIED WITH THE A/E AS WELL AS WITH MANUFACTURER'S REQUIREMENTS FOR PRODUCTS TO BE INSTALLED WITHIN THOSE DEPRESSIONS, BEFORE FORMING FOR THE CONCRETE POUR BEGINS.
 8. - INDICATES MOMENT CONNECTION SEE DETAILS SHT. S4.00.
 9. (X) - INDICATES WIND "X" BRACING. SEE ELEVATIONS.
 - (S) - INDICATES SINGLE STRUT WIND BRACING. SEE ELEVATIONS.
 10. S16K5 - INDICATES SPECIAL JOIST CONNECTION TO COLUMN SEE 4/S4.01.
 11. METAL STUDS IN EXTERIOR WALLS AT INTERIOR ZONES SHALL BE AT A MINIMUM 600S250-68 (6"x14 GA.)@16" O.C. AT CORNER ZONES SPACING SHALL BE REDUCED TO 12" O.C. WHERE 8" METAL STUD WALLS ARE INDICATED, PROVIDE AT A MINIMUM 800S162-68 (6"x14 GA.)@12". WALL TRACKS TO BE 16GA. MINIMUM TO MATCH STUD DEPTH. SEE ARCH. DRAWINGS FOR CONSTRUCTION, LOCATION AND EXTENTS. SEE ARCH. FOR ALL INTERIOR LIGHT GAGE METAL STUD WALLS.
 12. SP - INDICATES SHEAR PLATE CONNECTION AT BEAM END.
W14'S - 4-3/4" BOLTS
W16'S - 5-3/4" BOLTS
 13. (DT) - INDICATES ROD DRAG TIE AT COLUMN. SEE DETAILS SHEET S4.01.

1 PARTIAL 2ND FLOOR
S1.05 FRAMING PLAN 1/8"=1'-0"