

**NFPA 55**  
**Standard for**  
**the Storage, Use, and**  
**Handling of Compressed**  
**and Liquefied Gases**  
**in Portable Cylinders**

**1998 Edition**



National Fire Protection Association, 1 Batterymarch Park, PO Box 9101, Quincy, MA 02269-9101  
An International Codes and Standards Organization

Copyright ©  
National Fire Protection Association, Inc.  
One Batterymarch Park  
Quincy, Massachusetts 02269

## **IMPORTANT NOTICE ABOUT THIS DOCUMENT**

NFPA codes, standards, recommended practices, and guides, of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in its codes and standards.

The NFPA disclaims liability for any personal injury, property or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on this document. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making this document available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of this document. Nor does the NFPA list, certify, test or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

## **NOTICES**

All questions or other communications relating to this document and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA documents during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

Users of this document should be aware that this document may be amended from time to time through the issuance of Tentative Interim Amendments, and that an official NFPA document at any point in time consists of the current edition of the document together with any Tentative Interim Amendments then in effect. In order to determine whether this document is the current edition and whether it has been amended through the issuance of Tentative Interim Amendments, consult appropriate NFPA publications such as the *National Fire Codes*<sup>®</sup> Subscription Service, visit the NFPA website at [www.nfpa.org](http://www.nfpa.org), or contact the NFPA at the address listed above.

A statement, written or oral, that is not processed in accordance with Section 5 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

The NFPA does not take any position with respect to the validity of any patent rights asserted in connection with any items which are mentioned in or are the subject of this document, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on this document. Users of this document are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, is entirely their own responsibility.

Users of this document should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action that is not in compliance with applicable laws, and this document may not be construed as doing so.

## **Licensing Policy**

This document is copyrighted by the National Fire Protection Association (NFPA). By making this document available for use and adoption by public authorities and others, the NFPA does not waive any rights in copyright to this document.

**1. Adoption by Reference**—Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders, or similar instruments. Any deletions, additions, and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. The term "adoption by reference" means the citing of title and publishing information only.

**2. Adoption by Transcription**—**A.** Public authorities with lawmaking or rule-making powers only, upon written notice to the NFPA (Attention: Secretary, Standards Council), will be granted a royalty-free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders, or similar instruments having the force of law, provided that: (1) due notice of NFPA's copyright is contained in each law and in each copy thereof; and (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction's lawmaking or rule-making process. **B.** Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rule-making powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Secretary, Standards Council), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if any, noted separately, provided that due notice of NFPA's copyright is contained in each copy. Such license shall be granted only upon agreement to pay NFPA a royalty. This royalty is required to provide funds for the research and development necessary to continue the work of NFPA and its volunteers in continually updating and revising NFPA standards. Under certain circumstances, public authorities with lawmaking or rule-making powers may apply for and may receive a special royalty where the public interest will be served thereby.

**3. Scope of License Grant**—The terms and conditions set forth above do not extend to the index of this document.

(For further explanation, see the Policy Concerning the Adoption, Printing, and Publication of NFPA Documents, which is available upon request from the NFPA.)

Copyright © 1998 NFPA, All Rights Reserved

**NFPA 55**  
**Standard for the**  
**Storage, Use, and Handling of**  
**Compressed and**  
**Liquefied Gases in Portable Cylinders**

**1998 Edition**

This edition of NFPA 55, *Standard for the Storage, Use, and Handling of Compressed and Liquefied Gases in Portable Cylinders*, was prepared by the Technical Committee on Industrial and Medical Gases and acted on by the National Fire Protection Association, Inc., at its Fall Meeting held November 17–19, 1997, in Kansas City, MO. It was issued by the Standards Council on January 16, 1998, with an effective date of February 6, 1998, and supersedes all previous editions.

Changes other than editorial are indicated by a vertical rule in the margin of the pages on which they appear. These lines are included as an aid to the user in identifying changes from the previous edition.

This edition of NFPA 55 was approved as an American National Standard on March 31, 1998.

**Origin and Development of NFPA 55**

NFPA 55 was developed by the Industrial and Medical Gases Committee in recognition of the need to provide information on the use of cylinder gases in one standard. The Compressed Gas Association assisted the project by submitting a draft that was used as the framework for the standard.

NFPA 55 supersedes NFPA 43C, *Code for the Storage of Gaseous Oxidizing Materials*, which was developed by the Committee on Hazardous Chemicals and transferred to the Industrial and Medical Gases Committee. The committee believed that one standard covering storage of all gas cylinders was needed and, with the new NFPA 55, the need for NFPA 43C no longer existed.

Since this standard was introduced in 1993, it has been widely used and accepted by users of different types of gases as a single source covering requirements for installation and usage of gases in portable cylinders. This second edition clarifies many requirements and provides additional advisory information to assist the users of the standard. Editorial changes were also incorporated for clarity.

## Technical Committee on Industrial and Medical Gases

**Charles B. Henrici**, *Chair*

River Forest Fire Dept., IL [E]  
Rep. Int'l Assn. of Fire Chiefs

**Francis X. Bender**, Hazards Research Corp., NJ [SE]

**Carl A. Caves**, U.S. Dept. of Energy, MD [U]

**Rick Ginn**, Wright Brothers, Inc., OH [M]

**Dennis J. Murray**, KMS-Medical Gas System Consultants Ltd,  
MI [U]

Rep. American Hospital Assn.

**Douglas F. Nelson**, Industrial Risk Insurers, PA [I]

**John T. Pavlovcak**, Air Products & Chemicals, Inc., PA [IM]

Rep. Compressed Gas Assn.

**Samir Shiban**, Intel Corp., OR [U]

**David N. Simon**, Air Liquide America Corp., TX [IM]

Rep. Compressed Gas Assn.

**Michael W. St. Clair**, The Ohio State University, OH [U]

Rep. NFPA Industrial Fire Protection Section

**Randolph Viscomi**, ARC Chemical, NY [IM]

**Lionel Wolpert**, BOC Gases, NJ [IM]

Rep. Compressed Gas Assn.

**Robert A. Zeman**, Underwriters Laboratories Inc., IL [RT]

### Alternates

**Marshall Issen**, Underwriters Laboratories Inc., IL [RT]

(Alt. to R. A. Zeman)

**William A. Thornberg**, Industrial Risk Insurers, CT [I]

(Alt. to D. F. Nelson)

**Gary F. Trojak**, The Chlorine Inst., DC [M]

(Voting Alt. to The Chlorine Inst.)

### Nonvoting

**Wendell Glasier**, U.S. Dept. of Labor, OSHA, DC

(Alt. to J. Slattery)

**F. K. Kitson** Safety Assoc., VA

(Member Emeritus)

**Joanne E. Slattery**, U.S. Department of Labor, OSHA, DC

**Amy B. Spencer**, NFPA Staff Liaison

*This list represents the membership at the time the Committee was balloted on the text of this edition. Since that time, changes in membership may have occurred. A key to classifications is found at the back of this document.*

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

**Committee Scope:** This Committee shall have primary responsibility for documents on the storage, transfer, and use of industrial gases. Included are the storage and handling of such gases in their gaseous or liquid phases; the installation of associated storage, piping, and distribution equipment; and operating practices. The Committee also has a technical responsibility for contributions in the same areas for medical gases and clean rooms.

## Contents

<p><b>Chapter 1 General</b> ..... 55- 4</p> <p>  1-1 Scope ..... 55- 4</p> <p>  1-2 Alternate Materials and Procedures ..... 55- 4</p> <p>  1-3 Training ..... 55- 4</p> <p>  1-4 Definitions ..... 55- 4</p> <p><b>Chapter 2 Storage</b>..... 55- 6</p> <p>  2-1 General Storage Requirements ..... 55- 6</p> <p>  2-2 Flammable Gases ..... 55- 6</p> <p><b>Chapter 3 Toxic Gases</b>..... 55- 7</p> <p>  3-1 General Requirements ..... 55- 7</p> <p>  3-2 Health 4 Storage Requirements ..... 55- 8</p> <p>  3-3 Health 3 Storage Requirements ..... 55- 8</p> <p>  3-4 Leakage Mitigation ..... 55- 8</p> <p><b>Chapter 4 Hazard Warnings</b> ..... 55- 8</p> <p>  4-1 Hazard Identification ..... 55- 8</p> <p>  4-2 Labeling Requirements ..... 55- 8</p> <p>  4-3 Label Maintenance ..... 55- 8</p> <p><b>Chapter 5 Emergency Plan</b> ..... 55- 8</p> <p>  5-1 Emergency Plan Requirements ..... 55- 8</p>	<p><b>Chapter 6 Compressed Gas Cylinders</b>..... 55- 9</p> <p>  6-1 Design and Construction ..... 55- 9</p> <p>  6-2 Defective Cylinders ..... 55- 9</p> <p>  6-3 Cylinders Containing Residual Gas ..... 55- 9</p> <p>  6-4 Valve Protective Caps ..... 55- 9</p> <p>  6-5 Valve Outlet Caps or Plugs ..... 55- 9</p> <p>  6-6 Securing Cylinders ..... 55- 9</p> <p>  6-7 Cylinder Orientation ..... 55- 9</p> <p>  6-8 Cylinders Exposed to Fire ..... 55- 9</p> <p>  6-9 Exposure to Electrical Circuits ..... 55- 9</p> <p>  6-10 Temperature Limits ..... 55- 9</p> <p><b>Chapter 7 Safety Precautions</b> ..... 55- 9</p> <p>  7-1 Ignition Source Control ..... 55- 9</p> <p>  7-2 Fire Protection and Detection Systems ..... 55- 9</p> <p>  7-3 Standby Power ..... 55- 9</p> <p>  7-4 Compressed Gas Cabinets ..... 55- 9</p> <p>  7-5 Emergency Equipment ..... 55- 9</p> <p><b>Chapter 8 Referenced Publications</b> ..... 55-10</p> <p><b>Appendix A Explanatory Material</b> ..... 55-10</p> <p><b>Appendix B Referenced Publications</b> ..... 55-12</p> <p><b>Index</b> ..... 55-13</p>
---	---

## NFPA 55

**Standard for the  
Storage, Use, and Handling of  
Compressed and  
Liquefied Gases in Portable Cylinders**

## 1998 Edition

NOTICE: An asterisk (\*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Appendix A.

Information on referenced publications can be found in Chapter 8 and Appendix B.

## Chapter 1 General

## 1-1 Scope.

**1-1.1** This standard applies to the storage, use, and handling of compressed and liquefied gases in portable cylinders in all occupancies.

**1-1.2** This standard shall not apply to the following:

- (a) \*Off-site transportation of compressed gases
- (b) Storage, use, and handling of cylinders at gas manufacturer and distributor facilities
- (c) Storage, use, and handling of radioactive gases
- (d) \*Storage, use, and handling of medical gases at health care facilities
- (e) \*Cryogenic liquids in bulk and portable containers
- (f) \*Systems for gases, each containing more than 20,000 scf (566 m<sup>3</sup>) of oxygen, 3000 scf (85 m<sup>3</sup>) of hydrogen, 5000 scf (142 m<sup>3</sup>) of acetylene
- (g) Gas systems consisting only of hydrogen (Such systems shall be in accordance with NFPA 50A, *Standard for Gaseous Hydrogen Systems at Consumer Sites*.)
- (h) \*Storage and use of more than a total of 735 lb (333 kg) water capacity [nominal 300 lb (136 kg) propane] of liquefied flammable gases
- (i) Systems consisting of a single cylinder of oxygen and a single cylinder of fuel gas used for welding and cutting
- (j) Compressed and liquefied gases in use or in separate storage areas in quantities less than those specified in

Table 1-1.2(a) and Table 1-1.2(b), except as specified elsewhere in this standard

- (k) \*Flammable gases used as a vehicle fuel when stored on the vehicle
- (l) \*The handling and use of compressed or liquefied gases in laboratory work areas covered by NFPA 45, *Standard on Fire Protection for Laboratories Using Chemicals*

**1-2 Alternate Materials and Procedures.** The provisions of this standard are not intended to prevent the use of any material, method of construction, or procedure not specifically prescribed herein, provided any such alternate is acceptable to the authority having jurisdiction. (See *Section 1-4*.) The authority having jurisdiction shall require that sufficient evidence be submitted to substantiate any claims made regarding the safety of such alternates.

**1-3 Training.** Persons responsible for or working in the areas where compressed gases are produced, stored, handled, or used shall be trained in the chemical and physical properties of the materials and the appropriate emergency response.

**1-4 Definitions.** For the purpose of the standard, the following terms are defined.

**Absolute Pressure.** Pressure based on a zero reference point, the perfect vacuum. Measured from this reference point, the standard atmospheric pressure at sea level is 14.7 psia (an absolute pressure of 101 kPa). Absolute pressure is commonly denoted as psia.

**Approved.\*** Acceptable to the authority having jurisdiction.

**ASTM.** American Society for Testing and Materials.

**Authority Having Jurisdiction.\*** The organization, office, or individual responsible for approving equipment, an installation, or a procedure.

**CFR.** *Code of Federal Regulations*.

**CGA.** The Compressed Gas Association.

**Compressed Gas (Nonliquefied).** A gas, other than in solution, that in a packaging under the charged pressure is entirely gaseous at a temperature of 68°F (20°C).

**Continuous Gas Detection System.** A gas detection system where the instrument is maintained in continuous operation and the interval between sampling of any point does not exceed 30 minutes.

**Cryogenic Liquid.** A liquid having a boiling point lower than -150°F (-101°C) at 14.7 psia (an absolute pressure of 101 kPa).

**Table 1-1.2(a) Quantities Exempt from the Requirements of NFPA 55 in Industrial, Mercantile, and Storage Occupancies**

	Unsprinklered Areas		Sprinklered Areas	
	No Cabinet	Cabinet	No Cabinet	Cabinet
Toxic Gas (Health 4) <sup>a</sup>	0 scf (0 m <sup>3</sup> )	20 scf (0.57 m <sup>3</sup> )	0 scf (0 m <sup>3</sup> )	40 scf (1.1 m <sup>3</sup> )
Toxic Gas (Health 3) <sup>a</sup>				
Liquefied	100 lb (45.3 kg)	200 lb (90.7 kg)	100 lb (45.3 kg)	200 lb (90.7 kg)
Compressed	400 scf (11.3 m <sup>3</sup> )	650 scf (18.4 m <sup>3</sup> )	400 scf (11.3 m <sup>3</sup> )	650 scf (18.4 m <sup>3</sup> )
Pyrophoric Gas	500 scf (14.1 m <sup>3</sup> )	500 scf (14.1 m <sup>3</sup> )	1500 scf (42.5 m <sup>3</sup> )	1500 scf (42.5 m <sup>3</sup> )
Flammable Gas				
Liquefied	100 lb (45.3 kg)	100 lb (45.3 kg)	100 lb (45.3 kg)	100 lb (45.3 kg)
Compressed	400 scf (11.3 m <sup>3</sup> )	400 scf (11.3 m <sup>3</sup> )	400 scf (11.3 m <sup>3</sup> )	400 scf (11.3 m <sup>3</sup> )
Oxidizing Gas	400 scf (11.3 m <sup>3</sup> )	400 scf (11.3 m <sup>3</sup> )	400 scf (11.3 m <sup>3</sup> )	400 scf (11.3 m <sup>3</sup> )
Nonflammable Gas	1000 scf (28.3 m <sup>3</sup> )	1000 scf (28.3 m <sup>3</sup> )	2000 scf (56.6 m <sup>3</sup> )	2000 scf (56.6 m <sup>3</sup> )

<sup>a</sup>Health hazard rating in accordance with NFPA 704, *Standard System for the Identification of the Hazards of Materials for Emergency Response*.

**Table 1-1.2(b) Quantities Exempt from the Requirements of NFPA 55 in Occupancies Other than Industrial, Mercantile, and Storage**

Gas	Quantities
Toxic Gas (Health 4) <sup>a</sup>	0 scf (0 m <sup>3</sup> )
Toxic Gas (Health 3) <sup>a</sup>	
Liquefied	100 lb (45.3 kg)
Compressed	400 scf (11.3 m <sup>3</sup> )
Pyrophoric Gas	0 scf (0 m <sup>3</sup> )
Flammable Gas	
Liquefied	5 lb (2.2 kg)
Compressed	75 scf (2.1 m <sup>3</sup> )
Oxidizing Gas	400 scf (11.3 m <sup>3</sup> ) <sup>b</sup>
Nonflammable Gas	400 scf (11.3 m <sup>3</sup> )

<sup>a</sup>Health hazard rating in accordance with NFPA 704, *Standard System for the Identification of the Hazards of Materials for Emergency Response*.

<sup>b</sup>Unlimited for residential health care applications.

**Cylinder.** A portable compressed gas container, fabricated to or authorized for use by the U.S. Department of Transportation (DOT), or fabricated to Transport Canada (TC) or the “Rules for the Construction of Unfired Pressure Vessels,” Section VIII, ASME *Boiler & Pressure Vessel Code*.

**Distributor.** Any organization that repackages gases and handles compressed gas containers but does not consume compressed gases.

**Existing Facilities.** An existing facility storing, using, or handling compressed or liquefied gases that is not in strict compliance with this standard shall be permitted to continue in operation where such continued operation does not constitute a distinct hazard to life or adjoining property.

**Fire Area.** The floor area enclosed and bounded by fire walls, fire separation assemblies, or exterior walls of a building to restrict the spread of fire.

**Flammable Gas.** A gas that is flammable at atmospheric temperature and pressure in a mixture of 13 percent or less (by volume) with air, or that has a flammable range with air wider than 12 percent, regardless of the lower limit.

**Gas Manufacturer.** A business that produces compressed gases or fills portable gas cylinders or containers.

**Handling.** Moving, connecting, or disconnecting a compressed or liquefied gas cylinder.

**Hazard Rating.** The numerical rating of the health, flammability, and self-reactivity hazards of the material, including its reaction with water, as defined in NFPA 704, *Standard System for the Identification of the Hazards of Materials for Emergency Response*.

**Limited-Combustible.** As applied to a building construction material—a material not complying with the definition of noncombustible material that, in the form in which it is used, has a potential heat value not exceeding 3500 Btu/lb (8141 kJ/kg), and that complies with one of the following paragraphs (a) or (b). Materials subject to increase in combustibility or flame spread rating beyond the limits herein established through the effects of age, moisture, or other atmospheric conditions shall be considered combustible.

(a) Materials having a structural base of noncombustible material, with a surfacing not exceeding a thickness of  $\frac{1}{8}$  in. (3.2 mm) that has a flame spread rating not greater than 50

(b) Materials, in the form and thickness used, other than as described in (a), that have neither a flame spread rating greater than 25 nor evidence of continued progressive combustion, and of such composition that surfaces that would be exposed by cutting through the material on any plane would have neither a flame spread rating greater than 25 nor evidence of continued progressive combustion

**Liquefied Gas.** A gas, other than in solution, that in a packaging under the charged pressure exists both as a liquid and a gas at a temperature of 68°F (20°C).

**Material Safety Data Sheet (MSDS).** Written or printed material concerning a hazardous material that is prepared in accordance with the provisions of OSHA 29 *CFR* 1910.1200.

**Nesting.** A method of securing cylinders upright in a tight mass using a contiguous three-point contact system whereby all cylinders in a group have a minimum of three contact points with other cylinders or a solid support structure (i.e., wall, railing).

**Nonflammable Gas.** A gas that does not meet the definition of a flammable gas.

**OSHA.** The Occupational Safety Health Administration of the U.S. Department of Labor.

**Oxidizing Gas.** A gas that can support and accelerate combustion of other materials.

**Pyrophoric Gas.** A gas that will spontaneously ignite in air at or below a temperature of 130°F (54.4°C).

**Scf.** One cubic foot of gas at 70°F (21°C) and 14.7 psia (an absolute pressure of 101 kPa).

**Shall.** Indicates a mandatory requirement.

**Standard.** A document, the main text of which contains only mandatory provisions using the word “shall” to indicate requirements and which is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions shall be located in an appendix, footnote, or fine-print note and are not to be considered a part of the requirements of a standard.

**Storage.** An inventory of compressed or liquefied gases in containers that are not in the process of being examined, serviced, refilled, loaded, or unloaded.

**Toxic Gas.** A gas having a health hazard rating of 3 or 4 as defined in NFPA 704, *Standard System for the Identification of the Hazards of Materials for Emergency Response*.

**Treatment System.** An assembly of equipment capable of processing a toxic gas and reducing the gas concentration to a predetermined safe level at the point of discharge from the system to the atmosphere.

**Use.** The consumption of a compressed or liquefied gas in a nonrecoverable manner.

**User.** An individual, group, or organization who utilizes the compressed or liquefied gas in a nonrecoverable manner.

**Valve Outlet Caps and Plugs.** Removable caps and plugs that form a gastight seal on valve outlets of certain gases and, in some cases, provide valve thread protection.

**Valve Protection Device.** A device attached to the neck ring or body of the cylinder for the purpose of protecting the cylinder valve from being struck or damaged from impact resulting from a fall or an object striking the cylinder.

**Valve Protective Cap.** A rigid, removable cover provided for compressed gas container valve protection.

## Chapter 2 Storage

### 2-1\* General Storage Requirements.

**2-1.1** This chapter shall apply to the storage of all compressed and liquefied gases.

**2-1.2** Storage areas shall be secured against unauthorized entry.

**2-1.3** Gases shall be separated in storage in accordance with Table 2-1.5. When a gas is classified in more than one category, all compatibilities shall be checked and the most stringent separation shall be used.

**2-1.4** Flammable gases shall be stored in accordance with this standard and the following:

- (a) NFPA 50A, *Standard for Gaseous Hydrogen Systems at Consumer Sites*, for hydrogen at consumer sites
- (b) NFPA 51, *Standard for the Design and Installation of Oxygen-Fuel Gas Systems for Welding, Cutting, and Allied Processes*, for acetylene and other fuel gases used in welding, cutting, and similar applications within the scope of NFPA 51
- (c) NFPA 58, *Liquefied Petroleum Gas Code*, for butane, propane, and other gases under the scope of NFPA 58

**2-1.5\*** Toxic gases shall be stored in accordance with Table 2-1.5 and Chapter 3.

**2-1.6 Storage Location.** Where oxygen is stored or used as a liquid, surfacing of noncombustible material shall be provided under the liquid transfer connections of the storage container.

**2-1.6.1 Outdoor Storage.** Outdoor storage areas shall have a minimum of 25 percent of the perimeter open to the atmosphere. This open space shall be permitted to incorporate chain link fence, lattice construction, open block, or similar materials for the full height and width of the opening. The following are requirements for outdoor storage:

- (a) Storage areas shall be kept clear of dry vegetation and combustible materials for a minimum distance of 15 ft (4.6 m).
- (b) Cylinders stored outside shall not be placed on the ground (earth) or on surfaces where water can accumulate.
- (c) Storage areas shall be provided with physical protection from vehicle damage.

(d) Storage areas shall be permitted to be covered with canopies of noncombustible construction.

**2-1.6.2 Indoor Storage.** Heated indoor storage areas shall be arranged so that stored cylinders or other containers cannot be spot heated or heated above 125°F (51.7°C).

**2-1.6.3\* Other General Storage Requirements.** The following are general storage requirements:

- (a) When two or more compressed gases are stored in a gas cabinet, the gases shall be compatible. (*See Table 2-1.5.*)
- (b) Spill control, drainage, and secondary containment shall not be required for the storage of compressed gases.
- (c) Floors of storage areas shall be of noncombustible or limited-combustible construction.
- (d) Shelves used for the storage of cylinders shall be of noncombustible construction and designed to support the weight of the cylinders stored.
- (e) For separation from incompatible or combustible materials, storage of compressed gases shall be completed in either of the following ways:
  1. Segregated from any incompatible or combustible materials storage by a minimum distance of 20 ft (6.1 m)
  2. Isolated from any incompatible or combustible material storage by a barrier of noncombustible material at least 5 ft (1.5 m) high that has a minimum fire resistance rating of 1/2 hour

### 2-2 Flammable Gases.

**2-2.1** The following general requirements for storage of flammable gases shall apply.

**2-2.1.1** The storage location of nonliquefied flammable gas cylinders in buildings shall be determined by the total volume of flammable gas and shall be in the order of preference as indicated by roman numerals in Table 2-2.1.1.

**2-2.1.2** Storage of compressed flammable gases in other than industrial and storage occupancies shall not exceed the quantities listed in Table 1-1.2(b). Storage of compressed flammable gases in mercantile and business occupancies shall be limited to 400 scf (11.3 m<sup>3</sup>). Storage of liquefied flammable gases in all occupancies shall be in accordance with NFPA 58, *Liquefied Petroleum Gas Code*.

*Exception: Facilities that primarily distribute gases and related equipment that are open to the public.*

**2-2.1.3** Electrical equipment shall conform to the provisions of NFPA 70, *National Electrical Code*<sup>®</sup>, Article 501 for Class I, Division 2 locations.

Table 2-1.5 Separation of Gas Cylinders by Hazard

Gas Hazard Category	Nonflammable	Oxidizing	Flammable	Pyrophoric	Toxic
Toxic	C	20 ft (6.1 m)	20 ft (6.1 m)	20 ft (6.1 m)	—
Pyrophoric	C	20 ft (6.1 m)	20 ft (6.1 m)	—	20 ft (6.1 m)
Flammable	C	20 ft (6.1 m)	—	20 ft (6.1 m)	20 ft (6.1 m)
Oxidizing	C	—	20 ft (6.1 m)	20 ft (6.1 m)	20 ft (6.1 m)
Nonflammable	—	C	C	C	C

Notes:

1. C = Compatible. No separation required.

2. The 20-ft (6.1 m) distance shall be permitted to be reduced without limit when separated by a barrier of noncombustible materials at least 5 ft (1.5 m) high that has a fire resistance rating of at least 1/2 hour.

Table 2-2.1.1 Location Preference of Flammable Gas Storage Areas

Location	Total Volume of Flammable Gas (scf)		
	Up to 2500 scf (70.8 m <sup>3</sup> )	2501 scf (70.8 m <sup>3</sup> ) to 5000 scf (141.6 m <sup>3</sup> )	In Excess of 5000 scf (141.6 m <sup>3</sup> )
Outdoors	I	I	I
In a Separate Building	II	II	II
In a Separate Room	III	III	III
Inside Buildings Not in a Separate Room and Exposed to Other Occupancies	IV	Not Permitted	Not Permitted

*Exception:* Electrical equipment in ventilated storage rooms larger than 10,000 ft<sup>3</sup> (283 m<sup>3</sup>), containing 2500 scf (70.79 m<sup>3</sup>) or less of flammable gases, and with no cylinder sampling activity shall be permitted to be unclassified.

**2-2.1.4** Smoking and open flames shall not be permitted in storage areas or within 20 ft (6.1 m) of storage areas.

**2-2.1.5** Gas cylinders shall be stored a minimum distance of 20 ft (6.1 m) from storage of flammable and combustible liquids and solids.

**2-2.1.6** Liquefied flammable gas cylinders shall be stored in the upright position or such that the pressure relief valve is in direct communication with the vapor space of the cylinder.

**2-2.1.7** Storage of multiple groups of cylinders of flammable gases, each 2500 scf (70.79 m<sup>3</sup>) or less, in one fire area shall be permitted where the groups are separated by a minimum distance of 100 ft (30.5 m).

*Exception:* The separation distance shall be permitted to be reduced to 0 ft when separated by masonry walls with a fire resistance rating of 2 hours.

**2-2.1.8** Different flammable gases shall be permitted to be stored together in a group.

**2-2.2** The following requirements shall apply to the indoor storage of flammable gases between 2501 scf (70.82 m<sup>3</sup>) and 5000 scf (141.6 m<sup>3</sup>) in any fire area.

**2-2.2.1** Gas cylinders shall be stored in a room or enclosure with a minimum 1-hour fire resistance rating.

*Exception:* Gas cylinders shall be permitted to be stored in areas not within a 1-hour fire resistance rating where the entire building is equipped throughout with an automatic sprinkler system designed in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*. The sprinkler system protecting the gas cylinder storage, and for a distance of 25 ft (7.6 m) beyond in all directions, shall be capable of providing a minimum density of 0.30 gpm/ft<sup>2</sup> (0.012 m<sup>3</sup>/min m<sup>2</sup>) over the most hydraulically remote 2500 ft<sup>2</sup>.

**2-2.2.2** Multiple groups of cylinders within one sprinklered fire area shall be permitted where the groups are separated by a minimum distance of 100 ft (30.5 m).

*Exception No. 1:* This distance shall be permitted to be reduced to 50 ft (15 m) in buildings protected with a sprinkler system designed for Ordinary Hazard, Group 1 occupancies or Light Hazard occupancies in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*.

*Exception No. 2:* This distance shall be permitted to be reduced to 25 ft (7.6 m) in buildings where the occupancy between storage areas is free of combustible materials and protected with a sprinkler system designed for Ordinary Hazard, Group 1 occupancies or Light Hazard

occupancies in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*.

**2-2.2.3** Gas cylinder storage rooms shall be provided with natural or mechanical ventilation designed to provide a minimum of 1 cfm/ft<sup>2</sup> (0.3 m<sup>3</sup>/min·m<sup>2</sup>) of floor area. Ventilation systems shall discharge a minimum of 50 ft (15 m) from intakes of air-handling systems, air-conditioning equipment, and air compressors.

**2-2.3** The following requirements shall apply to the indoor storage of greater than 5000 scf (141.6 m<sup>3</sup>) of flammable gases in any fire area.

**2-2.3.1** Gas cylinders shall be stored in a room or enclosure with a minimum fire resistance rating of 2 hours. At least one wall of the room shall be an exterior building wall.

**2-2.3.2** Gas cylinder storage rooms shall be provided with a sprinkler system designed in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*. The sprinkler system shall be capable of providing a minimum density of 0.30 gpm/ft<sup>2</sup> (0.012 m<sup>3</sup>/min·m<sup>2</sup>) over the most hydraulically remote 2500 ft<sup>2</sup> (232.25 m<sup>2</sup>) or the entire room area, whichever is smaller.

**2-2.3.3** Gas cylinder storage rooms shall be provided with mechanical ventilation designed to provide a minimum of 1 cfm/ft<sup>2</sup> (0.3 m<sup>3</sup>/min·m<sup>2</sup>) of floor area. Ventilation systems shall discharge a minimum of 50 ft (15 m) from intakes of air-handling systems, air-conditioning equipment, and air compressors.

## Chapter 3 Toxic Gases

**3-1 General Requirements.** In addition to the requirements of Chapter 2, the following specific requirements for storage of toxic gases shall apply.

**3-1.1** Indoor storage areas used to store toxic gases shall be equipped with a continuous gas detection system that provides an alarm to warn of the presence of toxic gases in levels that present a hazard to life.

*Exception:* \*A continuous gas detection system shall not be required for toxic gases with a health rating of 3 when the upper range of the odor threshold limit of the gas is at a level below the permissible exposure level of the gas.

**3-1.2** Exhaust ventilation systems shall be installed in all indoor areas used for toxic gases.

*Exception:* Exhaust ventilation systems shall not be required for toxic gases with a health hazard rating of 3 when the total amount stored is less than 650 scf (18.4 m<sup>3</sup>), or 810 scf (22.9 m<sup>3</sup>) [150 lb (68 kg)] for chlorine.

**3-1.3** Exhaust ventilation systems for indoor toxic gas storage shall comply with the following, except where natural ventilation prevents toxic accumulations of gases being stored.

- (a) Where gas cabinets are not used, mechanical ventilation shall be operated continuously at a rate of not less than 1 cfm/ft<sup>2</sup> (0.3 m<sup>3</sup>/min·m<sup>2</sup>) of floor area of the storage area.

*Exception No. 1: Alternate engineered systems that recognize the properties of the gas being stored and approved by the authority having jurisdiction.*

*Exception No. 2: When the area is not occupied, the ventilation rate shall be permitted to be reduced provided ventilation is increased in the event concentrations exceed a predetermined set point below that concentration that poses a hazard to life.*

- (b) A manual ventilation shutoff shall be provided outside the room adjacent to the access door into the room or in a location approved by the authority having jurisdiction. The switch shall be labeled "Ventilation System Emergency Shutoff."
- (c) Exhaust ventilation shall not be recirculated within a room or building.
- (d) Ventilation shall not be required to be operated when no toxic gas is being stored.

**3-1.4** Outdoor storage of toxic gases shall be located 75 ft (22 m) from a line of property that can be built upon, public ways, places of public assembly, and buildings not associated with the manufacture or use of the gases in storage. Such storage areas shall be secured from unauthorized access.

**3-1.5** While in storage and while being handled, cylinders of toxic gases shall have valve protective devices or caps and gastight valve outlet caps or plugs in place. This shall apply to all cylinders whether full, partially full, or empty.

*Exception: Cylinders being connected for use or disconnected.*

**3-2 Health 4 Storage Requirements.** User locations storing toxic gases with a health hazard rating of 4 in accordance with NFPA 704 shall meet the following requirements.

*Exception: Chlorine storage areas shall meet the requirements of Section 3-3.*

**3-2.1** Storage within buildings shall be in gas cabinets or exhausted enclosures having positive exhaust ventilation.

*Exception: Other means acceptable to the authority having jurisdiction that provide an equivalent level of safety.*

**3-2.2** When storage is not in buildings, at least one gas cabinet or exhausted enclosure shall be provided for the handling of leaking cylinders. The cabinet or enclosure shall be located within or adjacent to the outdoor storage area.

**3-2.3** Gas cabinets or exhausted enclosures shall be connected to treatment systems.

**3-3\* Health 3 Storage Requirements.** User locations storing toxic gases with a health hazard rating of 3 in accordance with NFPA 704 shall have equipment on site that shall prevent gas from leaking cylinders from escaping into the building or atmosphere, or shall have equipment readily available.

**3-4\* Leakage Mitigation.** At gas manufacturers' and distributors' facilities that handle toxic gases and have a health hazard rating of 4 in accordance with NFPA 704, a containment device or other equivalent equipment shall be on site or

readily available. Such containment device or equivalent equipment shall be capable of containing, controlling, processing, or mitigating leaks from compressed gas cylinders and shall be permitted to be used in lieu of gas cabinets and treatment systems.

## Chapter 4 Hazard Warnings

### 4-1 Hazard Identification.

**4-1.1** Hazard identification signs shall be placed at all entrances to locations where compressed gases are produced, stored, used, or handled.

*Exception: The authority having jurisdiction shall be permitted to waive this requirement where consistent with safety.*

**4-1.2 Signs.** Signage shall be handled in the following manner:

- (a) Signs shall not be obscured or removed. Signs shall be in English as a primary language or in symbols.
- (b) Signs prohibiting smoking or open flames within 20 ft (6.1 m) shall be provided in areas where toxic, flammable, oxidizing, or pyrophoric gases are produced, handled, stored, or used.

**4-2\* Labeling Requirements.** Individual compressed gas cylinders shall be marked or labeled in accordance with DOT and OSHA requirements.

**4-3 Label Maintenance.** The labels applied by the gas manufacturer to identify the compressed or liquefied gas cylinder contents shall not be altered or removed by the user.

## Chapter 5 Emergency Plan

**5-1 Emergency Plan Requirements.** An emergency response plan shall be prepared and updated wherever liquefied or compressed gases are produced, handled, stored, or used. The plan shall be available for inspection by the authority having jurisdiction upon reasonable notice. The following information shall be included in the emergency plan. (*See 29 CFR 1910.120 and 1910.1200.*)

- (a) The type of emergency equipment available and its location
- (b) A brief description of any testing or maintenance programs for the available emergency equipment
- (c) An indication that hazard identification labeling is provided for each storage area
- (d) Location of posted emergency response procedures
- (e) Material safety data sheets (MSDSs) shall be available for all gases stored on the site.
- (f) A list of responsible personnel who are designated and trained to be liaison personnel for the fire department. These individuals shall aid the emergency responders in pre-emergency planning; identify the location of flammable, pyrophoric, oxidizing, and toxic gases; access material safety data sheets; and shall be knowledgeable in the site emergency response procedures.
- (g) A list of the types and quantities of compressed and liquefied gases normally at the facility

## Chapter 6 Compressed Gas Cylinders

**6-1 Design and Construction.** Cylinders shall be designed, fabricated, tested, and marked (stamped) in accordance with regulations of DOT, TC, or the “Rules for the Construction of Unfired Pressure Vessels,” Section VIII, ASME *Boiler & Pressure Vessel Code*.

**6-2 Defective Cylinders.** Defective cylinders shall be returned to the supplier. Suppliers shall repair the cylinder, remove it from service, or dispose of it in an approved manner.

**6-3 Cylinders Containing Residual Gas.** Compressed gas cylinders having residual product shall be treated as full except when being examined, serviced, or refilled by a gas manufacturer or distributor.

**6-4 Valve Protective Caps.** Where compressed gas cylinders are designed to accept valve protective caps, the user shall keep such caps on compressed gas cylinders at all times except when being filled or connected for use.

**6-5 Valve Outlet Caps or Plugs.** Where gastight valve outlet caps or plugs are provided, the user shall keep such devices on the valve outlet at all times except when compressed gas cylinders are being filled or connected for use.

**6-6 Securing Cylinders.** Compressed or liquefied gas cylinders in use or in storage shall be secured to prevent them from falling or being knocked over.

*Exception No. 1: Compressed gas cylinders in the process of examination, servicing, and refilling.*

*Exception No. 2: At cylinder-filling plants and distributors' warehouses, the nesting of cylinders shall be permitted to secure cylinders.*

**6-7 Cylinder Orientation.** Compressed gas cylinders shall be permitted to be stored and used in the horizontal position.

**6-8 Cylinders Exposed to Fire.** Compressed gas cylinders exposed to fire shall not be used until they are requalified in accordance with the pressure vessel code under which they were manufactured.

**6-9 Exposure to Electrical Circuits.** Compressed gas cylinders shall not be placed where they could become a part of an electrical circuit.

**6-10 Temperature Limits.** Compressed gas cylinders shall not be exposed to temperatures exceeding 125°F (52°C). Cylinders shall not be subjected to direct heating to increase vapor pressure.

*Exception: When cylinders are being refilled.*

## Chapter 7 Safety Precautions

### 7-1 Ignition Source Control.

**7-1.1** Smoking or open flames shall not be permitted within 20 ft (6.1 m) of any area where flammable, oxidizing, pyrophoric, or toxic compressed gases are stored.

**7-1.2\*** Where ignition of a flammable gas by static electricity is possible, means shall be provided to prevent a static discharge.

**7-1.3** Electrical equipment and wiring in areas where flammable gases are produced, stored, handled, or used shall be

installed in accordance with the provisions of NFPA 70, *National Electrical Code*®.

### 7-2 Fire Protection and Detection Systems.

**7-2.1** Separate rooms and areas of buildings for use or storage of toxic or pyrophoric gases shall be protected by an automatic fire extinguishing system in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*, or NFPA 15, *Standard for Water Spray Fixed Systems for Fire Protection*.

**7-2.2** A fire alarm activation station or approved emergency signal device shall be installed adjacent to exit doors of buildings and outside of rooms or areas where the toxic, pyrophoric, or flammable gases are used or stored. Activation of the system shall sound a local alarm.

**7-2.3 Smoke Detection.** An approved, supervised smoke detection system shall be provided in rooms or areas where flammable, pyrophoric, and toxic gases are stored indoors. Activation of the detection system shall sound a local alarm.

**7-2.4** Manual alarm, emergency signal, detection, or automatic fire extinguishing systems shall be supervised by an approved central or remote station service or shall initiate an audible or visual signal at a constantly attended on-site location.

**7-3\* Standby Power.** Where mechanical ventilation, treatment systems, temperature control, manual alarm, detection, or other electrically operated systems are required by other provisions of this standard, such systems shall be connected to a standby source of power to automatically supply electrical power in the event of loss of power from the primary source.

**7-4 Compressed Gas Cabinets.** Compressed gas cabinets shall be designed in accordance with this section. Cabinets shall meet the following requirements.

**7-4.1** They shall be labeled on the front of the cabinet in red letters a minimum of 1 in. (25.4 mm) high on contrasting background:

**HAZARDOUS—KEEP FIRE AWAY**

**7-4.2** They shall be operated at negative pressure in relation to the surrounding area.

**7-4.3** They shall be provided with self-closing limited access ports or noncombustible windows to give access to equipment controls. The average velocity of ventilation at the face of access ports or windows shall be not less than 200 ft/min (60.7 m/min) with a minimum of 150 ft/min (45.7 m/min) at any point of the access port or window.

**7-4.4\*** They shall be provided with a treatment system to process all exhausted ventilation from the gas cabinet such that emissions are not a hazard to life. The system shall be sized to treat the total capacity of the largest toxic gas cylinder at the maximum flow rate based on controls in place.

**7-4.5** They shall be provided with self-closing doors.

**7-4.6** They shall be constructed of not less than 12-gauge steel, which shall be permitted to be coated to prevent corrosion.

**7-4.7** They shall be internally sprinklered.

### 7-5 Emergency Equipment.

**7-5.1\* Breathing Apparatus.** When toxic compressed gases are produced, handled, stored, or used, a minimum of two self-contained breathing apparatus shall be provided. The

breathing apparatus shall be suitable for use with the material and shall be located near the immediate area in a location that provides safety to those expected to wear the apparatus.

When the hazard presented by the gas is other than respiratory, other appropriate protective equipment shall be provided.

**7-5.2** At least two employees who are trained in the use of self-contained breathing apparatus shall be available at all times the facility is in use.

*Exception:* With the approval of the authority having jurisdiction, where a formal arrangement has been made, the requirements of 7-5.1 and 7-5.2 shall be permitted to be met by other parties.

## Chapter 8 Referenced Publications

**8-1** The following documents or portions thereof are referenced within this standard as mandatory requirements and shall be considered part of the requirements of this standard. The edition indicated for each referenced mandatory document is the current edition as of the date of the NFPA issuance of this standard. Some of these mandatory documents might also be referenced in this standard for specific informational purposes and, therefore, are also listed in Appendix B.

**8-1.1 NFPA Publications.** National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 1996 edition.

NFPA 15, *Standard for Water Spray Fixed Systems for Fire Protection*, 1996 edition.

NFPA 45, *Standard on Fire Protection for Laboratories Using Chemicals*, 1996 edition.

NFPA 50A, *Standard for Gaseous Hydrogen Systems at Consumer Sites*, 1994 edition.

NFPA 51, *Standard for the Design and Installation of Oxygen-Fuel Gas Systems for Welding, Cutting, and Allied Processes*, 1997 edition.

NFPA 58, *Liquefied Petroleum Gas Code*, 1998 edition.

NFPA 70, *National Electrical Code*<sup>®</sup>, 1996 edition.

NFPA 704, *Standard System for the Identification of the Hazards of Materials for Emergency Response*, 1996 edition.

**8-1.2 Other Publications.**

**8-1.2.1 Government Publication.** U.S. Government Printing Office, 710 North Capitol Street, NW, Washington, DC 20401.

*Code of Federal Regulations*, Title 29, "Hazard Communication," 1910.120 and 1910.1200.

**8-1.2.2 ASME Publication.** American Society of Mechanical Engineers, 345 East 47th Street, New York, NY 10017.

"Rules for the Construction of Unfired Pressure Vessels," Section VIII, Division 1, *ASME Boiler & Pressure Vessel Code*, 1986, and all addenda and errata thru 1988.

**8-1.2.3 Transport Canada Publication.** Transport Canada, Transport Canada Building, Place deVill Tower C, 21st Floor, Ottawa, ON K1A 0N5 Canada.

*Transportation of Dangerous Goods.*

## Appendix A Explanatory Material

*Appendix A is not a part of the requirements of this NFPA document but is included for informational purposes only. This appendix con-*

*tains explanatory material, numbered to correspond with the applicable text paragraphs.*

**A-1-1.2(a)** For regulations on the transportation of gases, see the *Code of Federal Regulations*, Title 49, Parts 100 to 179 (Transportation) and Transportation of Dangerous Goods Regulations of Transport Canada.

**A-1-1.2(d)** For information on storage of medical gases at health care facilities see NFPA 99, *Standard for Health Care Facilities*.

**A-1-1.2(e)** In developing the standard, the committee did not consider applicability to portable containers of cryogenic liquids. The committee intends to expand the document in future editions to cover these containers.

**A-1-1.2(f)** For information on systems of more than 20,000 scf (566 m<sup>3</sup>) of oxygen see NFPA 50, *Standard for Bulk Oxygen Systems at Consumer Sites*. For information on systems of more than 3000 scf (85 m<sup>3</sup>) of hydrogen see NFPA 50A, *Standard for Gaseous Hydrogen Systems at Consumer Sites*. For information on storage of more than 5000 scf (142 m<sup>3</sup>) of acetylene see NFPA 51, *Standard for the Design and Installation of Oxygen-Fuel Gas Systems for Welding, Cutting, and Allied Processes*.

**A-1-1.2(h)** For information on storage and use of more than 735 lb (333 kg) water capacity [nominal 300 lb (136 kg) propane] of liquefied flammable gas see NFPA 58, *Liquefied Petroleum Gas Code*.

**A-1-1.2(k)** For information see NFPA 52, *Standard for Compressed Natural Gas (CNG) Vehicular Fuel Systems* or NFPA 58, *Liquefied Petroleum Gas Code*.

**A-1-2.2(l)** The storage of gases outside of laboratory work areas is covered by this standard.

**A-1-4 Approved.** The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials; nor does it approve or evaluate testing laboratories. In determining the acceptability of installations, procedures, equipment, or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization that is concerned with product evaluations and is thus in a position to determine compliance with appropriate standards for the current production of listed items.

**A-1-4 Authority Having Jurisdiction.** The phrase "authority having jurisdiction" is used in NFPA documents in a broad manner, since jurisdictions and approval agencies vary, as do their responsibilities. Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or individual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

Table A-2-1(a) Nominal Capacities of Some Gas Cylinders

Cylinder Size, (length × diameter in inches)	DOT Specification	Cylinder Pressure at 70°F	Nominal Capacity at 10% Overfill Pressure (scf)					
			Oxygen	Nitrogen	Argon	Air	Helium	Hydrogen
5 <sup>3</sup> / <sub>4</sub> × 32	3A/3AA-2015	2217	64	58	63	59	56	54
7 × 32	3A/3AA-2015	2217	92	85	92	86	81	79
7 × 43	3A/3AA-2015	2217	125	115	125	117	110	107
7 × 43	3AA-2065	2492	141	128	140	130	122	119
7 <sup>1</sup> / <sub>4</sub> × 46	3AA-2015	2217	156	143	155	145	136	133
9 × 51	3A/3AA-2015	2217	251	230	250	233	219	215
9 × 51	3AA-2265	2492	282	255	280	260	244	239
9 <sup>1</sup> / <sub>4</sub> × 55	3AA-2400	2640	337	304	336	310	291	284

Note: DOT permits compressed gas cylinders to be filled to 110% of rated service pressure when a "+" is stamped following the most recent test date.

**A-2-1** See Table A-2-1(a) and Table A-2-1(b).

**A-2-1.5** See Figure A-2-1.5.

**A-2-1.6.3** For additional information on storage of cylinder gases see CGA Publication P-1, *Safe Handling of Compressed Gas in Containers*.

**A-3.1.1 Exception.** See *Odor Thresholds for Chemicals with Established Occupational Health Standards* for an odor threshold rating of gases.

Table A-2-1(b) Nominal Capacities of Acetylene Cylinders

Cylinder Size (length × diameter in inches)	Nominal Acetylene Capacity (scf)
4 × 12	10
6 × 19	40
7 × 25	75
8 × 30	130
10 × 30	190
10 <sup>3</sup> / <sub>4</sub> × 32 <sup>1</sup> / <sub>4</sub>	275
12 × 37	300
12 × 39	360

Note: Acetylene is not compressed in cylinders but is dissolved in a solvent inside the cylinder. Pressure is not a variable.

**A-3-3 Health 3 Storage Requirements.** For chlorine cylinders, a kit specified by The Chlorine Institute, Inc. is available for this purpose.

**A-3-4 Leakage Mitigation.** The requirement for a gas cabinet connected to a treatment system is an appropriate requirement at users' locations for handling leaking toxic gas cylinders containing gases with a health hazard rating of 4. User locations incorporate cylinders both in storage and in use, where the potential for leaks is greater than at gas manufacturers' and distributors' storage locations for these gases.


At gas manufacturers' locations, the handling of these gases is the main business, and the employees are thoroughly trained in the properties and emergency handling of these

products. In fact, the majority of these locations actually house gas suppliers' emergency response teams that respond to emergencies at users' locations.

At these locations, based on the lower risk of leaks and the more highly trained emergency response personnel, it is appropriate to allow a containment device and other equipment to be used in lieu of a gas cabinet and treatment system to handle leaking toxic gas cylinders. With the on-site personnel capable of minimizing and controlling the initial stages of a leak from a cylinder in storage, the proximity of a containment device within up to 2 hours from a storage location is considered to be readily available because most leakage rates are low and continue for many hours.

**A-4-2** For information on labeling of compressed and liquefied gas cylinders see CGA C-7, *Guide to the Preparation of Precautionary Labeling and Marking of Compressed Gas Containers*.

**A-7-1.2** For information on reducing the hazards of static electricity see NFPA 77, *Recommended Practice on Static Electricity*.

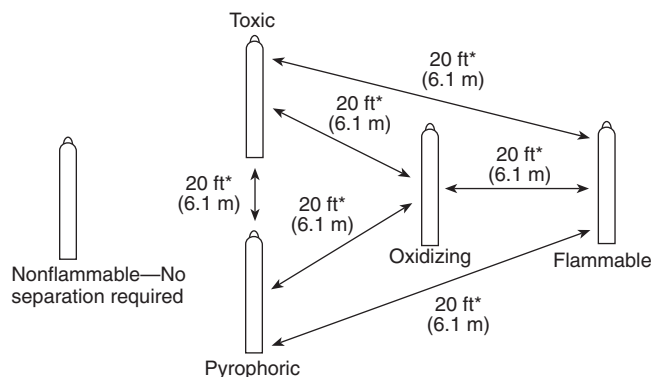

\* The 20-ft (6.1-m) distance may be reduced without limit when separated by a barrier of noncombustible materials at least 5 ft (1.5 m) high that has a fire resistant rating of at least ½ hour.

**Figure A-2-1.5 Separation of gas cylinders by hazard.**

**A-7-3** See NFPA 70, Articles 700 and 701.

**A-7-4.4** If toxic gas leakage is emitted to the atmosphere, regulations of EPA and state and local environmental law can also apply.

**A-7-5.1** A safe area is one that is not likely to be immediately affected by the release of toxic compressed gases in the area of concern.

## Appendix B Referenced Publications

**B-1** The following documents or portions thereof are referenced within this standard for informational purposes only and are thus not considered part of the requirements of this standard unless also listed in Chapter 8. The edition indicated here for each reference is the current edition as of the date of the NFPA issuance of this standard.

**B-1.1 NFPA Publications.** National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 50, *Standard for Bulk Oxygen Systems at Consumer Sites*, 1996 edition.

NFPA 50A, *Standard for Gaseous Hydrogen Systems at Consumer Sites*, 1994 edition.

NFPA 51, *Standard for the Design and Installation of Oxygen-Fuel Gas Systems for Welding, Cutting, and Allied Processes*, 1997 edition.

NFPA 52, *Standard for Compressed Natural Gas (CNG) Vehicular Fuel Systems*, 1995 edition.

NFPA 58, *Liquefied Petroleum Gas Code*, 1998 edition.

NFPA 70, *National Electrical Code*<sup>®</sup>, 1996 edition.

NFPA 77, *Recommended Practice on Static Electricity*, 1993 edition.

NFPA 99, *Standard for Health Care Facilities*, 1996 edition.

### B-1.2 Other Publications.

**B-1.2.1 CGA Publications.** Compressed Gas Association, Inc., 1235 Jefferson Davis Highway, Arlington, VA 22202.

CGA P-1 1991, *Safe Handling of Compressed Gases in Containers*.

CGA C-7 1983, *Guide to the Preparation of Precautionary Labeling and Marking of Compressed Gas Containers*.

**B-1.2.2 U.S. Government Publications.** U.S. Government Printing Office, 710 North Capitol Street, NW, Washington, DC 20401.

*Code of Federal Regulations*, Title 49, Parts 100-179 and Parts 393 and 397. (Also available from the Association of American Railroads, American Railroads Building, 1920 L Street, NW, Washington, DC 20036 and American Trucking Association, Inc., 2201 Mill Road., Alexandria, VA 22314.)

*Code of Federal Regulations*, Title 29, "Hazard Communication," 1910.120 and 1910.1200.

**B-1.2.3 AIHA Publication.** American Industrial Hygiene Association, 2700 Prosperity Avenue, Suite 250, Fairfax, VA 22031-4319.

*Odor Thresholds for Chemicals with Established Occupational Health Standards*, 1989.

## Index

© 1998 National Fire Protection Association. All Rights Reserved.

The copyright in this index is separate and distinct from the copyright in the document which it indexes. The licensing provisions set forth for the document are not applicable to this index. This index may not be reproduced in whole or in part by any means without the express written permission of the National Fire Protection Association, Inc.

### -A-

**Absolute pressure (definition)** . . . . . 1-4  
**Alarms, fire** . . . . . 7-2.2 to 7-2.3, 7-3, A-7-3  
**Alternate materials and procedures** . . . . . 1-2  
**Approved (definition)** . . . . . 1-4, A-1-4  
**ASTM (definition)** . . . . . 1-4  
**Authority having jurisdiction (definition)** . . . . . 1-4, A-1-4

### -B-

**Breathing apparatus** . . . . . 7-5.1, A-7-5.1

### -C-

**Cabinets, gas** . . . . . 2-1.6.3(a), 7-4, A-7-4.4  
    Exempt quantities . . . . . Table 1-1.2(a)  
    Toxic gases . . . . . 3-2.1 to 3-2.3  
**CFR (definition)** . . . . . 1-4  
**CGA (definition)** . . . . . 1-4  
**Chlorine cylinders** . . . . . 3-2 to 3-3, A-3-3  
**Compressed gas cabinets** . . . . . *See* Cabinets, gas  
**Compressed gas cylinders** . . . . . *See* Cylinders, compressed gas  
**Compressed gases (nonliquefied)**  
    Definition . . . . . 1-4  
**Continuous gas detection system** . . . . . 3-1.1, A-3-1.1  
    Definition . . . . . 1-4  
**Cryogenic liquids** . . . . . 1-1.2(e), A-1-1.2(e)  
    Definition . . . . . 1-4  
**Cylinders, compressed gas**  
    Chlorine . . . . . 3-2 to 3-3, A-3-3

    Defective . . . . . 6-2  
    Definition . . . . . 1-4  
    Design and construction . . . . . 6-1  
    Electrical circuits, exposure to . . . . . 6-9  
    Fire, exposed to . . . . . 6-8  
    Marking . . . . . 4-2 to 4-3, A-4-2  
    Orientation . . . . . 6-7  
    Residual gas, containing . . . . . 6-3  
    Securing . . . . . 6-6  
    Separation by hazard . . . . . Table 2-1.5, Fig. A-2-1.5  
    Temperature limits . . . . . 6-10

### -D-

**Definitions** . . . . . 1-4, A-1-4  
**Detection systems**  
    Continuous gas . . . . . 3-1.1, A-3-1.1  
    Definition . . . . . 1-4  
    Fire . . . . . 7-2 to 7-3, A-7-3  
**Distributors**  
    Definition . . . . . 1-4  
    Toxic gases at facilities of . . . . . 3-4, A-3-4

### -E-

**Electrical equipment and wiring** . . . . . 2-2.1.3, 6-9, 7-1.3  
**Emergency equipment** . . . . . 7-5, A-7-5.1  
**Emergency plan** . . . . . Chap. 5  
**Enclosures, exhausted** . . . . . 3-2.1 to 3-2.3  
**Exempt quantities** . . . . . 1-1.2, Tables 1-1.2(a and b)

Existing facilities, continued operation of . . . . . 1-4  
Extinguishing systems . . . . . 7-2.4

**-F-**

**Fire, cylinders exposed to** . . . . . 6-8  
**Fire area (definition)** . . . . . 1-4  
**Fire protection** . . . . . 7-2, 7-4.7  
**Flammable gases** . . . . . 2-1.4  
    Definition . . . . . 1-4  
    Electrical equipment and wiring in area of . . . . . 7-1.3  
    General storage requirements . . . . . 2-2  
    As vehicle fuel . . . . . 1-1.2(k), A-1-1.2(k)

**-G-**

**Gas cabinets** . . . . . *See* Cabinets, gas  
**Gas manufacturers**  
    Definition . . . . . 1-4  
    Toxic gases at facilities of . . . . . 3-4, A-3-4  
**Gases** . . . . . *See* specific gases such as Toxic gases

**-H-**

**Handling (definition)** . . . . . 1-4  
**Hazard identification** . . . . . 4-1  
**Hazard rating (definition)** . . . . . 1-4  
**Hazard warnings** . . . . . Chap. 4, A-4-2  
**Health 3 storage requirements** . . . . . 3-3, A-3-3  
**Health 4 storage requirements** . . . . . 3-2

**-I-**

**Ignition source control** . . . . . 7-1, A-7-1.2  
**Indoor storage** . . . . . 2-1.6.2  
    Flammable gases . . . . . 2-2  
    Toxic gases . . . . . 3-1.1 to 3-1.3, A-3-1.1

**-L-**

**Labels**  
    Compressed gas cabinets . . . . . 7-4.1  
    Cylinders . . . . . 4-2 to 4-3, A-4-2  
**Leakage mitigation** . . . . . 3-4, A-3-4  
**Leaking cylinders, handling of** . . . . . 3-2.2, 3-3  
**Limited-combustible (definition)** . . . . . 1-4  
**Liquefied gases (definition)** . . . . . 1-4

**-M-**

**Manufacturers, gas**  
    Definition . . . . . 1-4  
    Toxic gases at facilities of . . . . . 3-4, A-3-4  
**Material Safety Data Sheet (MSDS) (definition)** . . . . . 1-4  
**Medical gases** . . . . . 1-1.2(d), A-1-1.2(d)

**-N-**

**Nesting (definition)** . . . . . 1-4  
**Nonflammable gases (definition)** . . . . . 1-4

**-O-**

**Open flames** . . . . . 2-2.1.4, 7-1.1  
**OSHA (definition)** . . . . . 1-4  
**Outdoor storage** . . . . . 2-1.6.1, 3-1.4  
**Oxidizing gases (definition)** . . . . . 1-4

**Oxygen, storage of** . . . . . 2-1.4(b), 2-1.6, A-2-1.6.3

**-P-**

**Pyrophoric gases**  
    Definition . . . . . 1-4  
    Protection of . . . . . 7-2.1

**-R-**

**Referenced publications** . . . . . Chap. 8, App. B  
**Residual gas, cylinders containing** . . . . . 6-3

**-S-**

**Safety precautions** . . . . . Chap. 7, A-7  
**Scf (definition)** . . . . . 1-4  
**Scope of standard** . . . . . 1-1, A-1-1.2  
**Separation of cylinders by hazard** . . . . . Table 2-1.5, Fig. A-2-1.5  
**Shall (definition)** . . . . . 1-4  
**Signs, warning** . . . . . 4-1.2  
**Smoke detection** . . . . . 7-2.3  
**Smoking** . . . . . 2-2.1.4, 7-1.1  
**Spill control** . . . . . 2-1.6.3(b)  
**Sprinkler systems** . . . . . 2-2.2.1 to 2-2.2.2, 2-2.3.2, 7-2.1, 7-4.7  
**Standard (definition)** . . . . . 1-4  
**Standby power** . . . . . 7-3, A-7-3  
**Static electricity** . . . . . 7-1.2, A-7-1.2  
**Storage** . . . . . Chap. 2, A-2  
    Definition . . . . . 1-4  
    General requirements . . . . . 2-1, A-2-1, A-2-1.5  
    Indoor . . . . . *see* Indoor storage  
    Outdoor . . . . . 2-1.6.1, 3-1.4

**-T-**

**Temperature limits, cylinder exposure** . . . . . 6-10  
**Toxic gases**  
    Definition . . . . . 1-4  
    General storage requirements . . . . . 2-1.5, A-2-1.5  
    Manufacturer's facilities . . . . . 3-4, A-3-4  
    Protection of . . . . . 7-2.1  
    Specific storage requirements . . . . . 3-1, A-3-1.1  
    User locations . . . . . 3-2, 3-3, A-3-3  
    Ventilation systems . . . . . 3-1.2 to 3-1.3  
**Training, personnel** . . . . . 1-3  
**Treatment systems (definition)** . . . . . 1-4

**-U-**

**Use (definition)** . . . . . 1-4  
**Users**  
    Definition . . . . . 1-4  
    Locations storing toxic gases . . . . . 3-2 to 3-3, A-3-3

**-V-**

**Valves**  
    Outlet caps and plugs . . . . . 3-1.5, 6-5  
        Definition . . . . . 1-4  
    Protection devices . . . . . 3-1.5  
        Definition . . . . . 1-4  
    Protective caps . . . . . 3-1.5, 6-4  
        Definition . . . . . 1-4  
**Ventilation systems**  
    Compressed gas cabinets . . . . . 7-4.4, A-7-4.4  
    Flammable gases . . . . . 2-2.2.3, 2-2.3.3  
    Toxic gases . . . . . 3-1.2 to 3-1.3, 3-2.1 to 3-2.3