


I-Quest 2006 Codes Complete Collection

2006 International Plumbing Code

2006 International Plumbing Code®

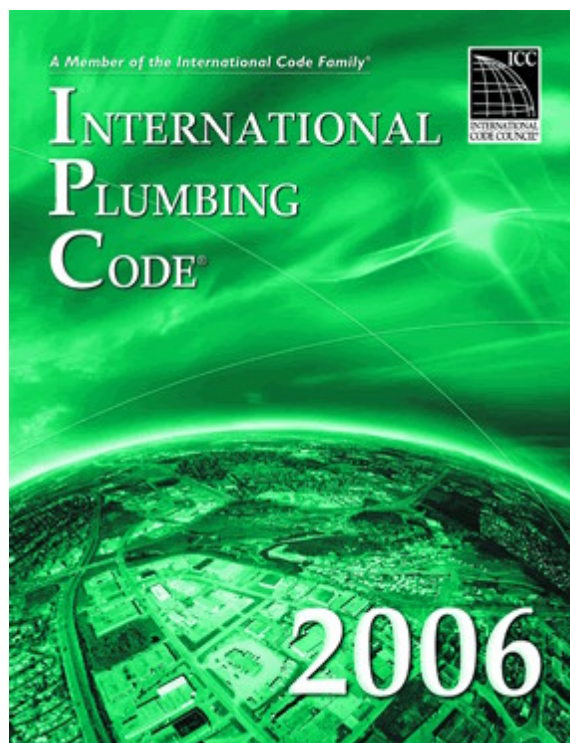

2006 International Plumbing Code®

First Printing: January 2006
Second Printing: March 2006

ISBN-13: 978-1-58001-259-1 (soft-cover)
ISBN-10: 1-58001-259-0 (soft-cover)
ISBN-13: 978-1-58001-258-4 (loose-leaf)
ISBN-10: 1-58001-258-2 (loose-leaf)
ISBN-13: 978-1-58001-307-9 (e-document)
ISBN-10: 1-58001-307-4 (e-document)

COPYRIGHT© 2006
by
INTERNATIONAL CODE COUNCIL, INC.

COPYRIGHT © 2006 by INTERNATIONAL CODE COUNCIL, INC.

I-Quest 2006 Codes Complete Collection

ALL RIGHTS RESERVED. This 2006 *International Plumbing Code*® is a copyrighted work owned by the International Code Council, Inc. Without advance written permission from the copyright owner, no part of this book may be reproduced, distributed, or transmitted in any form or by any means, including, without limitation, electronic, optical or mechanical means (by way of example, and not limitation, photocopying, or recording by or in an information storage retrieval system). For information on permission to copy material exceeding fair use, please contact: Publications, 4051 West Flossmoor Road, Country Club Hills, IL 60478-5795. Phone 1-888-ICC-SAFE (422-7233).

Trademarks: "International Code Council," the "International Code Council" logo and the "International Plumbing Code" are trademarks of the International Code Council, Inc.

PRINTED IN THE U.S.A.

2006 International Plumbing Code / PREFACE

PREFACE

2006 International Plumbing Code / PREFACE / Introduction

Introduction

Internationally, code officials recognize the need for a modern, up-to-date plumbing code addressing the design and installation of plumbing systems through requirements emphasizing performance. The *International Plumbing Code*®, in this 2006 edition, is designed to meet these needs through model code regulations that safeguard the public health and safety in all communities, large and small.

This comprehensive plumbing code establishes minimum regulations for plumbing systems using prescriptive and performance-related provisions. It is founded on broad-based principles that make possible the use of new materials and new plumbing designs. This 2006 edition is fully compatible with all the *International Codes*® (I-Codes®) published by the International Code Council (ICC)®, including the *International Building Code*®, *ICC Electrical Code*®, *International Energy Conservation Code*®, *International Existing Building Code*®, *International Fire Code*®, *International Fuel Gas Code*®, *International Mechanical Code*®, *ICC Performance Code*®, *International Private Sewage Disposal Code*®, *International Property Maintenance Code*®, *International Residential Code*®, *International Wildland-Urban Interface Code*™ and *International Zoning Code*®.

The *International Plumbing Code* provisions provide many benefits, among which is the model code development process that offers an international forum for plumbing professionals to discuss performance and prescriptive code requirements. This forum provides an excellent

I-Quest 2006 Codes Complete Collection

arena to debate proposed revisions. This model code also encourages international consistency in the application of provisions.

2006 International Plumbing Code / PREFACE / Development

Development

The first edition of the *International Plumbing Code* (1995) was the culmination of an effort initiated in 1994 by a development committee appointed by the ICC and consisting of representatives of the three statutory members of the International Code Council at that time, including: Building Officials and Code Administrators International, Inc. (BOCA), International Conference of Building Officials (ICBO) and Southern Building Code Congress International (SBCCI). The intent was to draft a comprehensive set of regulations for plumbing systems consistent with and inclusive of the scope of the existing model codes. Technical content of the latest model codes promulgated by BOCA, ICBO and SBCCI was utilized as the basis for the development. This 2006 edition presents the code as originally issued, with changes as reflected in the subsequent editions through 2003 and with changes approved through the ICC Code Development Process through 2005. A new edition such as this is promulgated every three years.

This code is founded on principles intended to establish provisions consistent with the scope of a plumbing code that adequately protects public health, safety and welfare; provisions that do not unnecessarily increase construction costs; provisions that do not restrict the use of new materials, products or methods of construction; and provisions that do not give preferential treatment to particular types or classes of materials, products or methods of construction.

2006 International Plumbing Code / PREFACE / Adoption

Adoption

The *International Plumbing Code* is available for adoption and use by jurisdictions internationally. Its use within a governmental jurisdiction is intended to be accomplished through adoption by reference in accordance with proceedings establishing the jurisdiction's laws. At the time of adoption, jurisdictions should insert the appropriate information in provisions requiring specific local information, such as the name of the adopting jurisdiction. These locations are shown in bracketed words in small capital letters in the code and in the sample ordinance. The sample adoption ordinance on page v addresses several key elements of a code adoption ordinance, including the information required for insertion into the code text.

2006 International Plumbing Code / PREFACE / Maintenance

Maintenance

The *International Plumbing Code* is kept up to date through the review of proposed changes submitted by code enforcing officials, industry representatives, design professionals and other interested parties. Proposed changes are carefully considered through an open code

I-Quest 2006 Codes Complete Collection

development process in which all interested and affected parties may participate.

The contents of this work are subject to change both through the Code Development Cycles and the governmental body that enacts the code into law. For more information regarding the code development process, contact the Code and Standard Development Department of the International Code Council.

While the development procedure of the *International Plumbing Code* ensures the highest degree of care, ICC and ICC's members and those participating in the development of this code do not accept any liability resulting from compliance or noncompliance with the provisions, since ICC and its members do not have the power or authority to police or enforce compliance with the contents of this code. Only the governmental body that enacts the code into law has such authority.

2006 International Plumbing Code / PREFACE / Letter Designations in Front of Section Numbers

Letter Designations in Front of Section Numbers

In each code development cycle, proposed changes to the code are considered at the Code Development Hearings by the ICC Plumbing Code Development Committee, whose action constitutes a recommendation to the voting membership for final action on the proposed change. Proposed changes to a code section that has a number beginning with a letter in brackets are considered by a different code development committee. For example, proposed changes to code sections that have [B] in front of them (e.g. [B] 309.2) are considered by the ICC Building Code Development Committee at the code development hearings.

The content of sections in this code that begin with a letter designation are maintained by another code development committee in accordance with the following:

- [B] = International Building Code Development Committee;
- [E] = International Energy Conservation Code Development Committee;
- [F] = International Fire Code Development Committee;
- [M] = International Mechanical Code Development Committee.

2006 International Plumbing Code / PREFACE / Marginal Markings

Marginal Markings

Solid vertical lines in the margins within the body of the code indicate a technical change from the requirements of the 2003 edition. Deletion indicators in the form of an arrow (➡) are provided in the margin where an entire section, paragraph, exception or table has been deleted or an item in a list of items or a table has been deleted.

2006 International Plumbing Code / ORDINANCE

ORDINANCE

The *International Codes* are designed and promulgated to be adopted by reference by ordinance. Jurisdictions wishing to adopt the *2006 International Plumbing Code* as an enforceable regulation governing plumbing systems should ensure that certain factual information is included in the adopting ordinance at the time adoption is being considered by the appropriate governmental body. The following sample adoption ordinance addresses several key elements of a code adoption ordinance, including the information required for insertion into the code text.

**SAMPLE ORDINANCE FOR ADOPTION OF
THE INTERNATIONAL PLUMBING CODE
ORDINANCE NO. _____**

An ordinance of the **[JURISDICTION]** adopting the 2006 edition of the *International Plumbing Code*, regulating and governing the design, construction, quality of materials, erection, installation, alteration, repair, location, relocation, replacement, addition to, use or maintenance of plumbing systems in the **[JURISDICTION]**; providing for the issuance of permits and collection of fees therefor; repealing Ordinance No. _____ of the **[JURISDICTION]** and all other ordinances and parts of the ordinances in conflict therewith.

The **[GOVERNING BODY]** of the **[JURISDICTION]** does ordain as follows:

Section 1. That a certain document, three (3) copies of which are on file in the office of the **[TITLE OF JURISDICTION S KEEPER OF RECORDS]** of **[NAME OF JURISDICTION]**, being marked and designated as the *International Plumbing Code*, 2006 edition, including Appendix Chapters **[FILL IN THE APPENDIX CHAPTERS BEING ADOPTED]**, as published by the International Code Council, be and is hereby adopted as the Plumbing Code of the **[JURISDICTION]**, in the State of **[STATE NAME]** regulating and governing the design, construction, quality of materials, erection, installation, alteration, repair, location, relocation, replacement, addition to, use or maintenance of plumbing systems as herein provided; providing for the issuance of permits and collection of fees therefor; and each and all of the regulations, provisions, penalties, conditions and terms of said Plumbing Code on file in the office of the **[JURISDICTION]** are hereby referred to, adopted, and made a part hereof, as if fully set out in this ordinance, with the additions, insertions, deletions and changes, if any, prescribed in Section 2 of this ordinance.

Section 2. The following sections are hereby revised:

Section 101.1. Insert: **[NAME OF JURISDICTION]**

Section 106.6.2. Insert: **[APPROPRIATE SCHEDULE]**

Section 106.6.3. Insert: **[PERCENTAGES IN TWO LOCATIONS]**

Section 108.4. Insert: **[OFFENSE, DOLLAR AMOUNT, NUMBER OF DAYS]**

Section 108.5. Insert: **[DOLLAR AMOUNT IN TWO LOCATIONS]**

Section 305.6.1. Insert: **[NUMBER OF INCHES IN TWO LOCATIONS]**

Section 904.1. Insert: **[NUMBER OF INCHES]**

Section 3. That Ordinance No. _____ of **[JURISDICTION]** entitled **[FILL IN HERE THE COMPLETE TITLE OF THE ORDINANCE OR ORDINANCES IN EFFECT AT THE PRESENT TIME SO THAT THEY WILL BE REPEALED BY DEFINITE MENTION]** and all other ordinances or parts of ordinances in conflict herewith are hereby repealed.

Section 4. That if any section, subsection, sentence, clause or phrase of this ordinance is, for any reason, held to be unconstitutional, such decision shall not affect the validity of the remaining portions of this ordinance. The **[GOVERNING BODY]** hereby declares that it would have passed this ordinance, and each section, subsection, clause or phrase thereof, irrespective of the fact that any one or more sections, subsections, sentences, clauses and phrases be declared unconstitutional.

Section 5. That nothing in this ordinance or in the Plumbing Code hereby adopted shall be construed to affect any suit or proceeding impending in any court, or any rights acquired, or liability incurred, or any cause or causes of action acquired or existing, under any act or ordinance hereby repealed as cited in Section 3 of this ordinance; nor shall any just or legal right or remedy of any character be lost, impaired or affected by this ordinance.

Section 6. That the **[JURISDICTION S KEEPER OF RECORDS]** is hereby ordered and directed to cause this ordinance to be published. (An additional provision may be required to direct the number of times the ordinance is to be published and to specify that it is to be in a newspaper in general circulation. Posting may also be required.)

Section 7. That this ordinance and the rules, regulations, provisions, requirements, orders and matters established and adopted hereby shall take effect and be in full force and effect **[TIME PERIOD]** from and after the date of its final passage and adoption.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION

CHAPTER 1

ADMINISTRATION

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 101 GENERAL

SECTION 101 GENERAL

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 101 GENERAL / 101.1 Title.

101.1 Title.

These regulations shall be known as the *International Plumbing Code* of [NAME OF JURISDICTION] hereinafter referred to as “this code.”

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 101 GENERAL / 101.2 Scope.

101.2 Scope.

The provisions of this code shall apply to the erection, installation, alteration, repairs, relocation, replacement, addition to, use or maintenance of plumbing systems within this jurisdiction. This code shall also regulate nonflammable medical gas, inhalation anesthetic, vacuum piping, nonmedical oxygen systems and sanitary and condensate vacuum collection systems. The installation of fuel gas distribution piping and equipment, fuel-gas-fired water heaters and water heater venting systems shall be regulated by the *International Fuel Gas Code*. Provisions in the appendices shall not apply unless specifically adopted.

Exception: Detached one- and two-family dwellings and multiple single-family dwellings (townhouses) not more than three stories high with separate means of egress and their accessory structures shall comply with the *International Residential Code*.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 101 GENERAL / 101.3 Intent.

101.3 Intent.

The purpose of this code is to provide minimum standards to safeguard life or limb, health, property and public welfare by regulating and controlling the design, construction, installation, quality of materials, location, operation and maintenance or use of plumbing equipment and systems.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 101 GENERAL / 101.4 Severability.

101.4 Severability.

If any section, subsection, sentence, clause or phrase of this code is for any reason held to be unconstitutional, such decision shall not affect the validity of the remaining portions of this code.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 102 APPLICABILITY

**SECTION 102
APPLICABILITY**

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 102 APPLICABILITY / 102.1 General.

102.1 General.

The provisions of this code shall apply to all matters affecting or relating to structures, as set forth in Section 101. Where, in any specific case, different sections of this code specify different materials, methods of construction or other requirements, the most restrictive shall govern.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 102 APPLICABILITY / 102.2 Existing installations.

102.2 Existing installations.

Plumbing systems lawfully in existence at the time of the adoption of this code shall be permitted to have their use and maintenance continued if the use, maintenance or repair is in accordance with the original design and no hazard to life, health or property is created by such plumbing system.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 102 APPLICABILITY / 102.3 Maintenance.

102.3 Maintenance.

All plumbing systems, materials and appurtenances, both existing and new, and all parts thereof, shall be maintained in proper operating condition in accordance with the original design in a safe and sanitary condition. All devices or safeguards required by this code shall be maintained in compliance with the code edition under which they were installed.

The owner or the owner's designated agent shall be responsible for maintenance of plumbing systems. To determine compliance with this provision, the code official shall have the

authority to require any plumbing system to be reinspected.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 102 APPLICABILITY / 102.4 Additions, alterations or repairs.

102.4 Additions, alterations or repairs.

Additions, alterations, renovations or repairs to any plumbing system shall conform to that required for a new plumbing system without requiring the existing plumbing system to comply with all the requirements of this code. Additions, alterations or repairs shall not cause an existing system to become unsafe, insanitary or overloaded.

Minor additions, alterations, renovations and repairs to existing plumbing systems shall be permitted in the same manner and arrangement as in the existing system, provided that such repairs or replacement are not hazardous and are approved.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 102 APPLICABILITY / 102.5 Change in occupancy.

102.5 Change in occupancy.

It shall be unlawful to make any change in the occupancy of any structure that will subject the structure to any special provision of this code without approval of the code official. The code official shall certify that such structure meets the intent of the provisions of law governing building construction for the proposed new occupancy and that such change of occupancy does not result in any hazard to the public health, safety or welfare.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 102 APPLICABILITY / 102.6 Historic buildings.

102.6 Historic buildings.

The provisions of this code relating to the construction, alteration, repair, enlargement, restoration, relocation or moving of buildings or structures shall not be mandatory for existing buildings or structures identified and classified by the state or local jurisdiction as historic buildings when such buildings or structures are judged by the code official to be safe and in the public interest of health, safety and welfare regarding any proposed construction, alteration, repair, enlargement, restoration, relocation or moving of buildings.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 102 APPLICABILITY / 102.7 Moved buildings.

102.7 Moved buildings.

Except as determined by Section 102.2, plumbing systems that are a part of buildings or structures moved into or within the jurisdiction shall comply with the provisions of this code for

new installations.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 102
APPLICABILITY / 102.8 Referenced codes and standards.**

102.8 Referenced codes and standards.

The codes and standards referenced in this code shall be those that are listed in Chapter 13 and such codes and standards shall be considered as part of the requirements of this code to the prescribed extent of each such reference. Where the differences occur between provisions of this code and the referenced standards, the provisions of this code shall be the minimum requirements.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 102
APPLICABILITY / 102.9 Requirements not covered by code.**

102.9 Requirements not covered by code.

Any requirements necessary for the strength, stability or proper operation of an existing or proposed plumbing system, or for the public safety, health and general welfare, not specifically covered by this code shall be determined by the code official.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 103
DEPARTMENT OF PLUMBING INSPECTION**

**SECTION 103
DEPARTMENT OF PLUMBING INSPECTION**

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 103
DEPARTMENT OF PLUMBING INSPECTION / 103.1 General.**

103.1 General.

The department of plumbing inspection is hereby created and the executive official in charge thereof shall be known as the code official.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 103
DEPARTMENT OF PLUMBING INSPECTION / 103.2 Appointment.**

103.2 Appointment.

The code official shall be appointed by the chief appointing authority of the jurisdiction, and the code official shall not be removed from office except for cause and after full opportunity to be heard on specific and relevant charges by and before the appointing authority.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 103
DEPARTMENT OF PLUMBING INSPECTION / 103.3 Deputies.**

103.3 Deputies.

In accordance with the prescribed procedures of this jurisdiction and with the concurrence of the appointing authority, the code official shall have the authority to appoint a deputy code official, other related technical officers, inspectors and other employees.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 103
DEPARTMENT OF PLUMBING INSPECTION / 103.4 Liability.**

103.4 Liability.

The code official, officer or employee charged with the enforcement of this code, while acting for the jurisdiction, shall not thereby be rendered liable personally, and is hereby relieved from all personal liability for any damage accruing to persons or property as a result of any act required or permitted in the discharge of official duties.

Any suit instituted against any officer or employee because of an act performed by that officer or employee in the lawful discharge of duties and under the provisions of this code shall be defended by the legal representative of the jurisdiction until the final termination of the proceedings. The code official or any subordinate shall not be liable for costs in any action, suit or proceeding that is instituted in pursuance of the provisions of this code, and any officer of the department of plumbing inspection, acting in good faith and without malice, shall be free from liability for acts performed under any of its provisions or by reason of any act or omission in the performance of official duties in connection therewith.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 104
DUTIES AND POWERS OF THE CODE OFFICIAL**

**SECTION 104
DUTIES AND POWERS OF THE CODE OFFICIAL**

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 104
DUTIES AND POWERS OF THE CODE OFFICIAL / 104.1 General.**

104.1 General.

The code official shall enforce all of the provisions of this code and shall act on any question relative to the installation, alteration, repair, maintenance or operation of all plumbing systems, devices and equipment except as otherwise specifically provided for by statutory requirements or as provided for in Sections 104.2 through 104.8.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 104
DUTIES AND POWERS OF THE CODE OFFICIAL / 104.2 Rule-making authority.**

104.2 Rule-making authority.

The code official shall have authority as necessary in the interest of public health, safety and general welfare to adopt and promulgate rules and regulations to interpret and implement the provisions of this code to secure the intent thereof and to designate requirements applicable because of local climatic or other conditions. Such rules shall not have the effect of waiving structural or fire performance requirements specifically provided for in this code, or of violating accepted engineering practice involving public safety.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 104
DUTIES AND POWERS OF THE CODE OFFICIAL / 104.3 Applications and permits.**

104.3 Applications and permits.

The code official shall receive applications and issue permits for the installation and alteration of plumbing, inspect the premises for which such permits have been issued, and enforce compliance with the provisions of this code.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 104
DUTIES AND POWERS OF THE CODE OFFICIAL / 104.4 Inspections.**

104.4 Inspections.

The code official shall make all the required inspections, or shall accept reports of inspection by approved agencies or individuals. All reports of such inspections shall be in writing and be certified by a responsible officer of such approved agency or by the responsible individual. The code official is authorized to engage such expert opinion as deemed necessary to report on unusual technical issues that arise, subject to the approval of the appointing authority.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 104
DUTIES AND POWERS OF THE CODE OFFICIAL / 104.5 Right of entry.**

104.5 Right of entry.

Whenever it is necessary to make an inspection to enforce the provisions of this code, or whenever the code official has reasonable cause to believe that there exists in any building or upon any premises any conditions or violations of this code that make the building or premises unsafe, insanitary, dangerous or hazardous, the code official shall have the authority to enter the building or premises at all reasonable times to inspect or to perform the duties imposed upon the code official by this code. If such building or premises is occupied, the code official shall present credentials to the occupant and request entry. If such building or premises is unoccupied, the code official shall first make a reasonable effort to locate the owner or other person having charge or control of the building or premises and request entry. If entry is

refused, the code official shall have recourse to every remedy provided by law to secure entry.

When the code official shall have first obtained a proper inspection warrant or other remedy provided by law to secure entry, no owner or occupant or person having charge, care or control of any building or premises shall fail or neglect, after proper request is made as herein provided, to promptly permit entry therein by the code official for the purpose of inspection and examination pursuant to this code.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 104
DUTIES AND POWERS OF THE CODE OFFICIAL / 104.6 Identification.**

104.6 Identification.

The code official shall carry proper identification when inspecting structures or premises in the performance of duties under this code.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 104
DUTIES AND POWERS OF THE CODE OFFICIAL / 104.7 Notices and orders.**

104.7 Notices and orders.

The code official shall issue all necessary notices or orders to ensure compliance with this code.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 104
DUTIES AND POWERS OF THE CODE OFFICIAL / 104.8 Department records.**

104.8 Department records.

The code official shall keep official records of applications received, permits and certificates issued, fees collected, reports of inspections, and notices and orders issued. Such records shall be retained in the official records as long as the building or structure to which such records relate remains in existence unless otherwise provided for by other regulations.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 105
APPROVAL**

**SECTION 105
APPROVAL**

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 105
APPROVAL / 105.1 Modifications.**

105.1 Modifications.

Whenever there are practical difficulties involved in carrying out the provisions of this code, the

code official shall have the authority to grant modifications for individual cases, provided the code official shall first find that special individual reason makes the strict letter of this code impractical and the modification is in conformity with the intent and purpose of this code and that such modification does not lessen health, life and fire safety requirements. The details of action granting modifications shall be recorded and entered in the files of the plumbing inspection department.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 105 APPROVAL / 105.2 Alternative materials, methods and equipment.

105.2 Alternative materials, methods and equipment.

The provisions of this code are not intended to prevent the installation of any material or to prohibit any method of construction not specifically prescribed by this code, provided that any such alternative has been approved. An alternative material or method of construction shall be approved where the code official finds that the proposed design is satisfactory and complies with the intent of the provisions of this code, and that the material, method or work offered is, for the purpose intended, at least the equivalent of that prescribed in this code in quality, strength, effectiveness, fire resistance, durability and safety.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 105 APPROVAL / 105.3 Required testing.

105.3 Required testing.

Whenever there is insufficient evidence of compliance with the provisions of this code, or evidence that a material or method does not conform to the requirements of this code, or in order to substantiate claims for alternate materials or methods, the code official shall have the authority to require tests as evidence of compliance to be made at no expense to the jurisdiction.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 105 APPROVAL / 105.3 Required testing. / 105.3.1 Test methods.

105.3.1 Test methods.

Test methods shall be as specified in this code or by other recognized test standards. In the absence of recognized and accepted test methods, the code official shall approve the testing procedures.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 105 APPROVAL / 105.3 Required testing. / 105.3.2 Testing agency.

105.3.2 Testing agency.

All tests shall be performed by an approved agency.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 105 APPROVAL / 105.3 Required testing. / 105.3.3 Test reports.

105.3.3 Test reports.

Reports of tests shall be retained by the code official for the period required for retention of public records.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 105 APPROVAL / 105.4 Alternative engineered design.

105.4 Alternative engineered design.

The design, documentation, inspection, testing and approval of an alternative engineered design plumbing system shall comply with Sections 105.4.1 through 105.4.6.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 105 APPROVAL / 105.4 Alternative engineered design. / 105.4.1 Design criteria.

105.4.1 Design criteria.

An alternative engineered design shall conform to the intent of the provisions of this code and shall provide an equivalent level of quality, strength, effectiveness, fire resistance, durability and safety. Material, equipment or components shall be designed and installed in accordance with the manufacturer's installation instructions.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 105 APPROVAL / 105.4 Alternative engineered design. / 105.4.2 Submittal.

105.4.2 Submittal.

The registered design professional shall indicate on the permit application that the plumbing system is an alternative engineered design. The permit and permanent permit records shall indicate that an alternative engineered design was part of the approved installation.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 105 APPROVAL / 105.4 Alternative engineered design. / 105.4.3 Technical data.

105.4.3 Technical data.

The registered design professional shall submit sufficient technical data to substantiate the proposed alternative engineered design and to prove that the performance meets the intent of this code.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 105

APPROVAL / 105.4 Alternative engineered design. / 105.4.4 Construction documents.

105.4.4 Construction documents.

The registered design professional shall submit to the code official two complete sets of signed and sealed construction documents for the alternative engineered design. The construction documents shall include floor plans and a riser diagram of the work. Where appropriate, the construction documents shall indicate the direction of flow, all pipe sizes, grade of horizontal piping, loading, and location of fixtures and appliances.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 105 APPROVAL / 105.4 Alternative engineered design. / 105.4.5 Design approval.

105.4.5 Design approval.

Where the code official determines that the alternative engineered design conforms to the intent of this code, the plumbing system shall be approved. If the alternative engineered design is not approved, the code official shall notify the registered design professional in writing, stating the reasons thereof.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 105 APPROVAL / 105.4 Alternative engineered design. / 105.4.6 Inspection and testing.

105.4.6 Inspection and testing.

The alternative engineered design shall be tested and inspected in accordance with the requirements of Sections 107 and 312.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 105 APPROVAL / 105.5 Material and equipment reuse.

105.5 Material and equipment reuse.

Materials, equipment and devices shall not be reused unless such elements have been reconditioned, tested, placed in good and proper working condition and approved.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 106 PERMITS

**SECTION 106
PERMITS**

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 106 PERMITS / 106.1 When required.

106.1 When required.

Any owner, authorized agent or contractor who desires to construct, enlarge, alter, repair, move, demolish or change the occupancy of a building or structure, or to erect, install, enlarge, alter, repair, remove, convert or replace any plumbing system, the installation of which is regulated by this code, or to cause any such work to be done, shall first make application to the code official and obtain the required permit for the work.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 106 PERMITS / 106.2 Exempt work.

106.2 Exempt work.

The following work shall be exempt from the requirement for a permit:

1. The stopping of leaks in drains, water, soil, waste or vent pipe provided, however, that if any concealed trap, drainpipe, water, soil, waste or vent pipe becomes defective and it becomes necessary to remove and replace the same with new material, such work shall be considered as new work and a permit shall be obtained and inspection made as provided in this code.
2. The clearing of stoppages or the repairing of leaks in pipes, valves or fixtures, and the removal and reinstallation of water closets, provided such repairs do not involve or require the replacement or rearrangement of valves, pipes or fixtures.

Exemption from the permit requirements of this code shall not be deemed to grant authorization for any work to be done in violation of the provisions of this code or any other laws or ordinances of this jurisdiction.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 106 PERMITS / 106.3 Application for permit.

106.3 Application for permit.

Each application for a permit, with the required fee, shall be filed with the code official on a form furnished for that purpose and shall contain a general description of the proposed work and its location. The application shall be signed by the owner or an authorized agent. The permit application shall indicate the proposed occupancy of all parts of the building and of that portion of the site or lot, if any, not covered by the building or structure and shall contain such other information required by the code official.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 106 PERMITS / 106.3 Application for permit. / 106.3.1 Construction documents.

106.3.1 Construction documents.

Construction documents, engineering calculations, diagrams and other such data shall be

I-Quest 2006 Codes Complete Collection

submitted in two or more sets with each application for a permit. The code official shall require construction documents, computations and specifications to be prepared and designed by a registered design professional when required by state law. Construction documents shall be drawn to scale and shall be of sufficient clarity to indicate the location, nature and extent of the work proposed and show in detail that the work conforms to the provisions of this code. Construction documents for buildings more than two stories in height shall indicate where penetrations will be made for pipe, fittings and components and shall indicate the materials and methods for maintaining required structural safety, fire-resistance rating and fireblocking.

Exception: The code official shall have the authority to waive the submission of construction documents, calculations or other data if the nature of the work applied for is such that reviewing of construction documents is not necessary to determine compliance with this code.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 106 PERMITS / 106.4 By whom application is made.

106.4 By whom application is made.

Application for a permit shall be made by the person or agent to install all or part of any plumbing system. The applicant shall meet all qualifications established by statute, or by rules promulgated by this code, or by ordinance or by resolution. The full name and address of the applicant shall be stated in the application.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 106 PERMITS / 106.5 Permit issuance.

106.5 Permit issuance.

The application, construction documents and other data filed by an applicant for permit shall be reviewed by the code official. If the code official finds that the proposed work conforms to the requirements of this code and all laws and ordinances applicable thereto, and that the fees specified in Section 106.6 have been paid, a permit shall be issued to the applicant.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 106 PERMITS / 106.5 Permit issuance. / 106.5.1 Approved construction documents.

106.5.1 Approved construction documents.

When the code official issues the permit where construction documents are required, the construction documents shall be endorsed in writing and stamped "APPROVED." Such approved construction documents shall not be changed, modified or altered without authorization from the code official. All work shall be done in accordance with the approved construction documents.

The code official shall have the authority to issue a permit for the construction of a part

of a plumbing system before the entire construction documents for the whole system have been submitted or approved, provided adequate information and detailed statements have been filed complying with all pertinent requirements of this code. The holders of such permit shall proceed at their own risk without assurance that the permit for the entire plumbing system will be granted.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 106 PERMITS / 106.5 Permit issuance. / 106.5.2 Validity.

106.5.2 Validity.

The issuance of a permit or approval of construction documents shall not be construed to be a permit for, or an approval of, any violation of any of the provisions of this code or any other ordinance of the jurisdiction. No permit presuming to give authority to violate or cancel the provisions of this code shall be valid.

The issuance of a permit based upon construction documents and other data shall not prevent the code official from thereafter requiring the correction of errors in said construction documents and other data or from preventing building operations being carried on thereunder when in violation of this code or of other ordinances of this jurisdiction.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 106 PERMITS / 106.5 Permit issuance. / 106.5.3 Expiration.

106.5.3 Expiration.

Every permit issued by the code official under the provisions of this code shall expire by limitation and become null and void if the work authorized by such permit is not commenced within 180 days from the date of such permit, or if the work authorized by such permit is suspended or abandoned at any time after the work is commenced for a period of 180 days. Before such work can be recommenced, a new permit shall be first obtained and the fee therefor shall be one-half the amount required for a new permit for such work, provided no changes have been made or will be made in the original construction documents for such work, and provided further that such suspension or abandonment has not exceeded 1 year.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 106 PERMITS / 106.5 Permit issuance. / 106.5.4 Extensions.

106.5.4 Extensions.

Any permittee holding an unexpired permit shall have the right to apply for an extension of the time within which the permittee will commence work under that permit when work is unable to be commenced within the time required by this section for good and satisfactory reasons. The code official shall extend the time for action by the permittee for a period not exceeding 180 days if there is reasonable cause. No permit shall be extended more than once. The fee for an extension shall be one-half the amount required for a new permit for

such work.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 106 PERMITS / 106.5 Permit issuance. / 106.5.5 Suspension or revocation of permit.

106.5.5 Suspension or revocation of permit.

The code official shall revoke a permit or approval issued under the provisions of this code in case of any false statement or misrepresentation of fact in the application or on the construction documents upon which the permit or approval was based.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 106 PERMITS / 106.5 Permit issuance. / 106.5.6 Retention of construction documents.

106.5.6 Retention of construction documents.

One set of construction documents shall be retained by the code official until final approval of the work covered therein. One set of approved construction documents shall be returned to the applicant, and said set shall be kept on the site of the building or work at all times during which the work authorized thereby is in progress.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 106 PERMITS / 106.6 Fees.

106.6 Fees.

A permit shall not be issued until the fees prescribed in Section 106.6.2 have been paid, and an amendment to a permit shall not be released until the additional fee, if any, due to an increase of the plumbing systems, has been paid.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 106 PERMITS / 106.6 Fees. / 106.6.1 Work commencing before permit issuance.

106.6.1 Work commencing before permit issuance.

Any person who commences any work on a plumbing system before obtaining the necessary permits shall be subject to 100 percent of the usual permit fee in addition to the required permit fees.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 106 PERMITS / 106.6 Fees. / 106.6.2 Fee schedule.

106.6.2 Fee schedule.

The fees for all plumbing work shall be as indicated in the following schedule:

[JURISDICTION TO INSERT APPROPRIATE SCHEDULE]

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 106 PERMITS / 106.6 Fees. / 106.6.3 Fee refunds.

106.6.3 Fee refunds.

The code official shall authorize the refunding of fees as follows:

1. The full amount of any fee paid hereunder that was erroneously paid or collected.
2. Not more than [SPECIFY PERCENTAGE] percent of the permit fee paid when no work has been done under a permit issued in accordance with this code.
3. Not more than [SPECIFY PERCENTAGE] percent of the plan review fee paid when an application for a permit for which a plan review fee has been paid is withdrawn or canceled before any plan review effort has been expended.

The code official shall not authorize the refunding of any fee paid except upon written application filed by the original permittee not later than 180 days after the date of fee payment.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 107 INSPECTIONS AND TESTING

**SECTION 107
INSPECTIONS AND TESTING**

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 107 INSPECTIONS AND TESTING / 107.1 Required inspections and testing.

107.1 Required inspections and testing.

The code official, upon notification from the permit holder or the permit holder's agent, shall make the following inspections and such other inspections as necessary, and shall either release that portion of the construction or shall notify the permit holder or an agent of any violations that must be corrected. The holder of the permit shall be responsible for the scheduling of such inspections.

1. Underground inspection shall be made after trenches or ditches are excavated and bedded, piping installed, and before any backfill is put in place.
2. Rough-in inspection shall be made after the roof, framing, fireblocking, firestopping, draftstopping and bracing is in place and all sanitary, storm and water distribution piping is roughed-in, and prior to the installation of wall or ceiling membranes.

3. Final inspection shall be made after the building is complete, all plumbing fixtures are in place and properly connected, and the structure is ready for occupancy.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 107 INSPECTIONS AND TESTING / 107.1 Required inspections and testing. / 107.1.1 Approved agencies.

107.1.1 Approved agencies.

Test reports submitted to the code official for consideration shall be developed by approved agencies that have satisfied the requirements as to qualifications and reliability.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 107 INSPECTIONS AND TESTING / 107.1 Required inspections and testing. / 107.1.2 Evaluation and follow-up inspection services.

107.1.2 Evaluation and follow-up inspection services.

Prior to the approval of a closed, prefabricated plumbing system and the issuance of a plumbing permit, the code official shall require the submittal of an evaluation report on each prefabricated plumbing system indicating the complete details of the plumbing system, including a description of the system and its components, the basis upon which the plumbing system is being evaluated, test results and similar information, and other data as necessary for the code official to determine conformance to this code.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 107 INSPECTIONS AND TESTING / 107.1 Required inspections and testing. / 107.1.2 Evaluation and follow-up inspection services. / 107.1.2.1 Evaluation service.

107.1.2.1 Evaluation service.

The code official shall designate the evaluation service of an approved agency as the evaluation agency, and review such agency's evaluation report for adequacy and conformance to this code.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 107 INSPECTIONS AND TESTING / 107.1 Required inspections and testing. / 107.1.2 Evaluation and follow-up inspection services. / 107.1.2.2 Follow-up inspection.

107.1.2.2 Follow-up inspection.

Except where ready access is provided to all plumbing systems, service equipment and accessories for complete inspection at the site without disassembly or dismantling, the code official shall conduct the frequency of in-plant inspections necessary to ensure conformance to the approved evaluation report or shall designate an independent, approved inspection agency to conduct such inspections. The inspection agency shall

I-Quest 2006 Codes Complete Collection

furnish the code official with the follow-up inspection manual and a report of inspections upon request, and the plumbing system shall have an identifying label permanently affixed to the system indicating that factory inspections have been performed.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 107 INSPECTIONS AND TESTING / 107.1 Required inspections and testing. / 107.1.2 Evaluation and follow-up inspection services. / 107.1.2.3 Test and inspection records.

107.1.2.3 Test and inspection records.

All required test and inspection records shall be available to the code official at all times during the fabrication of the plumbing system and the erection of the building, or such records as the code official designates shall be filed.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 107 INSPECTIONS AND TESTING / 107.2 Special inspections.

107.2 Special inspections.

Special inspections of alternative engineered design plumbing systems shall be conducted in accordance with Sections 107.2.1 and 107.2.2.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 107 INSPECTIONS AND TESTING / 107.2 Special inspections. / 107.2.1 Periodic inspection.

107.2.1 Periodic inspection.

The registered design professional or designated inspector shall periodically inspect and observe the alternative engineered design to determine that the installation is in accordance with the approved construction documents. All discrepancies shall be brought to the immediate attention of the plumbing contractor for correction. Records shall be kept of all inspections.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 107 INSPECTIONS AND TESTING / 107.2 Special inspections. / 107.2.2 Written report.

107.2.2 Written report.

The registered design professional shall submit a final report in writing to the code official upon completion of the installation, certifying that the alternative engineered design conforms to the approved construction documents. A notice of approval for the plumbing system shall not be issued until a written certification has been submitted.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 107 INSPECTIONS AND TESTING / 107.3 Testing.

107.3 Testing.

Plumbing work and systems shall be tested as required in Section 312 and in accordance with Sections 107.3.1 through 107.3.3. Tests shall be made by the permit holder and observed by the code official.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 107 INSPECTIONS AND TESTING / 107.3 Testing. / 107.3.1 New, altered, extended or repaired systems.

107.3.1 New, altered, extended or repaired systems.

New plumbing systems and parts of existing systems that have been altered, extended or repaired shall be tested as prescribed herein to disclose leaks and defects, except that testing is not required in the following cases:

1. In any case that does not include addition to, replacement, alteration or relocation of any water supply, drainage or vent piping.
2. In any case where plumbing equipment is set up temporarily for exhibition purposes.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 107 INSPECTIONS AND TESTING / 107.3 Testing. / 107.3.2 Equipment, material and labor for tests.

107.3.2 Equipment, material and labor for tests.

All equipment, material and labor required for testing a plumbing system or part thereof shall be furnished by the permit holder.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 107 INSPECTIONS AND TESTING / 107.3 Testing. / 107.3.3 Reinspection and testing.

107.3.3 Reinspection and testing.

Where any work or installation does not pass any initial test or inspection, the necessary corrections shall be made to comply with this code. The work or installation shall then be resubmitted to the code official for inspection and testing.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 107 INSPECTIONS AND TESTING / 107.4 Approval.

107.4 Approval.

After the prescribed tests and inspections indicate that the work complies in all respects with this code, a notice of approval shall be issued by the code official.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 107
INSPECTIONS AND TESTING / 107.5 Temporary connection.**

107.5 Temporary connection.

The code official shall have the authority to authorize the temporary connection of the building or system to the utility source for the purpose of testing plumbing systems or for use under a temporary certificate of occupancy.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 108
VIOLATIONS**

**SECTION 108
VIOLATIONS**

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 108
VIOLATIONS / 108.1 Unlawful acts.**

108.1 Unlawful acts.

It shall be unlawful for any person, firm or corporation to erect, construct, alter, repair, remove, demolish or utilize any plumbing system, or cause same to be done, in conflict with or in violation of any of the provisions of this code.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 108
VIOLATIONS / 108.2 Notice of violation.**

108.2 Notice of violation.

The code official shall serve a notice of violation or order to the person responsible for the erection, installation, alteration, extension, repair, removal or demolition of plumbing work in violation of the provisions of this code, or in violation of a detail statement or the approved construction documents thereunder, or in violation of a permit or certificate issued under the provisions of this code. Such order shall direct the discontinuance of the illegal action or condition and the abatement of the violation.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 108
VIOLATIONS / 108.3 Prosecution of violation.**

108.3 Prosecution of violation.

If the notice of violation is not complied with promptly, the code official shall request the legal counsel of the jurisdiction to institute the appropriate proceeding at law or in equity to restrain, correct or abate such violation, or to require the removal or termination of the unlawful

occupancy of the structure in violation of the provisions of this code or of the order or direction made pursuant thereto.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 108 VIOLATIONS / 108.4 Violation penalties.

108.4 Violation penalties.

Any person who shall violate a provision of this code or shall fail to comply with any of the requirements thereof or who shall erect, install, alter or repair plumbing work in violation of the approved construction documents or directive of the code official, or of a permit or certificate issued under the provisions of this code, shall be guilty of a [SPECIFY OFFENSE], punishable by a fine of not more than [AMOUNT] dollars or by imprisonment not exceeding [NUMBER OF DAYS], or both such fine and imprisonment. Each day that a violation continues after due notice has been served shall be deemed a separate offense.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 108 VIOLATIONS / 108.5 Stop work orders.

108.5 Stop work orders.

Upon notice from the code official, work on any plumbing system that is being done contrary to the provisions of this code or in a dangerous or unsafe manner shall immediately cease. Such notice shall be in writing and shall be given to the owner of the property, or to the owner's agent, or to the person doing the work. The notice shall state the conditions under which work is authorized to resume. Where an emergency exists, the code official shall not be required to give a written notice prior to stopping the work. Any person who shall continue any work in or about the structure after having been served with a stop work order, except such work as that person is directed to perform to remove a violation or unsafe condition, shall be liable to a fine of not less than [AMOUNT] dollars or more than [AMOUNT] dollars.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 108 VIOLATIONS / 108.6 Abatement of violation.

108.6 Abatement of violation.

The imposition of the penalties herein prescribed shall not preclude the legal officer of the jurisdiction from instituting appropriate action to prevent unlawful construction or to restrain, correct or abate a violation, or to prevent illegal occupancy of a building, structure or premises, or to stop an illegal act, conduct, business or utilization of the plumbing on or about any premises.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 108 VIOLATIONS / 108.7 Unsafe plumbing.

108.7 Unsafe plumbing.

Any plumbing regulated by this code that is unsafe or that constitutes a fire or health hazard, insanitary condition, or is otherwise dangerous to human life is hereby declared unsafe. Any use of plumbing regulated by this code constituting a hazard to safety, health or public welfare by reason of inadequate maintenance, dilapidation, obsolescence, fire hazard, disaster, damage or abandonment is hereby declared an unsafe use. Any such unsafe equipment is hereby declared to be a public nuisance and shall be abated by repair, rehabilitation, demolition or removal.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 108 VIOLATIONS / 108.7 Unsafe plumbing. / 108.7.1 Authority to condemn equipment.

108.7.1 Authority to condemn equipment.

Whenever the code official determines that any plumbing, or portion thereof, regulated by this code has become hazardous to life, health or property or has become insanitary, the code official shall order in writing that such plumbing either be removed or restored to a safe or sanitary condition. A time limit for compliance with such order shall be specified in the written notice. No person shall use or maintain defective plumbing after receiving such notice.

When such plumbing is to be disconnected, written notice as prescribed in Section 108.2 shall be given. In cases of immediate danger to life or property, such disconnection shall be made immediately without such notice.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 108 VIOLATIONS / 108.7 Unsafe plumbing. / 108.7.2 Authority to disconnect service utilities.

108.7.2 Authority to disconnect service utilities.

The code official shall have the authority to authorize disconnection of utility service to the building, structure or system regulated by the technical codes in case of an emergency, where necessary, to eliminate an immediate danger to life or property. Where possible, the owner and occupant of the building, structure or service system shall be notified of the decision to disconnect utility service prior to taking such action. If not notified prior to disconnecting, the owner or occupant of the building, structure or service systems shall be notified in writing, as soon as practical thereafter.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 108 VIOLATIONS / 108.7 Unsafe plumbing. / 108.7.3 Connection after order to disconnect.

108.7.3 Connection after order to disconnect.

No person shall make connections from any energy, fuel, power supply or water distribution system or supply energy, fuel or water to any equipment regulated by this code that has been disconnected or ordered to be disconnected by the code official or the use of which has been ordered to be discontinued by the code official until the code official authorizes the

reconnection and use of such equipment.

When any plumbing is maintained in violation of this code, and in violation of any notice issued pursuant to the provisions of this section, the code official shall institute any appropriate action to prevent, restrain, correct or abate the violation.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 109
MEANS OF APPEAL**

**SECTION 109
MEANS OF APPEAL**

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 109
MEANS OF APPEAL / 109.1 Application for appeal.**

109.1 Application for appeal.

Any person shall have the right to appeal a decision of the code official to the board of appeals. An application for appeal shall be based on a claim that the true intent of this code or the rules legally adopted thereunder have been incorrectly interpreted, the provisions of this code do not fully apply, or an equally good or better form of construction is proposed. The application shall be filed on a form obtained from the code official within 20 days after the notice was served.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 109
MEANS OF APPEAL / 109.2 Membership of board.**

109.2 Membership of board.

The board of appeals shall consist of five members appointed by the chief appointing authority as follows: one for 5 years, one for 4 years, one for 3 years, one for 2 years and one for 1 year. Thereafter, each new member shall serve for 5 years or until a successor has been appointed.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 109
MEANS OF APPEAL / 109.2 Membership of board. / 109.2.1 Qualifications.**

109.2.1 Qualifications.

The board of appeals shall consist of five individuals, one from each of the following professions or disciplines:

1. Registered design professional who is a registered architect; or a builder or superintendent of building construction with at least 10 years' experience, 5 years of which shall have been in responsible charge of work.
2. Registered design professional with structural engineering or architectural

experience.

3. Registered design professional with mechanical and plumbing engineering experience; or a mechanical and plumbing contractor with at least 10 years' experience, 5 years of which shall have been in responsible charge of work.
4. Registered design professional with electrical engineering experience; or an electrical contractor with at least 10 years' experience, 5 years of which shall have been in responsible charge of work.
5. Registered design professional with fire protection engineering experience; or a fire protection contractor with at least 10 years' experience, 5 years of which shall have been in responsible charge of work.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 109 MEANS OF APPEAL / 109.2 Membership of board. / 109.2.2 Alternate members.

109.2.2 Alternate members.

The chief appointing authority shall appoint two alternate members who shall be called by the board chairman to hear appeals during the absence or disqualification of a member. Alternate members shall possess the qualifications required for board membership, and shall be appointed for 5 years or until a successor has been appointed.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 109 MEANS OF APPEAL / 109.2 Membership of board. / 109.2.3 Chairman.

109.2.3 Chairman.

The board shall annually select one of its members to serve as chairman.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 109 MEANS OF APPEAL / 109.2 Membership of board. / 109.2.4 Disqualification of member.

109.2.4 Disqualification of member.

A member shall not hear an appeal in which that member has any personal, professional or financial interest.

2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 109 MEANS OF APPEAL / 109.2 Membership of board. / 109.2.5 Secretary.

109.2.5 Secretary.

The chief administrative officer shall designate a qualified clerk to serve as secretary to the board. The secretary shall file a detailed record of all proceedings in the office of the chief administrative officer.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 109
MEANS OF APPEAL / 109.2 Membership of board. / 109.2.6 Compensation of members.**

109.2.6 Compensation of members.

Compensation of members shall be determined by law.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 109
MEANS OF APPEAL / 109.3 Notice of meeting.**

109.3 Notice of meeting.

The board shall meet upon notice from the chairman, within 10 days of the filing of an appeal or at stated periodic meetings.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 109
MEANS OF APPEAL / 109.4 Open hearing.**

109.4 Open hearing.

All hearings before the board shall be open to the public. The appellant, the appellant's representative, the code official and any person whose interests are affected shall be given an opportunity to be heard.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 109
MEANS OF APPEAL / 109.4 Open hearing. / 109.4.1 Procedure.**

109.4.1 Procedure.

The board shall adopt and make available to the public through the secretary procedures under which a hearing will be conducted. The procedures shall not require compliance with strict rules of evidence, but shall mandate that only relevant information be received.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 109
MEANS OF APPEAL / 109.5 Postponed hearing.**

109.5 Postponed hearing.

When five members are not present to hear an appeal, either the appellant or the appellant's representative shall have the right to request a postponement of the hearing.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 109
MEANS OF APPEAL / 109.6 Board decision.**

109.6 Board decision.

The board shall modify or reverse the decision of the code official by a concurring vote of three

members.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 109
MEANS OF APPEAL / 109.6 Board decision. / 109.6.1 Resolution.**

109.6.1 Resolution.

The decision of the board shall be by resolution. Certified copies shall be furnished to the appellant and to the code official.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 109
MEANS OF APPEAL / 109.6 Board decision. / 109.6.2 Administration.**

109.6.2 Administration.

The code official shall take immediate action in accordance with the decision of the board.

**2006 International Plumbing Code / CHAPTER 1 ADMINISTRATION / SECTION 109
MEANS OF APPEAL / 109.7 Court review.**

109.7 Court review.

Any person, whether or not a previous party of the appeal, shall have the right to apply to the appropriate court for a writ of certiorari to correct errors of law. Application for review shall be made in the manner and time required by law following the filing of the decision in the office of the chief administrative officer.

2006 International Plumbing Code / CHAPTER 2 DEFINITIONS

**CHAPTER 2
DEFINITIONS**

**2006 International Plumbing Code / CHAPTER 2 DEFINITIONS / SECTION 201
GENERAL**

**SECTION 201
GENERAL**

**2006 International Plumbing Code / CHAPTER 2 DEFINITIONS / SECTION 201
GENERAL / 201.1 Scope.**

201.1 Scope.

Unless otherwise expressly stated, the following words and terms shall, for the purposes of this code, have the meanings shown in this chapter.

2006 International Plumbing Code / CHAPTER 2 DEFINITIONS / SECTION 201 GENERAL / 201.2 Interchangeability.

201.2 Interchangeability.

Words stated in the present tense include the future; words stated in the masculine gender include the feminine and neuter; the singular number includes the plural and the plural the singular.

2006 International Plumbing Code / CHAPTER 2 DEFINITIONS / SECTION 201 GENERAL / 201.3 Terms defined in other codes.

201.3 Terms defined in other codes.

Where terms are not defined in this code and are defined in the *International Building Code*, *International Fire Code*, *ICC Electrical Code*, *International Fuel Gas Code* or the *International Mechanical Code*, such terms shall have the meanings ascribed to them as in those codes.

2006 International Plumbing Code / CHAPTER 2 DEFINITIONS / SECTION 201 GENERAL / 201.4 Terms not defined.

201.4 Terms not defined.

Where terms are not defined through the methods authorized by this section, such terms shall have ordinarily accepted meanings such as the context implies.

2006 International Plumbing Code / CHAPTER 2 DEFINITIONS / SECTION 202 GENERAL DEFINITIONS

**SECTION 202
GENERAL DEFINITIONS**

ACCEPTED ENGINEERING PRACTICE. That which conforms to accepted principles, tests or standards of nationally recognized technical or scientific authorities.

ACCESS (TO). That which enables a fixture, appliance or equipment to be reached by ready access or by a means that first requires the removal or movement of a panel, door or similar obstruction (see "Ready access").

ACCESS COVER. A removable plate, usually secured by bolts or screws, to permit access to a

pipe or pipe fitting for the purposes of inspection, repair or cleaning.

ADAPTER FITTING. An approved connecting device that suitably and properly joins or adjusts pipes and fittings which do not otherwise fit together.

AIR ADMITTANCE VALVE. One-way valve designed to allow air to enter the plumbing drainage system when negative pressures develop in the piping system. The device shall close by gravity and seal the vent terminal at zero differential pressure (no flow conditions) and under positive internal pressures. The purpose of an air admittance valve is to provide a method of allowing air to enter the plumbing drainage system without the use of a vent extended to open air and to prevent sewer gases from escaping into a building.

AIR BREAK (Drainage System). A piping arrangement in which a drain from a fixture, appliance or device discharges indirectly into another fixture, receptacle or interceptor at a point below the flood level rim and above the trap seal.

AIR GAP (Drainage System). The unobstructed vertical distance through the free atmosphere between the outlet of the waste pipe and the flood level rim of the receptacle into which the waste pipe is discharging.

AIR GAP (Water Distribution System). The unobstructed vertical distance through the free atmosphere between the lowest opening from any pipe or faucet supplying water to a tank, plumbing fixture or other device and the flood level rim of the receptacle.

ALTERNATIVE ENGINEERED DESIGN. A plumbing system that performs in accordance with the intent of Chapters 3 through 12 and provides an equivalent level of performance for the protection of public health, safety and welfare. The system design is not specifically regulated by Chapters 3 through 12.

ANCHORS. See "Supports."

ANTISIPHON. A term applied to valves or mechanical devices that eliminate siphonage.

APPROVED. Acceptable to the code official or other authority having jurisdiction.

APPROVED AGENCY. An established and recognized agency approved by the code official and that is regularly engaged in conducting tests or furnishing inspection services.

AREA DRAIN. A receptacle designed to collect surface or storm water from an open area.

ASPIRATOR. A fitting or device supplied with water or other fluid under positive pressure that passes through an integral orifice or constriction, causing a vacuum. Aspirators are also referred to as suction apparatus, and are similar in operation to an ejector.

BACKFLOW. Pressure created by any means in the water distribution system, which by being in excess of the pressure in the water supply mains causes a potential backflow condition.

Backpressure, low head. A pressure less than or equal to 4.33 psi (29.88 kPa) or the pressure exerted by a 10-foot (3048 mm) column of water.

I-Quest 2006 Codes Complete Collection

Backsiphonage. The backflow of potentially contaminated water into the potable water system as a result of the pressure in the potable water system falling below atmospheric pressure of the plumbing fixtures, pools, tanks or vats connected to the potable water distribution piping.

Backwater valve. A device or valve installed in the building drain or sewer pipe where a sewer is subject to backflow, and which prevents drainage or waste from backing up into a low level or fixtures and causing a flooding condition.

Drainage. A reversal of flow in the drainage system.

Water supply system. The flow of water or other liquids, mixtures or substances into the distribution pipes of a potable water supply from any source except the intended source.

BACKFLOW CONNECTION. Any arrangement whereby backflow is possible.

BACKFLOW PREVENTER. A device or means to prevent backflow.

BALL COCK. See "Fill valve."

BASE FLOOD ELEVATION. A reference point, determined in accordance with the building code, based on the depth or peak elevation of flooding, including wave height, which has a 1 percent (100-year flood) or greater chance of occurring in any given year.

BATHROOM GROUP. A group of fixtures consisting of a water closet, lavatory, bathtub or shower, including or excluding a bidet, an emergency floor drain or both. Such fixtures are located together on the same floor level.

BEDPAN STEAMER OR BOILER. A fixture utilized for scalding bedpans or urinals by direct application of steam or boiling water.

BEDPAN WASHER AND STERILIZER. A fixture designed to wash bedpans and to flush the contents into the sanitary drainage system. Included are fixtures of this type that provide for disinfecting utensils by scalding with steam or hot water.

BEDPAN WASHER HOSE. A device supplied with hot and cold water and located adjacent to a water closet or clinical sink to be utilized for cleansing bedpans.

BRANCH. Any part of the piping system except a riser, main or stack.

BRANCH INTERVAL. A vertical measurement of distance, 8 feet (2438 mm) or more in developed length, between the connections of horizontal branches to a drainage stack. Measurements are taken down the stack from the highest horizontal branch connection.

BRANCH VENT. A vent connecting one or more individual vents with a vent stack or stack vent.

BUILDING. Any structure occupied or intended for supporting or sheltering any occupancy.

BUILDING DRAIN. That part of the lowest piping of a drainage system that receives the discharge from soil, waste and other drainage pipes inside and that extends 30 inches (762

mm) in developed length of pipe beyond the exterior walls of the building and conveys the drainage to the building sewer.

Combined. A building drain that conveys both sewage and storm water or other drainage.

Sanitary. A building drain that conveys sewage only.

Storm. A building drain that conveys storm water or other drainage, but not sewage.

BUILDING SEWER. That part of the drainage system that extends from the end of the building drain and conveys the discharge to a public sewer, private sewer, individual sewage disposal system or other point of disposal.

Combined. A building sewer that conveys both sewage and storm water or other drainage.

Sanitary. A building sewer that conveys sewage only.

Storm. A building sewer that conveys storm water or other drainage, but not sewage.

BUILDING SUBDRAIN. That portion of a drainage system that does not drain by gravity into the building sewer.

BUILDING TRAP. A device, fitting or assembly of fittings installed in the building drain to prevent circulation of air between the drainage system of the building and the building sewer.

CIRCUIT VENT. A vent that connects to a horizontal drainage branch and vents two traps to a maximum of eight traps or trapped fixtures connected into a battery.

CISTERN. A small covered tank for storing water for a home or farm. Generally, this tank stores rainwater to be utilized for purposes other than in the potable water supply, and such tank is placed underground in most cases.

CLEANOUT. An access opening in the drainage system utilized for the removal of obstructions. Types of cleanouts include a removable plug or cap, and a removable fixture or fixture trap.

CODE. These regulations, subsequent amendments thereto, or any emergency rule or regulation that the administrative authority having jurisdiction has lawfully adopted.

CODE OFFICIAL. The officer or other designated authority charged with the administration and enforcement of this code, or a duly authorized representative.

COMBINATION FIXTURE. A fixture combining one sink and laundry tray or a two- or three-compartment sink or laundry tray in one unit.

COMBINATION WASTE AND VENT SYSTEM. A specially designed system of waste piping embodying the horizontal wet venting of one or more sinks or floor drains by means of a common waste and vent pipe adequately sized to provide free movement of air above the flow line of the drain.

COMBINED BUILDING DRAIN. See “Building drain, combined.”

COMBINED BUILDING SEWER. See “Building sewer, combined.”

COMMON VENT. A vent connecting at the junction of two fixture drains or to a fixture branch and serving as a vent for both fixtures.

CONCEALED FOULING SURFACE. Any surface of a plumbing fixture which is not readily visible and is not scoured or cleansed with each fixture operation.

CONDUCTOR. A pipe inside the building that conveys storm water from the roof to a storm or combined building drain.

CONSTRUCTION DOCUMENTS. All of the written, graphic and pictorial documents prepared or assembled for describing the design, location and physical characteristics of the elements of the project necessary for obtaining a building permit. The construction drawings shall be drawn to an appropriate scale.

CONTAMINATION. An impairment of the quality of the potable water that creates an actual hazard to the public health through poisoning or through the spread of disease by sewage, industrial fluids or waste.

CRITICAL LEVEL (C-L). An elevation (height) reference point that determines the minimum height at which a backflow preventer or vacuum breaker is installed above the flood level rim of the fixture or receptor served by the device. The critical level is the elevation level below which there is a potential for backflow to occur. If the critical level marking is not indicated on the device, the bottom of the device shall constitute the critical level.

CROSS CONNECTION. Any physical connection or arrangement between two otherwise separate piping systems, one of which contains potable water and the other either water of unknown or questionable safety or steam, gas or chemical, whereby there exists the possibility for flow from one system to the other, with the direction of flow depending on the pressure differential between the two systems (see “Backflow”).

DEAD END. A branch leading from a soil, waste or vent pipe; a building drain; or a building sewer, and terminating at a developed length of 2 feet (610 mm) or more by means of a plug, cap or other closed fitting.

DEPTH OF WATER SEAL. The depth of water that would have to be removed from a full trap before air could pass through the trap.

DESIGN FLOOD ELEVATION. The elevation of the “design flood,” including wave height, relative to the datum specified on the community’s legally designated flood hazard map.

DEVELOPED LENGTH. The length of a pipeline measured along the centerline of the pipe and fittings.

DISCHARGE PIPE. A pipe that conveys the discharges from plumbing fixtures or appliances.

DRAIN. Any pipe that carries wastewater or water-borne wastes in a building drainage system.

DRAINAGE FITTINGS. Type of fitting or fittings utilized in the drainage system. Drainage fittings are similar to cast-iron fittings, except that instead of having a bell and spigot, drainage fittings are recessed and tapped to eliminate ridges on the inside of the installed pipe.

DRAINAGE FIXTURE UNIT

Drainage (dfu). A measure of the probable discharge into the drainage system by various types of plumbing fixtures. The drainage fixture-unit value for a particular fixture depends on its volume rate of drainage discharge, on the time duration of a single drainage operation and on the average time between successive operations.

DRAINAGE SYSTEM. Piping within a public or private premise that conveys sewage, rainwater or other liquid wastes to a point of disposal. A drainage system does not include the mains of a public sewer system or a private or public sewage treatment or disposal plant.

Building gravity. A drainage system that drains by gravity into the building sewer.

Sanitary. A drainage system that carries sewage and excludes storm, surface and ground water.

Storm. A drainage system that carries rainwater, surface water, subsurface water and similar liquid wastes.

EFFECTIVE OPENING. The minimum cross-sectional area at the point of water supply discharge, measured or expressed in terms of the diameter of a circle or, if the opening is not circular, the diameter of a circle of equivalent cross-sectional area. For faucets and similar fittings, the effective opening shall be measured at the smallest orifice in the fitting body or in the supply piping to the fitting.

EMERGENCY FLOOR DRAIN. A floor drain that does not receive the discharge of any drain or indirect waste pipe, and that protects against damage from accidental spills, fixture overflows and leakage.

ESSENTIALLY NONTOXIC TRANSFER FLUIDS. Fluids having a Gosselin rating of 1, including propylene glycol; mineral oil; polydimethylsiloxane; hydrochlorofluoro-carbon, chlorofluorocarbon and carbon refrigerants; and FDA-approved boiler water additives for steam boilers.

ESSENTIALLY TOXIC TRANSFER FLUIDS. Soil, waste or gray water and fluids having a Gosselin rating of 2 or more including ethylene glycol, hydrocarbon oils, ammonia refrigerants and hydrazine.

EXISTING INSTALLATIONS. Any plumbing system regulated by this code that was legally installed prior to the effective date of this code, or for which a permit to install has been issued.

FAUCET. A valve end of a water pipe through which water is drawn from or held within the pipe.

FILL VALVE. A water supply valve, opened or closed by means of a float or similar device, utilized to supply water to a tank. An antisiphon fill valve contains an antisiphon device in the form of an approved air gap or vacuum breaker that is an integral part of the fill valve unit and that is positioned on the discharge side of the water supply control valve.

FIXTURE. See "Plumbing fixture."

FIXTURE BRANCH. A drain serving two or more fixtures that discharges to another drain or to a stack.

FIXTURE DRAIN. The drain from the trap of a fixture to a junction with any other drain pipe.

FIXTURE FITTING

Supply fitting. A fitting that controls the volume and/or directional flow of water and is either attached to or accessible from a fixture, or is used with an open or atmospheric discharge.

Waste fitting. A combination of components that conveys the sanitary waste from the outlet of a fixture to the connection to the sanitary drainage system.

FIXTURE SUPPLY. The water supply pipe connecting a fixture to a branch water supply pipe or directly to a main water supply pipe.

FLOOD LEVEL RIM. The edge of the receptacle from which water overflows.

FLOOD HAZARD AREA. The greater of the following two areas:

1. The area within a flood plain subject to a 1-percent or greater chance of flooding in any given year.
2. The area designated as a flood hazard area on a community's flood hazard map or as otherwise legally designated.

FLOW CONTROL (Vented). A device installed upstream from the interceptor having an orifice that controls the rate of flow through the interceptor and an air intake (vent) downstream from the orifice that allows air to be drawn into the flow stream.

FLOW PRESSURE. The pressure in the water supply pipe near the faucet or water outlet while the faucet or water outlet is wide open and flowing.

FLUSH TANK. A tank designed with a fill valve and flush valve to flush the contents of the bowl or usable portion of the fixture.

FLUSHOMETER TANK. A device integrated within an air accumulator vessel that is designed to discharge a predetermined quantity of water to fixtures for flushing purposes.

FLUSHOMETER VALVE. A valve attached to a pressurized water supply pipe and so designed that when activated it opens the line for direct flow into the fixture at a rate and quantity to operate the fixture properly, and then gradually closes to reseal fixture traps and avoid water

hammer.

GREASE INTERCEPTOR. A plumbing appurtenance that is installed in a sanitary drainage system to intercept oily and greasy wastes from a wastewater discharge. Such device has the ability to intercept free-floating fats and oils.

GREASE-LADEN WASTE. Effluent discharge that is produced from food processing, food preparation or other sources where grease, fats and oils enter automatic dishwasher prerinse stations, sinks or other appurtenances.

GREASE REMOVAL DEVICE, AUTOMATIC (GRD). A plumbing appurtenance that is installed in the sanitary drainage system to intercept free-floating fats, oils and grease from wastewater discharge. Such a device operates on a time- or event-controlled basis and has the ability to remove free-floating fats, oils and grease automatically without intervention from the user except for maintenance.

GRIDDED WATER DISTRIBUTION SYSTEM. A water distribution system where every water distribution pipe is interconnected so as to provide two or more paths to each fixture supply pipe.

HANGERS. See "Supports."

HORIZONTAL BRANCH DRAIN. A drainage branch pipe extending laterally from a soil or waste stack or building drain, with or without vertical sections or branches, that receives the discharge from two or more fixture drains or branches and conducts the discharge to the soil or waste stack or to the building drain.

HORIZONTAL PIPE. Any pipe or fitting that makes an angle of less than 45 degrees (0.79 rad) with the horizontal.

HOT WATER. Water at a temperature greater than or equal to 110°F (43°C).

HOUSE TRAP. See "Building trap."

INDIRECT WASTE PIPE. A waste pipe that does not connect directly with the drainage system, but that discharges into the drainage system through an air break or air gap into a trap, fixture, receptor or interceptor.

INDIVIDUAL SEWAGE DISPOSAL SYSTEM. A system for disposal of domestic sewage by means of a septic tank, cesspool or mechanical treatment, designed for utilization apart from a public sewer to serve a single establishment or building.

INDIVIDUAL VENT. A pipe installed to vent a fixture trap and connects with the vent system above the fixture served or terminates in the open air.

INDIVIDUAL WATER SUPPLY. A water supply that serves one or more families, and that is not an approved public water supply.

INTERCEPTOR. A device designed and installed to separate and retain for removal, by

automatic or manual means, deleterious, hazardous or undesirable matter from normal wastes, while permitting normal sewage or wastes to discharge into the drainage system by gravity.

JOINT

Expansion. A loop, return bend or return offset that provides for the expansion and contraction in a piping system and is utilized in tall buildings or where there is a rapid change of temperature, as in power plants, steam rooms and similar occupancies.

Flexible. Any joint between two pipes that permits one pipe to be deflected or moved without movement or deflection of the other pipe.

Mechanical. See "Mechanical joint."

Slip. A type of joint made by means of a washer or a special type of packing compound in which one pipe is slipped into the end of an adjacent pipe.

LEAD-FREE PIPE AND FITTINGS. Containing not more than 8.0-percent lead.

LEAD-FREE SOLDER AND FLUX. Containing not more than 0.2-percent lead.

LEADER. An exterior drainage pipe for conveying storm water from roof or gutter drains to an approved means of disposal.

LOCAL VENT STACK. A vertical pipe to which connections are made from the fixture side of traps and through which vapor or foul air is removed from the fixture or device utilized on bedpan washers.

MACERATING TOILET SYSTEMS. An assembly consisting of a water closet and sump with a macerating pump that is designed to collect, grind and pump wastes from the water closet and up to two other fixtures connected to the sump.

MAIN. The principal pipe artery to which branches are connected.

MANIFOLD. See "Plumbing appurtenance."

MECHANICAL JOINT. A connection between pipes, fittings, or pipes and fittings that is not screwed, caulked, threaded, soldered, solvent cemented, brazed or welded. A joint in which compression is applied along the centerline of the pieces being joined. In some applications, the joint is part of a coupling, fitting or adapter.

MEDICAL GAS SYSTEM. The complete system to convey medical gases for direct patient application from central supply systems (bulk tanks, manifolds and medical air compressors), with pressure and operating controls, alarm warning systems, related components and piping networks extending to station outlet valves at patient use points.

MEDICAL VACUUM SYSTEMS. A system consisting of central-vacuum-producing equipment with pressure and operating controls, shutoff valves, alarm-warning systems, gauges and a network of piping extending to and terminating with suitable station inlets at locations where

patient suction may be required.

NONPOTABLE WATER. Water not safe for drinking, personal or culinary utilization.

NUISANCE. Public nuisance as known in common law or in equity jurisprudence; whatever is dangerous to human life or detrimental to health; whatever structure or premises is not sufficiently ventilated, sewerred, drained, cleaned or lighted, with respect to its intended occupancy; and whatever renders the air, or human food, drink or water supply unwholesome.

OCCUPANCY. The purpose for which a building or portion thereof is utilized or occupied.

OFFSET. A combination of approved bends that makes two changes in direction bringing one section of the pipe out of line but into a line parallel with the other section.

OPEN AIR. Outside the structure.

PLUMBING. The practice, materials and fixtures utilized in the installation, maintenance, extension and alteration of all piping, fixtures, plumbing appliances and plumbing appurtenances, within or adjacent to any structure, in connection with sanitary drainage or storm drainage facilities; venting systems; and public or private water supply systems.

PLUMBING APPLIANCE. Any one of a special class of plumbing fixtures intended to perform a special function. Included are fixtures having the operation or control dependent on one or more energized components, such as motors, controls, heating elements, or pressure- or temperature-sensing elements.

Such fixtures are manually adjusted or controlled by the owner or operator, or are operated automatically through one or more of the following actions: a time cycle, a temperature range, a pressure range, a measured volume or weight.

PLUMBING APPURTENANCE. A manufactured device, prefabricated assembly or an on-the-job assembly of component parts that is an adjunct to the basic piping system and plumbing fixtures. An appurtenance demands no additional water supply and does not add any discharge load to a fixture or to the drainage system.

PLUMBING FIXTURE. A receptacle or device that is either permanently or temporarily connected to the water distribution system of the premises and demands a supply of water therefrom; discharges wastewater, liquid-borne waste materials or sewage either directly or indirectly to the drainage system of the premises; or requires both a water supply connection and a discharge to the drainage system of the premises.

PLUMBING SYSTEM. Includes the water supply and distribution pipes; plumbing fixtures and traps; water-treating or water-using equipment; soil, waste and vent pipes; and sanitary and storm sewers and building drains; in addition to their respective connections, devices and appurtenances within a structure or premises.

POLLUTION. An impairment of the quality of the potable water to a degree that does not create a hazard to the public health but that does adversely and unreasonably affect the aesthetic

qualities of such potable water for domestic use.

POTABLE WATER. Water free from impurities present in amounts sufficient to cause disease or harmful physiological effects and conforming to the bacteriological and chemical quality requirements of the Public Health Service Drinking Water Standards or the regulations of the public health authority having jurisdiction.

PRIVATE. In the classification of plumbing fixtures, “private” applies to fixtures in residences and apartments, and to fixtures in nonpublic toilet rooms of hotels and motels and similar installations in buildings where the plumbing fixtures are intended for utilization by a family or an individual.

PUBLIC OR PUBLIC UTILIZATION. In the classification of plumbing fixtures, “public” applies to fixtures in general toilet rooms of schools, gymnasiums, hotels, airports, bus and railroad stations, public buildings, bars, public comfort stations, office buildings, stadiums, stores, restaurants and other installations where a number of fixtures are installed so that their utilization is similarly unrestricted.

PUBLIC WATER MAIN. A water supply pipe for public utilization controlled by public authority.

QUICK-CLOSING VALVE. A valve or faucet that closes automatically when released manually or that is controlled by a mechanical means for fast-action closing.

READY ACCESS. That which enables a fixture, appliance or equipment to be directly reached without requiring the removal or movement of any panel, door or similar obstruction and without the use of a portable ladder, step stool or similar device.

REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTER. A backflow prevention device consisting of two independently acting check valves, internally force-loaded to a normally closed position and separated by an intermediate chamber (or zone) in which there is an automatic relief means of venting to the atmosphere, internally loaded to a normally open position between two tightly closing shutoff valves and with a means for testing for tightness of the checks and opening of the relief means.

REGISTERED DESIGN PROFESSIONAL. An individual who is registered or licensed to practice professional architecture or engineering as defined by the statutory requirements of the professional registration laws of the state or jurisdiction in which the project is to be constructed.

RELIEF VALVE

Pressure relief valve. A pressure-actuated valve held closed by a spring or other means and designed to relieve pressure automatically at the pressure at which such valve is set.

Temperature and pressure relief (T&P) valve. A combination relief valve designed to function as both a temperature relief and a pressure relief valve.

Temperature relief valve. A temperature-actuated valve designed to discharge automatically at the temperature at which such valve is set.

RELIEF VENT. A vent whose primary function is to provide circulation of air between drainage and vent systems.

RIM. An unobstructed open edge of a fixture.

RISER. See “Water pipe, riser.”

ROOF DRAIN. A drain installed to receive water collecting on the surface of a roof and to discharge such water into a leader or a conductor.

ROUGH-IN. Parts of the plumbing system that are installed prior to the installation of fixtures. This includes drainage, water supply, vent piping and the necessary fixture supports and any fixtures that are built into the structure.

SELF-CLOSING FAUCET. A faucet containing a valve that automatically closes upon deactivation of the opening means.

SEPARATOR. See “Interceptor.”

SEWAGE. Any liquid waste containing animal or vegetable matter in suspension or solution, including liquids containing chemicals in solution.

SEWAGE EJECTORS. A device for lifting sewage by entraining the sewage in a high-velocity jet of steam, air or water.

SEWER

Building sewer. See “Building sewer.”

Public sewer. A common sewer directly controlled by public authority.

Sanitary sewer. A sewer that carries sewage and excludes storm, surface and ground water.

Storm sewer. A sewer that conveys rainwater, surface water, subsurface water and similar liquid wastes.

SLOPE. The fall (pitch) of a line of pipe in reference to a horizontal plane. In drainage, the slope is expressed as the fall in units vertical per units horizontal (percent) for a length of pipe.

SOIL PIPE. A pipe that conveys sewage containing fecal matter to the building drain or building sewer.

SPILLPROOF VACUUM BREAKER. An assembly consisting of one check valve force-loaded closed and an air-inlet vent valve force-loaded open to atmosphere, positioned downstream of the check valve, and located between and including two tightly closing shutoff valves and a test cock.

STACK. A general term for any vertical line of soil, waste, vent or inside conductor piping that

extends through at least one story with or without offsets.

STACK VENT. The extension of a soil or waste stack above the highest horizontal drain connected to the stack.

STACK VENTING. A method of venting a fixture or fixtures through the soil or waste stack.

STERILIZER

Boiling type. A boiling-type sterilizer is a fixture of a nonpressure type utilized for boiling instruments, utensils or other equipment for disinfection. These devices are portable or are connected to the plumbing system.

Instrument. A device for the sterilization of various instruments.

Pressure (autoclave). A pressure vessel fixture designed to utilize steam under pressure for sterilizing.

Pressure instrument washer sterilizer. A pressure instrument washer sterilizer is a pressure vessel fixture designed to both wash and sterilize instruments during the operating cycle of the fixture.

Utensil. A device for the sterilization of utensils as utilized in health care services.

Water. A water sterilizer is a device for sterilizing water and storing sterile water.

STERILIZER VENT. A separate pipe or stack, indirectly connected to the building drainage system at the lower terminal, that receives the vapors from nonpressure sterilizers, or the exhaust vapors from pressure sterilizers, and conducts the vapors directly to the open air. Also called vapor, steam, atmospheric or exhaust vent.

STORM DRAIN. See "Drainage system, storm."

STRUCTURE. That which is built or constructed or a portion thereof.

SUBSOIL DRAIN. A drain that collects subsurface water or seepage water and conveys such water to a place of disposal.

SUMP. A tank or pit that receives sewage or liquid waste, located below the normal grade of the gravity system and that must be emptied by mechanical means.

SUMP PUMP. An automatic water pump powered by an electric motor for the removal of drainage, except raw sewage, from a sump, pit or low point.

SUMP VENT. A vent from pneumatic sewage ejectors, or similar equipment, that terminates separately to the open air.

SUPPORTS. Devices for supporting and securing pipe, fixtures and equipment.

SWIMMING POOL. Any structure, basin, chamber or tank containing an artificial body of water

I-Quest 2006 Codes Complete Collection

for swimming, diving or recreational bathing having a depth of 2 feet (610 mm) or more at any point.

TEMPERED WATER. Water having a temperature range between 85°F (29°C) and 110°F (43°C).

THIRD-PARTY CERTIFICATION AGENCY. An approved agency operating a product or material certification system that incorporates initial product testing, assessment and surveillance of a manufacturer's quality control system.

THIRD-PARTY CERTIFIED. Certification obtained by the manufacturer indicating that the function and performance characteristics of a product or material have been determined by testing and ongoing surveillance by an approved third-party certification agency. Assertion of certification is in the form of identification in accordance with the requirements of the third-party certification agency.

THIRD-PARTY TESTED. Procedure by which an approved testing laboratory provides documentation that a product, material or system conforms to specified requirements.

TRAP. A fitting or device that provides a liquid seal to prevent the emission of sewer gases without materially affecting the flow of sewage or wastewater through the trap.

TRAP SEAL. The vertical distance between the weir and the top of the dip of the trap.

UNSTABLE GROUND. Earth that does not provide a uniform bearing for the barrel of the sewer pipe between the joints at the bottom of the pipe trench.

VACUUM. Any pressure less than that exerted by the atmosphere.

VACUUM BREAKER. A type of backflow preventer installed on openings subject to normal atmospheric pressure that prevents backflow by admitting atmospheric pressure through ports to the discharge side of the device.

VENT PIPE. See "Vent system."

VENT STACK. A vertical vent pipe installed primarily for the purpose of providing circulation of air to and from any part of the drainage system.

VENT SYSTEM. A pipe or pipes installed to provide a flow of air to or from a drainage system, or to provide a circulation of air within such system to protect trap seals from siphonage and backpressure.

VERTICAL PIPE. Any pipe or fitting that makes an angle of 45 degrees (0.79 rad) or more with the horizontal.

WALL-HUNG WATER CLOSET. A wall-mounted water closet installed in such a way that the fixture does not touch the floor.

WASTE. The discharge from any fixture, appliance, area or appurtenance that does not contain

fecal matter.

WASTE PIPE. A pipe that conveys only waste.

WATER-HAMMER ARRESTOR. A device utilized to absorb the pressure surge (water hammer) that occurs when water flow is suddenly stopped in a water supply system.

WATER HEATER. Any heating appliance or equipment that heats potable water and supplies such water to the potable hot water distribution system.

WATER MAIN. A water supply pipe or system of pipes, installed and maintained by a city, township, county, public utility company or other public entity, on public property, in the street or in an approved dedicated easement of public or community use.

WATER OUTLET. A discharge opening through which water is supplied to a fixture, into the atmosphere (except into an open tank that is part of the water supply system), to a boiler or heating system, or to any devices or equipment requiring water to operate but which are not part of the plumbing system.

WATER PIPE

Riser. A water supply pipe that extends one full story or more to convey water to branches or to a group of fixtures.

Water distribution pipe. A pipe within the structure or on the premises that conveys water from the water service pipe, or from the meter when the meter is at the structure, to the points of utilization.

Water service pipe. The pipe from the water main or other source of potable water supply, or from the meter when the meter is at the public right of way, to the water distribution system of the building served.

WATER SUPPLY SYSTEM. The water service pipe, water distribution pipes, and the necessary connecting pipes, fittings, control valves and all appurtenances in or adjacent to the structure or premises.

WELL

Bored. A well constructed by boring a hole in the ground with an auger and installing a casing.

Drilled. A well constructed by making a hole in the ground with a drilling machine of any type and installing casing and screen.

Driven. A well constructed by driving a pipe in the ground. The drive pipe is usually fitted with a well point and screen.

Dug. A well constructed by excavating a large-diameter shaft and installing a casing.

WHIRLPOOL BATHTUB. A plumbing appliance consisting of a bathtub fixture that is equipped

and fitted with a circulating piping system designed to accept, circulate and discharge bathtub water upon each use.

YOKE VENT. A pipe connecting upward from a soil or waste stack to a vent stack for the purpose of preventing pressure changes in the stacks.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS

**CHAPTER 3
GENERAL REGULATIONS**

**2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /
SECTION 301 GENERAL**

**SECTION 301
GENERAL**

**2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /
SECTION 301 GENERAL / 301.1 Scope.**

301.1 Scope.

The provisions of this chapter shall govern the general regulations regarding the installation of plumbing not specific to other chapters.

**2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /
SECTION 301 GENERAL / 301.2 System installation.**

301.2 System installation.

Plumbing shall be installed with due regard to preservation of the strength of structural members and prevention of damage to walls and other surfaces through fixture usage.

**2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /
SECTION 301 GENERAL / 301.3 Connections to the sanitary drainage system.**

301.3 Connections to the sanitary drainage system.

All plumbing fixtures, drains, appurtenances and appliances used to receive or discharge liquid wastes or sewage shall be directly connected to the sanitary drainage system of the building or premises, in accordance with the requirements of this code. This section shall not be construed

to prevent the indirect waste systems required by Chapter 8.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 301 GENERAL / 301.4 Connections to water supply.

301.4 Connections to water supply.

Every plumbing fixture, device or appliance requiring or using water for its proper operation shall be directly or indirectly connected to the water supply system in accordance with the provisions of this code.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 301 GENERAL / 301.5 Pipe, tube and fitting sizes.

301.5 Pipe, tube and fitting sizes.

Unless otherwise specified, the pipe, tube and fitting sizes specified in this code are expressed in nominal or standard sizes as designated in the referenced material standards.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 301 GENERAL / 301.6 Prohibited locations.

301.6 Prohibited locations.

Plumbing systems shall not be located in an elevator shaft or in an elevator equipment room.

Exception: Floor drains, sumps and sump pumps shall be permitted at the base of the shaft provided they are indirectly connected to the plumbing system.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 301 GENERAL / 301.7 Conflicts.

301.7 Conflicts.

Where conflicts between this code and the conditions of the listing or the manufacturer's installation instructions occur, the provisions of this code apply.

Exception: Where a code provision is less restrictive than the conditions of the listing of the equipment or appliance or the manufacturer's installation instructions, the conditions of the listing and manufacturer's installation instructions shall apply.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 302 EXCLUSION OF MATERIALS DETRIMENTAL TO THE SEWER SYSTEM

**SECTION 302
EXCLUSION OF MATERIALS DETRIMENTAL
TO THE SEWER SYSTEM**

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 302 EXCLUSION OF MATERIALS DETRIMENTAL TO THE SEWER SYSTEM / 302.1 Detrimental or dangerous materials.

302.1 Detrimental or dangerous materials.

Ashes, cinders or rags; flammable, poisonous or explosive liquids or gases; oil, grease or any other insoluble material capable of obstructing, damaging or overloading the building drainage or sewer system, or capable of interfering with the normal operation of the sewage treatment processes, shall not be deposited, by any means, into such systems.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 302 EXCLUSION OF MATERIALS DETRIMENTAL TO THE SEWER SYSTEM / 302.2 Industrial wastes.

302.2 Industrial wastes.

Waste products from manufacturing or industrial operations shall not be introduced into the public sewer until it has been determined by the code official or other authority having jurisdiction that the introduction thereof will not damage the public sewer system or interfere with the functioning of the sewage treatment plant.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 303 MATERIALS

**SECTION 303
MATERIALS**

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 303 MATERIALS / 303.1 Identification.

303.1 Identification.

Each length of pipe and each pipe fitting, trap, fixture, material and device utilized in a plumbing system shall bear the identification of the manufacturer.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /

SECTION 303 MATERIALS / 303.2 Installation of materials.

303.2 Installation of materials.

All materials used shall be installed in strict accordance with the standards under which the materials are accepted and approved. In the absence of such installation procedures, the manufacturer's installation instructions shall be followed. Where the requirements of referenced standards or manufacturer's installation instructions do not conform to minimum provisions of this code, the provisions of this code shall apply.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 303 MATERIALS / 303.3 Plastic pipe, fittings and components.

303.3 Plastic pipe, fittings and components.

All plastic pipe, fittings and components shall be third-party certified as conforming to NSF 14.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 303 MATERIALS / 303.4 Third-party testing and certification.

303.4 Third-party testing and certification.

All plumbing products and materials shall comply with the referenced standards, specifications and performance criteria of this code and shall be identified in accordance with Section 303.1. When required by Table 303.4, plumbing products and materials shall either be tested by an approved third-party testing agency or certified by an approved third-party certification agency.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 303 MATERIALS / 303.4 Third-party testing and certification. / TABLE 303.4 PRODUCTS AND MATERIALS REQUIRING THIRD-PARTY TESTING AND THIRD-PARTY CERTIFICATION

**TABLE 303.4
PRODUCTS AND MATERIALS REQUIRING THIRD-PARTY TESTING AND THIRD-PARTY CERTIFICATION**

PRODUCT OR MATERIAL	THIRD-PARTY CERTIFIED	THIRD-PARTY
Potable water supply system components and potable water fixture fittings	Required	—
Sanitary drainage and vent system components	Plastic pipe, fittings and pipe-related components	All oth
Waste fixture fittings	Plastic pipe, fittings and pipe-related components	All oth
Storm drainage system components	Plastic pipe, fittings and pipe-related components	All oth
Plumbing fixtures	—	Requ
Plumbing appliances	Required	—

I-Quest 2006 Codes Complete Collection

Backflow prevention devices	Required	—
Water distribution system safety devices	Required	—
Special waste system components	—	Requ
Subsoil drainage system components	—	Requ

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 304 RODENTPROOFING

**SECTION 304
RODENTPROOFING**

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 304 RODENTPROOFING / 304.1 General.

304.1 General.

Plumbing systems shall be designed and installed in accordance with Sections 304.2 through 304.4 to prevent rodents from entering structures.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 304 RODENTPROOFING / 304.2 Strainer plates.

304.2 Strainer plates.

All strainer plates on drain inlets shall be designed and installed so that all openings are not greater than 0.5 inch (12.7 mm) in least dimension.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 304 RODENTPROOFING / 304.3 Meter boxes.

304.3 Meter boxes.

Meter boxes shall be constructed in such a manner that rodents are prevented from entering a structure by way of the water service pipes connecting the meter box and the structure.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 304 RODENTPROOFING / 304.4 Openings for pipes.

304.4 Openings for pipes.

In or on structures where openings have been made in walls, floors or ceilings for the passage of pipes, such openings shall be closed and protected by the installation of approved metal collars that are securely fastened to the adjoining structure.

**2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /
SECTION 305 PROTECTION OF PIPES AND PLUMBING SYSTEM COMPONENTS**

**SECTION 305
PROTECTION OF PIPES AND
PLUMBING SYSTEM COMPONENTS**

**2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /
SECTION 305 PROTECTION OF PIPES AND PLUMBING SYSTEM COMPONENTS /
305.1 Corrosion.**

305.1 Corrosion.

Pipes passing through concrete or cinder walls and floors or other corrosive material shall be protected against external corrosion by a protective sheathing or wrapping or other means that will withstand any reaction from the lime and acid of concrete, cinder or other corrosive material. Sheathing or wrapping shall allow for expansion and contraction of piping to prevent any rubbing action. Minimum wall thickness of material shall be 0.025 inch (0.64 mm).

**2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /
SECTION 305 PROTECTION OF PIPES AND PLUMBING SYSTEM COMPONENTS /
305.2 Breakage.**

305.2 Breakage.

Pipes passing through or under walls shall be protected from breakage.

**2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /
SECTION 305 PROTECTION OF PIPES AND PLUMBING SYSTEM COMPONENTS /
305.3 Stress and strain.**

305.3 Stress and strain.

Piping in a plumbing system shall be installed so as to prevent strains and stresses that exceed the structural strength of the pipe. Where necessary, provisions shall be made to protect piping from damage resulting from expansion, contraction and structural settlement.

**2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /
SECTION 305 PROTECTION OF PIPES AND PLUMBING SYSTEM COMPONENTS /
305.4 Sleeves.**

305.4 Sleeves.

Annular spaces between sleeves and pipes shall be filled or tightly caulked in an approved

manner. Annular spaces between sleeves and pipes in fire-resistance-rated assemblies shall be filled or tightly caulked in accordance with the *International Building Code*.

**2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /
SECTION 305 PROTECTION OF PIPES AND PLUMBING SYSTEM COMPONENTS /
305.5 Pipes through or under footings or foundation walls.**

305.5 Pipes through or under footings or foundation walls.

Any pipe that passes under a footing or through a foundation wall shall be provided with a relieving arch, or a pipe sleeve pipe shall be built into the foundation wall. The sleeve shall be two pipe sizes greater than the pipe passing through the wall.

**2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /
SECTION 305 PROTECTION OF PIPES AND PLUMBING SYSTEM COMPONENTS /
305.6 Freezing.**

305.6 Freezing.

Water, soil and waste pipes shall not be installed outside of a building, in attics or crawl spaces, concealed in outside walls, or in any other place subjected to freezing temperature unless adequate provision is made to protect such pipes from freezing by insulation or heat or both. Exterior water supply system piping shall be installed not less than 6 inches (152 mm) below the frost line and not less than 12 inches (305 mm) below grade.

**2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /
SECTION 305 PROTECTION OF PIPES AND PLUMBING SYSTEM COMPONENTS /
305.6 Freezing. / 305.6.1 Sewer depth.**

305.6.1 Sewer depth.

Building sewers that connect to private sewage disposal systems shall be a minimum of [NUMBER] inches (mm) below finished grade at the point of septic tank connection. Building sewers shall be a minimum of [NUMBER] inches (mm) below grade.

**2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /
SECTION 305 PROTECTION OF PIPES AND PLUMBING SYSTEM COMPONENTS /
305.7 Waterproofing of openings.**

305.7 Waterproofing of openings.

Joints at the roof and around vent pipes, shall be made water tight by the use of lead, copper, galvanized steel, aluminum, plastic or other approved flashings or flashing material. Exterior wall openings shall be made water tight.

**2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /
SECTION 305 PROTECTION OF PIPES AND PLUMBING SYSTEM COMPONENTS /
305.8 Protection against physical damage.**

305.8 Protection against physical damage.

In concealed locations where piping, other than cast-iron or galvanized steel, is installed through holes or notches in studs, joists, rafters or similar members less than 1.5 inches (38 mm) from the nearest edge of the member, the pipe shall be protected by shield plates. Protective shield plates shall be a minimum of 0.062-inch-thick (1.6 mm) steel, shall cover the area of the pipe where the member is notched or bored, and shall extend a minimum of 2 inches (51 mm) above sole plates and below top plates.

**2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /
SECTION 305 PROTECTION OF PIPES AND PLUMBING SYSTEM COMPONENTS /
305.9 Protection of components of plumbing system.**

305.9 Protection of components of plumbing system.

Components of a plumbing system installed along alleyways, driveways, parking garages or other locations exposed to damage shall be recessed into the wall or otherwise protected in an approved manner.

**2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /
SECTION 306 TRENCHING, EXCAVATION AND BACKFILL**

**SECTION 306
TRENCHING, EXCAVATION AND BACKFILL**

**2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /
SECTION 306 TRENCHING, EXCAVATION AND BACKFILL / 306.1 Support of piping.**

306.1 Support of piping.

Buried piping shall be supported throughout its entire length.

**2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /
SECTION 306 TRENCHING, EXCAVATION AND BACKFILL / 306.2 Trenching and bedding.**

306.2 Trenching and bedding.

Where trenches are excavated such that the bottom of the trench forms the bed for the pipe, solid and continuous load-bearing support shall be provided between joints. Bell holes, hub

holes and coupling holes shall be provided at points where the pipe is joined. Such pipe shall not be supported on blocks to grade. In instances where the materials manufacturer's installation instructions are more restrictive than those prescribed by the code, the material shall be installed in accordance with the more restrictive requirement.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 306 TRENCHING, EXCAVATION AND BACKFILL / 306.2 Trenching and bedding. / 306.2.1 Overexcavation.

306.2.1 Overexcavation.

Where trenches are excavated below the installation level of the pipe such that the bottom of the trench does not form the bed for the pipe, the trench shall be backfilled to the installation level of the bottom of the pipe with sand or fine gravel placed in layers of 6 inches (152 mm) maximum depth and such backfill shall be compacted after each placement.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 306 TRENCHING, EXCAVATION AND BACKFILL / 306.2 Trenching and bedding. / 306.2.2 Rock removal.

306.2.2 Rock removal.

Where rock is encountered in trenching, the rock shall be removed to a minimum of 3 inches (76 mm) below the installation level of the bottom of the pipe, and the trench shall be backfilled to the installation level of the bottom of the pipe with sand tamped in place so as to provide uniform load-bearing support for the pipe between joints. The pipe, including the joints, shall not rest on rock at any point.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 306 TRENCHING, EXCAVATION AND BACKFILL / 306.2 Trenching and bedding. / 306.2.3 Soft load-bearing materials.

306.2.3 Soft load-bearing materials.

If soft materials of poor load-bearing quality are found at the bottom of the trench, stabilization shall be achieved by overexcavating a minimum of two pipe diameters and backfilling to the installation level of the bottom of the pipe with fine gravel, crushed stone or a concrete foundation. The concrete foundation shall be bedded with sand tamped into place so as to provide uniform load-bearing support for the pipe between joints.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 306 TRENCHING, EXCAVATION AND BACKFILL / 306.3 Backfilling.

306.3 Backfilling.

Backfill shall be free from discarded construction material and debris. Loose earth free from rocks, broken concrete and frozen chunks shall be placed in the trench in 6-inch (152 mm) layers and tamped in place until the crown of the pipe is covered by 12 inches (305 mm) of tamped earth. The backfill under and beside the pipe shall be compacted for pipe support. Backfill shall be brought up evenly on both sides of the pipe so that the pipe remains aligned. In instances where the manufacturer's installation instructions for materials are more restrictive than those prescribed by the code, the material shall be installed in accordance with the more restrictive requirement.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 306 TRENCHING, EXCAVATION AND BACKFILL / 306.4 Tunneling.

306.4 Tunneling.

Where pipe is to be installed by tunneling, jacking or a combination of both, the pipe shall be protected from damage during installation and from subsequent uneven loading. Where earth tunnels are used, adequate supporting structures shall be provided to prevent future settling or caving.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 307 STRUCTURAL SAFETY

**SECTION 307
STRUCTURAL SAFETY**

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 307 STRUCTURAL SAFETY / 307.1 General.

307.1 General.

In the process of installing or repairing any part of a plumbing and drainage installation, the finished floors, walls, ceilings, tile work or any other part of the building or premises that must be changed or replaced shall be left in a safe structural condition in accordance with the requirements of the *International Building Code*.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 307 STRUCTURAL SAFETY / 307.2 Cutting, notching or bored holes.

307.2 Cutting, notching or bored holes.

A framing member shall not be cut, notched or bored in excess of limitations specified in the *International Building Code*.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /

SECTION 307 STRUCTURAL SAFETY / 307.3 Penetrations of floor/ceiling assemblies and fire-resistance-rated assemblies.

307.3 Penetrations of floor/ceiling assemblies and fire-resistance-rated assemblies.

Penetrations of floor/ceiling assemblies and assemblies required to have a fire-resistance rating shall be protected in accordance with the *International Building Code*.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 307 STRUCTURAL SAFETY / [B] 307.4 Alterations to trusses.

[B] 307.4 Alterations to trusses.

Truss members and components shall not be cut, drilled, notched, spliced or otherwise altered in any way without written concurrence and approval of a registered design professional. Alterations resulting in the addition of loads to any member (e.g., HVAC equipment, water heater) shall not be permitted without verification that the truss is capable of supporting such additional loading.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 307 STRUCTURAL SAFETY / 307.5 Trench location.

307.5 Trench location.

Trenches installed parallel to footings shall not extend below the 45-degree (0.79 rad) bearing plane of the footing or wall.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 307 STRUCTURAL SAFETY / 307.6 Piping materials exposed within plenums.

307.6 Piping materials exposed within plenums.

All piping materials exposed within plenums shall comply with the provisions of the *International Mechanical Code*.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 308 PIPING SUPPORT

**SECTION 308
PIPING SUPPORT**

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 308 PIPING SUPPORT / 308.1 General.

308.1 General.

All plumbing piping shall be supported in accordance with this section.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 308 PIPING SUPPORT / 308.2 Piping seismic supports.

308.2 Piping seismic supports.

Where earthquake loads are applicable in accordance with the building code, plumbing piping supports shall be designed and installed for the seismic forces in accordance with the *International Building Code*.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 308 PIPING SUPPORT / 308.3 Materials.

308.3 Materials.

Hangers, anchors and supports shall support the piping and the contents of the piping. Hangers and strapping material shall be of approved material that will not promote galvanic action.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 308 PIPING SUPPORT / 308.4 Structural attachment.

308.4 Structural attachment.

Hangers and anchors shall be attached to the building construction in an approved manner.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 308 PIPING SUPPORT / 308.5 Interval of support.

308.5 Interval of support.

Pipe shall be supported in accordance with Table 308.5.

Exception: The interval of support for piping systems designed to provide for expansion/contraction shall conform to the engineered design in accordance with Section 105.4.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 308 PIPING SUPPORT / 308.5 Interval of support. / TABLE 308.5 HANGER SPACING

**TABLE 308.5
HANGER SPACING**

PIPING MATERIAL	MAXIMUM HORIZONTAL SPACING (feet)	MAXIMUM VERTICAL SPACING (feet)
-----------------	-----------------------------------	---------------------------------

I-Quest 2006 Codes Complete Collection

PIPING MATERIAL	MAXIMUM HORIZONTAL SPACING (feet)	MAXIMUM VERTICAL SPACING (feet)
ABS pipe	4	10 ^b
Aluminum tubing	10	15
Brass pipe	10	10
Cast-iron pipe	5 ^a	15
Copper or copper-alloy pipe	12	10
Copper or copper-alloy tubing, 1¼-inch diameter and smaller	6	10
Copper or copper-alloy tubing, 1½-inch diameter and larger	10	10
Cross-linked polyethylene (PEX) pipe	2.67 (32 inches)	10 ^b
Cross-linked polyethylene/aluminum/cross-linked polyethylene (PEX-AL-PEX) pipe	2.67 (32 inches)	4
CPVC pipe or tubing, 1 inch and smaller	3	10 ^b
CPVC pipe or tubing, 1¼ inches and larger	4	10 ^b
Steel pipe	12	15
Lead pipe	Continuous	4
PB pipe or tubing	2.67 (32 inches)	4
Polyethylene/aluminum/polyethylene (PE-AL-PE) pipe	2.67 (32 inches)	4
Polypropylene (PP) pipe or tubing 1 inch and smaller	2.67 (32 inches)	10 ^b
Polypropylene (PP) pipe or tubing, 1¼ inches and larger	4	10 ^b
PVC pipe	4	10 ^b
Stainless steel drainage systems	10	10 ^b

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm.

- a. The maximum horizontal spacing of cast-iron pipe hangers shall be increased to 10 feet where 10-foot lengths of pipe are installed.
- b. Midstory guide for sizes 2 inches and smaller.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 308 PIPING SUPPORT / 308.6 Sway bracing.

308.6 Sway bracing.

Rigid support sway bracing shall be provided at changes in direction greater than 45 degrees (0.79 rad) for pipe sizes 4 inches (102 mm) and larger.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 308 PIPING SUPPORT / 308.7 Anchorage.

308.7 Anchorage.

Anchorage shall be provided to restrain drainage piping from axial movement.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 308 PIPING SUPPORT / 308.7 Anchorage. / 308.7.1 Location.

308.7.1 Location.

For pipe sizes greater than 4 inches (102 mm), restraints shall be provided for drain pipes at all changes in direction and at all changes in diameter greater than two pipe sizes. Braces, blocks, rodding and other suitable methods as specified by the coupling manufacturer shall be utilized.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 308 PIPING SUPPORT / 308.8 Expansion joint fittings.

308.8 Expansion joint fittings.

Expansion joint fittings shall be used only where necessary to provide for expansion and contraction of the pipes. Expansion joint fittings shall be of the typical material suitable for use with the type of piping in which such fittings are installed.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 308 PIPING SUPPORT / 308.9 Parallel water distribution systems.

308.9 Parallel water distribution systems.

Piping bundles for manifold systems shall be supported in accordance with Table 308.5. Support at changes in direction shall be in accordance with the manufacturer's installation instructions. Hot and cold water piping shall not be grouped in the same bundle.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 309 FLOOD HAZARD RESISTANCE

**SECTION 309
FLOOD HAZARD RESISTANCE**

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 309 FLOOD HAZARD RESISTANCE / 309.1 General.

309.1 General.

Plumbing systems and equipment in structures erected in flood hazard areas shall be constructed in accordance with the requirements of this section and the *International Building Code*.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 309 FLOOD HAZARD RESISTANCE / [B] 309.2 Flood hazard.

[B] 309.2 Flood hazard.

For structures located in flood hazard areas, the following systems and equipment shall be located at or above the design flood elevation.

Exception: The following systems are permitted to be located below the design flood elevation provided that the systems are designed and installed to prevent water from entering or accumulating within their components and the systems are constructed to resist hydrostatic and hydrodynamic loads and stresses, including the effects of buoyancy, during the occurrence of flooding to the design flood elevation.

1. All water service pipes.
2. Pump seals in individual water supply systems where the pump is located below the design flood elevation.
3. Covers on potable water wells shall be sealed, except where the top of the casing well or pipe sleeve is elevated to at least 1 foot (305 mm) above the design flood elevation.
4. All sanitary drainage piping.
5. All storm drainage piping.
6. Manhole covers shall be sealed, except where elevated to or above the design flood elevation.
7. All other plumbing fixtures, faucets, fixture fittings, piping systems and equipment.
8. Water heaters.
9. Vents and vent systems.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 309 FLOOD HAZARD RESISTANCE / [B] 309.3 Flood hazard areas subject to high-velocity wave action.

[B] 309.3 Flood hazard areas subject to high-velocity wave action.

Structures located in flood hazard areas subject to high-velocity wave action shall meet the

requirements of Section 309.2. The plumbing systems, pipes and fixtures shall not be mounted on or penetrate through walls intended to break away under flood loads.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 310 WASHROOM AND TOILET ROOM REQUIREMENTS

**SECTION 310
WASHROOM AND TOILET ROOM REQUIREMENTS**

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 310 WASHROOM AND TOILET ROOM REQUIREMENTS / 310.1 Light and ventilation.

310.1 Light and ventilation.

Washrooms and toilet rooms shall be illuminated and ventilated in accordance with the *International Building Code* and *International Mechanical Code*.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 310 WASHROOM AND TOILET ROOM REQUIREMENTS / 310.2 Location of fixtures and piping.

310.2 Location of fixtures and piping.

Piping, fixtures or equipment shall not be located in such a manner as to interfere with the normal operation of windows, doors or other means of egress openings.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 310 WASHROOM AND TOILET ROOM REQUIREMENTS / 310.3 Interior finish.

310.3 Interior finish.

Interior finish surfaces of toilet rooms shall comply with the *International Building Code*.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 310 WASHROOM AND TOILET ROOM REQUIREMENTS / 310.4 Water closet compartment.

310.4 Water closet compartment.

Each water closet utilized by the public or employees shall occupy a separate compartment with walls or partitions and a door enclosing the fixtures to ensure privacy.

Exceptions:

1. Water closet compartments shall not be required in a single-occupant toilet room with a lockable door.
2. Toilet rooms located in day care and child-care facilities and containing two or more water closets shall be permitted to have one water closet without an enclosing compartment.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 310 WASHROOM AND TOILET ROOM REQUIREMENTS / 310.5 Urinal partitions.

310.5 Urinal partitions.

Each urinal utilized by the public or employees shall occupy a separate area with walls or partitions to provide privacy. The construction of such walls or partitions shall incorporate waterproof, smooth, readily cleanable and nonabsorbent finish surfaces. The walls or partitions shall begin at a height not more than 12 inches (305 mm) from and extend not less than 60 inches (1524 mm) above the finished floor surface. The walls or partitions shall extend from the wall surface at each side of the urinal a minimum of 18 inches (457 mm) or to a point not less than 6 inches (152 mm) beyond the outermost front lip of the urinal measured from the finished back wall surface, whichever is greater.

Exceptions:

1. Urinal partitions shall not be required in a single occupant or unisex toilet room with a lockable door.
2. Toilet rooms located in day care and child care facilities and containing two or more urinals shall be permitted to have one urinal without partitions.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 311 TOILET FACILITIES FOR WORKERS

**SECTION 311
TOILET FACILITIES FOR WORKERS**

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 311 TOILET FACILITIES FOR WORKERS / 311.1 General.

311.1 General.

Toilet facilities shall be provided for construction workers and such facilities shall be maintained in a sanitary condition. Construction worker toilet facilities of the nonsewer type shall conform to

ANSI Z4.3.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 312 TESTS AND INSPECTIONS

**SECTION 312
TESTS AND INSPECTIONS**

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 312 TESTS AND INSPECTIONS / 312.1 Required tests.

312.1 Required tests.

The permit holder shall make the applicable tests prescribed in Sections 312.2 through 312.9 to determine compliance with the provisions of this code. The permit holder shall give reasonable advance notice to the code official when the plumbing work is ready for tests. The equipment, material, power and labor necessary for the inspection and test shall be furnished by the permit holder and the permit holder shall be responsible for determining that the work will withstand the test pressure prescribed in the following tests. All plumbing system piping shall be tested with either water or, for piping systems other than plastic, by air. After the plumbing fixtures have been set and their traps filled with water, the entire drainage system shall be submitted to final tests. The code official shall require the removal of any cleanouts if necessary to ascertain whether the pressure has reached all parts of the system.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 312 TESTS AND INSPECTIONS / 312.1 Required tests. / 312.1.1 Test gauges.

312.1.1 Test gauges.

Gauges used for testing shall be as follows:

1. Tests requiring a pressure of 10 pounds per square inch (psi) (69 kPa) or less shall utilize a testing gauge having increments of 0.10 psi (0.69 kPa) or less.
2. Tests requiring a pressure of greater than 10 psi (69 kPa) but less than or equal to 100 psi (689 kPa) shall utilize a testing gauge having increments of 1 psi (6.9 kPa) or less.
3. Tests requiring a pressure of greater than 100 psi (689 kPa) shall utilize a testing gauge having increments of 2 psi (14 kPa) or less.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 312 TESTS AND INSPECTIONS / 312.2 Drainage and vent water test.

312.2 Drainage and vent water test.

A water test shall be applied to the drainage system either in its entirety or in sections. If applied to the entire system, all openings in the piping shall be tightly closed, except the highest opening, and the system shall be filled with water to the point of overflow. If the system is tested in sections, each opening shall be tightly plugged except the highest openings of the section under test, and each section shall be filled with water, but no section shall be tested with less than a 10-foot (3048 mm) head of water. In testing successive sections, at least the upper 10 feet (3048 mm) of the next preceding section shall be tested so that no joint or pipe in the building, except the uppermost 10 feet (3048 mm) of the system, shall have been submitted to a test of less than a 10-foot (3048 mm) head of water. This pressure shall be held for at least 15 minutes. The system shall then be tight at all points.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 312 TESTS AND INSPECTIONS / 312.3 Drainage and vent air test.

312.3 Drainage and vent air test.

An air test shall be made by forcing air into the system until there is a uniform gauge pressure of 5 psi (34.5 kPa) or sufficient to balance a 10-inch (254 mm) column of mercury. This pressure shall be held for a test period of at least 15 minutes. Any adjustments to the test pressure required because of changes in ambient temperature or the seating of gaskets shall be made prior to the beginning of the test period.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 312 TESTS AND INSPECTIONS / 312.4 Drainage and vent final test.

312.4 Drainage and vent final test.

The final test of the completed drainage and vent system shall be visual and insufficient detail to determine compliance with the provisions of this code except that the plumbing shall be subjected to a smoke test where necessary for cause. Where the smoke test is utilized, it shall be made by filling all traps with water and then introducing into the entire system a pungent, thick smoke produced by one or more smoke machines. When the smoke appears at stack openings on the roof, the stack openings shall be closed and a pressure equivalent to a 1-inch water column (248.8 Pa) shall be held for a test period of not less than 15 minutes.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 312 TESTS AND INSPECTIONS / 312.5 Water supply system test.

312.5 Water supply system test.

Upon completion of a section of or the entire water supply system, the system, or portion completed shall be tested and proved tight under a water pressure not less than the working pressure of the system; or, for piping systems other than plastic, by an air test of not less than 50 psi (344 kPa). This pressure shall be held for at least 15 minutes. The water utilized for tests

shall be obtained from a potable source of supply. The required tests shall be performed in accordance with this section and Section 107.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 312 TESTS AND INSPECTIONS / 312.6 Gravity sewer test.

312.6 Gravity sewer test.

Gravity sewer tests shall consist of plugging the end of the building sewer at the point of connection with the public sewer, filling the building sewer with water, testing with not less than a 10-foot (3048 mm) head of water and maintaining such pressure for 15 minutes.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 312 TESTS AND INSPECTIONS / 312.7 Forced sewer test.

312.7 Forced sewer test.

Forced sewer tests shall consist of plugging the end of the building sewer at the point of connection with the public sewer and applying a pressure of 5 psi (34.5 kPa) greater than the pump rating, and maintaining such pressure for 15 minutes.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 312 TESTS AND INSPECTIONS / 312.8 Storm drainage system test.

312.8 Storm drainage system test.

Storm drain systems within a building shall be tested by water or air in accordance with Section 312.2 or 312.3.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 312 TESTS AND INSPECTIONS / 312.9 Inspection and testing of backflow prevention assemblies.

312.9 Inspection and testing of backflow prevention assemblies.

Inspection and testing shall comply with Sections 312.9.1 and 312.9.2.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 312 TESTS AND INSPECTIONS / 312.9 Inspection and testing of backflow prevention assemblies. / 312.9.1 Inspections.

312.9.1 Inspections.

Annual inspections shall be made of all backflow prevention assemblies and air gaps to determine whether they are operable.

**2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /
SECTION 312 TESTS AND INSPECTIONS / 312.9 Inspection and testing of backflow
prevention assemblies. / 312.9.2 Testing.**

312.9.2 Testing.

Reduced pressure principle backflow preventer assemblies, double check-valve assemblies, pressure vacuum breaker assemblies, reduced pressure detector fire protection backflow prevention assemblies, double check detector fire protection backflow prevention assemblies, hose connection backflow preventers, and spill-proof vacuum breakers shall be tested at the time of installation, immediately after repairs or relocation and at least annually. The testing procedure shall be performed in accordance with one of the following standards:

ASSE 5013, ASSE 5015, ASSE 5020, ASSE 5047, ASSE 5048, ASSE 5052, ASSE 5056, CSA B64.10 or CSA B64.10.1.

**2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /
SECTION 313 EQUIPMENT EFFICIENCIES**

**SECTION 313
EQUIPMENT EFFICIENCIES**

**2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /
SECTION 313 EQUIPMENT EFFICIENCIES / 313.1 General.**

313.1 General.

Equipment efficiencies shall be in accordance with the *International Energy Conservation Code*.

**2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /
SECTION 314 CONDENSATE DISPOSAL**

**SECTION 314
CONDENSATE DISPOSAL**

**2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS /
SECTION 314 CONDENSATE DISPOSAL / [M] 314.1 Fuel-burning appliances.**

[M] 314.1 Fuel-burning appliances.

Liquid combustion byproducts of condensing appliances shall be collected and discharged to an approved plumbing fixture or disposal area in accordance with the manufacturer's installation instructions. Condensate piping shall be of approved corrosion-resistant material and shall not

be smaller than the drain connection on the appliance. Such piping shall maintain a minimum horizontal slope in the direction of discharge of not less than one-eighth unit vertical in 12 units horizontal (1-percent slope).

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 314 CONDENSATE DISPOSAL / [M] 314.2 Evaporators and cooling coils.

[M] 314.2 Evaporators and cooling coils.

Condensate drain systems shall be provided for equipment and appliances containing evaporators or cooling coils. Condensate drain systems shall be designed, constructed and installed in accordance with Sections 314.2.1 through 314.2.4.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 314 CONDENSATE DISPOSAL / [M] 314.2 Evaporators and cooling coils. / [M] 314.2.1 Condensate disposal.

[M] 314.2.1 Condensate disposal.

Condensate from all cooling coils and evaporators shall be conveyed from the drain pan outlet to an approved place of disposal. Condensate shall not discharge into a street, alley or other areas so as to cause a nuisance.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 314 CONDENSATE DISPOSAL / [M] 314.2 Evaporators and cooling coils. / [M] 314.2.2 Drain pipe materials and sizes.

[M] 314.2.2 Drain pipe materials and sizes.

Components of the condensate disposal system shall be cast iron, galvanized steel, copper, cross-linked polyethylene, polybutylene, polyethylene, ABS, CPVC, or PVC pipe or tubing. All components shall be selected for the pressure and temperature rating of the installation. Condensate waste and drain line size shall not be less than ¾-inch (19 mm) internal diameter and shall not decrease in size from the drain pan connection to the place of condensate disposal. Where the drain pipes from more than one unit are manifolded together for condensate drainage, the pipe or tubing shall be sized in accordance with an approved method. All horizontal sections of drain piping shall be installed in uniform alignment at a uniform slope.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 314 CONDENSATE DISPOSAL / [M] 314.2 Evaporators and cooling coils. / [M] 314.2.3 Auxiliary and secondary drain systems.

[M] 314.2.3 Auxiliary and secondary drain systems.

In addition to the requirements of Section 314.2.1, a secondary drain or auxiliary drain pan

shall be required for each cooling or evaporator coil or fuel-fired appliance that produces condensate, where damage to any building components will occur as a result of overflow from the equipment drain pan or stoppage in the condensate drain piping. One of the following methods shall be used:

1. An auxiliary drain pan with a separate drain shall be provided under the coils on which condensation will occur. The auxiliary pan drain shall discharge to a conspicuous point of disposal to alert occupants in the event of a stoppage of the primary drain. The pan shall have a minimum depth of 1.5 inches (38 mm), shall not be less than 3 inches (76 mm) larger than the unit or the coil dimensions in width and length and shall be constructed of corrosion-resistant material. Metallic pans shall have a minimum thickness of not less than 0.0276-inch (0.7 mm) galvanized sheet metal. Nonmetallic pans shall have a minimum thickness of not less than 0.0625 inch (1.6 mm).
2. A separate overflow drain line shall be connected to the drain pan provided with the equipment. The overflow drain shall discharge to a conspicuous point of disposal to alert occupants in the event of a stoppage of the primary drain. The overflow drain line shall connect to the drain pan at a higher level than the primary drain connection.
3. An auxiliary drain pan without a separate drain line shall be provided under the coils on which condensate will occur. The pan shall be equipped with a water-level detection device conforming to UL 508 that will shut off the equipment served prior to overflow of the pan. The auxiliary drain pan shall be constructed in accordance with Item 1 of this section.
4. A water level detection device conforming to UL 508 shall be provided that will shut off the equipment served in the event that the primary drain is blocked. The device shall be installed in the primary drain line, the overflow drain line or in the equipment-supplied drain pan located at a point higher than the primary drain line connection and below the overflow rim of such pan.

Exception: Fuel-fired appliances that automatically shut down operation in the event of a stoppage in the condensate drainage system.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 314 CONDENSATE DISPOSAL / [M] 314.2 Evaporators and cooling coils. / [M] 314.2.3 Auxiliary and secondary drain systems. / [M] 314.2.3.1 Water level monitoring devices.

[M] 314.2.3.1 Water level monitoring devices.

On downflow units and all other coils that have no secondary drain and no means to install an auxiliary drain pan, a water level monitoring device shall be installed inside the primary drain pan. This device shall shut off the equipment served in the event that the primary drain becomes restricted. Externally installed devices and devices installed in

the drain line shall not be permitted.

2006 International Plumbing Code / CHAPTER 3 GENERAL REGULATIONS / SECTION 314 CONDENSATE DISPOSAL / [M] 314.2 Evaporators and cooling coils. / [M] 314.2.4 Traps.

[M] 314.2.4 Traps.

Condensate drains shall be trapped as required by the equipment or appliance manufacturer.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS

**CHAPTER 4
FIXTURES, FAUCETS AND FIXTURE FITTINGS**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 401 GENERAL

**SECTION 401
GENERAL**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 401 GENERAL / 401.1 Scope.

401.1 Scope.

This chapter shall govern the materials, design and installation of plumbing fixtures, faucets and fixture fittings in accordance with the type of occupancy, and shall provide for the minimum number of fixtures for various types of occupancies.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 401 GENERAL / 401.2 Prohibited fixtures and connections.

401.2 Prohibited fixtures and connections.

Water closets having a concealed trap seal or an unventilated space or having walls that are not thoroughly washed at each discharge in accordance with ASME A112.19.2M shall be prohibited. Any water closet that permits siphonage of the contents of the bowl back into the

tank shall be prohibited. Trough urinals shall be prohibited.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 401 GENERAL / 401.3 Water conservation.

401.3 Water conservation.

The maximum water flow rates and flush volume for plumbing fixtures and fixture fittings shall comply with Section 604.4.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 402 FIXTURE MATERIALS

**SECTION 402
FIXTURE MATERIALS**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 402 FIXTURE MATERIALS / 402.1 Quality of fixtures.

402.1 Quality of fixtures.

Plumbing fixtures shall be constructed of approved materials, with smooth, impervious surfaces, free from defects and concealed fouling surfaces, and shall conform to standards cited in this code. All porcelain enameled surfaces on plumbing fixtures shall be acid resistant.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 402 FIXTURE MATERIALS / 402.2 Materials for specialty fixtures.

402.2 Materials for specialty fixtures.

Materials for specialty fixtures not otherwise covered in this code shall be of stainless steel, soapstone, chemical stoneware or plastic, or shall be lined with lead, copper-base alloy, nickel-copper alloy, corrosion-resistant steel or other material especially suited to the application for which the fixture is intended.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 402 FIXTURE MATERIALS / 402.3 Sheet copper.

402.3 Sheet copper.

Sheet copper for general applications shall conform to ASTM B 152 and shall not weigh less than 12 ounces per square foot (3.7 kg/m²).

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 402 FIXTURE MATERIALS / 402.4 Sheet lead.

402.4 Sheet lead.

Sheet lead for pans shall not weigh less than 4 pounds per square foot (19.5 kg/m²) coated with an asphalt paint or other approved coating.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 403 MINIMUM PLUMBING FACILITIES

**SECTION 403
MINIMUM PLUMBING FACILITIES**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 403 MINIMUM PLUMBING FACILITIES / 403.1 Minimum number of fixtures.

403.1 Minimum number of fixtures.

Plumbing fixtures shall be provided for the type of occupancy and in the minimum number shown in Table 403.1. Types of occupancies not shown in Table 403.1 shall be considered individually by the code official. The number of occupants shall be determined by the *International Building Code*. Occupancy classification shall be determined in accordance with the *International Building Code*.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 403 MINIMUM PLUMBING FACILITIES / 403.1 Minimum number of fixtures. / TABLE 403.1 MINIMUM NUMBER OF REQUIRED PLUMBING FIXTURES^a (See Sections 403.2 and 403.3)

**TABLE 403.1
MINIMUM NUMBER OF REQUIRED PLUMBING FIXTURES^a
(See Sections 403.2 and 403.3)**

NO.	CLASSIFICATION	OCCUPANCY	DESCRIPTION	WATER CLOSETS (URINALS SEE SECTION 419.2)		LAVATORIES		BATH SHOWERS
				MALE	FEMALE	MALE	FEMALE	
1	Assembly (see Sections 403.2, 403.4 and 403.4.1)	A-1 ^d	Theaters and other buildings for the performing arts and motion pictures	1 per 125	1 per 65	1 per 200		
		A-2 ^d	Nightclubs, bars, taverns, dance halls	1 per 40	1 per 40	1 per 75		

I-Quest 2006 Codes Complete Collection

NO.	CLASSIFICATION	OCCUPANCY	DESCRIPTION	WATER CLOSETS (URINALS SEE SECTION 419.2)		LAVATORIES		BAT SH
				MALE	FEMALE	MALE	FEMALE	
			and buildings for similar purposes					
			Restaurants, banquet halls and food courts	1 per 75	1 per 75	1 per 200		
		A-3 ^d	Auditoriums without permanent seating, art galleries, exhibition halls, museums, lecture halls, libraries, arcades and gymnasiums	1 per 125	1 per 65	1 per 200		
			Passenger terminals and transportation facilities	1 per 500	1 per 500	1 per 750		
			Places of worship and other religious services.	1 per 150	1 per 75	1 per 200		
		A-4	Coliseums, arenas, skating rinks, pools and tennis courts for indoor sporting events and activities	1 per 75 for the first 1,500 and 1 per 120 for the remainder exceeding 1,500	1 per 40 for the first 1,500 and 1 per 60 for the remainder exceeding 1,500	1 per 200	1 per 150	
		A-5	Stadiums, amusement parks, bleachers and grandstands for outdoor sporting events and activities	1 per 75 for the first 1,500 and 1 per 120 for the remainder exceeding 1,500	1 per 40 for the first 1,500 and 1 per 60 for the remainder exceeding 1,500	1 per 200	1 per 150	
2	Business (see Sections 403.2, 403.4 and 403.4.1)	B	Buildings for the transaction of business, professional services, other services involving merchandise, office buildings, banks, light industrial and similar uses	1 per 25 for the first 50 and 1 per 50 for the remainder exceeding 50		1 per 40 for the first 80 and 1 per 80 for the remainder exceeding 80		
3	Educational	E	Educational facilities	1 per 50		1 per 50		
4	Factory and industrial	F-1 and F-2	Structures in which occupants are engaged in work fabricating, assembly or processing of products or materials	1 per 100		1 per 100		(see

I-Quest 2006 Codes Complete Collection

NO.	CLASSIFICATION	OCCUPANCY	DESCRIPTION	WATER CLOSETS (URINALS SEE SECTION 419.2)		LAVATORIES		BATH SHOWER
				MALE	FEMALE	MALE	FEMALE	
5	Institutional	I-1	Residential care	1 per 10		1 per 10		1
		I-2	Hospitals, ambulatory nursing home patients ^b	1 per room ^c		1 per room ^c		(see
			Employees, other than residential care ^b	1 per 25		1 per 35		
			Visitors, other than residential care	1 per 75		1 per 100		
		I-3	Prisons ^b	1 per cell		1 per cell		1
		I-3	Reformatories, detention centers, and correctional centers ^b	1 per 15		1 per 15		1
		I-4	Adult day care and child care	1 per 15		1 per 15		

(continued)

NO.	CLASSIFICATION	OCCUPANCY	DESCRIPTION	WATER CLOSETS (URINALS SEE SECTION 419.2)		LAVATORIES		BATH SHOWER
				MALE	FEMALE	MALE	FEMALE	
6	Mercantile (see Sections 403.2, 403.4, 403.4.1 and 403.4.2)	M	Retail stores, service stations, shops, salesrooms, markets and shopping centers	1 per 500		1 per 750		
7	Residential	R-1	Hotels, motels, boarding houses (transient)	1 per sleeping unit		1 per sleeping unit		sleeping
		R-2	Dormitories, fraternities, sororities and boarding houses (not transient)	1 per 10		1 per 10		
		R-2	Apartment house	1 per dwelling unit		1 per dwelling unit		dwelling

I-Quest 2006 Codes Complete Collection

NO.	CLASSIFICATION	OCCUPANCY	DESCRIPTION	WATER CLOSETS (URINALS SEE SECTION 419.2)		LAVATORIES		BASIS
				MALE	FEMALE	MALE	FEMALE	
		R-3	One- and two-family dwellings	1 per dwelling unit		1 per dwelling unit		dw
		R-4	Residential care/assisted living facilities	1 per 10		1 per 10		
8	Storage (see Sections 403.2, 403.4 and 403.4.1)	S-1 S-2	Structures for the storage of goods, warehouses, storehouse and freight depots. Low and Moderate Hazard.	1 per 100		1 per 100		Sc

- a. The fixtures shown are based on one fixture being the minimum required for the number of persons indicated or any fraction of the number of persons indicated. The number of occupants shall be determined by the *International Building Code*.
- b. Toilet facilities for employees shall be separate from facilities for inmates or patients.
- c. A single-occupant toilet room with one water closet and one lavatory serving not more than two adjacent patient sleeping units shall be permitted where such room is provided with direct access from each patient room and with provisions for privacy.
- d. The occupant load for seasonal outdoor seating and entertainment areas shall be included when determining the minimum number of facilities required.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 403 MINIMUM PLUMBING FACILITIES / 403.1 Minimum number of fixtures. / [B] 403.1.1 Unisex toilet and bath fixtures.

[B] 403.1.1 Unisex toilet and bath fixtures.

Fixtures located within unisex toilet and bathing rooms complying with Section 404 are permitted to be included in determining the minimum required number of fixtures for assembly and mercantile occupancies.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 403 MINIMUM PLUMBING FACILITIES / 403.2 Separate facilities.

403.2 Separate facilities.

Where plumbing fixtures are required, separate facilities shall be provided for each sex.

Exceptions:

1. Separate facilities shall not be required for dwelling units and sleeping units.
2. Separate facilities shall not be required in structures or tenant spaces with a total occupant load, including both employees and customers, of 15 or less.
3. Separate facilities shall not be required in mercantile occupancies in which the maximum occupant load is 50 or less.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 403 MINIMUM PLUMBING FACILITIES / 403.3 Number of occupants of each sex.

403.3 Number of occupants of each sex.

The required water closets, lavatories, and showers or bathtubs shall be distributed equally between the sexes based on the percentage of each sex anticipated in the occupant load. The occupant load shall be composed of 50 percent of each sex, unless statistical data approved by the code official indicate a different distribution of the sexes.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 403 MINIMUM PLUMBING FACILITIES / 403.4 Required public toilet facilities.

403.4 Required public toilet facilities.

Customers, patrons and visitors shall be provided with public toilet facilities in structures and tenant spaces intended for public utilization. The accessible route to public facilities shall not pass through kitchens, storage rooms, closets or similar spaces. Employees shall be provided with toilet facilities in all occupancies. Employee toilet facilities shall be either separate or combined employee and public toilet facilities.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 403 MINIMUM PLUMBING FACILITIES / 403.4 Required public toilet facilities. / 403.4.1 Location of toilet facilities in occupancies other than covered malls.

403.4.1 Location of toilet facilities in occupancies other than covered malls.

In occupancies other than covered malls, the required public and employee toilet facilities shall be located not more than one story above or below the space required to be provided with toilet facilities, and the path of travel to such facilities shall not exceed a distance of 500 feet (152 m).

Exception: The location and maximum travel distances to required employee facilities in factory and industrial occupancies are permitted to exceed that required by this section, provided that the location and maximum travel distance are approved.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 403 MINIMUM PLUMBING FACILITIES / 403.4 Required public toilet facilities. / 403.4.2 Location of toilet facilities in covered malls.

403.4.2 Location of toilet facilities in covered malls.

In covered mall buildings, the required public and employee toilet facilities shall be located not more than one story above or below the space required to be provided with toilet facilities, and the path of travel to such facilities shall not exceed a distance of 300 feet (91 440 mm). In covered mall buildings, the required facilities shall be based on total square footage, and facilities shall be installed in each individual store or in a central toilet area located in accordance with this section. The maximum travel distance to central toilet facilities in covered mall buildings shall be measured from the main entrance of any store or tenant space. In covered mall buildings, where employees' toilet facilities are not provided in the individual store, the maximum travel distance shall be measured from the employee's work area of the store or tenant space.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 403 MINIMUM PLUMBING FACILITIES / 403.4 Required public toilet facilities. / 403.4.3 Pay facilities.

403.4.3 Pay facilities.

Where pay facilities are installed, such facilities shall be in excess of the required minimum facilities. Required facilities shall be free of charge.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 403 MINIMUM PLUMBING FACILITIES / 403.5 Signage.

403.5 Signage.

Required public facilities shall be designated by a legible sign for each sex. Signs shall be readily visible and located near the entrance to each toilet facility.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE

FITTINGS / SECTION 404 ACCESSIBLE PLUMBING FACILITIES

**SECTION 404
ACCESSIBLE PLUMBING FACILITIES**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 404 ACCESSIBLE PLUMBING FACILITIES / 404.1 Where required.

404.1 Where required.

Accessible plumbing facilities and fixtures shall be provided in accordance with the *International Building Code*.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 405 INSTALLATION OF FIXTURES

**SECTION 405
INSTALLATION OF FIXTURES**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 405 INSTALLATION OF FIXTURES / 405.1 Water supply protection.

405.1 Water supply protection.

The supply lines and fittings for every plumbing fixture shall be installed so as to prevent backflow.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 405 INSTALLATION OF FIXTURES / 405.2 Access for cleaning.

405.2 Access for cleaning.

Plumbing fixtures shall be installed so as to afford easy access for cleaning both the fixture and the area around the fixture.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 405 INSTALLATION OF FIXTURES / 405.3 Setting.

405.3 Setting.

Fixtures shall be set level and in proper alignment with reference to adjacent walls.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 405 INSTALLATION OF FIXTURES / 405.3 Setting. / 405.3.1

Water closets, urinals, lavatories and bidets.


405.3.1 Water closets, urinals, lavatories and bidets.

A water closet, urinal, lavatory or bidet shall not be set closer than 15 inches (381 mm) from its center to any side wall, partition, vanity or other obstruction, or closer than 30 inches (762 mm) center-to-center between adjacent fixtures. There shall be at least a 21-inch (533 mm) clearance in front of the water closet, urinal, lavatory or bidet to any wall, fixture or door. Water closet compartments shall not be less than 30 inches (762 mm) wide and 60 inches (1524 mm) deep (see Figure 405.3.1).

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 405 INSTALLATION OF FIXTURES / 405.3 Setting. / 405.3.1

Water closets, urinals, lavatories and bidets. / FIGURE 405.3.1 FIXTURE CLEARANCE

**FIGURE 405.3.1
FIXTURE CLEARANCE**

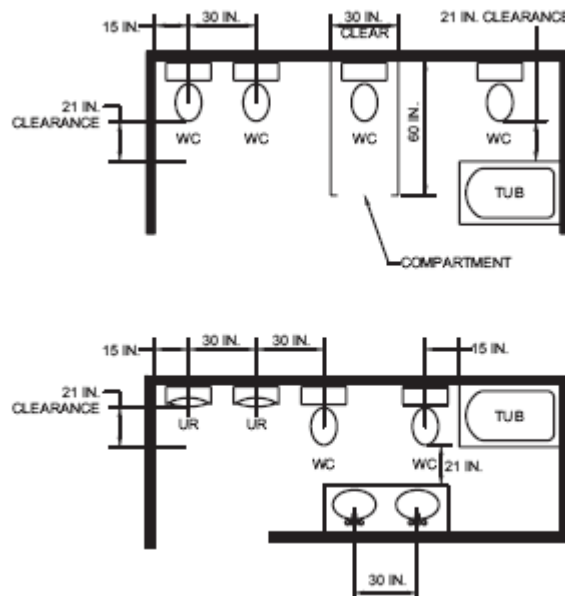

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 405 INSTALLATION OF FIXTURES / 405.3 Setting. / 405.3.2

Public lavatories.

405.3.2 Public lavatories.

In employee and public toilet rooms, the required lavatory shall be located in the same room as the required water closet.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 405 INSTALLATION OF FIXTURES / 405.4 Floor and wall drainage connections.

405.4 Floor and wall drainage connections.

Connections between the drain and floor outlet plumbing fixtures shall be made with a floor flange. The flange shall be attached to the drain and anchored to the structure. Connections between the drain and wall-hung water closets shall be made with an approved extension nipple or horn adaptor. The water closet shall be bolted to the hanger with corrosion-resistant bolts or screws. Joints shall be sealed with an approved elastomeric gasket, flange-to-fixture connection complying with ASME A112.4.3 or an approved setting compound.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 405 INSTALLATION OF FIXTURES / 405.4 Floor and wall drainage connections. / 405.4.1 Floor flanges.

405.4.1 Floor flanges.

Floor flanges for water closets or similar fixtures shall not be less than 0.125 inch (3.2 mm) thick for brass, 0.25 inch (6.4 mm) thick for plastic, and 0.25 inch (6.4 mm) thick and not less than a 2-inch (51 mm) caulking depth for cast-iron or galvanized malleable iron.

Floor flanges of hard lead shall weigh not less than 1 pound, 9 ounces (0.7 kg) and shall be composed of lead alloy with not less than 7.75-percent antimony by weight. Closet screws and bolts shall be of brass. Flanges shall be secured to the building structure with corrosion-resistant screws or bolts.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 405 INSTALLATION OF FIXTURES / 405.4 Floor and wall drainage connections. / 405.4.2 Securing floor outlet fixtures.

405.4.2 Securing floor outlet fixtures.

Floor outlet fixtures shall be secured to the floor or floor flanges by screws or bolts of corrosion-resistant material.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 405 INSTALLATION OF FIXTURES / 405.4 Floor and wall drainage connections. / 405.4.3 Securing wall-hung water closet bowls.

405.4.3 Securing wall-hung water closet bowls.

Wall-hung water closet bowls shall be supported by a concealed metal carrier that is attached to the building structural members so that strain is not transmitted to the closet connector or any other part of the plumbing system. The carrier shall conform to ASME A112.6.1M or ASME A112.6.2.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 405 INSTALLATION OF FIXTURES / 405.5 Water-tight joints.

405.5 Water-tight joints.

Joints formed where fixtures come in contact with walls or floors shall be sealed.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 405 INSTALLATION OF FIXTURES / 405.6 Plumbing in mental health centers.

405.6 Plumbing in mental health centers.

In mental health centers, pipes or traps shall not be exposed, and fixtures shall be bolted through walls.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 405 INSTALLATION OF FIXTURES / 405.7 Design of overflows.

405.7 Design of overflows.

Where any fixture is provided with an overflow, the waste shall be designed and installed so that standing water in the fixture will not rise in the overflow when the stopper is closed, and no water will remain in the overflow when the fixture is empty.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 405 INSTALLATION OF FIXTURES / 405.7 Design of overflows.

/ 405.7.1 Connection of overflows.

405.7.1 Connection of overflows.

The overflow from any fixture shall discharge into the drainage system on the inlet or fixture side of the trap.

Exception: The overflow from a flush tank serving a water closet or urinal shall discharge into the fixture served.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 405 INSTALLATION OF FIXTURES / 405.8 Slip joint

connections.

405.8 Slip joint connections.

Slip joints shall be made with an approved elastomeric gasket and shall only be installed on the trap outlet, trap inlet and within the trap seal. Fixtures with concealed slip-joint connections shall be provided with an access panel or utility space at least 12 inches (305 mm) in its smallest dimension or other approved arrangement so as to provide access to the slip joint connections for inspection and repair.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 405 INSTALLATION OF FIXTURES / 405.9 Design and installation of plumbing fixtures.

405.9 Design and installation of plumbing fixtures.

Integral fixture fitting mounting surfaces on manufactured plumbing fixtures or plumbing fixtures constructed on site, shall meet the design requirements of ASME A112.19.2M or ASME A112.19.3M.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 406 AUTOMATIC CLOTHES WASHERS

**SECTION 406
AUTOMATIC CLOTHES WASHERS**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 406 AUTOMATIC CLOTHES WASHERS / 406.1 Approval.

406.1 Approval.

Domestic automatic clothes washers shall conform to ASSE 1007.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 406 AUTOMATIC CLOTHES WASHERS / 406.2 Water connection.

406.2 Water connection.

The water supply to an automatic clothes washer shall be protected against backflow by an air gap installed integrally within the machine conforming to ASSE 1007 or with the installation of a backflow preventer in accordance with Section 608.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE

FITTINGS / SECTION 406 AUTOMATIC CLOTHES WASHERS / 406.3 Waste connection.

406.3 Waste connection.

The waste from an automatic clothes washer shall discharge through an air break into a standpipe in accordance with Section 802.4 or into a laundry sink. The trap and fixture drain for an automatic clothes washer standpipe shall be a minimum of 2 inches (51 mm) in diameter. The automatic clothes washer fixture drain shall connect to a branch drain or drainage stack a minimum of 3 inches (76 mm) in diameter. Automatic clothes washers that discharge by gravity shall be permitted to drain to a waste receptor or an approved trench drain.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 407 BATHTUBS

**SECTION 407
BATHTUBS**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 407 BATHTUBS / 407.1 Approval.

407.1 Approval.

Bathtubs shall conform to ANSI Z124.1, ASME A112.19.1M, ASME A112.19.4M, ASME A112.19.9M, CSA B45.2, CSA B45.3 or CSA B45.5.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 407 BATHTUBS / 407.2 Bathtub waste outlets.

407.2 Bathtub waste outlets.

Bathtubs shall have waste outlets a minimum of 1.5 inches (38 mm) in diameter. The waste outlet shall be equipped with an approved stopper.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 407 BATHTUBS / 407.3 Glazing.

407.3 Glazing.

Windows and doors within a bathtub enclosure shall conform to the safety glazing requirements of the *International Building Code*.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 407 BATHTUBS / 407.4 Bathtub enclosure.

407.4 Bathtub enclosure.

Doors within a bathtub enclosure shall conform to ASME A112.19.15.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 408 BIDETS

**SECTION 408
BIDETS**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 408 BIDETS / 408.1 Approval.

408.1 Approval.

Bidets shall conform to ASME A112.19.2M, ASME A112.19.9M or CSA B45.1.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 408 BIDETS / 408.2 Water connection.

408.2 Water connection.

The water supply to a bidet shall be protected against backflow by an air gap or backflow preventer in accordance with Section 608.13.1, 608.13.2, 608.13.3, 608.13.5, 608.13.6 or 608.13.8.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 408 BIDETS / 408.3 Bidet water temperature.

408.3 Bidet water temperature.

The discharge water temperature from a bidet fitting shall be limited to a maximum temperature of 110°F (43°C) by a water temperature limiting device conforming to ASSE 1070.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 409 DISHWASHING MACHINES

**SECTION 409
DISHWASHING MACHINES**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 409 DISHWASHING MACHINES / 409.1 Approval.

409.1 Approval.

Domestic dishwashing machines shall conform to ASSE 1006. Commercial dishwashing machines shall conform to ASSE 1004 and NSF 3.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 409 DISHWASHING MACHINES / 409.2 Water connection.

409.2 Water connection.

The water supply to a dishwashing machine shall be protected against backflow by an air gap or backflow preventer in accordance with Section 608.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 409 DISHWASHING MACHINES / 409.3 Waste connection.

409.3 Waste connection.

The waste connection of a dishwashing machine shall comply with Section 802.1.6 or 802.1.7, as applicable.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 410 DRINKING FOUNTAINS

**SECTION 410
DRINKING FOUNTAINS**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 410 DRINKING FOUNTAINS / 410.1 Approval.

410.1 Approval.

Drinking fountains shall conform to ASME A112.19.1M, ASME A112.19.2M or ASME A112.19.9M and water coolers shall conform to ARI 1010. Drinking fountains and water coolers shall conform to NSF 61, Section 9. Where water is served in restaurants, drinking fountains shall not be required. In other occupancies, where drinking fountains are required, water coolers or bottled water dispensers shall be permitted to be substituted for not more than 50 percent of the required drinking fountains.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 410 DRINKING FOUNTAINS / 410.2 Prohibited location.

410.2 Prohibited location.

Drinking fountains shall not be installed in public restrooms.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 411 EMERGENCY SHOWERS AND EYEWASH STATIONS

**SECTION 411
EMERGENCY SHOWERS AND
EYEWASH STATIONS**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 411 EMERGENCY SHOWERS AND EYEWASH STATIONS / 411.1 Approval.

411.1 Approval.

Emergency showers and eyewash stations shall conform to ISEA Z358.1.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 411 EMERGENCY SHOWERS AND EYEWASH STATIONS / 411.2 Waste connection.

411.2 Waste connection.

Waste connections shall not be required for emergency showers and eyewash stations.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 412 FLOOR AND TRENCH DRAINS

**SECTION 412
FLOOR AND TRENCH DRAINS**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 412 FLOOR AND TRENCH DRAINS / 412.1 Approval.

412.1 Approval.

Floor drains shall conform to ASME A112.6.3, ASME A112.3.1 or CSA B79. Trench drains shall comply with ASME A112.6.3.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 412 FLOOR AND TRENCH DRAINS / 412.2 Floor drains.

412.2 Floor drains.

Floor drains shall have removeable strainers. The floor drain shall be constructed so that the drain is capable of being cleaned. Access shall be provided to the drain inlet.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 412 FLOOR AND TRENCH DRAINS / 412.3 Size of floor drains.

412.3 Size of floor drains.

Floor drains shall have a minimum 2-inch-diameter (51 mm) drain outlet.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 412 FLOOR AND TRENCH DRAINS / 412.4 Public laundries and central washing facilities.

412.4 Public laundries and central washing facilities.

In public coin-operated laundries and in the central washing facilities of multiple-family dwellings, the rooms containing automatic clothes washers shall be provided with floor drains located to readily drain the entire floor area. Such drains shall have a minimum outlet of not less than 3 inches (76 mm) in diameter.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 413 FOOD WASTE GRINDER UNITS

**SECTION 413
FOOD WASTE GRINDER UNITS**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 413 FOOD WASTE GRINDER UNITS / 413.1 Approval.

413.1 Approval.

Domestic food waste grinders shall conform to ASSE 1008. Commercial food waste grinders shall conform to ASSE 1009. Food waste grinders shall not increase the drainage fixture unit load on the sanitary drainage system.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 413 FOOD WASTE GRINDER UNITS / 413.2 Domestic food waste grinder waste outlets.

413.2 Domestic food waste grinder waste outlets.

Domestic food waste grinders shall be connected to a drain of not less than 1.5 inches (38 mm)

in diameter.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 413 FOOD WASTE GRINDER UNITS / 413.3 Commercial food waste grinder waste outlets.

413.3 Commercial food waste grinder waste outlets.

Commercial food waste grinders shall be connected to a drain a minimum of 2 inches (51 mm) in diameter. Commercial food waste grinders shall be connected and trapped separately from any other fixtures or sink compartments.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 413 FOOD WASTE GRINDER UNITS / 413.4 Water supply required.

413.4 Water supply required.

All food waste grinders shall be provided with a supply of cold water.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 414 GARBAGE CAN WASHERS

**SECTION 414
GARBAGE CAN WASHERS**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 414 GARBAGE CAN WASHERS / 414.1 Water connection.

414.1 Water connection.

The water supply to a garbage can washer shall be protected against backflow by an air gap or a backflow preventer in accordance with Section 608.13.1, 608.13.2, 608.13.3, 608.13.5, 608.13.6 or 608.13.8.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 414 GARBAGE CAN WASHERS / 414.2 Waste connection.

414.2 Waste connection.

Garbage can washers shall be trapped separately. The receptacle receiving the waste from the washer shall have a removable basket or strainer to prevent the discharge of large particles into the drainage system.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 415 LAUNDRY TRAYS

**SECTION 415
LAUNDRY TRAYS**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 415 LAUNDRY TRAYS / 415.1 Approval.

415.1 Approval.

Laundry trays shall conform to ANSI Z124.6, ASME A112.19.1M, ASME A112.19.3M, ASME A112.19.9M, CSA B45.2 or CSA B45.4.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 415 LAUNDRY TRAYS / 415.2 Waste outlet.

415.2 Waste outlet.

Each compartment of a laundry tray shall be provided with a waste outlet a minimum of 1.5 inches (38 mm) in diameter and a strainer or crossbar to restrict the clear opening of the waste outlet.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 416 LAVATORIES

**SECTION 416
LAVATORIES**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 416 LAVATORIES / 416.1 Approval.

416.1 Approval.

Lavatories shall conform to ANSI Z124.3, ASME A112.19.1M, ASME A112.19.2M, ASME A112.19.3M, ASME A112.19.4M, ASME A112.19.9M, CSA B45.1, CSA B45.2, CSA B45.3 or CSA B45.4. Group wash-up equipment shall conform to the requirements of Section 402. Every 20 inches (508 mm) of rim space shall be considered as one lavatory.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 416 LAVATORIES / 416.2 Cultured marble lavatories.

416.2 Cultured marble lavatories.

Cultured marble vanity tops with an integral lavatory shall conform to ANSI Z124.3 or CSA B45.5.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 416 LAVATORIES / 416.3 Lavatory waste outlets.

416.3 Lavatory waste outlets.

Lavatories shall have waste outlets not less than 1.25 inches (32 mm) in diameter. A strainer, pop-up stopper, crossbar or other device shall be provided to restrict the clear opening of the waste outlet.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 416 LAVATORIES / 416.4 Moveable lavatory systems.

416.4 Moveable lavatory systems.

Moveable lavatory systems shall comply with ASME A112.19.12.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 416 LAVATORIES / 416.5 Tempered water for public hand-washing facilities.

416.5 Tempered water for public hand-washing facilities.

Tempered water shall be delivered from public hand-washing facilities through an approved water temperature limiting device that conforms to ASSE 1070.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 417 SHOWERS

**SECTION 417
SHOWERS**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 417 SHOWERS / 417.1 Approval.

417.1 Approval.

Prefabricated showers and shower compartments shall conform to ANSI Z124.2, ASME A112.19.9M or CSA B45.5. Shower valves for individual showers shall conform to the requirements of Section 424.3.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 417 SHOWERS / 417.2 Water supply riser.

417.2 Water supply riser.

Every water supply riser from the shower valve to the shower head outlet, whether exposed or not, shall be attached to the structure in an approved manner.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 417 SHOWERS / 417.3 Shower waste outlet.

417.3 Shower waste outlet.

Waste outlets serving showers shall be at least 1½ inches (38 mm) in diameter and, for other than waste outlets in bathtubs, shall have removable strainers not less than 3 inches (76 mm) in diameter with strainer openings not less than 0.25 inch (6.4 mm) in minimum dimension. Where each shower space is not provided with an individual waste outlet, the waste outlet shall be located and the floor pitched so that waste from one shower does not flow over the floor area serving another shower. Waste outlets shall be fastened to the waste pipe in an approved manner.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 417 SHOWERS / 417.4 Shower compartments.

417.4 Shower compartments.

All shower compartments shall have a minimum of 900 square inches (0.58 m²) of interior cross-sectional area. Shower compartments shall not be less than 30 inches (762 mm) in minimum dimension measured from the finished interior dimension of the compartment, exclusive of fixture valves, showerheads, soap dishes, and safety grab bars or rails. Except as required in Section 404, the minimum required area and dimension shall be measured from the finished interior dimension at a height equal to the top of the threshold and at a point tangent to its centerline and shall be continued to a height not less than 70 inches (1778 mm) above the shower drain outlet.

Exception: Shower compartments having not less than 25 inches (635 mm) in minimum dimension measured from the finished interior dimension of the compartment, provided that the shower compartment has a minimum of 1,300 square inches (.838 m²) of cross-sectional area.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 417 SHOWERS / 417.4 Shower compartments. / 417.4.1 Wall area.

417.4.1 Wall area.

The wall area above built-in tubs with installed shower heads and in shower compartments

shall be constructed of smooth, noncorrosive and nonabsorbent waterproof materials to a height not less than 6 feet (1829 mm) above the room floor level, and not less than 70 inches (1778 mm) where measured from the compartment floor at the drain. Such walls shall form a water-tight joint with each other and with either the tub, receptor or shower floor.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 417 SHOWERS / 417.4 Shower compartments. / 417.4.2 Access.

417.4.2 Access.

The shower compartment access and egress opening shall have a minimum clear and unobstructed finished width of 22 inches (559 mm). Shower compartments required to be designed in conformance to accessibility provisions shall comply with Section 404.1.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 417 SHOWERS / 417.5 Shower floors or receptors.

417.5 Shower floors or receptors.

Floor surfaces shall be constructed of impervious, noncorrosive, nonabsorbent and waterproof materials.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 417 SHOWERS / 417.5 Shower floors or receptors. / 417.5.1 Support.

417.5.1 Support.

Floors or receptors under shower compartments shall be laid on, and supported by, a smooth and structurally sound base.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 417 SHOWERS / 417.5 Shower floors or receptors. / 417.5.2 Shower lining.

417.5.2 Shower lining.

Floors under shower compartments, except where prefabricated receptors have been provided, shall be lined and made water tight utilizing material complying with Sections 417.5.2.1 through 417.5.2.4. Such liners shall turn up on all sides at least 2 inches (51 mm) above the finished threshold level. Liners shall be recessed and fastened to an approved backing so as not to occupy the space required for wall covering, and shall not be nailed or perforated at any point less than 1 inch (25 mm) above the finished threshold. Liners shall be pitched one-fourth unit vertical in 12 units horizontal (2-percent slope) and shall be sloped toward the fixture drains and be securely fastened to the waste outlet at the seepage

entrance, making a water-tight joint between the liner and the outlet.

Exception: Floor surfaces under shower heads provided for rinsing laid directly on the ground are not required to comply with this section.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 417 SHOWERS / 417.5 Shower floors or receptors. / 417.5.2 Shower lining. / 417.5.2.1 PVC sheets.

417.5.2.1 PVC sheets.

Plasticized polyvinyl chloride (PVC) sheets shall be a minimum of 0.040 inch (1.02 mm) thick, and shall meet the requirements of ASTM D 4551. Sheets shall be joined by solvent welding in accordance with the manufacturer's installation instructions.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 417 SHOWERS / 417.5 Shower floors or receptors. / 417.5.2 Shower lining. / 417.5.2.2 Chlorinated polyethylene (CPE) sheets.

417.5.2.2 Chlorinated polyethylene (CPE) sheets.

Nonplasticized chlorinated polyethylene sheet shall be a minimum 0.040 inch (1.02 mm) thick, and shall meet the requirements of ASTM D 4068. The liner shall be joined in accordance with the manufacturer's installation instructions.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 417 SHOWERS / 417.5 Shower floors or receptors. / 417.5.2 Shower lining. / 417.5.2.3 Sheet lead.

417.5.2.3 Sheet lead.

Sheet lead shall not weigh less than 4 pounds per square foot (19.5 kg/m²) coated with an asphalt paint or other approved coating. The lead sheet shall be insulated from conducting substances other than the connecting drain by 15-pound (6.80 kg) asphalt felt or its equivalent. Sheet lead shall be joined by burning.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 417 SHOWERS / 417.5 Shower floors or receptors. / 417.5.2 Shower lining. / 417.5.2.4 Sheet copper.

417.5.2.4 Sheet copper.

Sheet copper shall conform to ASTM B 152 and shall not weigh less than 12 ounces per square foot (3.7 kg/m²). The copper sheet shall be insulated from conducting substances other than the connecting drain by 15-pound (6.80 kg) asphalt felt or its equivalent.

Sheet copper shall be joined by brazing or soldering.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 417 SHOWERS / 417.6 Glazing.

417.6 Glazing.

Windows and doors within a shower enclosure shall conform to the safety glazing requirements of the *International Building Code*.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 418 SINKS

**SECTION 418
SINKS**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 418 SINKS / 418.1 Approval.

418.1 Approval.

Sinks shall conform to ANSI Z124.6, ASME A112.19.1M, ASME A112.19.2M, ASME A112.19.3M, ASME A112.19.4M, ASME A112.19.9M, CSA B45.1, CSA B45.2, CSA B45.3 or CSA B45.4.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 418 SINKS / 418.2 Sink waste outlets.

418.2 Sink waste outlets.

Sinks shall be provided with waste outlets a minimum of 1.5 inches (38 mm) in diameter. A strainer or crossbar shall be provided to restrict the clear opening of the waste outlet.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 418 SINKS / 418.3 Moveable sink systems.

418.3 Moveable sink systems.

Moveable sink systems shall comply with ASME A112.19.12.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 419 URINALS

SECTION 419 URINALS

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 419 URINALS / 419.1 Approval.

419.1 Approval.

Urinals shall conform to ANSI Z124.9, ASME A112.19.2M, CSA B45.1 or CSA B45.5. Urinals shall conform to the water consumption requirements of Section 604.4. Water supplied urinals shall conform to the hydraulic performance requirements of ASME A112.19.6, CSA B45.1 or CSA B45.5.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 419 URINALS / 419.2 Substitution for water closets.

419.2 Substitution for water closets.

In each bathroom or toilet room, urinals shall not be substituted for more than 67 percent of the required water closets in assembly and educational occupancies. Urinals shall not be substituted for more than 50 percent of the required water closets in all other occupancies.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 419 URINALS / [B] 419.3 Surrounding material.

[B] 419.3 Surrounding material.

Wall and floor space to a point 2 feet (610 mm) in front of a urinal lip and 4 feet (1219 mm) above the floor and at least 2 feet (610 mm) to each side of the urinal shall be waterproofed with a smooth, readily cleanable, nonabsorbent material.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 420 WATER CLOSETS

SECTION 420 WATER CLOSETS

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 420 WATER CLOSETS / 420.1 Approval.

420.1 Approval.

Water closets shall conform to the water consumption requirements of Section 604.4 and shall

conform to ANSI Z124.4, ASME A112.19.2M, CSA B45.1, CSA B45.4 or CSA B45.5. Water closets shall conform to the hydraulic performance requirements of ASME A112.19.6. Water closet tanks shall conform to ANSI Z124.4, ASME A112.19.2, ASME A112.19.9M, CSA B45.1, CSA B45.4 or CSA B45.5. Electro-hydraulic water closets shall comply with ASME A112.19.13.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 420 WATER CLOSETS / 420.2 Water closets for public or employee toilet facilities.

420.2 Water closets for public or employee toilet facilities.

Water closet bowls for public or employee toilet facilities shall be of the elongated type.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 420 WATER CLOSETS / 420.3 Water closet seats.

420.3 Water closet seats.

Water closets shall be equipped with seats of smooth, nonabsorbent material. All seats of water closets provided for public or employee toilet facilities shall be of the hinged open-front type. Integral water closet seats shall be of the same material as the fixture. Water closet seats shall be sized for the water closet bowl type.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 420 WATER CLOSETS / 420.4 Water closet connections.

420.4 Water closet connections.

A 4-inch by 3-inch (102 mm by 76 mm) closet bend shall be acceptable. Where a 3-inch (76 mm) bend is utilized on water closets, a 4-inch by 3-inch (102 mm by 76 mm) flange shall be installed to receive the fixture horn.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 421 WHIRLPOOL BATHTUBS

**SECTION 421
WHIRLPOOL BATHTUBS**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 421 WHIRLPOOL BATHTUBS / 421.1 Approval.

421.1 Approval.

Whirlpool bathtubs shall comply with ASME A112.19.7M or with CSA B45.5 and CSA B45

(Supplement 1).

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 421 WHIRLPOOL BATHTUBS / 421.2 Installation.

421.2 Installation.

Whirlpool bathtubs shall be installed and tested in accordance with the manufacturer's installation instructions. The pump shall be located above the weir of the fixture trap.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 421 WHIRLPOOL BATHTUBS / 421.3 Drain.

421.3 Drain.

The pump drain and circulation piping shall be sloped to drain the water in the volute and the circulation piping when the whirlpool bathtub is empty.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 421 WHIRLPOOL BATHTUBS / 421.4 Suction fittings.

421.4 Suction fittings.

Suction fittings for whirlpool bathtubs shall comply with ASME A112.19.8M.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 421 WHIRLPOOL BATHTUBS / 421.5 Access to pump.

421.5 Access to pump.

Access shall be provided to circulation pumps in accordance with the fixture or pump manufacturer's installation instructions. Where the manufacturer's instructions do not specify the location and minimum size of field-fabricated access openings, a 12-inch by 12-inch (305 mm by 305 mm) minimum sized opening shall be installed to provide access to the circulation pump. Where pumps are located more than 2 feet (609 mm) from the access opening, an 18-inch by 18-inch (457 mm by 457 mm) minimum sized opening shall be installed. A door or panel shall be permitted to close the opening. In all cases, the access opening shall be unobstructed and of the size necessary to permit the removal and replacement of the circulation pump.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 421 WHIRLPOOL BATHTUBS / 421.6 Whirlpool enclosure.

421.6 Whirlpool enclosure.

Doors within a whirlpool enclosure shall conform to ASME A112.19.15.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 422 HEALTH CARE FIXTURES AND EQUIPMENT

**SECTION 422
HEALTH CARE FIXTURES AND EQUIPMENT**

**2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 422 HEALTH CARE FIXTURES AND EQUIPMENT / 422.1
Scope.**

422.1 Scope.

This section shall govern those aspects of health care plumbing systems that differ from plumbing systems in other structures. Health care plumbing systems shall conform to the requirements of this section in addition to the other requirements of this code. The provisions of this section shall apply to the special devices and equipment installed and maintained in the following occupancies: nursing homes, homes for the aged, orphanages, infirmaries, first aid stations, psychiatric facilities, clinics, professional offices of dentists and doctors, mortuaries, educational facilities, surgery, dentistry, research and testing laboratories, establishments manufacturing pharmaceutical drugs and medicines, and other structures with similar apparatus and equipment classified as plumbing.

**2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 422 HEALTH CARE FIXTURES AND EQUIPMENT / 422.2
Approval.**

422.2 Approval.

All special plumbing fixtures, equipment, devices and apparatus shall be of an approved type.

**2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 422 HEALTH CARE FIXTURES AND EQUIPMENT / 422.3
Protection.**

422.3 Protection.

All devices, appurtenances, appliances and apparatus intended to serve some special function, such as sterilization, distillation, processing, cooling, or storage of ice or foods, and that connect to either the water supply or drainage system, shall be provided with protection against backflow, flooding, fouling, contamination of the water supply system and stoppage of the drain.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 422 HEALTH CARE FIXTURES AND EQUIPMENT / 422.4

Materials.

422.4 Materials.

Fixtures designed for therapy, special cleansing or disposal of waste materials, combinations of such purposes, or any other special purpose, shall be of smooth, impervious, corrosion-resistant materials and, where subjected to temperatures in excess of 180°F (82°C), shall be capable of withstanding, without damage, higher temperatures.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 422 HEALTH CARE FIXTURES AND EQUIPMENT / 422.5

Access.

422.5 Access.

Access shall be provided to concealed piping in connection with special fixtures where such piping contains steam traps, valves, relief valves, check valves, vacuum breakers or other similar items that require periodic inspection, servicing, maintenance or repair. Access shall be provided to concealed piping that requires periodic inspection, maintenance or repair.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 422 HEALTH CARE FIXTURES AND EQUIPMENT / 422.6

Clinical sink.

422.6 Clinical sink.

A clinical sink shall have an integral trap in which the upper portion of a visible trap seal provides a water surface. The fixture shall be designed so as to permit complete removal of the contents by siphonic or blowout action and to reseal the trap. A flushing rim shall provide water to cleanse the interior surface. The fixture shall have the flushing and cleansing characteristics of a water closet.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 422 HEALTH CARE FIXTURES AND EQUIPMENT / 422.7

Prohibited usage of clinical sinks and service sinks.

422.7 Prohibited usage of clinical sinks and service sinks.

A clinical sink serving a soiled utility room shall not be considered as a substitute for, or be utilized as, a service sink. A service sink shall not be utilized for the disposal of urine, fecal matter or other human waste.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 422 HEALTH CARE FIXTURES AND EQUIPMENT / 422.8

Ice prohibited in soiled utility room.

422.8 Ice prohibited in soiled utility room.

Machines for manufacturing ice, or any device for the handling or storage of ice, shall not be located in a soiled utility room.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 422 HEALTH CARE FIXTURES AND EQUIPMENT / 422.9 Sterilizer equipment requirements.

422.9 Sterilizer equipment requirements.

The approval and installation of all sterilizers shall conform to the requirements of the *International Mechanical Code*.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 422 HEALTH CARE FIXTURES AND EQUIPMENT / 422.9 Sterilizer equipment requirements. / 422.9.1 Sterilizer piping.

422.9.1 Sterilizer piping.

Access for the purposes of inspection and maintenance shall be provided to all sterilizer piping and devices necessary for the operation of sterilizers.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 422 HEALTH CARE FIXTURES AND EQUIPMENT / 422.9 Sterilizer equipment requirements. / 422.9.2 Steam supply.

422.9.2 Steam supply.

Steam supplies to sterilizers, including those connected by pipes from overhead mains or branches, shall be drained to prevent any moisture from reaching the sterilizer. The condensate drainage from the steam supply shall be discharged by gravity.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 422 HEALTH CARE FIXTURES AND EQUIPMENT / 422.9 Sterilizer equipment requirements. / 422.9.3 Steam condensate return.

422.9.3 Steam condensate return.

Steam condensate returns from sterilizers shall be a gravity return system.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 422 HEALTH CARE FIXTURES AND EQUIPMENT / 422.9 Sterilizer equipment requirements. / 422.9.4 Condensers.

422.9.4 Condensers.

Pressure sterilizers shall be equipped with a means of condensing and cooling the exhaust steam vapors. Nonpressure sterilizers shall be equipped with a device that will automatically control the vapor, confining the vapors within the vessel.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 422 HEALTH CARE FIXTURES AND EQUIPMENT / 422.10

Special elevations.

422.10 Special elevations.

Control valves, vacuum outlets and devices protruding from a wall of an operating, emergency, recovery, examining or delivery room, or in a corridor or other location where patients are transported on a wheeled stretcher, shall be located at an elevation that prevents bumping the patient or stretcher against the device.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 423 SPECIALTY PLUMBING FIXTURES

**SECTION 423
SPECIALTY PLUMBING FIXTURES**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 423 SPECIALTY PLUMBING FIXTURES / 423.1 Water connections.

423.1 Water connections.

Baptisteries, ornamental and lily pools, aquariums, ornamental fountain basins, swimming pools, and similar constructions, where provided with water supplies, shall be protected against backflow in accordance with Section 608.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 423 SPECIALTY PLUMBING FIXTURES / 423.2 Approval.

423.2 Approval.

Specialties requiring water and waste connections shall be submitted for approval.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 424 FAUCETS AND OTHER FIXTURE FITTINGS

**SECTION 424
FAUCETS AND OTHER FIXTURE FITTINGS**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 424 FAUCETS AND OTHER FIXTURE FITTINGS / 424.1

Approval.

424.1 Approval.

Faucets and fixture fittings shall conform to ASME A112.18.1 or CSA B125. Faucets and fixture fittings that supply drinking water for human ingestion shall conform to the requirements of NSF 61, Section 9. Flexible water connectors exposed to continuous pressure shall conform to the requirements of Section 605.6.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 424 FAUCETS AND OTHER FIXTURE FITTINGS / 424.1

Approval. / 424.1.1 Faucets and supply fittings.

424.1.1 Faucets and supply fittings.

Faucets and supply fittings shall conform to the water consumption requirements of Section 604.4.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 424 FAUCETS AND OTHER FIXTURE FITTINGS / 424.1

Approval. / 424.1.2 Waste fittings.

424.1.2 Waste fittings.

Waste fittings shall conform to ASME A112.18.2, ASTM F 409, CSA B125 or to one of the standards listed in Tables 702.1 and 702.4 for above-ground drainage and vent pipe and fittings.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 424 FAUCETS AND OTHER FIXTURE FITTINGS / 424.2 Hand showers.

424.2 Hand showers.

Hand-held showers shall conform to ASME A112.18.1 or CSA B125.1. Hand-held showers shall provide backflow protection in accordance with ASME A112.18.1 or CSA B125.1 or shall be protected against backflow by a device complying with ASME A112.18.3.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 424 FAUCETS AND OTHER FIXTURE FITTINGS / 424.3

Individual shower valves.

424.3 Individual shower valves.

Individual shower and tub-shower combination valves shall be balanced-pressure, thermostatic or combination balanced-pressure/thermostatic valves that conform to the requirements of ASSE 1016 or CSA B125 and shall be installed at the point of use. Shower and tub-shower combination valves required by this section shall be equipped with a means to limit the maximum setting of the valve to 120°F (49°C), which shall be field adjusted in accordance with the manufacturer's instructions. In-line thermostatic valves shall not be utilized for compliance with this section.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 424 FAUCETS AND OTHER FIXTURE FITTINGS / 424.4

Multiple (gang) showers.

424.4 Multiple (gang) showers.

Multiple (gang) showers supplied with a single-tempered water supply pipe shall have the water supply for such showers controlled by an approved automatic temperature control mixing valve that conforms to ASSE 1069 or CSA B125, or each shower head shall be individually controlled by a balanced-pressure, thermostatic or combination balanced-pressure/thermostatic valve that conforms to ASSE 1016 or CSA B125 and is installed at the point of use. Such valves shall be equipped with a means to limit the maximum setting of the valve to 120°F (49°C), which shall be field adjusted in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 424 FAUCETS AND OTHER FIXTURE FITTINGS / 424.5

Bathtub and whirlpool bathtub valves.

424.5 Bathtub and whirlpool bathtub valves.

The hot water supplied to bathtubs and whirlpool bathtubs shall be limited to a maximum temperature of 120°F (49°C) by a water temperature limiting device that conforms to ASSE 1070, except where such protection is otherwise provided by a combination tub/shower valve in accordance with Section 424.3.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 424 FAUCETS AND OTHER FIXTURE FITTINGS / 424.6

Hose-connected outlets.

424.6 Hose-connected outlets.

Faucets and fixture fittings with hose-connected outlets shall conform to ASME A112.18.3M or

CSA B125.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 424 FAUCETS AND OTHER FIXTURE FITTINGS / 424.7

Temperature-actuated, flow reduction valves for individual fixture fittings.

424.7 Temperature-actuated, flow reduction valves for individual fixture fittings.

Temperature-actuated, flow reduction devices, where installed for individual fixture fittings, shall conform to ASSE 1062. Such valves shall not be used alone as a substitute for the balanced pressure, thermostatic or combination shower valves required in Section 424.3.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 424 FAUCETS AND OTHER FIXTURE FITTINGS / 424.8

Transfer valves.

424.8 Transfer valves.

Deck-mounted bath/shower transfer valves containing an integral atmospheric vacuum breaker shall conform to the requirements of ASME A112.18.7.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 425 FLUSHING DEVICES FOR WATER CLOSETS AND URINALS

**SECTION 425
FLUSHING DEVICES FOR WATER CLOSETS AND URINALS**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 425 FLUSHING DEVICES FOR WATER CLOSETS AND URINALS / 425.1 Flushing devices required.

425.1 Flushing devices required.

Each water closet, urinal, clinical sink and any plumbing fixture that depends on trap siphonage to discharge the fixture contents to the drainage system shall be provided with a flushometer valve, flushometer tank or a flush tank designed and installed to supply water in quantity and rate of flow to flush the contents of the fixture, cleanse the fixture and refill the fixture trap.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 425 FLUSHING DEVICES FOR WATER CLOSETS AND URINALS / 425.1 Flushing devices required. / 425.1.1 Separate for each fixture.

425.1.1 Separate for each fixture.

A flushing device shall not serve more than one fixture.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 425 FLUSHING DEVICES FOR WATER CLOSETS AND URINALS / 425.2 Flushometer valves and tanks.

425.2 Flushometer valves and tanks.

Flushometer valves and tanks shall comply with ASSE 1037. Vacuum breakers on flushometer valves shall conform to the performance requirements of ASSE 1001 or CSA B64.1.1. Access shall be provided to vacuum breakers. Flushometer valves shall be of the water-conservation type and shall not be utilized where the water pressure is lower than the minimum required for normal operation. When operated, the valve shall automatically complete the cycle of operation, opening fully and closing positively under the water supply pressure. Each flushometer valve shall be provided with a means for regulating the flow through the valve. The trap seal to the fixture shall be automatically refilled after each valve flushing cycle.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 425 FLUSHING DEVICES FOR WATER CLOSETS AND URINALS / 425.3 Flush tanks.

425.3 Flush tanks.

Flush tanks equipped for manual flushing shall be controlled by a device designed to refill the tank after each discharge and to shut off completely the water flow to the tank when the tank is filled to operational capacity. The trap seal to the fixture shall be automatically refilled after each flushing. The water supply to flush tanks equipped for automatic flushing shall be controlled with a timing device or sensor control devices.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 425 FLUSHING DEVICES FOR WATER CLOSETS AND URINALS / 425.3 Flush tanks. / 425.3.1 Fill valves.

425.3.1 Fill valves.

All flush tanks shall be equipped with an antisiphon fill valve conforming to ASSE 1002 or CSA B125. The fill valve backflow preventer shall be located at least 1 inch (25 mm) above the full opening of the overflow pipe.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 425 FLUSHING DEVICES FOR WATER CLOSETS AND URINALS / 425.3 Flush tanks. / 425.3.2 Overflows in flush tanks.

425.3.2 Overflows in flush tanks.

Flush tanks shall be provided with overflows discharging to the water closet or urinal connected thereto and shall be sized to prevent flooding the tank at the maximum rate at which the tanks are supplied with water according to the manufacturer's design conditions. The opening of the overflow pipe shall be located above the flood level rim of the water closet or urinal or above a secondary overflow in the flush tank.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 425 FLUSHING DEVICES FOR WATER CLOSETS AND URINALS / 425.3 Flush tanks. / 425.3.3 Sheet copper.

425.3.3 Sheet copper.

Sheet copper utilized for flush tank linings shall conform to ASTM B 152 and shall not weigh less than 10 ounces per square foot (0.03 kg/m²).

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 425 FLUSHING DEVICES FOR WATER CLOSETS AND URINALS / 425.3 Flush tanks. / 425.3.4 Access required.

425.3.4 Access required.

All parts in a flush tank shall be accessible for repair and replacement.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 425 FLUSHING DEVICES FOR WATER CLOSETS AND URINALS / 425.4 Flush pipes and fittings.

425.4 Flush pipes and fittings.

Flush pipes and fittings shall be of nonferrous material and shall conform to ASME A112.19.5 or CSA B125.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 426 MANUAL FOOD AND BEVERAGE DISPENSING EQUIPMENT

**SECTION 426
MANUAL FOOD AND BEVERAGE DISPENSING EQUIPMENT**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 426 MANUAL FOOD AND BEVERAGE DISPENSING

EQUIPMENT / 426.1 Approval.

426.1 Approval.

Manual food and beverage dispensing equipment shall conform to the requirements of NSF 18.

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 427 FLOOR SINKS

**SECTION 427
FLOOR SINKS**

2006 International Plumbing Code / CHAPTER 4 FIXTURES, FAUCETS AND FIXTURE FITTINGS / SECTION 427 FLOOR SINKS / 427.1 Approval.

427.1 Approval.

Sanitary floor sinks shall conform to the requirements of ASME A112.6.7.

2006 International Plumbing Code / CHAPTER 5 WATER HEATERS

**CHAPTER 5
WATER HEATERS**

2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 501 GENERAL

**SECTION 501
GENERAL**

2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 501 GENERAL / 501.1 Scope.

501.1 Scope.

The provisions of this chapter shall govern the materials, design and installation of water heaters and the related safety devices and appurtenances.

2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 501

GENERAL / 501.2 Water heater as space heater.

501.2 Water heater as space heater.

Where a combination potable water heating and space heating system requires water for space heating at temperatures higher than 140°F (60°C), a master thermostatic mixing valve complying with ASSE 1017 shall be provided to limit the water supplied to the potable hot water distribution system to a temperature of 140°F (60°C) or less. The potability of the water shall be maintained throughout the system.

**2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 501
GENERAL / 501.3 Drain valves.**

501.3 Drain valves.

Drain valves for emptying shall be installed at the bottom of each tank-type water heater and hot water storage tank. Drain valves shall conform to ASSE 1005.

**2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 501
GENERAL / 501.4 Location.**

501.4 Location.

Water heaters and storage tanks shall be located and connected so as to provide access for observation, maintenance, servicing and replacement.

**2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 501
GENERAL / 501.5 Water heater labeling.**

501.5 Water heater labeling.

All water heaters shall be third-party certified.

**2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 501
GENERAL / 501.6 Water temperature control in piping from tankless heaters.**

501.6 Water temperature control in piping from tankless heaters.

The temperature of water from tankless water heaters shall be a maximum of 140°F (60°C) when intended for domestic uses. This provision shall not supersede the requirement for protective shower valves in accordance with Section 424.3.

**2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 501
GENERAL / 501.7 Pressure marking of storage tanks.**

501.7 Pressure marking of storage tanks.

Storage tanks and water heaters installed for domestic hot water shall have the maximum

allowable working pressure clearly and indelibly stamped in the metal or marked on a plate welded thereto or otherwise permanently attached. Such markings shall be in an accessible position outside of the tank so as to make inspection or reinspection readily possible.

2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 501 GENERAL / 501.8 Temperature controls.

501.8 Temperature controls.

All hot water supply systems shall be equipped with automatic temperature controls capable of adjustments from the lowest to the highest acceptable temperature settings for the intended temperature operating range.

2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 502 INSTALLATION

**SECTION 502
INSTALLATION**

2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 502 INSTALLATION / 502.1 General.

502.1 General.

Water heaters shall be installed in accordance with the manufacturer's installation instructions. Oil-fired water heaters shall conform to the requirements of this code and the *International Mechanical Code*. Electric water heaters shall conform to the requirements of this code and provisions of the ICC *Electrical Code*. Gas-fired water heaters shall conform to the requirements of the *International Fuel Gas Code*.

2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 502 INSTALLATION / 502.2 Rooms used as a plenum.

502.2 Rooms used as a plenum.

Water heaters using solid, liquid or gas fuel shall not be installed in a room containing air-handling machinery when such room is used as a plenum.

2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 502 INSTALLATION / 502.3 Water heaters installed in attics.

502.3 Water heaters installed in attics.

Attics containing a water heater shall be provided with an opening and unobstructed passageway large enough to allow removal of the water heater. The passageway shall not be

less than 30 inches (762 mm) high and 22 inches (559 mm) wide and not more than 20 feet (6096 mm) in length when measured along the centerline of the passageway from the opening to the water heater. The passageway shall have continuous solid flooring not less than 24 inches (610 mm) wide. A level service space at least 30 inches (762 mm) deep and 30 inches (762 mm) wide shall be present at the front or service side of the water heater. The clear access opening dimensions shall be a minimum of 20 inches by 30 inches (508 mm by 762 mm) where such dimensions are large enough to allow removal of the water heater.

**2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 502
INSTALLATION / 502.4 Seismic supports.**

502.4 Seismic supports.

Where earthquake loads are applicable in accordance with the *International Building Code*, water heater supports shall be designed and installed for the seismic forces in accordance with the *International Building Code*.

**2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 503
CONNECTIONS**

**SECTION 503
CONNECTIONS**

**2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 503
CONNECTIONS / 503.1 Cold water line valve.**

503.1 Cold water line valve.

The cold water branch line from the main water supply line to each hot water storage tank or water heater shall be provided with a valve, located near the equipment and serving only the hot water storage tank or water heater. The valve shall not interfere or cause a disruption of the cold water supply to the remainder of the cold water system. The valve shall be provided with access on the same floor level as the water heater served.

**2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 503
CONNECTIONS / 503.2 Water circulation.**

503.2 Water circulation.

The method of connecting a circulating water heater to the tank shall provide proper circulation of water through the water heater. The pipe or tubes required for the installation of appliances that will draw from the water heater or storage tank shall comply with the provisions of this code for material and installation.

2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 504 SAFETY DEVICES

**SECTION 504
SAFETY DEVICES**

2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 504 SAFETY DEVICES / 504.1 Antisiphon devices.

504.1 Antisiphon devices.

An approved means, such as a cold water “dip” tube with a hole at the top or a vacuum relief valve installed in the cold water supply line above the top of the heater or tank, shall be provided to prevent siphoning of any storage water heater or tank.

2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 504 SAFETY DEVICES / 504.2 Vacuum relief valve.

504.2 Vacuum relief valve.

Bottom fed water heaters and bottom fed tanks connected to water heaters shall have a vacuum relief valve installed. The vacuum relief valve shall comply with ANSI Z21.22.

2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 504 SAFETY DEVICES / 504.3 Shutdown.

504.3 Shutdown.

A means for disconnecting an electric hot water supply system from its energy supply shall be provided in accordance with the ICC *Electrical Code*. A separate valve shall be provided to shut off the energy fuel supply to all other types of hot water supply systems.

2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 504 SAFETY DEVICES / 504.4 Relief valve.

504.4 Relief valve.

All storage water heaters operating above atmospheric pressure shall be provided with an approved, self-closing (levered) pressure relief valve and temperature relief valve or combination thereof. The relief valve shall conform to ANSI Z21.22. The relief valve shall not be used as a means of controlling thermal expansion.

2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 504

SAFETY DEVICES / 504.4 Relief valve. / 504.4.1 Installation.

504.4.1 Installation.

Such valves shall be installed in the shell of the water heater tank. Temperature relief valves shall be so located in the tank as to be actuated by the water in the top 6 inches (152 mm) of the tank served. For installations with separate storage tanks, the valves shall be installed on the tank and there shall not be any type of valve installed between the water heater and the storage tank. There shall not be a check valve or shutoff valve between a relief valve and the heater or tank served.

2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 504 SAFETY DEVICES / 504.5 Relief valve approval.

504.5 Relief valve approval.

Temperature and pressure relief valves, or combinations thereof, and energy cutoff devices shall bear the label of an approved agency and shall have a temperature setting of not more than 210°F (99°C) and a pressure setting not exceeding the tank or water heater manufacturer's rated working pressure or 150 psi (1035 kPa), whichever is less. The relieving capacity of each pressure relief valve and each temperature relief valve shall equal or exceed the heat input to the water heater or storage tank.

2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 504 SAFETY DEVICES / 504.6 Requirements for discharge piping.

504.6 Requirements for discharge piping.

The discharge piping serving a pressure relief valve, temperature relief valve or combination thereof shall:

1. Not be directly connected to the drainage system.
2. Discharge through an air gap located in the same room as the water heater.
3. Not be smaller than the diameter of the outlet of the valve served and shall discharge full size to the air gap.
4. Serve a single relief device and shall not connect to piping serving any other relief device or equipment.
5. Discharge to the floor, to an indirect waste receptor or to the outdoors. Where discharging to the outdoors in areas subject to freezing, discharge piping shall be first piped to an indirect waste receptor through an air gap located in a conditioned area.
6. Discharge in a manner that does not cause personal injury or structural damage.
7. Discharge to a termination point that is readily observable by the building occupants.

8. Not be trapped.
9. Be installed so as to flow by gravity.
10. Not terminate more than 6 inches (152 mm) above the floor or waste receptor.
11. Not have a threaded connection at the end of such piping.
12. Not have valves or tee fittings.
13. Be constructed of those materials listed in Section 605.4 or materials tested, rated and approved for such use in accordance with ASME A112.4.1.

2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 504 SAFETY DEVICES / 504.7 Required pan.

504.7 Required pan.

Where water heaters or hot water storage tanks are installed in locations where leakage of the tanks or connections will cause damage, the tank or water heater shall be installed in a galvanized steel pan having a minimum thickness of 24 gage, or other pans approved for such use.

2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 504 SAFETY DEVICES / 504.7 Required pan. / 504.7.1 Pan size and drain.

504.7.1 Pan size and drain.

The pan shall be not less than 1.5 inches (38 mm) deep and shall be of sufficient size and shape to receive all dripping or condensate from the tank or water heater. The pan shall be drained by an indirect waste pipe having a minimum diameter of 0.75 inch (19 mm). Piping for safety pan drains shall be of those materials listed in Table 605.4.

2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 504 SAFETY DEVICES / 504.7 Required pan. / 504.7.2 Pan drain termination.

504.7.2 Pan drain termination.

The pan drain shall extend full-size and terminate over a suitably located indirect waste receptor or floor drain or extend to the exterior of the building and terminate not less than 6 inches (152 mm) and not more than 24 inches (610 mm) above the adjacent ground surface.

2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 505 INSULATION

SECTION 505 INSULATION

**2006 International Plumbing Code / CHAPTER 5 WATER HEATERS / SECTION 505
INSULATION / [E] 505.1 Unfired vessel insulation.**

[E] 505.1 Unfired vessel insulation.

Unfired hot water storage tanks shall be insulated so that heat loss is limited to a maximum of 15 British thermal units per hour (Btu/h) per square foot (47 W/m²) of external tank surface area. For purposes of determining this heat loss, the design ambient temperature shall not be higher than 65°F (18°C).

**2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND
DISTRIBUTION**

CHAPTER 6 WATER SUPPLY AND DISTRIBUTION

**2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND
DISTRIBUTION / SECTION 601 GENERAL**

SECTION 601 GENERAL

**2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND
DISTRIBUTION / SECTION 601 GENERAL / 601.1 Scope.**

601.1 Scope.

This chapter shall govern the materials, design and installation of water supply systems, both hot and cold, for utilization in connection with human occupancy and habitation and shall govern the installation of individual water supply systems.

**2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND
DISTRIBUTION / SECTION 601 GENERAL / 601.2 Solar energy utilization.**

601.2 Solar energy utilization.

Solar energy systems used for heating potable water or using an independent medium for heating potable water shall comply with the applicable requirements of this code. The use of solar energy shall not compromise the requirements for cross connection or protection of the potable water supply system required by this code.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 601 GENERAL / 601.3 Existing piping used for grounding.

601.3 Existing piping used for grounding.

Existing metallic water service piping used for electrical grounding shall not be replaced with nonmetallic pipe or tubing until other approved means of grounding is provided.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 601 GENERAL / 601.4 Tests.

601.4 Tests.

The potable water distribution system shall be tested in accordance with Section 312.5.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 602 WATER REQUIRED

**SECTION 602
WATER REQUIRED**

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 602 WATER REQUIRED / 602.1 General.

602.1 General.

Every structure equipped with plumbing fixtures and utilized for human occupancy or habitation shall be provided with a potable supply of water in the amounts and at the pressures specified in this chapter.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 602 WATER REQUIRED / 602.2 Potable water required.

602.2 Potable water required.

Only potable water shall be supplied to plumbing fixtures that provide water for drinking, bathing or culinary purposes, or for the processing of food, medical or pharmaceutical products. Unless otherwise provided in this code, potable water shall be supplied to all plumbing fixtures.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 602 WATER REQUIRED / 602.3 Individual water supply.

602.3 Individual water supply.

Where a potable public water supply is not available, individual sources of potable water supply shall be utilized.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 602 WATER REQUIRED / 602.3 Individual water supply. / 602.3.1 Sources.

602.3.1 Sources.

Dependent on geological and soil conditions and the amount of rainfall, individual water supplies are of the following types: drilled well, driven well, dug well, bored well, spring, stream or cistern. Surface bodies of water and land cisterns shall not be sources of individual water supply unless properly treated by approved means to prevent contamination.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 602 WATER REQUIRED / 602.3 Individual water supply. / 602.3.2 Minimum quantity.

602.3.2 Minimum quantity.

The combined capacity of the source and storage in an individual water supply system shall supply the fixtures with water at rates and pressures as required by this chapter.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 602 WATER REQUIRED / 602.3 Individual water supply. / 602.3.3 Water quality.

602.3.3 Water quality.

Water from an individual water supply shall be approved as potable by the authority having jurisdiction prior to connection to the plumbing system.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 602 WATER REQUIRED / 602.3 Individual water supply. / 602.3.4 Disinfection of system.

602.3.4 Disinfection of system.

After construction or major repair, the individual water supply system shall be purged of

deleterious matter and disinfected in accordance with Section 610.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 602 WATER REQUIRED / 602.3 Individual water supply. / 602.3.5 Pumps.

602.3.5 Pumps.

Pumps shall be rated for the transport of potable water. Pumps in an individual water supply system shall be constructed and installed so as to prevent contamination from entering a potable water supply through the pump units. Pumps shall be sealed to the well casing or covered with a water-tight seal. Pumps shall be designed to maintain a prime and installed such that ready access is provided to the pump parts of the entire assembly for repairs.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 602 WATER REQUIRED / 602.3 Individual water supply. / 602.3.5 Pumps. / 602.3.5.1 Pump enclosure.

602.3.5.1 Pump enclosure.

The pump room or enclosure around a well pump shall be drained and protected from freezing by heating or other approved means. Where pumps are installed in basements, such pumps shall be mounted on a block or shelf not less than 18 inches (457 mm) above the basement floor. Well pits shall be prohibited.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 603 WATER SERVICE

**SECTION 603
WATER SERVICE**

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 603 WATER SERVICE / 603.1 Size of water service pipe.

603.1 Size of water service pipe.

The water service pipe shall be sized to supply water to the structure in the quantities and at the pressures required in this code. The minimum diameter of water service pipe shall be $\frac{3}{4}$ inch (19.1 mm).

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 603 WATER SERVICE / 603.2 Separation of water service and building sewer.

603.2 Separation of water service and building sewer.

Water service pipe and the building sewer shall be separated by 5 feet (1524 mm) of undisturbed or compacted earth.

Exceptions:

1. The required separation distance shall not apply where the bottom of the water service pipe within 5 feet (1524 mm) of the sewer is a minimum of 12 inches (305 mm) above the top of the highest point of the sewer and the pipe materials conform to Table 702.3.
2. Water service pipe is permitted to be located in the same trench with a building sewer, provided such sewer is constructed of materials listed in Table 702.2.
3. The required separation distance shall not apply where a water service pipe crosses a sewer pipe, provided the water service pipe is sleeved to at least 5 feet (1524 mm) horizontally from the sewer pipe centerline on both sides of such crossing with pipe materials listed in Table 605.3, 702.2 or 702.3.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 603 WATER SERVICE / 603.2 Separation of water service and building sewer. / 603.2.1 Water service near sources of pollution.

603.2.1 Water service near sources of pollution.

Potable water service pipes shall not be located in, under or above cesspools, septic tanks, septic tank drainage fields or seepage pits (see Section 605.1 for soil and groundwater conditions).

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 604 DESIGN OF BUILDING WATER DISTRIBUTION SYSTEM

**SECTION 604
DESIGN OF BUILDING WATER
DISTRIBUTION SYSTEM**

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 604 DESIGN OF BUILDING WATER DISTRIBUTION SYSTEM / 604.1 General.

604.1 General.

The design of the water distribution system shall conform to accepted engineering practice.

Methods utilized to determine pipe sizes shall be approved.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 604 DESIGN OF BUILDING WATER DISTRIBUTION SYSTEM / 604.2 System interconnection.

604.2 System interconnection.

At the points of interconnection between the hot and cold water supply piping systems and the individual fixtures, appliances or devices, provisions shall be made to prevent flow between such piping systems.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 604 DESIGN OF BUILDING WATER DISTRIBUTION SYSTEM / 604.3 Water distribution system design criteria.

604.3 Water distribution system design criteria.

The water distribution system shall be designed, and pipe sizes shall be selected such that under conditions of peak demand, the capacities at the fixture supply pipe outlets shall not be less than shown in Table 604.3. The minimum flow rate and flow pressure provided to fixtures and appliances not listed in Table 604.3 shall be in accordance with the manufacturer's installation instructions.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 604 DESIGN OF BUILDING WATER DISTRIBUTION SYSTEM / 604.3 Water distribution system design criteria. / TABLE 604.3 WATER DISTRIBUTION SYSTEM DESIGN CRITERIA REQUIRED CAPACITY AT FIXTURE SUPPLY PIPE OUTLETS

**TABLE 604.3
WATER DISTRIBUTION SYSTEM DESIGN CRITERIA
REQUIRED CAPACITY AT FIXTURE SUPPLY PIPE OUTLETS**

FIXTURE SUPPLY OUTLET SERVING	FLOW RATE^a (gpm)	FLOW PRESSURE (psi)
Bathtub	4	8
Bidet	2	4
Combination fixture	4	8
Dishwasher, residential	2.75	8
Drinking fountain	0.75	8
Laundry tray	4	8
Lavatory	2	8
Shower	3	8
Shower, temperature controlled	3	20

I-Quest 2006 Codes Complete Collection

FIXTURE SUPPLY OUTLET SERVING	FLOW RATE ^a (gpm)	FLOW PRESSURE (psi)
Sillcock, hose bibb	5	8
Sink, residential	2.5	8
Sink, service	3	8
Urinal, valve	15	15
Water closet, blow out, flushometer valve	35	25
Water closet, flushometer tank	1.6	15
Water closet, siphonic, flushometer valve	25	15
Water closet, tank, close coupled	3	8
Water closet, tank, one piece	6	20

For SI: 1 pound per square inch = 6.895 kPa, 1 gallon per minute = 3.785 L/m.
a. For additional requirements for flow rates and quantities, see Section 604.4.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 604 DESIGN OF BUILDING WATER DISTRIBUTION SYSTEM / 604.4 Maximum flow and water consumption.

604.4 Maximum flow and water consumption.

The maximum water consumption flow rates and quantities for all plumbing fixtures and fixture fittings shall be in accordance with Table 604.4.

Exceptions:

1. Blowout design water closets having a maximum water consumption of 3.5 gallons (13 L) per flushing cycle.
2. Vegetable sprays.
3. Clinical sinks having a maximum water consumption of 4.5 gallons (17 L) per flushing cycle.
4. Service sinks.
5. Emergency showers.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 604 DESIGN OF BUILDING WATER DISTRIBUTION SYSTEM / 604.4 Maximum flow and water consumption. / TABLE 604.4 MAXIMUM FLOW RATES AND CONSUMPTION FOR PLUMBING FIXTURES AND FIXTURE FITTINGS

**TABLE 604.4
MAXIMUM FLOW RATES AND CONSUMPTION FOR**

PLUMBING FIXTURES AND FIXTURE FITTINGS

PLUMBING FIXTURE OR FIXTURE FITTING	MAXIMUM FLOW RATE OR QUANTITY^b
Lavatory, private	2.2 gpm at 60 psi
Lavatory, public, (metering)	0.25 gallon per metering cycle
Lavatory, public (other than metering)	0.5 gpm at 60 psi
Shower head ^a	2.5 gpm at 80 psi
Sink faucet	2.2 gpm at 60 psi
Urinal	1.0 gallon per flushing cycle
Water closet	1.6 gallons per flushing cycle

For SI: 1 gallon = 3.785 L, 1 gallon per minute = 3.785 L/m,
1 pound per square inch = 6.895 kPa.

- a. A hand-held shower spray is a shower head.
- b. Consumption tolerances shall be determined from referenced standards.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 604 DESIGN OF BUILDING WATER DISTRIBUTION SYSTEM / 604.5 Size of fixture supply.

604.5 Size of fixture supply.

The minimum size of a fixture supply pipe shall be as shown in Table 604.5. The fixture supply pipe shall not terminate more than 30 inches (762 mm) from the point of connection to the fixture. A reduced-size flexible water connector installed between the supply pipe and the fixture shall be of an approved type. The supply pipe shall extend to the floor or wall adjacent to the fixture. The minimum size of individual distribution lines utilized in gridded or parallel water distribution systems shall be as shown in Table 604.5.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 604 DESIGN OF BUILDING WATER DISTRIBUTION SYSTEM / 604.5 Size of fixture supply. / TABLE 604.5 MINIMUM SIZES OF FIXTURE WATER SUPPLY PIPES

**TABLE 604.5
MINIMUM SIZES OF FIXTURE WATER SUPPLY PIPES**

FIXTURE	MINIMUM PIPE SIZE (inch)
Bathtubs ^a (60" x 32" and smaller)	1/ 2
Bathtubs ^a (larger than 60" x 32")	1/ 2
Bidet	3/ 8
Combination sink and tray	1/ 2

I-Quest 2006 Codes Complete Collection

Dishwasher, domestic ^a	1/ 2
Drinking fountain	3/ 8
Hose bibbs	1/ 2
Kitchen sink ^a	1/ 2
Laundry, 1, 2 or 3 compartments ^a	1/ 2
Lavatory	3/ 8
Shower, single head ^a	1/ 2
Sinks, flushing rim	3/ 4
Sinks, service	1/ 2
Urinal, flush tank	1/ 2
Urinal, flush valve	3/ 4
Wall hydrant	1/ 2
Water closet, flush tank	3/ 8
Water closet, flush valve	1
Water closet, flushometer tank	3/ 8
Water closet, one piece ^a	1/ 2

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm,
1 pound per square inch = 6.895 kPa.

- a. Where the developed length of the distribution line is 60 feet or less, and the available pressure at the meter is a minimum of 35 psi, the minimum size of an individual distribution line supplied from a manifold and installed as part of a parallel water distribution system shall be one nominal tube size smaller than the sizes indicated.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 604 DESIGN OF BUILDING WATER DISTRIBUTION SYSTEM / 604.6 Variable street pressures.

604.6 Variable street pressures.

Where street water main pressures fluctuate, the building water distribution system shall be designed for the minimum pressure available.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 604 DESIGN OF BUILDING WATER DISTRIBUTION SYSTEM / 604.7 Inadequate water pressure.

604.7 Inadequate water pressure.

Wherever water pressure from the street main or other source of supply is insufficient to provide flow pressures at fixture outlets as required under Table 604.3, a water pressure booster system conforming to Section 606.5 shall be installed on the building water supply system.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 604 DESIGN OF BUILDING WATER DISTRIBUTION SYSTEM / 604.8 Water-pressure reducing valve or regulator.

604.8 Water-pressure reducing valve or regulator.

Where water pressure within a building exceeds 80 psi (552 kPa) static, an approved water-pressure reducing valve conforming to ASSE 1003 with strainer shall be installed to reduce the pressure in the building water distribution piping to 80 psi (552 kPa) static or less.

Exception: Service lines to sill cocks and outside hydrants, and main supply risers where pressure from the mains is reduced to 80 psi (552 kPa) or less at individual fixtures.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 604 DESIGN OF BUILDING WATER DISTRIBUTION SYSTEM / 604.8 Water-pressure reducing valve or regulator. / 604.8.1 Valve design.

604.8.1 Valve design.

The pressure-reducing valve shall be designed to remain open to permit uninterrupted water flow in case of valve failure.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 604 DESIGN OF BUILDING WATER DISTRIBUTION SYSTEM / 604.8 Water-pressure reducing valve or regulator. / 604.8.2 Repair and removal.

604.8.2 Repair and removal.

All water-pressure reducing valves, regulators and strainers shall be so constructed and installed as to permit repair or removal of parts without breaking a pipeline or removing the valve and strainer from the pipeline.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 604 DESIGN OF BUILDING WATER DISTRIBUTION SYSTEM / 604.9 Water hammer.

604.9 Water hammer.

The flow velocity of the water distribution system shall be controlled to reduce the possibility of

water hammer. A water-hammer arrestor shall be installed where quick-closing valves are utilized. Water-hammer arrestors shall be installed in accordance with the manufacturer's specifications. Water-hammer arrestors shall conform to ASSE 1010.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 604 DESIGN OF BUILDING WATER DISTRIBUTION SYSTEM / 604.10 Gridded and parallel water distribution system manifolds.

604.10 Gridded and parallel water distribution system manifolds.

Hot water and cold water manifolds installed with gridded or parallel connected individual distribution lines to each fixture or fixture fitting shall be designed in accordance with Sections 604.10.1 through 604.10.3.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 604 DESIGN OF BUILDING WATER DISTRIBUTION SYSTEM / 604.10 Gridded and parallel water distribution system manifolds. / 604.10.1 Manifold sizing.

604.10.1 Manifold sizing.

Hot water and cold water manifolds shall be sized in accordance with Table 604.10.1. The total gallons per minute is the demand of all outlets supplied.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 604 DESIGN OF BUILDING WATER DISTRIBUTION SYSTEM / 604.10 Gridded and parallel water distribution system manifolds. / 604.10.1 Manifold sizing. / TABLE 604.10.1 MANIFOLD SIZING

**TABLE 604.10.1
MANIFOLD SIZING**

NOMINAL SIZE INTERNAL DIAMETER (inches)	MAXIMUM DEMAND (gpm)	
	Velocity at 4 feet per second	Velocity at 8 feet per second
½	2	5
¾	6	11
1	10	20
1¼	15	31
1½	22	44

For SI: 1 inch = 25.4 mm, 1 gallon per minute = 3.785 L/m,
1 foot per second = 0.305 m/s.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 604 DESIGN OF BUILDING WATER DISTRIBUTION SYSTEM / 604.10 Gridded and parallel water distribution system manifolds. / 604.10.2 Valves.

604.10.2 Valves.

Individual fixture shutoff valves installed at the manifold shall be identified as to the fixture being supplied.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 604 DESIGN OF BUILDING WATER DISTRIBUTION SYSTEM / 604.10 Gridded and parallel water distribution system manifolds. / 604.10.3 Access.

604.10.3 Access.

Access shall be provided to manifolds.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 604 DESIGN OF BUILDING WATER DISTRIBUTION SYSTEM / 604.11 Individual pressure balancing in-line valves for individual fixture fittings.

604.11 Individual pressure balancing in-line valves for individual fixture fittings.

Where individual pressure balancing in-line valves for individual fixture fittings are installed, such valves shall comply with ASSE 1066. Such valves shall be installed in an accessible location and shall not be utilized alone as a substitute for the balanced pressure, thermostatic or combination shower valves required in Section 424.3.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS

**SECTION 605
MATERIALS, JOINTS AND CONNECTIONS**

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.1 Soil and ground water.

605.1 Soil and ground water.

The installation of a water service or water distribution pipe shall be prohibited in soil and

ground water contaminated with solvents, fuels, organic compounds or other detrimental materials causing permeation, corrosion, degradation or structural failure of the piping material. Where detrimental conditions are suspected, a chemical analysis of the soil and ground water conditions shall be required to ascertain the acceptability of the water service or water distribution piping material for the specific installation. Where detrimental conditions exist, approved alternative materials or routing shall be required.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.2 Lead content of water supply pipe and fittings.

605.2 Lead content of water supply pipe and fittings.

Pipe and pipe fittings, including valves and faucets, utilized in the water supply system shall have a maximum of 8-percent lead content.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.3 Water service pipe.

605.3 Water service pipe.

Water service pipe shall conform to NSF 61 and shall conform to one of the standards listed in Table 605.3. All water service pipe or tubing, installed underground and outside of the structure, shall have a minimum working pressure rating of 160 psi (1100 kPa) at 73.4°F (23°C). Where the water pressure exceeds 160 psi (1100 kPa), piping material shall have a minimum rated working pressure equal to the highest available pressure. Water service piping materials not third-party certified for water distribution shall terminate at or before the full open valve located at the entrance to the structure. All ductile iron water service piping shall be cement mortar lined in accordance with AWWA C104.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.3 Water service pipe. / TABLE 605.3 WATER SERVICE PIPE

**TABLE 605.3
WATER SERVICE PIPE**

MATERIAL	STANDARD
Acrylonitrile butadiene styrene (ABS) plastic pipe	ASTM D 1527; ASTM D 2282
Asbestos-cement pipe	ASTM C 296
Brass pipe	ASTM B 43
Chlorinated polyvinyl chloride (CPVC) plastic pipe	ASTM D 2846; ASTM F 441; ASTM F 442; CSA B137.6
Copper or copper-alloy pipe	ASTM B 42; ASTM B 302
Copper or copper-alloy tubing (Type K, WK, L, WL, M or	ASTM B 75; ASTM B 88; ASTM B 251; ASTM B 447

I-Quest 2006 Codes Complete Collection

MATERIAL	STANDARD
WM)	
Cross-linked polyethylene (PEX) plastic tubing	ASTM F 876; ASTM F 877; CSA B137.5
Cross-linked polyethylene/aluminum/cross-linked polyethylene (PEX-AL-PEX) pipe	ASTM F 1281; CSA B137.10M
Cross-linked polyethylene/aluminum/high-density polyethylene (PEX-AL-HDPE)	ASTM F 1986
Ductile iron water pipe	AWWA C151; AWWA C115
Galvanized steel pipe	ASTM A 53
Polybutylene (PB) plastic pipe and tubing	ASTM D 2662; ASTM D 2666; ASTM D 3309; CSA B137.8M
Polyethylene (PE) plastic pipe	ASTM D 2239; CSA B137.1
Polyethylene (PE) plastic tubing	ASTM D 2737; CSA B137.1
Polyethylene/aluminum/polyethylene (PE-AL-PE) pipe	ASTM F 1282; CSA B137.9
Polypropylene (PP) plastic pipe or tubing	ASTM F 2389; CSA B137.11
Polyvinyl chloride (PVC) plastic pipe	ASTM D 1785; ASTM D 2241; ASTM D 2672; CSA B137.3
Stainless steel pipe (Type 304/304L)	ASTM A 312; ASTM A 778
Stainless steel pipe (Type 316/316L)	ASTM A 312; ASTM A 778

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.3 Water service pipe. / 605.3.1 Dual check-valve-type backflow preventer.

605.3.1 Dual check-valve-type backflow preventer.

Where a dual check-valve backflow preventer is installed on the water supply system, it shall comply with ASSE 1024 or CSA B64.6.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.4 Water distribution pipe.

605.4 Water distribution pipe.

Water distribution pipe shall conform to NSF 61 and shall conform to one of the standards listed in Table 605.4. All hot water distribution pipe and tubing shall have a minimum pressure rating of 100 psi (690 kPa) at 180°F (82°C).

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.4 Water distribution pipe. / TABLE 605.4 WATER DISTRIBUTION PIPE

**TABLE 605.4
WATER DISTRIBUTION PIPE**

MATERIAL	STANDARD
Brass pipe	ASTM B 43
Chlorinated polyvinyl chloride (CPVC) plastic pipe and tubing	ASTM D 2846; ASTM F 441; ASTM F 442; CSA B137.6
Copper or copper-alloy pipe	ASTM B 42; ASTM B 302
Copper or copper-alloy tubing (Type K, WK, L, WL, M or WM)	ASTM B 75; ASTM B 88; ASTM B 251; ASTM B 447
Cross-linked polyethylene (PEX) plastic tubing	ASTM F 877; CSA B137.5
Cross-linked polyethylene/aluminum/cross-linked polyethylene (PEX-AL-PEX) pipe	ASTM F 1281; CSA B137.10M
Cross-linked polyethylene/aluminum/high-density polyethylene (PEX-AL-HDPE)	ASTM F 1986
Galvanized steel pipe	ASTM A 53
Polybutylene (PB) plastic pipe and tubing	ASTM D 3309; CSA B137.8M
Polyethylene/Aluminum/Polyethylene (PE-AL-PE) composite pipe	ASTM F 1282
Polypropylene (PP) plastic pipe or tubing	ASTM F 2389; CSA B137.11
Stainless steel pipe (Type 304/304L)	ASTM A 312; ASTM A 778
Stainless steel pipe (Type 316/316L)	ASTM A 312; ASTM A 778

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.5 Fittings.

605.5 Fittings.

Pipe fittings shall be approved for installation with the piping material installed and shall conform to the respective pipe standards or one of the standards listed in Table 605.5. All pipe fittings utilized in water supply systems shall also conform to NSF 61. The fittings shall not have ledges, shoulders or reductions capable of retarding or obstructing flow in the piping. Ductile and gray iron pipe fittings shall be cement mortar lined in accordance with AWWA C104.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.5 Fittings. / TABLE 605.5 PIPE FITTINGS

**TABLE 605.5
PIPE FITTINGS**

MATERIAL	STANDARD
Acrylonitrile butadiene styrene (ABS) plastic	ASTM D 2468

I-Quest 2006 Codes Complete Collection

MATERIAL	STANDARD
Cast-iron	ASME B16.4; ASME B16.12
Chlorinated polyvinyl chloride (CPVC) plastic	ASTM F 437; ASTM F 438; ASTM F 439; CSA B137.6
Copper or copper alloy	ASME B16.15; ASME B16.18; ASME B16.22; ASME B16.23; ASME B16.26; ASME B16.29
Cross-linked polyethylene/aluminum/high-density polyethylene (PEX-AL-HDPE)	ASTM F 1986
Fittings for cross-linked polyethylene (PEX) plastic tubing	ASTM F 877; ASTM F 1807; ASTM F 1960; ASTM F 2080; ASTM F 2159; CSA B137.5
Gray iron and ductile iron	AWWA C110; AWWA C153
Malleable iron	ASME B16.3
Metal (brass) insert fittings for Polyethylene/Aluminum/Polyethylene (PE-AL-PE) and Cross-linked Polyethylene/Aluminum/Polyethylene (PEX-AL-PEX)	ASTM F 1974
Polybutylene (PB) plastic	CSA B137.8
Polyethylene (PE) plastic	ASTM D 2609; CSA B137.1
Polypropylene (PP) plastic pipe or tubing	ASTM F 2389; CSA B137.11
Polyvinyl chloride (PVC) plastic	ASTM D 2464; ASTM D 2466; ASTM D 2467; CSA B137.2
Stainless steel (Type 304/304L)	ASTM A 312; ASTM A 778
Stainless steel (Type 316/316L)	ASTM A 312; ASTM A 778
Steel	ASME B16.9; ASME B16.11; ASME B16.28

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.5 Fittings. / 605.5.1 Mechanically formed tee fittings.

605.5.1 Mechanically formed tee fittings.

Mechanically extracted outlets shall have a height not less than three times the thickness of the branch tube wall.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.5 Fittings. / 605.5.1 Mechanically formed tee fittings. / 605.5.1.1 Full flow assurance.

605.5.1.1 Full flow assurance.

Branch tubes shall not restrict the flow in the run tube. A dimple/depth stop shall be formed in the branch tube to ensure that penetration into the collar is of the correct depth. For inspection purposes, a second dimple shall be placed 0.25 inch (6.4 mm) above the first dimple. Dimples shall be aligned with the tube run.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.5 Fittings. / 605.5.1 Mechanically formed tee fittings. / 605.5.1.2 Brazed joints.

605.5.1.2 Brazed joints.

Mechanically formed tee fittings shall be brazed in accordance with Section 605.14.1.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.6 Flexible water connectors.

605.6 Flexible water connectors.

Flexible water connectors exposed to continuous pressure shall conform to ASME A112.18.6. Access shall be provided to all flexible water connectors.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.7 Valves.

605.7 Valves.

All valves shall be of an approved type and compatible with the type of piping material installed in the system. Ball valves, gate valves, globe valves and plug valves intended to supply drinking water shall meet the requirements of NSF 61.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.8 Manufactured pipe nipples.

605.8 Manufactured pipe nipples.

Manufactured pipe nipples shall conform to one of the standards listed in Table 605.8.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.8 Manufactured pipe nipples. / TABLE 605.8 MANUFACTURED PIPE NIPPLES

**TABLE 605.8
MANUFACTURED PIPE NIPPLES**

MATERIAL	STANDARD
Brass-, copper-, chromium-plated	ASTM B 687
Steel	ASTM A 733

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.9 Prohibited joints and connections.

605.9 Prohibited joints and connections.

The following types of joints and connections shall be prohibited:

1. Cement or concrete joints.
2. Joints made with fittings not approved for the specific installation.
3. Solvent-cement joints between different types of plastic pipe.
4. Saddle-type fittings.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.10 ABS plastic.

605.10 ABS plastic.

Joints between ABS plastic pipe or fittings shall comply with Sections 605.10.1 through 605.10.3.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.10 ABS plastic. / 605.10.1 Mechanical joints.

605.10.1 Mechanical joints.

Mechanical joints on water pipes shall be made with an elastomeric seal conforming to ASTM D 3139. Mechanical joints shall only be installed in underground systems, unless otherwise approved. Joints shall be installed only in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.10 ABS plastic. / 605.10.2 Solvent cementing.

605.10.2 Solvent cementing.

Joint surfaces shall be clean and free from moisture. Solvent cement that conforms to ASTM D 2235 shall be applied to all joint surfaces. The joint shall be made while the cement is wet. Joints shall be made in accordance with ASTM D 2235. Solvent-cement joints shall be

permitted above or below ground.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.10 ABS plastic. / 605.10.3 Threaded joints.

605.10.3 Threaded joints.

Threads shall conform to ASME B1.20.1. Schedule 80 or heavier pipe shall be permitted to be threaded with dies specifically designed for plastic pipe. Approved thread lubricant or tape shall be applied on the male threads only.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.11 Asbestos-cement.

605.11 Asbestos-cement.

Joints between asbestos-cement pipe or fittings shall be made with a sleeve coupling of the same composition as the pipe, sealed with an elastomeric ring conforming to ASTM D 1869.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.12 Brass.

605.12 Brass.

Joints between brass pipe or fittings shall comply with Sections 605.12.1 through 605.12.4.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.12 Brass. / 605.12.1 Brazed joints.

605.12.1 Brazed joints.

All joint surfaces shall be cleaned. An approved flux shall be applied where required. The joint shall be brazed with a filler metal conforming to AWS A5.8.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.12 Brass. / 605.12.2 Mechanical joints.

605.12.2 Mechanical joints.

Mechanical joints shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.12 Brass. / 605.12.3 Threaded joints.

605.12.3 Threaded joints.

Threads shall conform to ASME B1.20.1. Pipe-joint compound or tape shall be applied on the male threads only.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.12 Brass. / 605.12.4 Welded joints.

605.12.4 Welded joints.

All joint surfaces shall be cleaned. The joint shall be welded with an approved filler metal.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.13 Gray iron and ductile iron joints.

605.13 Gray iron and ductile iron joints.

Joints for gray and ductile iron pipe and fittings shall comply with AWWA C111 and shall be installed in accordance with the manufacturer's installation instructions.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.14 Copper pipe.

605.14 Copper pipe.

Joints between copper or copper-alloy pipe or fittings shall comply with Sections 605.14.1 through 605.14.5.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.14 Copper pipe. / 605.14.1 Brazed joints.

605.14.1 Brazed joints.

All joint surfaces shall be cleaned. An approved flux shall be applied where required. The joint shall be brazed with a filler metal conforming to AWS A5.8.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND

**DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.14
Copper pipe. / 605.14.2 Mechanical joints.**

605.14.2 Mechanical joints.

Mechanical joints shall be installed in accordance with the manufacturer's instructions.

**2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND
DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.14
Copper pipe. / 605.14.3 Soldered joints.**

605.14.3 Soldered joints.

Solder joints shall be made in accordance with the methods of ASTM B 828. All cut tube ends shall be reamed to the full inside diameter of the tube end. All joint surfaces shall be cleaned. A flux conforming to ASTM B 813 shall be applied. The joint shall be soldered with a solder conforming to ASTM B 32. The joining of water supply piping shall be made with lead-free solder and fluxes. "Lead free" shall mean a chemical composition equal to or less than 0.2-percent lead.

**2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND
DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.14
Copper pipe. / 605.14.4 Threaded joints.**

605.14.4 Threaded joints.

Threads shall conform to ASME B1.20.1. Pipe-joint compound or tape shall be applied on the male threads only.

**2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND
DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.14
Copper pipe. / 605.14.5 Welded joints.**

605.14.5 Welded joints.

All joint surfaces shall be cleaned. The joint shall be welded with an approved filler metal.

**2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND
DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.15
Copper tubing.**

605.15 Copper tubing.

Joints between copper or copper-alloy tubing or fittings shall comply with Sections 605.15.1 through 605.15.4.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.15 Copper tubing. / 605.15.1 Brazed joints.

605.15.1 Brazed joints.

All joint surfaces shall be cleaned. An approved flux shall be applied where required. The joint shall be brazed with a filler metal conforming to AWS A5.8.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.15 Copper tubing. / 605.15.2 Flared joints.

605.15.2 Flared joints.

Flared joints for water pipe shall be made by a tool designed for that operation.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.15 Copper tubing. / 605.15.3 Mechanical joints.

605.15.3 Mechanical joints.

Mechanical joints shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.15 Copper tubing. / 605.15.4 Soldered joints.

605.15.4 Soldered joints.

Solder joints shall be made in accordance with the methods of ASTM B 828. All cut tube ends shall be reamed to the full inside diameter of the tube end. All joint surfaces shall be cleaned. A flux conforming to ASTM B 813 shall be applied. The joint shall be soldered with a solder conforming to ASTM B 32. The joining of water supply piping shall be made with lead-free solders and fluxes. "Lead free" shall mean a chemical composition equal to or less than 0.2-percent lead.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.16 CPVC plastic.

605.16 CPVC plastic.

Joints between CPVC plastic pipe or fittings shall comply with Sections 605.16.1 through

605.16.3.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.16 CPVC plastic. / 605.16.1 Mechanical joints.

605.16.1 Mechanical joints.

Mechanical joints shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.16 CPVC plastic. / 605.16.2 Solvent cementing.

605.16.2 Solvent cementing.

Joint surfaces shall be clean and free from moisture, and an approved primer shall be applied. Solvent cement, orange in color and conforming to ASTM F 493, shall be applied to all joint surfaces. The joint shall be made while the cement is wet, and in accordance with ASTM D 2846 or ASTM F 493. Solvent-cement joints shall be permitted above or below ground.

Exception: A primer is not required where all of the following conditions apply:

1. The solvent cement used is third-party certified as conforming to ASTM F 493.
2. The solvent cement used is yellow in color.
3. The solvent cement is used only for joining ½ inch (12.7 mm) through 2 inch (51 mm) diameter CPVC pipe and fittings.
4. The CPVC pipe and fittings are manufactured in accordance with ASTM D 2846.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.16 CPVC plastic. / 605.16.3 Threaded joints.

605.16.3 Threaded joints.

Threads shall conform to ASME B1.20.1. Schedule 80 or heavier pipe shall be permitted to be threaded with dies specifically designed for plastic pipe, but the pressure rating of the pipe shall be reduced by 50 percent. Thread by socket molded fittings shall be permitted. Approved thread lubricant or tape shall be applied on the male threads only.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.17 Cross-linked polyethylene plastic.

605.17 Cross-linked polyethylene plastic.

Joints between cross-linked polyethylene plastic tubing or fittings shall comply with Sections 605.17.1 and 605.17.2.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.17 Cross-linked polyethylene plastic. / 605.17.1 Flared joints.

605.17.1 Flared joints.

Flared pipe ends shall be made by a tool designed for that operation.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.17 Cross-linked polyethylene plastic. / 605.17.2 Mechanical joints.

605.17.2 Mechanical joints.

Mechanical joints shall be installed in accordance with the manufacturer's instructions. Fittings for cross-linked polyethylene (PEX) plastic tubing as described in ASTM F 877, ASTM F 1807, ASTM F 1960, and ASTM F 2080 shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.18 Steel.

605.18 Steel.

Joints between galvanized steel pipe or fittings shall comply with Sections 605.18.1 and 605.18.2.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.18 Steel. / 605.18.1 Threaded joints.

605.18.1 Threaded joints.

Threads shall conform to ASME B1.20.1. Pipe-joint compound or tape shall be applied on the male threads only.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.18 Steel. / 605.18.2 Mechanical joints.

605.18.2 Mechanical joints.

Joints shall be made with an approved elastomeric seal. Mechanical joints shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.19 Polybutylene plastic.

605.19 Polybutylene plastic.

Joints between polybutylene plastic pipe and tubing or fittings shall comply with Sections 605.19.1 through 605.19.3.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.19 Polybutylene plastic. / 605.19.1 Flared joints.

605.19.1 Flared joints.

Flared pipe ends shall be made by a tool designed for that operation.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.19 Polybutylene plastic. / 605.19.2 Heat-fusion joints.

605.19.2 Heat-fusion joints.

Joints shall be of the socket-fusion or butt-fusion type. Joint surfaces shall be clean and free from moisture. All joint surfaces shall be heated to melt temperature and joined. The joint shall be undisturbed until cool. Joints shall be made in accordance with ASTM D 2657, ASTM D 3309 or CAN3-B137.8M.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.19 Polybutylene plastic. / 605.19.3 Mechanical joints.

605.19.3 Mechanical joints.

Mechanical joints shall be installed in accordance with the manufacturer's instructions. Metallic lock rings employed with insert fittings as described in ASTM D 3309 or

CAN3-B137.8M shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.20 Polyethylene plastic.

605.20 Polyethylene plastic.

Joints between polyethylene plastic pipe and tubing or fittings shall comply with Sections 605.20.1 through 605.20.4.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.20 Polyethylene plastic. / 605.20.1 Flared joints.

605.20.1 Flared joints.

Flared joints shall be permitted where so indicated by the pipe manufacturer. Flared joints shall be made by a tool designed for that operation.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.20 Polyethylene plastic. / 605.20.2 Heat-fusion joints.

605.20.2 Heat-fusion joints.

Joint surfaces shall be clean and free from moisture. All joint surfaces shall be heated to melt temperature and joined. The joint shall be undisturbed until cool. Joints shall be made in accordance with ASTM D 2657.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.20 Polyethylene plastic. / 605.20.3 Mechanical joints.

605.20.3 Mechanical joints.

Mechanical joints shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.20 Polyethylene plastic. / 605.20.4 Installation.

605.20.4 Installation.

Polyethylene pipe shall be cut square, with a cutter designed for plastic pipe. Except where joined by heat fusion, pipe ends shall be chamfered to remove sharp edges. Kinked pipe

shall not be installed. The minimum pipe bending radius shall not be less than 30 pipe diameters, or the minimum coil radius, whichever is greater. Piping shall not be bent beyond straightening of the curvature of the coil. Bends shall not be permitted within 10 pipe diameters of any fitting or valve. Stiffener inserts installed with compression-type couplings and fittings shall not extend beyond the clamp or nut of the coupling or fitting.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.21 Polypropylene (PP) plastic.

605.21 Polypropylene (PP) plastic.

Joints between PP plastic pipe and fittings shall comply with Section 605.21.1 or 605.21.2.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.21 Polypropylene (PP) plastic. / 605.21.1 Heat-fusion joints.

605.21.1 Heat-fusion joints.

Heat-fusion joints for polypropylene pipe and tubing joints shall be installed with socket-type heat-fused polypropylene fittings, butt-fusion polypropylene fittings or electrofusion polypropylene fittings. Joint surfaces shall be clean and free from moisture. The joint shall be undisturbed until cool. Joints shall be made in accordance with ASTM F 2389.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.21 Polypropylene (PP) plastic. / 605.21.2 Mechanical and compression sleeve joints.

605.21.2 Mechanical and compression sleeve joints.

Mechanical and compression sleeve joints shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.22 PVC plastic.

605.22 PVC plastic.

Joints between PVC plastic pipe or fittings shall comply with Sections 605.22.1 through 605.22.3.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.22

PVC plastic. / 605.22.1 Mechanical joints.

605.22.1 Mechanical joints.

Mechanical joints on water pipe shall be made with an elastomeric seal conforming to ASTM D 3139. Mechanical joints shall not be installed in above-ground systems unless otherwise approved. Joints shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.22

PVC plastic. / 605.22.2 Solvent cementing.

605.22.2 Solvent cementing.

Joint surfaces shall be clean and free from moisture. A purple primer that conforms to ASTM F 656 shall be applied. Solvent cement not purple in color and conforming to ASTM D 2564 or CSA-B137.3 shall be applied to all joint surfaces. The joint shall be made while the cement is wet and shall be in accordance with ASTM D 2855. Solvent-cement joints shall be permitted above or below ground.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.22

PVC plastic. / 605.22.3 Threaded joints.

605.22.3 Threaded joints.

Threads shall conform to ASME B1.20.1. Schedule 80 or heavier pipe shall be permitted to be threaded with dies specifically designed for plastic pipe, but the pressure rating of the pipe shall be reduced by 50 percent. Thread by socket molded fittings shall be permitted. Approved thread lubricant or tape shall be applied on the male threads only.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.23

Stainless steel.

605.23 Stainless steel.

Joints between stainless steel pipe and fittings shall comply with Sections 605.23.1 and 605.23.2.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.23

Stainless steel. / 605.23.1 Mechanical joints.

605.23.1 Mechanical joints.

Mechanical joints shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.23 Stainless steel. / 605.23.2 Welded joints.

605.23.2 Welded joints.

All joint surfaces shall be cleaned. The joint shall be welded autogenously or with an approved filler metal as referenced in ASTM A 312.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.24 Joints between different materials.

605.24 Joints between different materials.

Joints between different piping materials shall be made with a mechanical joint of the compression or mechanical-sealing type, or as permitted in Sections 605.24.1, 605.24.2 and 605.24.3. Connectors or adapters shall have an elastomeric seal conforming to ASTM D 1869 or ASTM F 477. Joints shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.24 Joints between different materials. / 605.24.1 Copper or copper-alloy tubing to galvanized steel pipe.

605.24.1 Copper or copper-alloy tubing to galvanized steel pipe.

Joints between copper or copper-alloy tubing and galvanized steel pipe shall be made with a brass fitting or dielectric fitting. The copper tubing shall be soldered to the fitting in an approved manner, and the fitting shall be screwed to the threaded pipe.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.24 Joints between different materials. / 605.24.2 Plastic pipe or tubing to other piping material.

605.24.2 Plastic pipe or tubing to other piping material.

Joints between different grades of plastic pipe or between plastic pipe and other piping material shall be made with an approved adapter fitting.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 605 MATERIALS, JOINTS AND CONNECTIONS / 605.24

Joints between different materials. / 605.24.3 Stainless steel.

605.24.3 Stainless steel.

Joints between stainless steel and different piping materials shall be made with a mechanical joint of the compression or mechanical sealing type or a dielectric fitting.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 606 INSTALLATION OF THE BUILDING WATER DISTRIBUTION SYSTEM

**SECTION 606
INSTALLATION OF THE BUILDING
WATER DISTRIBUTION SYSTEM**

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 606 INSTALLATION OF THE BUILDING WATER DISTRIBUTION SYSTEM / 606.1 Location of full-open valves.

606.1 Location of full-open valves.

Full-open valves shall be installed in the following locations:

1. On the building water service pipe from the public water supply near the curb.
2. On the water distribution supply pipe at the entrance into the structure.
3. On the discharge side of every water meter.
4. On the base of every water riser pipe in occupancies other than multiple-family residential occupancies that are two stories or less in height and in one- and two-family residential occupancies.
5. On the top of every water down-feed pipe in occupancies other than one- and two-family residential occupancies.
6. On the entrance to every water supply pipe to a dwelling unit, except where supplying a single fixture equipped with individual stops.
7. On the water supply pipe to a gravity or pressurized water tank.
8. On the water supply pipe to every water heater.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 606 INSTALLATION OF THE BUILDING WATER DISTRIBUTION SYSTEM / 606.2 Location of shutoff valves.

606.2 Location of shutoff valves.

Shutoff valves shall be installed in the following locations:

1. On the fixture supply to each plumbing fixture other than bathtubs and showers in one- and two-family residential occupancies, and other than in individual sleeping units that are provided with unit shutoff valves in hotels, motels, boarding houses and similar occupancies.
2. On the water supply pipe to each sillcock.
3. On the water supply pipe to each appliance or mechanical equipment.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 606 INSTALLATION OF THE BUILDING WATER DISTRIBUTION SYSTEM / 606.3 Access to valves.

606.3 Access to valves.

Access shall be provided to all full-open valves and shutoff valves.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 606 INSTALLATION OF THE BUILDING WATER DISTRIBUTION SYSTEM / 606.4 Valve identification.

606.4 Valve identification.

Service and hose bibb valves shall be identified. All other valves installed in locations that are not adjacent to the fixture or appliance shall be identified, indicating the fixture or appliance served.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 606 INSTALLATION OF THE BUILDING WATER DISTRIBUTION SYSTEM / 606.5 Water pressure booster systems.

606.5 Water pressure booster systems.

Water pressure booster systems shall be provided as required by Sections 606.5.1 through 606.5.10.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 606 INSTALLATION OF THE BUILDING WATER DISTRIBUTION SYSTEM / 606.5 Water pressure booster systems. / 606.5.1 Water pressure booster systems required.

606.5.1 Water pressure booster systems required.

Where the water pressure in the public water main or individual water supply system is insufficient to supply the minimum pressures and quantities specified in this code, the supply shall be supplemented by an elevated water tank, a hydropneumatic pressure booster system or a water pressure booster pump installed in accordance with Section 606.5.5.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 606 INSTALLATION OF THE BUILDING WATER DISTRIBUTION SYSTEM / 606.5 Water pressure booster systems. / 606.5.2 Support.

606.5.2 Support.

All water supply tanks shall be supported in accordance with the *International Building Code*.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 606 INSTALLATION OF THE BUILDING WATER DISTRIBUTION SYSTEM / 606.5 Water pressure booster systems. / 606.5.3 Covers.

606.5.3 Covers.

All water supply tanks shall be covered to keep out unauthorized persons, dirt and vermin. The covers of gravity tanks shall be vented with a return bend vent pipe with an area not less than the area of the down-feed riser pipe, and the vent shall be screened with a corrosion-resistant screen of not less than 16 by 20 mesh per inch (630 by 787 mesh per m).

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 606 INSTALLATION OF THE BUILDING WATER DISTRIBUTION SYSTEM / 606.5 Water pressure booster systems. / 606.5.4 Overflows for water supply tanks.

606.5.4 Overflows for water supply tanks.

Each gravity or suction water supply tank shall be provided with an overflow with a diameter not less than that shown in Table 606.5.4. The overflow outlet shall discharge at a point not less than 6 inches (152 mm) above the roof or roof drain; floor or floor drain; or over an open water-supplied fixture. The overflow outlet shall be covered with a corrosion-resistant screen of not less than 16 by 20 mesh per inch (630 by 787 mesh per m) and by 0.25-inch (6.4 mm) hardware cloth or shall terminate in a horizontal angle seat check valve. Drainage from overflow pipes shall be directed so as not to freeze on roof walks.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 606 INSTALLATION OF THE BUILDING WATER DISTRIBUTION SYSTEM / 606.5 Water pressure booster systems. / 606.5.4 Overflows for

water supply tanks. / TABLE 606.5.4 SIZES FOR OVERFLOW PIPES FOR WATER SUPPLY TANKS

**TABLE 606.5.4
SIZES FOR OVERFLOW PIPES FOR WATER SUPPLY TANKS**

MAXIMUM CAPACITY OF WATER SUPPLY LINE TO TANK (gpm)	DIAMETER OF OVERFLOW PIPE (inches)
0 - 50	2
50 - 150	2½
150 - 200	3
200 - 400	4
400 - 700	5
700 - 1,000	6
Over 1,000	8

For SI: 1 inch = 25.4 mm, 1 gallon per minute = 3.785 L/m.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 606 INSTALLATION OF THE BUILDING WATER DISTRIBUTION SYSTEM / 606.5 Water pressure booster systems. / 606.5.5 Low-pressure cutoff required on booster pumps.

606.5.5 Low-pressure cutoff required on booster pumps.

A low-pressure cutoff shall be installed on all booster pumps in a water pressure booster system to prevent creation of a vacuum or negative pressure on the suction side of the pump when a positive pressure of 10 psi (68.94 kPa) or less occurs on the suction side of the pump.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 606 INSTALLATION OF THE BUILDING WATER DISTRIBUTION SYSTEM / 606.5 Water pressure booster systems. / 606.5.6 Potable water inlet control and location.

606.5.6 Potable water inlet control and location.

Potable water inlets to gravity tanks shall be controlled by a fill valve or other automatic supply valve installed so as to prevent the tank from overflowing. The inlet shall be terminated so as to provide an air gap not less than 4 inches (102 mm) above the overflow.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 606 INSTALLATION OF THE BUILDING WATER DISTRIBUTION SYSTEM / 606.5 Water pressure booster systems. / 606.5.7 Tank drain pipes.

606.5.7 Tank drain pipes.

A valved pipe shall be provided at the lowest point of each tank to permit emptying of the tank. The tank drain pipe shall discharge as required for overflow pipes and shall not be smaller in size than specified in Table 606.5.7.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 606 INSTALLATION OF THE BUILDING WATER DISTRIBUTION SYSTEM / 606.5 Water pressure booster systems. / 606.5.7 Tank drain pipes. / TABLE 606.5.7 SIZE OF DRAIN PIPES FOR WATER TANKS

**TABLE 606.5.7
SIZE OF DRAIN PIPES FOR WATER TANKS**

TANK CAPACITY (gallons)	DRAIN PIPE (inches)
Up to 750	1
751 to 1,500	1½
1,501 to 3,000	2
3,001 to 5,000	2½
5,000 to 7,500	3
Over 7,500	4

For SI: 1 inch = 25.4 mm, 1 gallon = 3.785 L.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 606 INSTALLATION OF THE BUILDING WATER DISTRIBUTION SYSTEM / 606.5 Water pressure booster systems. / 606.5.8 Prohibited location of potable supply tanks.

606.5.8 Prohibited location of potable supply tanks.

Potable water gravity tanks or manholes of potable water pressure tanks shall not be located directly under any soil or waste piping or any source of contamination.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 606 INSTALLATION OF THE BUILDING WATER DISTRIBUTION SYSTEM / 606.5 Water pressure booster systems. / 606.5.9 Pressure tanks, vacuum relief.

606.5.9 Pressure tanks, vacuum relief.

All water pressure tanks shall be provided with a vacuum relief valve at the top of the tank that will operate up to a maximum water pressure of 200 psi (1380 kPa) and up to a maximum temperature of 200°F (93°C). The minimum size of such vacuum relief valve shall

be 0.50 inch (12.7 mm).

Exception: This section shall not apply to pressurized captive air diaphragm/bladder tanks.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 606 INSTALLATION OF THE BUILDING WATER DISTRIBUTION SYSTEM / 606.5 Water pressure booster systems. / 606.5.10 Pressure relief for tanks.

606.5.10 Pressure relief for tanks.

Every pressure tank in a hydropneumatic pressure booster system shall be protected with a pressure relief valve. The pressure relief valve shall be set at a maximum pressure equal to the rating of the tank. The relief valve shall be installed on the supply pipe to the tank or on the tank. The relief valve shall discharge by gravity to a safe place of disposal.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 606 INSTALLATION OF THE BUILDING WATER DISTRIBUTION SYSTEM / 606.6 Water supply system test.

606.6 Water supply system test.

Upon completion of a section of or the entire water supply system, the system, or portion completed, shall be tested in accordance with Section 312.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 607 HOT WATER SUPPLY SYSTEM

**SECTION 607
HOT WATER SUPPLY SYSTEM**

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 607 HOT WATER SUPPLY SYSTEM / 607.1 Where required.

607.1 Where required.

In residential occupancies, hot water shall be supplied to all plumbing fixtures and equipment utilized for bathing, washing, culinary purposes, cleansing, laundry or building maintenance. In nonresidential occupancies, hot water shall be supplied for culinary purposes, cleansing, laundry or building maintenance purposes. In nonresidential occupancies, hot water or tempered water shall be supplied for bathing and washing purposes. Tempered water shall be supplied through a water temperature limiting device that conforms to ASSE 1070 and shall limit

the tempered water to a maximum of 110°F (43°C). This provision shall not supersede the requirement for protective shower valves in accordance with Section 424.3.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 607 HOT WATER SUPPLY SYSTEM / 607.2 Hot water supply temperature maintenance.

607.2 Hot water supply temperature maintenance.

Where the developed length of hot water piping from the source of hot water supply to the farthest fixture exceeds 100 feet (30 480 mm), the hot water supply system shall be provided with a method of maintaining the temperature in accordance with the *International Energy Conservation Code*.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 607 HOT WATER SUPPLY SYSTEM / 607.2 Hot water supply temperature maintenance. / 607.2.1 Piping insulation.

607.2.1 Piping insulation.

Circulating hot water system piping shall be insulated in accordance with the *International Energy Conservation Code*.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 607 HOT WATER SUPPLY SYSTEM / 607.2 Hot water supply temperature maintenance. / [E] 607.2.2 Hot water system controls.

[E] 607.2.2 Hot water system controls.

Automatic circulating hot water system pumps or heat trace shall be arranged to be conveniently turned off, automatically or manually, when the hot water system is not in operation.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 607 HOT WATER SUPPLY SYSTEM / 607.2 Hot water supply temperature maintenance. / 607.2.3 Recirculating pump.

607.2.3 Recirculating pump.

Where a thermostatic mixing valve is used in a system with a hot water recirculating pump, the hot water or tempered water return line shall be routed to the cold water inlet pipe of the water heater and the cold water inlet pipe or the hot water return connection of the thermostatic mixing valve.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND

DISTRIBUTION / SECTION 607 HOT WATER SUPPLY SYSTEM / 607.3 Thermal expansion control.

607.3 Thermal expansion control.

A means of controlling increased pressure caused by thermal expansion shall be provided where required in accordance with Sections 607.3.1 and 607.3.2.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 607 HOT WATER SUPPLY SYSTEM / 607.3 Thermal expansion control. / 607.3.1 Pressure-reducing valve.

607.3.1 Pressure-reducing valve.

For water service system sizes up to and including 2 inches (51 mm), a device for controlling pressure shall be installed where, because of thermal expansion, the pressure on the downstream side of a pressure-reducing valve exceeds the pressure-reducing valve setting.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 607 HOT WATER SUPPLY SYSTEM / 607.3 Thermal expansion control. / 607.3.2 Backflow prevention device or check valve.

607.3.2 Backflow prevention device or check valve.

Where a backflow prevention device, check valve or other device is installed on a water supply system utilizing storage water heating equipment such that thermal expansion causes an increase in pressure, a device for controlling pressure shall be installed.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 607 HOT WATER SUPPLY SYSTEM / 607.4 Flow of hot water to fixtures.

607.4 Flow of hot water to fixtures.

Fixture fittings, faucets and diverters shall be installed and adjusted so that the flow of hot water from the fittings corresponds to the left-hand side of the fixture fitting.

Exception: Shower and tub/shower mixing valves conforming to ASSE 1016 or CSA B125, where the flow of hot water corresponds to the markings on the device.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY

SECTION 608

PROTECTION OF POTABLE WATER SUPPLY**2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.1 General.****608.1 General.**

A potable water supply system shall be designed, installed and maintained in such a manner so as to prevent contamination from nonpotable liquids, solids or gases being introduced into the potable water supply through cross-connections or any other piping connections to the system. Backflow preventer applications shall conform to Table 608.1, except as specifically stated in Sections 608.2 through 608.16.10.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.1 General. / TABLE 608.1 APPLICATION OF BACKFLOW PREVENTERS

**TABLE 608.1
APPLICATION OF BACKFLOW PREVENTERS**

DEVICE	DEGREE OF HAZARD^a	APPLICATION^b	APPLICABLE STA
Air gap	High or low hazard	Backsiphonage or backpressure	ASME A112.1.2
Air gap fittings for use with plumbing fixtures, appliances and appurtenances	High or low hazard	Backsiphonage or backpressure	ASME A112.1.3
Antisiphon-type fill valves for gravity water closet flush tanks	High hazard	Backsiphonage only	ASSE 1002, CSA B
Backflow preventer for carbonated beverage machines	Low hazard	Backpressure or backsiphonage Sizes 1/4" - 3/8"	ASSE 1022, CSA B
Backflow preventer with intermediate atmospheric vents	Low hazard	Backpressure or backsiphonage Sizes 1/4" - 3/4"	ASSE 1012, CSA B
Barometric loop	High or low hazard	Backsiphonage only	(See Section 608.13)
Double check backflow prevention assembly and double check fire protection backflow prevention assembly	Low hazard	Backpressure or backsiphonage Sizes 3/8" - 16"	ASSE 1015, AWWA CSA B64.5, CSA B6
Double check detector fire protection backflow prevention assemblies	Low hazard	Backpressure or backsiphonage (Fire sprinkler systems) Sizes 2" - 16"	ASSE 1048
Dual-check-valve-type backflow preventer	Low hazard	Backpressure or backsiphonage Sizes 1/4" - 1"	ASSE 1024, CSA B
Hose connection backflow preventer	High or low hazard	Low head backpressure, rated working pressure, backpressure or backsiphonage Sizes 1/2"-1"	ASSE 1052, CSA B
Hose connection vacuum breaker	High or low hazard	Low head backpressure or backsiphonage	ASSE 1011, CSA B CSA B64.2.1

I-Quest 2006 Codes Complete Collection

DEVICE	DEGREE OF HAZARD ^a	APPLICATION ^b	APPLICABLE STA
		Sizes ½", ¾", 1"	
Laboratory faucet backflow preventer	High or low hazard	Low head backpressure and backsiphonage	ASSE 1035, CSA B1
Pipe-applied atmospheric-type vacuum breaker	High or low hazard	Backsiphonage only Sizes ¼" - 4"	ASSE 1001, CSA B1
Pressure vacuum breaker assembly	High or low hazard	Backsiphonage only Sizes ½" - 2"	ASSE 1020, CSA B1
Reduced pressure principle backflow preventer and reduced pressure principle fire protection backflow preventer	High or low hazard	Backpressure or backsiphonage Sizes ¾" - 16"	ASSE 1013, AWWA CSA B64.4, CSA B6
Reduced pressure detector fire protection backflow prevention assemblies	High or low hazard	Backsiphonage or backpressure (Fire sprinkler systems)	ASSE 1047
Spillproof vacuum breaker	High or low hazard	Backsiphonage only Sizes ¼" - 2"	ASSE 1056
Vacuum breaker wall hydrants, frost-resistant, automatic draining type	High or low hazard	Low head backpressure or backsiphonage Sizes ¾", 1"	ASSE 1019, CSA B1

For SI: 1 inch = 25.4 mm.

- a. Low hazard—See Pollution (Section 202).
High hazard—See Contamination (Section 202).
- b. See Backpressure (Section 202).
See Backpressure, low head (Section 202).
See Backsiphonage (Section 202).

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.2 Plumbing fixtures.

608.2 Plumbing fixtures.

The supply lines and fittings for every plumbing fixture shall be installed so as to prevent backflow. Plumbing fixture fittings shall provide backflow protection in accordance with ASME A112.18.1.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.3 Devices, appurtenances, appliances and apparatus.

608.3 Devices, appurtenances, appliances and apparatus.

All devices, appurtenances, appliances and apparatus intended to serve some special function, such as sterilization, distillation, processing, cooling, or storage of ice or foods, and that connect to the water supply system, shall be provided with protection against backflow and

contamination of the water supply system. Water pumps, filters, softeners, tanks and all other appliances and devices that handle or treat potable water shall be protected against contamination.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.3 Devices, appurtenances, appliances and apparatus. / 608.3.1 Special equipment, water supply protection.

608.3.1 Special equipment, water supply protection.

The water supply for hospital fixtures shall be protected against backflow with a reduced pressure principle backflow preventer, an atmospheric or spill-proof vacuum breaker, or an air gap. Vacuum breakers for bedpan washer hoses shall not be located less than 5 feet (1524 mm) above the floor. Vacuum breakers for hose connections in health care or laboratory areas shall not be less than 6 feet (1829 mm) above the floor.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.4 Water service piping.

608.4 Water service piping.

Water service piping shall be protected in accordance with Sections 603.2 and 603.2.1.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.5 Chemicals and other substances.

608.5 Chemicals and other substances.

Chemicals and other substances that produce either toxic conditions, taste, odor or discoloration in a potable water system shall not be introduced into, or utilized in, such systems.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.6 Cross-connection control.

608.6 Cross-connection control.

Cross connections shall be prohibited, except where approved protective devices are installed.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.6 Cross-connection control. / 608.6.1 Private water supplies.

608.6.1 Private water supplies.

Cross connections between a private water supply and a potable public supply shall be prohibited.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.7 Stop-and-waste valves prohibited.

608.7 Stop-and-waste valves prohibited.

Combination stop-and-waste valves or cocks shall not be installed underground.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.8 Identification of potable and nonpotable water.

608.8 Identification of potable and nonpotable water.

In all buildings where two or more water distribution systems, one potable water and the other nonpotable water, are installed, each system shall be identified either by color marking or metal tags in accordance with Sections 608.8.1 through 608.8.3.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.8 Identification of potable and nonpotable water. / 608.8.1 Information.

608.8.1 Information.

Pipe identification shall include the contents of the piping system and an arrow indicating the direction of flow. Hazardous piping systems shall also contain information addressing the nature of the hazard. Pipe identification shall be repeated at maximum intervals of 25 feet (7620 mm) and at each point where the piping passes through a wall, floor or roof. Lettering shall be readily observable within the room or space where the piping is located.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.8 Identification of potable and nonpotable water. / 608.8.2 Color.

608.8.2 Color.

The color of the pipe identification shall be discernable and consistent throughout the building.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND

**DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY /
608.8 Identification of potable and nonpotable water. / 608.8.3 Size.**

608.8.3 Size.

The size of the background color field and lettering shall comply with Table 608.8.3.

**2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND
DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY /
608.8 Identification of potable and nonpotable water. / 608.8.3 Size. / TABLE 608.8.3 SIZE
OF PIPE IDENTIFICATION**

**TABLE 608.8.3
SIZE OF PIPE IDENTIFICATION**

PIPE DIAMETER (inches)	LENGTH BACKGROUND COLOR FIELD (inches)	SIZE OF LETTERS (inches)
¾ to 1¼	8	0.5
1½ to 2	8	0.75
2½ to 6	12	1.25
8 to 10	24	2.5
over 10	32	3.5

For SI: 1 inch = 25.4 mm.

**2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND
DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY /
608.9 Reutilization prohibited.**

608.9 Reutilization prohibited.

Water utilized for the cooling of equipment or other processes shall not be returned to the potable water system. Such water shall be discharged into a drainage system through an air gap or shall be utilized for nonpotable purposes.

**2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND
DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY /
608.10 Reuse of piping.**

608.10 Reuse of piping.

Piping that has been utilized for any purpose other than conveying potable water shall not be utilized for conveying potable water.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND

**DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY /
608.11 Painting of water tanks.**

608.11 Painting of water tanks.

The interior surface of a potable water tank shall not be lined, painted or repaired with any material that changes the taste, odor, color or potability of the water supply when the tank is placed in, or returned to, service.

**2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND
DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY /
608.12 Pumps and other appliances.**

608.12 Pumps and other appliances.

Water pumps, filters, softeners, tanks and all other devices that handle or treat potable water shall be protected against contamination.

**2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND
DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY /
608.13 Backflow protection.**

608.13 Backflow protection.

Means of protection against backflow shall be provided in accordance with Sections 608.13.1 through 608.13.9.

**2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND
DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY /
608.13 Backflow protection. / 608.13.1 Air gap.**

608.13.1 Air gap.

The minimum required air gap shall be measured vertically from the lowest end of a potable water outlet to the flood level rim of the fixture or receptacle into which such potable water outlet discharges. Air gaps shall comply with ASME A112.1.2 and air gap fittings shall comply with ASME A112.1.3.

**2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND
DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY /
608.13 Backflow protection. / 608.13.2 Reduced pressure principle backflow preventers.**

608.13.2 Reduced pressure principle backflow preventers.

Reduced pressure principle backflow preventers shall conform to ASSE 1013, AWWA C511, CSA B64.4 or CSA B64.4.1. Reduced pressure detector assembly backflow preventers shall conform to ASSE 1047. These devices shall be permitted to be installed where subject to

continuous pressure conditions. The relief opening shall discharge by air gap and shall be prevented from being submerged.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.13 Backflow protection. / 608.13.3 Backflow preventer with intermediate atmospheric vent.

608.13.3 Backflow preventer with intermediate atmospheric vent.

Backflow preventers with intermediate atmospheric vents shall conform to ASSE 1012 or CSA B64.3. These devices shall be permitted to be installed where subject to continuous pressure conditions. The relief opening shall discharge by air gap and shall be prevented from being submerged.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.13 Backflow protection. / 608.13.4 Barometric loop.

608.13.4 Barometric loop.

Barometric loops shall precede the point of connection and shall extend vertically to a height of 35 feet (10 668 mm). A barometric loop shall only be utilized as an atmospheric-type or pressure-type vacuum breaker.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.13 Backflow protection. / 608.13.5 Pressure-type vacuum breakers.

608.13.5 Pressure-type vacuum breakers.

Pressure-type vacuum breakers shall conform to ASSE 1020 or CSA B64.1.2 and spillproof vacuum breakers shall comply with ASSE 1056. These devices are designed for installation under continuous pressure conditions when the critical level is installed at the required height. Pressure-type vacuum breakers shall not be installed in locations where spillage could cause damage to the structure.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.13 Backflow protection. / 608.13.6 Atmospheric-type vacuum breakers.

608.13.6 Atmospheric-type vacuum breakers.

Pipe-applied atmospheric-type vacuum breakers shall conform to ASSE 1001 or CSA B64.1.1. Hose-connection vacuum breakers shall conform to ASSE 1011, ASSE 1019, ASSE 1035, ASSE 1052, CSA B64.2, CSA B64.2.1, CSA B64.2.1.1, CSA B64.2.2 or CSA

B64.7. These devices shall operate under normal atmospheric pressure when the critical level is installed at the required height.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.13 Backflow protection. / 608.13.7 Double check-valve assemblies.

608.13.7 Double check-valve assemblies.

Double check- valve assemblies shall conform to ASSE 1015, CSA B64.5, CSA B64.5.1 or AWWA C510. Double-detector check-valve assemblies shall conform to ASSE 1048. These devices shall be capable of operating under continuous pressure conditions.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.13 Backflow protection. / 608.13.8 Spillproof vacuum breakers.

608.13.8 Spillproof vacuum breakers.

Spillproof vacuum breakers (SVB) shall conform to ASSE 1056. These devices are designed for installation under continuous-pressure conditions when the critical level is installed at the required height.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.13 Backflow protection. / 608.13.9 Chemical dispenser backflow devices.

608.13.9 Chemical dispenser backflow devices.

Back- flow devices for chemical dispensers shall comply with ASSE 1055 or shall be equipped with an air gap fitting.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.14 Location of backflow preventers.

608.14 Location of backflow preventers.

Access shall be provided to backflow preventers as specified by the installation instructions of the approved manufacturer.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.14 Location of backflow preventers. / 608.14.1 Outdoor enclosures for backflow prevention devices.

608.14.1 Outdoor enclosures for backflow prevention devices.

Outdoor enclosures for backflow prevention devices shall comply with ASSE 1060.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.15 Protection of potable water outlets.

608.15 Protection of potable water outlets.

All potable water openings and outlets shall be protected against backflow in accordance with Section 608.15.1, 608.15.2, 608.15.3, 608.15.4, 608.15.4.1 or 608.15.4.2.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.15 Protection of potable water outlets. / 608.15.1 Protection by air gap.

608.15.1 Protection by air gap.

Openings and outlets shall be protected by an air gap between the opening and the fixture flood level rim as specified in Table 608.15.1. Openings and outlets equipped for hose connection shall be protected by means other than an air gap.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.15 Protection of potable water outlets. / 608.15.1 Protection by air gap. / TABLE 608.15.1 MINIMUM REQUIRED AIR GAPS

**TABLE 608.15.1
MINIMUM REQUIRED AIR GAPS**

FIXTURE	MINIMUM AIR GAP	
	Away from a wall ^a (inches)	Close to a wall (inches)
Lavatories and other fixtures with effective opening not greater than ½ inch in diameter	1	1½
Sink, laundry trays, gooseneck back faucets and other fixtures with effective openings not greater than ¾ inch in diameter	1.5	2.5
Over-rim bath fillers and other fixtures with effective openings not greater than 1 inch in diameter	2	3
Drinking water fountains, single orifice not greater than $\frac{7}{16}$ inch in diameter or multiple orifices with a total area of 0.150 square inch (area of circle $\frac{7}{16}$ inch in diameter)	1	1½
Effective openings greater than 1 inch	Two times the diameter of the effective opening	Three times the diameter of the effective opening

I-Quest 2006 Codes Complete Collection

For SI: 1 inch = 25.4 mm.

- a. Applicable where walls or obstructions are spaced from the nearest inside-edge of the spout opening a distance greater than three times the diameter of the effective opening for a single wall, or a distance greater than four times the diameter of the effective opening for two intersecting walls.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.15 Protection of potable water outlets. / 608.15.2 Protection by a reduced pressure principle backflow preventer.

608.15.2 Protection by a reduced pressure principle backflow preventer.

Openings and outlets shall be protected by a reduced pressure principle backflow preventer.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.15 Protection of potable water outlets. / 608.15.3 Protection by a backflow preventer with intermediate atmospheric vent.

608.15.3 Protection by a backflow preventer with intermediate atmospheric vent.

Openings and outlets shall be protected by a backflow preventer with an intermediate atmospheric vent.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.15 Protection of potable water outlets. / 608.15.4 Protection by a vacuum breaker.

608.15.4 Protection by a vacuum breaker.

Openings and outlets shall be protected by atmospheric-type or pressure-type vacuum breakers. The critical level of the vacuum breaker shall be set a minimum of 6 inches (152 mm) above the flood level rim of the fixture or device. Fill valves shall be set in accordance with Section 425.3.1. Vacuum breakers shall not be installed under exhaust hoods or similar locations that will contain toxic fumes or vapors. Pipe-applied vacuum breakers shall be installed not less than 6 inches (152 mm) above the flood level rim of the fixture, receptor or device served.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.15 Protection of potable water outlets. / 608.15.4 Protection by a vacuum breaker. / 608.15.4.1 Deck-mounted and integral vacuum breakers.

608.15.4.1 Deck-mounted and integral vacuum breakers.

Approved deck-mounted or equipment-mounted vacuum breakers and faucets with integral atmospheric or spillproof vacuum breakers shall be installed in accordance with the manufacturer's instructions and the requirements for labeling with the critical level not less than 1 inch (25 mm) above the flood level rim.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.15 Protection of potable water outlets. / 608.15.4 Protection by a vacuum breaker. / 608.15.4.2 Hose connections.

608.15.4.2 Hose connections.

Sillcocks, hose bibbs, wall hydrants and other openings with a hose connection shall be protected by an atmospheric-type or pressure-type vacuum breaker or a permanently attached hose connection vacuum breaker.

Exceptions:

1. This section shall not apply to water heater and boiler drain valves that are provided with hose connection threads and that are intended only for tank or vessel draining.
2. This section shall not apply to water supply valves intended for connection of clothes washing machines where backflow prevention is otherwise provided or is integral with the machine.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.16 Connections to the potable water system.

608.16 Connections to the potable water system.

Connections to the potable water system shall conform to Sections 608.16.1 through 608.16.10.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.16 Connections to the potable water system. / 608.16.1 Beverage dispensers.

608.16.1 Beverage dispensers.

The water supply connection to beverage dispensers shall be protected against backflow by a backflow preventer conforming to ASSE 1022, CSA B64.3.1 or by an air gap. The backflow preventer device and the piping downstream therefrom shall not be affected by carbon dioxide gas.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.16 Connections to the potable water system. / 608.16.2 Connections to boilers.

608.16.2 Connections to boilers.

The potable supply to the boiler shall be equipped with a backflow preventer with an intermediate atmospheric vent complying with ASSE 1012 or CSA B64.3. Where conditioning chemicals are introduced into the system, the potable water connection shall be protected by an air gap or a reduced pressure principle backflow preventer, complying with ASSE 1013, CSA B64.4 or AWWA C511.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.16 Connections to the potable water system. / 608.16.3 Heat exchangers.

608.16.3 Heat exchangers.

Heat exchangers utilizing an essentially toxic transfer fluid shall be separated from the potable water by double-wall construction. An air gap open to the atmosphere shall be provided between the two walls. Heat exchangers utilizing an essentially nontoxic transfer fluid shall be permitted to be of single-wall construction.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.16 Connections to the potable water system. / 608.16.4 Connections to automatic fire sprinkler systems and standpipe systems.

608.16.4 Connections to automatic fire sprinkler systems and standpipe systems.

The potable water supply to automatic fire sprinkler and standpipe systems shall be protected against backflow by a double check-valve assembly or a reduced pressure principle backflow preventer.

Exceptions:

1. Where systems are installed as a portion of the water distribution system in accordance with the requirements of this code and are not provided with a fire department connection, isolation of the water supply system shall not be required.
2. Isolation of the water distribution system is not required for deluge, preaction or dry pipe systems.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND

DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.16 Connections to the potable water system. / 608.16.4 Connections to automatic fire sprinkler systems and standpipe systems. / 608.16.4.1 Additives or nonpotable source.

608.16.4.1 Additives or nonpotable source.

Where systems under continuous pressure contain chemical additives or antifreeze, or where systems are connected to a nonpotable secondary water supply, the potable water supply shall be protected against backflow by a reduced pressure principle backflow preventer. Where chemical additives or antifreeze are added to only a portion of an automatic fire sprinkler or standpipe system, the reduced pressure principle backflow preventer shall be permitted to be located so as to isolate that portion of the system. Where systems are not under continuous pressure, the potable water supply shall be protected against backflow by an air gap or a pipe applied atmospheric vacuum breaker conforming to ASSE 1001 or CSA B64.1.1.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.16 Connections to the potable water system. / 608.16.5 Connections to lawn irrigation systems.

608.16.5 Connections to lawn irrigation systems.

The potable water supply to lawn irrigation systems shall be protected against backflow by an atmospheric-type vacuum breaker, a pressure-type vacuum breaker or a reduced pressure principle backflow preventer. A valve shall not be installed downstream from an atmospheric vacuum breaker. Where chemicals are introduced into the system, the potable water supply shall be protected against backflow by a reduced pressure principle backflow preventer.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.16 Connections to the potable water system. / 608.16.6 Connections subject to backpressure.

608.16.6 Connections subject to backpressure.

Where a potable water connection is made to a nonpotable line, fixture, tank, vat, pump or other equipment subject to back-pressure, the potable water connection shall be protected by a reduced pressure principle backflow preventer.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.16 Connections to the potable water system. / 608.16.7 Chemical dispensers.

608.16.7 Chemical dispensers.

Where chemical dispensers connect to the potable water distribution system, the water supply system shall be protected against backflow in accordance with Section 608.13.1, 608.13.2, 608.13.5, 608.13.6, 608.13.8 or 608.13.9.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.16 Connections to the potable water system. / 608.16.8 Portable cleaning equipment.

608.16.8 Portable cleaning equipment.

Where the portable cleaning equipment connects to the water distribution system, the water supply system shall be protected against backflow in accordance with Section 608.13.1, 608.13.2, 608.13.3, 608.13.7 or 608.13.8.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.16 Connections to the potable water system. / 608.16.9 Dental pump equipment.

608.16.9 Dental pump equipment.

Where dental pumping equipment connects to the water distribution system, the water supply system shall be protected against backflow in accordance with Section 608.13.1, 608.13.2, 608.13.5, 608.13.6 or 608.13.8.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.16 Connections to the potable water system. / 608.16.10 Coffee machines and noncarbonated beverage dispensers.

608.16.10 Coffee machines and noncarbonated beverage dispensers.

The water supply connection to coffee machines and noncarbonated beverage dispensers shall be protected against backflow by a backflow preventer conforming to ASSE 1022 or by an air gap.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.17 Protection of individual water supplies.

608.17 Protection of individual water supplies.

An individual water supply shall be located and constructed so as to be safeguarded against contamination in accordance with Sections 608.17.1 through 608.17.8.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.17 Protection of individual water supplies. / 608.17.1 Well locations.

608.17.1 Well locations.

A potable ground water source or pump suction line shall not be located closer to potential sources of contamination than the distances shown in Table 608.17.1. In the event the underlying rock structure is limestone or fragmented shale, the local or state health department shall be consulted on well site location. The distances in Table 608.17.1 constitute minimum separation and shall be increased in areas of creviced rock or limestone, or where the direction of movement of the ground water is from sources of contamination toward the well.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.17 Protection of individual water supplies. / 608.17.1 Well locations. / TABLE 608.17.1 DISTANCE FROM CONTAMINATION TO PRIVATE WATER SUPPLIES AND PUMP SUCTION LINES

**TABLE 608.17.1
DISTANCE FROM CONTAMINATION TO
PRIVATE WATER SUPPLIES AND PUMP SUCTION LINES**

SOURCE OF CONTAMINATION	DISTANCE (feet)
Barnyard	100
Farm silo	25
Pasture	100
Pumphouse floor drain of cast iron draining to ground surface	2
Seepage pits	50
Septic tank	25
Sewer	10
Subsurface disposal fields	50
Subsurface pits	50

For SI: 1 foot = 304.8 mm.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.17 Protection of individual water supplies. / 608.17.2 Elevation.

608.17.2 Elevation.

Well sites shall be positively drained and shall be at higher elevations than potential sources

of contamination.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.17 Protection of individual water supplies. / 608.17.3 Depth.

608.17.3 Depth.

Private potable well supplies shall not be developed from a water table less than 10 feet (3048 mm) below the ground surface.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.17 Protection of individual water supplies. / 608.17.4 Water-tight casings.

608.17.4 Water-tight casings.

Each well shall be provided with a water-tight casing to a minimum distance of 10 feet (3048 mm) below the ground surface. All casings shall extend at least 6 inches (152 mm) above the well platform. The casing shall be large enough to permit installation of a separate drop pipe. Casings shall be sealed at the bottom in an impermeable stratum or extend several feet into the water-bearing stratum.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.17 Protection of individual water supplies. / 608.17.5 Drilled or driven well casings.

608.17.5 Drilled or driven well casings.

Drilled or driven well casings shall be of steel or other approved material. Where drilled wells extend into a rock formation, the well casing shall extend to and set firmly in the formation. The annular space between the earth and the outside of the casing shall be filled with cement grout to a minimum distance of 10 feet (3048 mm) below the ground surface. In an instance of casing to rock installation, the grout shall extend to the rock surface.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.17 Protection of individual water supplies. / 608.17.6 Dug or bored well casings.

608.17.6 Dug or bored well casings.

Dug or bored well casings shall be of water-tight concrete, tile, or galvanized or corrugated metal pipe to a minimum distance of 10 feet (3048 mm) below the ground surface. Where the water table is more than 10 feet (3048 mm) below the ground surface, the water-tight casing shall extend below the table surface. Well casings for dug wells or bored pipe wells constructed with sections of concrete, tile, or galvanized or corrugated metal pipe shall be

surrounded by 6 inches (152 mm) of grout poured into the hole between the outside of the casing and the ground to a minimum depth of 10 feet (3048 mm).

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.17 Protection of individual water supplies. / 608.17.7 Cover.

608.17.7 Cover.

Every potable water well shall be equipped with an overlapping water-tight cover at the top of the well casing or pipe sleeve such that contaminated water or other substances are prevented from entering the well through the annular opening at the top of the well casing, wall or pipe sleeve. Covers shall extend downward at least 2 inches (51 mm) over the outside of the well casing or wall. A dug well cover shall be provided with a pipe sleeve permitting the withdrawal of the pump suction pipe, cylinder or jet body without disturbing the cover. Where pump sections or discharge pipes enter or leave a well through the side of the casing, the circle of contact shall be water tight.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 608 PROTECTION OF POTABLE WATER SUPPLY / 608.17 Protection of individual water supplies. / 608.17.8 Drainage.

608.17.8 Drainage.

All potable water wells and springs shall be constructed such that surface drainage will be diverted away from the well or spring.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 609 HEALTH CARE PLUMBING

**SECTION 609
HEALTH CARE PLUMBING**

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 609 HEALTH CARE PLUMBING / 609.1 Scope.

609.1 Scope.

This section shall govern those aspects of health care plumbing systems that differ from plumbing systems in other structures. Health care plumbing systems shall conform to the requirements of this section in addition to the other requirements of this code. The provisions of this section shall apply to the special devices and equipment installed and maintained in the following occupancies: nursing homes, homes for the aged, orphanages, infirmaries, first aid stations, psychiatric facilities, clinics, professional offices of dentists and doctors, mortuaries,

educational facilities, surgery, dentistry, research and testing laboratories, establishments manufacturing pharmaceutical drugs and medicines, and other structures with similar apparatus and equipment classified as plumbing.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 609 HEALTH CARE PLUMBING / 609.2 Water service.

609.2 Water service.

All hospitals shall have two water service pipes installed in such a manner so as to minimize the potential for an interruption of the supply of water in the event of a water main or water service pipe failure.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 609 HEALTH CARE PLUMBING / 609.3 Hot water.

609.3 Hot water.

Hot water shall be provided to supply all of the hospital fixture, kitchen and laundry requirements. Special fixtures and equipment shall have hot water supplied at a temperature specified by the manufacturer. The hot water system shall be installed in accordance with Section 607.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 609 HEALTH CARE PLUMBING / 609.4 Vacuum breaker installation.

609.4 Vacuum breaker installation.

Vacuum breakers shall be installed a minimum of 6 inches (152 mm) above the flood level rim of the fixture or device in accordance with Section 608. The flood level rim of hose connections shall be the maximum height at which any hose is utilized.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 609 HEALTH CARE PLUMBING / 609.5 Prohibited water closet and clinical sink supply.

609.5 Prohibited water closet and clinical sink supply.

Jet- or water-supplied orifices, except those supplied by the flush connections, shall not be located in or connected with a water closet bowl or clinical sink. This section shall not prohibit an approved bidet installation.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 609 HEALTH CARE PLUMBING / 609.6 Clinical,

hydrotherapeutic and radiological equipment.

609.6 Clinical, hydrotherapeutic and radiological equipment.

All clinical, hydrotherapeutic, radiological or any equipment that is supplied with water or that discharges to the waste system shall conform to the requirements of this section and Section 608.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 609 HEALTH CARE PLUMBING / 609.7 Condensate drain trap seal.

609.7 Condensate drain trap seal.

A water supply shall be provided for cleaning, flushing and resealing the condensate trap, and the trap shall discharge through an air gap in accordance with Section 608.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 609 HEALTH CARE PLUMBING / 609.8 Valve leakage diverter.

609.8 Valve leakage diverter.

Each water sterilizer filled with water through directly connected piping shall be equipped with an approved leakage diverter or bleed line on the water supply control valve to indicate and conduct any leakage of unsterile water away from the sterile zone.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 610 DISINFECTION OF POTABLE WATER SYSTEM

**SECTION 610
DISINFECTION OF POTABLE WATER SYSTEM**

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 610 DISINFECTION OF POTABLE WATER SYSTEM / 610.1 General.

610.1 General.

New or repaired potable water systems shall be purged of deleterious matter and disinfected prior to utilization. The method to be followed shall be that prescribed by the health authority or water purveyor having jurisdiction or, in the absence of a prescribed method, the procedure described in either AWWA C651 or AWWA C652, or as described in this section. This requirement shall apply to "on-site" or "in-plant" fabrication of a system or to a modular portion of a system.

I-Quest 2006 Codes Complete Collection

1. The pipe system shall be flushed with clean, potable water until dirty water does not appear at the points of outlet.
2. The system or part thereof shall be filled with a water/chlorine solution containing at least 50 parts per million (50 mg/L) of chlorine, and the system or part thereof shall be valved off and allowed to stand for 24 hours; or the system or part thereof shall be filled with a water/chlorine solution containing at least 200 parts per million (200 mg/L) of chlorine and allowed to stand for 3 hours.
3. Following the required standing time, the system shall be flushed with clean potable water until the chlorine is purged from the system.
4. The procedure shall be repeated where shown by a bacteriological examination that contamination remains present in the system.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 611 DRINKING WATER TREATMENT UNITS

**SECTION 611
DRINKING WATER TREATMENT UNITS**

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 611 DRINKING WATER TREATMENT UNITS / 611.1 Design.

611.1 Design.

Drinking water treatment units shall meet the requirements of NSF 42, NSF 44, NSF 53 or NSF 62.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 611 DRINKING WATER TREATMENT UNITS / 611.2 Reverse osmosis systems.

611.2 Reverse osmosis systems.

The discharge from a reverse osmosis drinking water treatment unit shall enter the drainage system through an air gap or an air gap device that meets the requirements of NSF 58.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 611 DRINKING WATER TREATMENT UNITS / 611.3 Connection tubing.

611.3 Connection tubing.

The tubing to and from drinking water treatment units shall be of a size and material as recommended by the manufacturer. The tubing shall comply with NSF 14, NSF 42, NSF 44, NSF 53, NSF 58 or NSF 61.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 612 SOLAR SYSTEMS

**SECTION 612
SOLAR SYSTEMS**

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 612 SOLAR SYSTEMS / 612.1 Solar systems.

612.1 Solar systems.

The construction, installation, alterations and repair of systems, equipment and appliances intended to utilize solar energy for space heating or cooling, domestic hot water heating, swimming pool heating or process heating shall be in accordance with the *International Mechanical Code*.

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 613 TEMPERATURE CONTROL DEVICES AND VALVES

**SECTION 613
TEMPERATURE CONTROL
DEVICES AND VALVES**

2006 International Plumbing Code / CHAPTER 6 WATER SUPPLY AND DISTRIBUTION / SECTION 613 TEMPERATURE CONTROL DEVICES AND VALVES / 613.1 Temperature-actuated mixing valves.

613.1 Temperature-actuated mixing valves.

Temperature-actuated mixing valves, which are installed to reduce water temperatures to defined limits, shall comply with ASSE 1017.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE

CHAPTER 7 SANITARY DRAINAGE

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 701 GENERAL

SECTION 701 GENERAL

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 701 GENERAL / 701.1 Scope.

701.1 Scope.

The provisions of this chapter shall govern the materials, design, construction and installation of sanitary drainage systems.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 701 GENERAL / 701.2 Sewer required.

701.2 Sewer required.

Every building in which plumbing fixtures are installed and all premises having drainage piping shall be connected to a public sewer, where available, or an approved private sewage disposal system in accordance with the *International Private Sewage Disposal Code*.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 701 GENERAL / 701.3 Separate sewer connection.

701.3 Separate sewer connection.

Every building having plumbing fixtures installed and intended for human habitation, occupancy or use on premises abutting on a street, alley or easement in which there is a public sewer shall have a separate connection with the sewer. Where located on the same lot, multiple buildings shall not be prohibited from connecting to a common building sewer that connects to the public sewer.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 701 GENERAL / 701.4 Sewage treatment.

701.4 Sewage treatment.

Sewage or other waste from a plumbing system that is deleterious to surface or subsurface waters shall not be discharged into the ground or into any waterway unless it has first been rendered innocuous through subjection to an approved form of treatment.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 701 GENERAL / 701.5 Damage to drainage system or public sewer.

701.5 Damage to drainage system or public sewer.

Wastes detrimental to the public sewer system or to the functioning of the sewage-treatment plant shall be treated and disposed of in accordance with Section 1003 as directed by the code official.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 701 GENERAL / 701.6 Tests.

701.6 Tests.

The sanitary drainage system shall be tested in accordance with Section 312.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 701 GENERAL / 701.7 Connections.

701.7 Connections.

Direct connection of a steam exhaust, blowoff or drip pipe shall not be made with the building drainage system. Wastewater when discharged into the building drainage system shall be at a temperature not higher than 140°F (60°C). When higher temperatures exist, approved cooling methods shall be provided.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 701 GENERAL / 701.8 Engineered systems.

701.8 Engineered systems.

Engineered sanitary drainage systems shall conform to the provisions of Sections 105.4 and 714.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 701 GENERAL / 701.9 Drainage piping in food service areas.

701.9 Drainage piping in food service areas.

Exposed soil or waste piping shall not be installed above any working, storage or eating

surfaces in food service establishments.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 702 MATERIALS

**SECTION 702
MATERIALS**

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 702 MATERIALS / 702.1 Above-ground sanitary drainage and vent pipe.

702.1 Above-ground sanitary drainage and vent pipe.

Above-ground soil, waste and vent pipe shall conform to one of the standards listed in Table 702.1.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 702 MATERIALS / 702.1 Above-ground sanitary drainage and vent pipe. / TABLE 702.1 ABOVE-GROUND DRAINAGE AND VENT PIPE

**TABLE 702.1
ABOVE-GROUND DRAINAGE AND VENT PIPE**

MATERIAL	STANDARD
Acrylonitrile butadiene styrene (ABS) plastic pipe	ASTM D 2661; ASTM F 628; CSA B181.1
Brass pipe	ASTM B 43
Cast-iron pipe	ASTM A 74; ASTM A 888; CISPI 301
Coextruded composite ABS DWV schedule 40 IPS pipe (solid)	ASTM F 1488
Coextruded composite ABS DWV schedule 40 IPS pipe (cellular core)	ASTM F 1488
Coextruded composite PVC DWV schedule 40 IPS pipe (solid)	ASTM F 1488
Coextruded composite PVC DWV schedule 40 IPS pipe (cellular core)	ASTM F 891; ASTM F 1488
Coextruded composite PVC IPS-DR, PS140, PS200 DWV	ASTM F 1488
Copper or copper-alloy pipe	ASTM B 42; ASTM B 302
Copper or copper-alloy tubing (Type K, L, M or DWV)	ASTM B 75; ASTM B 88; ASTM B 251; ASTM B 306
Galvanized steel pipe	ASTM A 53
Glass pipe	ASTM C 1053
Polyolefin pipe	CSA B181.3

I-Quest 2006 Codes Complete Collection

MATERIAL	STANDARD
Polyvinyl chloride (PVC) plastic pipe (Type DWV)	ASTM D 2665; ASTM D 2949; ASTM F 1488; CSA B181.2
Stainless steel drainage systems, Types 304 and 316L	ASME A112.3.1

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 702 MATERIALS / 702.2 Underground building sanitary drainage and vent pipe.

702.2 Underground building sanitary drainage and vent pipe.

Underground building sanitary drainage and vent pipe shall conform to one of the standards listed in Table 702.2.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 702 MATERIALS / 702.2 Underground building sanitary drainage and vent pipe. / TABLE 702.2 UNDERGROUND BUILDING DRAINAGE AND VENT PIPE

**TABLE 702.2
UNDERGROUND BUILDING DRAINAGE AND VENT PIPE**

MATERIAL	STANDARD
Acrylonitrile butadiene styrene (ABS) plastic pipe	ASTM D 2661; ASTM F 628; CSA B181.1
Asbestos-cement pipe	ASTM C 428
Cast-iron pipe	ASTM A 74; ASTM A 888; CISPI 301
Coextruded composite ABS DWV schedule 40 IPS pipe (solid)	ASTM F 1488
Coextruded composite ABS DWV schedule 40 IPS pipe (cellular core)	ASTM F 1488
Coextruded composite PVC DWV schedule 40 IPS pipe (solid)	ASTM F 1488
Coextruded composite PVC DWV schedule 40 IPS pipe (cellular core)	ASTM F 891; ASTM F 1488
Coextruded composite PVC IPS-DR, PS140, PS200 DWV	ASTM F 1488
Copper or copper-alloy tubing (Type K, L, M or DWV)	ASTM B 75; ASTM B 88; ASTM B 251; ASTM B 306
Polyolefin pipe	ASTM F 1412; CSA B181.3
Polyvinyl chloride (PVC) plastic pipe (Type DWV)	ASTM D 2665; ASTM D 2949; CSA B181.2
Stainless steel drainage systems, Type 316L	ASME A112.3.1

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 702 MATERIALS / 702.3 Building sewer pipe.

702.3 Building sewer pipe.

Building sewer pipe shall conform to one of the standards listed in Table 702.3.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 702 MATERIALS / 702.3 Building sewer pipe. / TABLE 702.3 BUILDING SEWER PIPE

**TABLE 702.3
BUILDING SEWER PIPE**

MATERIAL	STANDARD
Acrylonitrile butadiene styrene (ABS) plastic pipe	ASTM D 2661; ASTM D 2751; ASTM F 628
Asbestos-cement pipe	ASTM C 428
Cast-iron pipe	ASTM A 74; ASTM A 888; CISPI 301
Coextruded composite ABS DWV schedule 40 IPS pipe (solid)	ASTM F 1488
Coextruded composite ABS DWV schedule 40 IPS pipe (cellular core)	ASTM F 1488
Coextruded composite PVC DWV schedule 40 IPS pipe (solid)	ASTM F 1488
Coextruded composite PVC DWV schedule 40 IPS pipe (cellular core)	ASTM F 891; ASTM F 1488
Coextruded composite PVC IPS-DR, PS140, PS200, DWV	ASTM F 1488
Coextruded composite ABS sewer and drain DR-PS in PS35, PS50, PS100, PS140, PS200	ASTM F 1488
Coextruded composite PVC sewer and drain DR-PS in PS35, PS50, PS100, PS140, PS200	ASTM F 1488
Coextruded PVC sewer and drain PS25, PS50, PS100 (cellular core)	ASTM F 891
Concrete pipe	ASTM C14; ASTM C76; CSA A257.1M; CSA A257.2M
Copper or copper-alloy tubing (Type K or L)	ASTM B 75; ASTM B 88; ASTM B 251
Polyethylene (PE) plastic pipe (SDR-PR)	ASTM F 714
Polyvinyl chloride (PVC) plastic pipe (Type DWV, SDR26, SDR35, SDR41, PS50 or PS100)	ASTM D 2665; ASTM D 2949; ASTM D 3034; CSA B182.2; CSA B182.4
Stainless steel drainage systems, Types 304 and 316L	ASME A112.3.1
Vitrified clay pipe	ASTM C 4; ASTM C 700

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 702 MATERIALS / 702.4 Fittings.

702.4 Fittings.

Pipe fittings shall be approved for installation with the piping material installed and shall conform

to the respective pipe standards or one of the standards listed in Table 702.4.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 702 MATERIALS / 702.4 Fittings. / TABLE 702.4 PIPE FITTINGS

**TABLE 702.4
PIPE FITTINGS**

MATERIAL	STANDARD
Acrylonitrile butadiene styrene (ABS) plastic pipe	ASTM D 2661; ASTM D 3311; CSA B181.1
Cast iron	ASME B 16.4; ASME B 16.12; ASTM A 74; ASTM A 888; CISPI 301
Coextruded composite ABS DWV schedule 40 IPS pipe (solid or cellular core)	ASTM D 2661; ASTM D 3311; ASTM F 628
Coextruded composite PVC DWV schedule 40 IPS-DR, PS140, PS200 (solid or cellular core)	ASTM D 2665; ASTM D 3311; ASTM F 891
Coextruded composite ABS sewer and drain DR-PS in PS35, PS50, PS100, PS140, PS200	ASTM D 2751
Coextruded composite PVC sewer and drain DR-PS in PS35, PS50, PS100, PS140, PS200	ASTM D 3034
Copper or copper alloy	ASME B 16.15; ASME B 16.18; ASME B 16.22; ASME B 16.23; ASME B 16.26; ASME B 16.29
Glass	ASTM C 1053
Gray iron and ductile iron	AWWA C 110
Malleable iron	ASME B 16.3
Polyolefin	ASTM F 1412; CSA B181.3
Polyvinyl chloride (PVC) plastic	ASTM D 2665; ASTM D 3311; ASTM F 1866
Stainless steel drainage systems, Types 304 and 316L	ASME A 112.3.1
Steel	ASME B 16.9; ASME B16.11; ASME B16.28

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 702 MATERIALS / 702.5 Chemical waste system.

702.5 Chemical waste system.

A chemical waste system shall be completely separated from the sanitary drainage system. The chemical waste shall be treated in accordance with Section 803.2 before discharging to the sanitary drainage system. Separate drainage systems for chemical wastes and vent pipes shall be of an approved material that is resistant to corrosion and degradation for the concentrations of chemicals involved.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 702 MATERIALS / 702.6 Lead bends and traps.

702.6 Lead bends and traps.

Lead bends and traps shall not be less than 0.125 inch (3.2 mm) wall thickness.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 703 BUILDING SEWER

**SECTION 703
BUILDING SEWER**

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 703 BUILDING SEWER / 703.1 Building sewer pipe near the water service.

703.1 Building sewer pipe near the water service.

Where the building sewer is installed within 5 feet (1524 mm) of the water service, the installation shall comply with the provisions of Section 603.2.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 703 BUILDING SEWER / 703.2 Drainage pipe in filled ground.

703.2 Drainage pipe in filled ground.

Where a building sewer or building drain is installed on filled or unstable ground, the drainage pipe shall conform to one of the standards for ABS plastic pipe, cast-iron pipe, copper or copper-alloy tubing, or PVC plastic pipe listed in Table 702.3.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 703 BUILDING SEWER / 703.3 Sanitary and storm sewers.

703.3 Sanitary and storm sewers.

Where separate systems of sanitary drainage and storm drainage are installed in the same property, the sanitary and storm building sewers or drains shall be permitted to be laid side by side in one trench.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 703 BUILDING SEWER / 703.4 Existing building sewers and drains.

703.4 Existing building sewers and drains.

Existing building sewers and drains shall connect with new building sewer and drainage systems only where found by examination and test to conform to the new system in quality of material. The code official shall notify the owner to make the changes necessary to conform to

this code.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 703 BUILDING SEWER / 703.5 Cleanouts on building sewers.

703.5 Cleanouts on building sewers.

Cleanouts on building sewers shall be located as set forth in Section 708.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 704 DRAINAGE PIPING INSTALLATION

**SECTION 704
DRAINAGE PIPING INSTALLATION**

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 704 DRAINAGE PIPING INSTALLATION / 704.1 Slope of horizontal drainage piping.

704.1 Slope of horizontal drainage piping.

Horizontal drainage piping shall be installed in uniform alignment at uniform slopes. The minimum slope of a horizontal drainage pipe shall be in accordance with Table 704.1.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 704 DRAINAGE PIPING INSTALLATION / 704.1 Slope of horizontal drainage piping. / TABLE 704.1 SLOPE OF HORIZONTAL DRAINAGE PIPE

**TABLE 704.1
SLOPE OF HORIZONTAL DRAINAGE PIPE**

SIZE (inches)	MINIMUM SLOPE (inch per foot)
2½ or less	¼
3 to 6	1/ 8
8 or larger	1/ 16

For SI: 1 inch = 25.4 mm, 1 inch per foot = 0.083.3 mm/m.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 704 DRAINAGE PIPING INSTALLATION / 704.2 Change in size.

704.2 Change in size.

The size of the drainage piping shall not be reduced in size in the direction of the flow. A 4-inch by 3-inch (102 mm by 76 mm) water closet connection shall not be considered as a reduction in size.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 704 DRAINAGE PIPING INSTALLATION / 704.3 Connections to offsets and bases of stacks.

704.3 Connections to offsets and bases of stacks.

Horizontal branches shall connect to the bases of stacks at a point located not less than 10 times the diameter of the drainage stack downstream from the stack. Except as prohibited by Section 711.2, horizontal branches shall connect to horizontal stack offsets at a point located not less than 10 times the diameter of the drainage stack downstream from the upper stack.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 704 DRAINAGE PIPING INSTALLATION / 704.4 Future fixtures.

704.4 Future fixtures.

Drainage piping for future fixtures shall terminate with an approved cap or plug.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 704 DRAINAGE PIPING INSTALLATION / 704.5 Dead ends.

704.5 Dead ends.

In the installation or removal of any part of a drainage system, dead ends shall be prohibited. Cleanout extensions and approved future fixture drainage piping shall not be considered as dead ends.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS

**SECTION 705
JOINTS**

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.1 General.

705.1 General.

This section contains provisions applicable to joints specific to sanitary drainage piping.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.2 ABS plastic.

705.2 ABS plastic.

Joints between ABS plastic pipe or fittings shall comply with Sections 705.2.1 through 705.2.3.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.2 ABS plastic. / 705.2.1 Mechanical joints.

705.2.1 Mechanical joints.

Mechanical joints on drainage pipes shall be made with an elastomeric seal conforming to ASTM C 1173, ASTM D 3212 or CSA B602. Mechanical joints shall be installed only in underground systems unless otherwise approved. Joints shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.2 ABS plastic. / 705.2.2 Solvent cementing.

705.2.2 Solvent cementing.

Joint surfaces shall be clean and free from moisture. Solvent cement that conforms to ASTM D 2235 or CSA B181.1 shall be applied to all joint surfaces. The joint shall be made while the cement is wet. Joints shall be made in accordance with ASTM D 2235, ASTM D 2661, ASTM F 628 or CSA B181.1. Solvent-cement joints shall be permitted above or below ground.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.2 ABS plastic. / 705.2.3 Threaded joints.

705.2.3 Threaded joints.

Threads shall conform to ASME B1.20.1. Schedule 80 or heavier pipe shall be permitted to be threaded with dies specifically designed for plastic pipe. Approved thread lubricant or tape shall be applied on the male threads only.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.3 Asbestos cement.

705.3 Asbestos cement.

Joints between asbestos-cement pipe or fittings shall be made with a sleeve coupling of the same composition as the pipe, sealed with an elastomeric ring conforming to ASTM D 1869.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.4 Brass.

705.4 Brass.

Joints between brass pipe or fittings shall comply with Sections 705.4.1 through 705.4.4.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.4 Brass. / 705.4.1 Brazed joints.

705.4.1 Brazed joints.

All joint surfaces shall be cleaned. An approved flux shall be applied where required. The joint shall be brazed with a filler metal conforming to AWS A5.8.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.4 Brass. / 705.4.2 Mechanical joints.

705.4.2 Mechanical joints.

Mechanical joints shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.4 Brass. / 705.4.3 Threaded joints.

705.4.3 Threaded joints.

Threads shall conform to ASME B1.20.1. Pipe-joint compound or tape shall be applied on the male threads only.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.4 Brass. / 705.4.4 Welded joints.

705.4.4 Welded joints.

All joint surfaces shall be cleaned. The joint shall be welded with an approved filler metal.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.5 Cast iron.

705.5 Cast iron.

Joints between cast-iron pipe or fittings shall comply with Sections 705.5.1 through 705.5.3.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.5 Cast iron. / 705.5.1 Caulked joints.

705.5.1 Caulked joints.

Joints for hub and spigot pipe shall be firmly packed with oakum or hemp. Molten lead shall be poured in one operation to a depth of not less than 1 inch (25 mm). The lead shall not recede more than 0.125 inch (3.2 mm) below the rim of the hub and shall be caulked tight. Paint, varnish or other coatings shall not be permitted on the jointing material until after the joint has been tested and approved. Lead shall be run in one pouring and shall be caulked tight. Acid-resistant rope and acidproof cement shall be permitted.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.5 Cast iron. / 705.5.2 Compression gasket joints.

705.5.2 Compression gasket joints.

Compression gaskets for hub and spigot pipe and fittings shall conform to ASTM C 564 and shall be tested to ASTM C 1563. Gaskets shall be compressed when the pipe is fully inserted.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.5 Cast iron. / 705.5.3 Mechanical joint coupling.

705.5.3 Mechanical joint coupling.

Mechanical joint couplings for hubless pipe and fittings shall comply with CISPI 310, ASTM C 1277 or ASTM C 1540. The elastomeric sealing sleeve shall conform to ASTM C 564 or CSA B602 and shall be provided with a center stop. Mechanical joint couplings shall be installed in accordance with the manufacturer's installation instructions.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.6 Concrete joints.

705.6 Concrete joints.

Joints between concrete pipe and fittings shall be made with an elastomeric seal conforming to ASTM C 443, ASTM C 1173, CSA A257.3M or CSA B602.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.7 Coextruded composite ABS pipe, joints.

705.7 Coextruded composite ABS pipe, joints.

Joints between coextruded composite pipe with an ABS outer layer or ABS fittings shall comply with Sections 705.7.1 and 705.7.2.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.7 Coextruded composite ABS pipe, joints. / 705.7.1 Mechanical joints.

705.7.1 Mechanical joints.

Mechanical joints on drainage pipe shall be made with an elastomeric seal conforming to ASTM C1173, ASTM D 3212 or CSA B602. Mechanical joints shall not be installed in above-ground systems, unless otherwise approved. Joints shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.7 Coextruded composite ABS pipe, joints. / 705.7.2 Solvent cementing.

705.7.2 Solvent cementing.

Joint surfaces shall be clean and free from moisture. Solvent cement that conforms to ASTM D 2235 or CSA B181.1 shall be applied to all joint surfaces. The joint shall be made while the cement is wet. Joints shall be made in accordance with ASTM D 2235, ASTM D 2661, ASTM F 628 or CSA B181.1. Solvent-cement joints shall be permitted above or below ground.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.8 Coextruded composite PVC pipe.

705.8 Coextruded composite PVC pipe.

Joints between coextruded composite pipe with a PVC outer layer or PVC fittings shall comply with Sections 705.8.1 and 705.8.2.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.8 Coextruded composite PVC pipe. / 705.8.1 Mechanical joints.

705.8.1 Mechanical joints.

Mechanical joints on drainage pipe shall be made with an elastomeric seal conforming to ASTM D 3212. Mechanical joints shall not be installed in above-ground systems, unless otherwise approved. Joints shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.8 Coextruded composite PVC pipe. / 705.8.2 Solvent cementing.

705.8.2 Solvent cementing.

Joint surfaces shall be clean and free from moisture. A purple primer that conforms to ASTM F 656 shall be applied. Solvent cement not purple in color and conforming to ASTM D 2564, CSA B137.3, CSA B181.2 or CSA B182.1 shall be applied to all joint surfaces. The joint shall be made while the cement is wet and shall be in accordance with ASTM D 2855. Solvent-cement joints shall be permitted above or below ground.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.9 Copper pipe.

705.9 Copper pipe.

Joints between copper or copper-alloy pipe or fittings shall comply with Sections 705.9.1 through 705.9.5.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.9 Copper pipe. / 705.9.1 Brazed joints.

705.9.1 Brazed joints.

All joint surfaces shall be cleaned. An approved flux shall be applied where required. The joint shall be brazed with a filler metal conforming to AWS A5.8.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.9 Copper pipe. / 705.9.2 Mechanical joints.

705.9.2 Mechanical joints.

Mechanical joints shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.9 Copper pipe. / 705.9.3 Soldered joints.

705.9.3 Soldered joints.

Solder joints shall be made in accordance with the methods of ASTM B 828. All cut tube ends shall be reamed to the full inside diameter of the tube end. All joint surfaces shall be cleaned. A flux conforming to ASTM B 813 shall be applied. The joint shall be soldered with a solder conforming to ASTM B 32.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.9 Copper pipe. / 705.9.4 Threaded joints.

705.9.4 Threaded joints.

Threads shall conform to ASME B1.20.1. Pipe-joint compound or tape shall be applied on the male threads only.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.9 Copper pipe. / 705.9.5 Welded joints.

705.9.5 Welded joints.

All joint surfaces shall be cleaned. The joint shall be welded with an approved filler metal.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.10 Copper tubing.

705.10 Copper tubing.

Joints between copper or copper-alloy tubing or fittings shall comply with Sections 705.10.1 through 705.10.3.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.10 Copper tubing. / 705.10.1 Brazed joints.

705.10.1 Brazed joints.

All joint surfaces shall be cleaned. An approved flux shall be applied where required. The joint shall be brazed with a filler metal conforming to AWS A5.8.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.10 Copper tubing. / 705.10.2 Mechanical joints.

705.10.2 Mechanical joints.

Mechanical joints shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.10 Copper tubing. / 705.10.3 Soldered joints.

705.10.3 Soldered joints.

Solder joints shall be made in accordance with the methods of ASTM B 828. All cut tube ends shall be reamed to the full inside diameter of the tube end. All joint surfaces shall be cleaned. A flux conforming to ASTM B 813 shall be applied. The joint shall be soldered with a solder conforming to ASTM B 32.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.11 Borosilicate glass joints.

705.11 Borosilicate glass joints.

Glass-to-glass connections shall be made with a bolted compression-type stainless steel (300 series) coupling with contoured acid-resistant elastomeric compression ring and a fluorocarbon polymer inner seal ring; or with caulked joints in accordance with Section 705.11.1.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.11 Borosilicate glass joints. / 705.11.1 Caulked joints.

705.11.1 Caulked joints.

Every lead-caulked joint for hub and spigot soil pipe shall be firmly packed with oakum or hemp and filled with molten lead not less than 1 inch (25 mm) deep and not to extend more than 0.125 inch (3.2 mm) below the rim of the hub. Paint, varnish or other coatings shall not be permitted on the jointing material until after the joint has been tested and approved. Lead shall be run in one pouring and shall be caulked tight. Acid-resistant rope and acidproof cement shall be permitted.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.12 Steel.

705.12 Steel.

Joints between galvanized steel pipe or fittings shall comply with Sections 705.12.1 and 705.12.2.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.12 Steel. / 705.12.1 Threaded joints.

705.12.1 Threaded joints.

Threads shall conform to ASME B1.20.1. Pipe-joint compound or tape shall be applied on the male threads only.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.12 Steel. / 705.12.2 Mechanical joints.

705.12.2 Mechanical joints.

Joints shall be made with an approved elastomeric seal. Mechanical joints shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.13 Lead.

705.13 Lead.

Joints between lead pipe or fittings shall comply with Sections 705.13.1 and 705.13.2.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.13 Lead. / 705.13.1 Burned.

705.13.1 Burned.

Burned joints shall be uniformly fused together into one continuous piece. The thickness of the joint shall be at least as thick as the lead being joined. The filler metal shall be of the

same material as the pipe.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.13 Lead. / 705.13.2 Wiped.

705.13.2 Wiped.

Joints shall be fully wiped, with an exposed surface on each side of the joint not less than 0.75 inch (19.1 mm). The joint shall be at least 0.325 inch (9.5 mm) thick at the thickest point.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.14 PVC plastic.

705.14 PVC plastic.

Joints between PVC plastic pipe or fittings shall comply with Sections 705.14.1 through 705.14.3.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.14 PVC plastic. / 705.14.1 Mechanical joints.

705.14.1 Mechanical joints.

Mechanical joints on drainage pipe shall be made with an elastomeric seal conforming to ASTM C 1173, ASTM D 3212 or CSA B602. Mechanical joints shall not be installed in above-ground systems, unless otherwise approved. Joints shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.14 PVC plastic. / 705.14.2 Solvent cementing.

705.14.2 Solvent cementing.

Joint surfaces shall be clean and free from moisture. A purple primer that conforms to ASTM F 656 shall be applied. Solvent cement not purple in color and conforming to ASTM D 2564, CSA B137.3, CSA B181.2 or CSA B182.1 shall be applied to all joint surfaces. The joint shall be made while the cement is wet and shall be in accordance with ASTM D 2855. Solvent-cement joints shall be permitted above or below ground.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.14 PVC plastic. / 705.14.3 Threaded joints.

705.14.3 Threaded joints.

Threads shall conform to ASME B1.20.1. Schedule 80 or heavier pipe shall be permitted to be threaded with dies specifically designed for plastic pipe. Approved thread lubricant or

tape shall be applied on the male threads only.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.15 Vitrified clay.

705.15 Vitrified clay.

Joints between vitrified clay pipe or fittings shall be made with an elastomeric seal conforming to ASTM C 425, ASTM C 1173 or CSA B602.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.16 Polyethylene plastic pipe.

705.16 Polyethylene plastic pipe.

Joints between polyethylene plastic pipe and fittings shall be underground and shall comply with Section 705.16.1 or 705.16.2.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.16 Polyethylene plastic pipe. / 705.16.1 Heat-fusion joints.

705.16.1 Heat-fusion joints.

Joint surfaces shall be clean and free from moisture. All joint surfaces shall be cut, heated to melting temperature and joined using tools specifically designed for the operation. Joints shall be undisturbed until cool. Joints shall be made in accordance with ASTM D 2657 and the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.16 Polyethylene plastic pipe. / 705.16.2 Mechanical joints.

705.16.2 Mechanical joints.

Mechanical joints in drainage piping shall be made with an elastomeric seal conforming to ASTM C 1173, ASTM D 3212 or CSA B602. Mechanical joints shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.17 Polyolefin plastic.

705.17 Polyolefin plastic.

Joints between polyolefin plastic pipe and fittings shall comply with Sections 705.17.1 and 705.17.2.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION

705 JOINTS / 705.17 Polyolefin plastic. / 705.17.1 Heat-fusion joints.

705.17.1 Heat-fusion joints.

Heat-fusion joints for polyolefin pipe and tubing joints shall be installed with socket-type heat-fused polyolefin fittings or electrofusion polyolefin fittings. Joint surfaces shall be clean and free from moisture. The joint shall be undisturbed until cool. Joints shall be made in accordance with ASTM F 1412 or CSA B181.3.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.17 Polyolefin plastic. / 705.17.2 Mechanical and compression sleeve joints.

705.17.2 Mechanical and compression sleeve joints.

Mechanical and compression sleeve joints shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.18 Joints between different materials.

705.18 Joints between different materials.

Joints between different piping materials shall be made with a mechanical joint of the compression or mechanical-sealing type conforming to ASTM C 1173, ASTM C 1460 or ASTM C 1461. Connectors and adapters shall be approved for the application and such joints shall have an elastomeric seal conforming to ASTM C 425, ASTM C 443, ASTM C 564, ASTM C 1440, ASTM D 1869, ASTM F 477, CSA A257.3M or CSA B602, or as required in Sections 705.18.1 through 705.18.7. Joints between glass pipe and other types of materials shall be made with adapters having a TFE seal. Joints shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.18 Joints between different materials. / 705.18.1 Copper or copper-alloy tubing to cast-iron hub pipe.

705.18.1 Copper or copper-alloy tubing to cast-iron hub pipe.

Joints between copper or copper-alloy tubing and cast-iron hub pipe shall be made with a brass ferrule or compression joint. The copper or copper-alloy tubing shall be soldered to the ferrule in an approved manner, and the ferrule shall be joined to the cast-iron hub by a caulked joint or a mechanical compression joint.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.18 Joints between different materials. / 705.18.2 Copper or copper-alloy tubing to galvanized steel pipe.

705.18.2 Copper or copper-alloy tubing to galvanized steel pipe.

Joints between copper or copper-alloy tubing and galvanized steel pipe shall be made with a brass converter fitting or dielectric fitting. The copper tubing shall be soldered to the fitting in an approved manner, and the fitting shall be screwed to the threaded pipe.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.18 Joints between different materials. / 705.18.3 Cast-iron pipe to galvanized steel or brass pipe.

705.18.3 Cast-iron pipe to galvanized steel or brass pipe.

Joints between cast-iron and galvanized steel or brass pipe shall be made by either caulked or threaded joints or with an approved adapter fitting.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.18 Joints between different materials. / 705.18.4 Plastic pipe or tubing to other piping material.

705.18.4 Plastic pipe or tubing to other piping material.

Joints between different types of plastic pipe or between plastic pipe and other piping material shall be made with an approved adapter fitting. Joints between plastic pipe and cast-iron hub pipe shall be made by a caulked joint or a mechanical compression joint.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.18 Joints between different materials. / 705.18.5 Lead pipe to other piping material.

705.18.5 Lead pipe to other piping material.

Joints between lead pipe and other piping material shall be made by a wiped joint to a caulking ferrule, soldering nipple, or bushing or shall be made with an approved adapter fitting.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.18 Joints between different materials. / 705.18.6 Borosilicate glass to other materials.

705.18.6 Borosilicate glass to other materials.

Joints between glass pipe and other types of materials shall be made with adapters having a TFE seal and shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION

705 JOINTS / 705.18 Joints between different materials. / 705.18.7 Stainless steel drainage systems to other materials.

705.18.7 Stainless steel drainage systems to other materials.

Joints between stainless steel drainage systems and other piping materials shall be made with approved mechanical couplings.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.19 Drainage slip joints.

705.19 Drainage slip joints.

Slip joints shall comply with Section 405.8.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.20 Caulking ferrules.

705.20 Caulking ferrules.

Ferrules shall be of red brass and shall be in accordance with Table 705.20.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.20 Caulking ferrules. / TABLE 705.20 CAULKING FERRULE SPECIFICATIONS

**TABLE 705.20
CAULKING FERRULE SPECIFICATIONS**

PIPE SIZES (inches)	INSIDE DIAMETER (inches)	LENGTH (inches)	MINIMUM WEIGHT EACH
2	2¼	4½	1 pound
3	3¼	4½	1 pound 12 ounces
4	4¼	4½	2 pounds 8 ounces

For SI: 1 inch = 25.4 mm, 1 ounce = 28.35 g, 1 pound = 0.454 kg.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.21 Soldering bushings.

705.21 Soldering bushings.

Soldering bushings shall be of red brass and shall be in accordance with Table 705.21.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.21 Soldering bushings. / TABLE 705.21 SOLDERING BUSHING

SPECIFICATIONS

**TABLE 705.21
SOLDERING BUSHING SPECIFICATIONS**

PIPE SIZES (inches)	MINIMUM WEIGHT EACH
1¼	6 ounces
1½	8 ounces
2	14 ounces
2½	1 pound 6 ounces
3	2 pounds
4	3 pounds 8 ounces

For SI: 1 inch = 25.4 mm, 1 ounce = 28.35 g, 1 pound = 0.454 kg.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 705 JOINTS / 705.22 Stainless steel drainage systems.

705.22 Stainless steel drainage systems.

O-ring joints for stainless steel drainage systems shall be made with an approved elastomeric seal.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 706 CONNECTIONS BETWEEN DRAINAGE PIPING AND FITTINGS

**SECTION 706
CONNECTIONS BETWEEN DRAINAGE
PIPING AND FITTINGS**

**2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 706 CONNECTIONS BETWEEN DRAINAGE PIPING AND FITTINGS / 706.1
Connections and changes in direction.**

706.1 Connections and changes in direction.

All connections and changes in direction of the sanitary drainage system shall be made with approved drainage fittings. Connections between drainage piping and fixtures shall conform to Section 405.

**2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 706 CONNECTIONS BETWEEN DRAINAGE PIPING AND FITTINGS / 706.2
Obstructions.**

706.2 Obstructions.

The fittings shall not have ledges, shoulders or reductions capable of retarding or obstructing flow in the piping. Threaded drainage pipe fittings shall be of the recessed drainage type.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 706 CONNECTIONS BETWEEN DRAINAGE PIPING AND FITTINGS / 706.3

Installation of fittings.

706.3 Installation of fittings.

Fittings shall be installed to guide sewage and waste in the direction of flow. Change in direction shall be made by fittings installed in accordance with Table 706.3. Change in direction by combination fittings, side inlets or increasers shall be installed in accordance with Table 706.3 based on the pattern of flow created by the fitting. Double sanitary tee patterns shall not receive the discharge of back-to-back water closets and fixtures or appliances with pumping action discharge.

Exception: Back-to-back water closet connections to double sanitary tees shall be permitted where the horizontal developed length between the outlet of the water closet and the connection to the double sanitary tee pattern is 18 inches (457 mm) or greater.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 706 CONNECTIONS BETWEEN DRAINAGE PIPING AND FITTINGS / 706.3

Installation of fittings. / TABLE 706.3 FITTINGS FOR CHANGE IN DIRECTION

**TABLE 706.3
FITTINGS FOR CHANGE IN DIRECTION**

TYPE OF FITTING PATTERN	CHANGE IN DIRECTION		
	Horizontal to vertical	Vertical to horizontal	Horizontal to horizontal
Sixteenth bend	X	X	X
Eighth bend	X	X	X
Sixth bend	X	X	X
Quarter bend	X	X ^a	X ^a
Short sweep	X	X ^{a,b}	X ^a
Long sweep	X	X	X
Sanitary tee	X ^c	—	—
Wye	X	X	X
Combination wye and eighth bend	X	X	X

For SI: 1 inch = 25.4 mm.

a. The fittings shall only be permitted for a 2-inch or smaller fixture drain.

- b. Three inches or larger.
- c. For a limitation on double sanitary tees, see Section 706.3.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 706 CONNECTIONS BETWEEN DRAINAGE PIPING AND FITTINGS / 706.4 Heel- or side-inlet quarter bends.

706.4 Heel- or side-inlet quarter bends.

Heel-inlet quarter bends shall be an acceptable means of connection, except where the quarter bend serves a water closet. A low-heel inlet shall not be used as a wet-vented connection. Side-inlet quarter bends shall be an acceptable means of connection for drainage, wet venting and stack venting arrangements.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 707 PROHIBITED JOINTS AND CONNECTIONS

**SECTION 707
PROHIBITED JOINTS AND CONNECTIONS**

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 707 PROHIBITED JOINTS AND CONNECTIONS / 707.1 Prohibited joints.

707.1 Prohibited joints.

The following types of joints and connections shall be prohibited:

1. Cement or concrete joints.
2. Mastic or hot-pour bituminous joints.
3. Joints made with fittings not approved for the specific installation.
4. Joints between different diameter pipes made with elastomeric rolling O-rings.
5. Solvent-cement joints between different types of plastic pipe.
6. Saddle-type fittings.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 708 CLEANOUTS

**SECTION 708
CLEANOUTS**

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 708 CLEANOUTS / 708.1 Scope.

708.1 Scope.

This section shall govern the size, location, installation and maintenance of drainage pipe cleanouts.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 708 CLEANOUTS / 708.2 Cleanout plugs.

708.2 Cleanout plugs.

Cleanout plugs shall be brass or plastic, or other approved materials. Brass cleanout plugs shall be utilized with metallic drain, waste and vent piping only, and shall conform to ASTM A 74, ASME A112.3.1 or ASME A112.36.2M. Cleanouts with plate-style access covers shall be fitted with corrosion-resisting fasteners. Plastic cleanout plugs shall conform to the requirements of Section 702.4. Plugs shall have raised square or countersunk square heads. Countersunk heads shall be installed where raised heads are a trip hazard. Cleanout plugs with borosilicate glass systems shall be of borosilicate glass.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 708 CLEANOUTS / 708.3 Where required.

708.3 Where required.

Cleanouts shall be located in accordance with Sections 708.3.1 through 708.3.6.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 708 CLEANOUTS / 708.3 Where required. / 708.3.1 Horizontal drains within buildings.

708.3.1 Horizontal drains within buildings.

All horizontal drains shall be provided with cleanouts located not more than 100 feet (30 480 mm) apart.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 708 CLEANOUTS / 708.3 Where required. / 708.3.2 Building sewers.

708.3.2 Building sewers.

Building sewers shall be provided with cleanouts located not more than 100 feet (30 480 mm) apart measured from the upstream entrance of the cleanout. For building sewers 8 inches (203 mm) and larger, manholes shall be provided and located not more than 200 feet (60 960 mm) from the junction of the building drain and building sewer, at each change in direction and at intervals of not more than 400 feet (122 m) apart. Manholes and manhole

covers shall be of an approved type.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 708 CLEANOUTS / 708.3 Where required. / 708.3.3 Changes of direction.

708.3.3 Changes of direction.

Cleanouts shall be installed at each change of direction greater than 45 degrees (0.79 rad) in the building sewer, building drain and horizontal waste or soil lines. Where more than one change of direction occurs in a run of piping, only one cleanout shall be required for each 40 feet (12 192 mm) of developed length of the drainage piping.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 708 CLEANOUTS / 708.3 Where required. / 708.3.4 Base of stack.

708.3.4 Base of stack.

A cleanout shall be provided at the base of each waste or soil stack.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 708 CLEANOUTS / 708.3 Where required. / 708.3.5 Building drain and building sewer junction.

708.3.5 Building drain and building sewer junction.

There shall be a cleanout near the junction of the building drain and the building sewer. The cleanout shall be either inside or outside the building wall and shall be brought up to the finished ground level or to the basement floor level. An approved two-way cleanout is allowed to be used at this location to serve as a required cleanout for both the building drain and building sewer. The cleanout at the junction of the building drain and building sewer shall not be required if the cleanout on a 3-inch (76 mm) or larger diameter soil stack is located within a developed length of 10 feet (3048 mm) of the building drain and building sewer connection. The minimum size of the cleanout at the junction of the building drain and building sewer shall comply with Section 708.7.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 708 CLEANOUTS / 708.3 Where required. / 708.3.6 Manholes.

708.3.6 Manholes.

Manholes serving a building drain shall have secured gas-tight covers and shall be located in accordance with Section 708.3.2.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 708 CLEANOUTS / 708.4 Concealed piping.

708.4 Concealed piping.

Cleanouts on concealed piping or piping under a floor slab or in a crawl space of less than 24 inches (610 mm) in height or a plenum shall be extended through and terminate flush with the finished wall, floor or ground surface or shall be extended to the outside of the building. Cleanout plugs shall not be covered with cement, plaster or any other permanent finish material. Where it is necessary to conceal a cleanout or to terminate a cleanout in an area subject to vehicular traffic, the covering plate, access door or cleanout shall be of an approved type designed and installed for this purpose.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 708 CLEANOUTS / 708.5 Opening direction.

708.5 Opening direction.

Every cleanout shall be installed to open to allow cleaning in the direction of the flow of the drainage pipe or at right angles thereto.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 708 CLEANOUTS / 708.6 Prohibited installation.

708.6 Prohibited installation.

Cleanout openings shall not be utilized for the installation of new fixtures, except where approved and where another cleanout of equal access and capacity is provided.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 708 CLEANOUTS / 708.7 Minimum size.

708.7 Minimum size.

Cleanouts shall be the same nominal size as the pipe they serve up to 4 inches (102 mm). For pipes larger than 4 inches (102 mm) nominal size, the minimum size of the cleanout shall be 4 inches (102 mm).

Exceptions:

1. "P" trap connections with slip joints or ground joint connections, or stack cleanouts that are not more than one pipe diameter smaller than the drain served, shall be permitted.
2. Cast-iron cleanout sizing shall be in accordance with referenced standards in Table 702.4, ASTM A 74 for hub and spigot fittings or ASTM A 888 or CISPI 301 for hubless fittings.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION

708 CLEANOUTS / 708.8 Clearances.

708.8 Clearances.

Cleanouts on 6-inch (153 mm) and smaller pipes shall be provided with a clearance of not less than 18 inches (457 mm) for rodding. Cleanouts on 8-inch (203 mm) and larger pipes shall be provided with a clearance of not less than 36 inches (914 mm) for rodding.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 708 CLEANOUTS / 708.9 Access.

708.9 Access.

Access shall be provided to all cleanouts.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 709 FIXTURE UNITS

**SECTION 709
FIXTURE UNITS**

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 709 FIXTURE UNITS / 709.1 Values for fixtures.

709.1 Values for fixtures.

Drainage fixture unit values as given in Table 709.1 designate the relative load weight of different kinds of fixtures that shall be employed in estimating the total load carried by a soil or waste pipe, and shall be used in connection with Tables 710.1(1) and 710.1(2) of sizes for soil, waste and vent pipes for which the permissible load is given in terms of fixture units.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 709 FIXTURE UNITS / 709.1 Values for fixtures. / TABLE 709.1 DRAINAGE FIXTURE UNITS FOR FIXTURES AND GROUPS

**TABLE 709.1
DRAINAGE FIXTURE UNITS FOR FIXTURES AND GROUPS**

FIXTURE TYPE	DRAINAGE FIXTURE UNIT VALUE AS LOAD FACTORS	MINIMUM SIZE OF TRAP (inches)
Automatic clothes washers, commercial ^{a,g}	3	2
Automatic clothes washers, residential ^g	2	2
Bathroom group as defined in Section 202 (1.6 gpf water closet) ^f	5	—

I-Quest 2006 Codes Complete Collection

FIXTURE TYPE	DRAINAGE FIXTURE UNIT VALUE AS LOAD FACTORS	MINIMUM SIZE OF TRAP (inches)
Bathroom group as defined in Section 202 (water closet flushing greater than 1.6 gpf) ^f	6	—
Bathtub ^b (with or without overhead shower or whirlpool attachments)	2	1½
Bidet	1	1¼
Combination sink and tray	2	1½
Dental lavatory	1	1¼
Dental unit or cuspidor	1	1¼
Dishwashing machine, ^c domestic	2	1½
Drinking fountain	½	1¼
Emergency floor drain	0	2
Floor drains	2	2
Kitchen sink, domestic	2	1½
Kitchen sink, domestic with food waste grinder and/or dishwasher	2	1½
Laundry tray (1 or 2 compartments)	2	1½
Lavatory	1	1¼
Shower	2	1½
Service sink	2	1½
Sink	2	1½
Urinal	4	Note d
Urinal, 1 gallon per flush or less	2 ^e	Note d
Urinal, nonwater supplied	0.5	Note d
Wash sink (circular or multiple) each set of faucets	2	1½
Water closet, flushometer tank, public or private	4 ^e	Note d
Water closet, private (1.6 gpf)	3 ^e	Note d
Water closet, private (flushing greater than 1.6 gpf)	4 ^e	Note d
Water closet, public (1.6 gpf)	4 ^e	Note d
Water closet, public (flushing greater than 1.6 gpf)	6 ^e	Note d

For SI: 1 inch = 25.4 mm, 1 gallon = 3.785 L (gpf = gallon per flushing cycle).

a. For traps larger than 3 inches, use Table 709.2.

b. A showerhead over a bathtub or whirlpool bathtub attachment does not increase the drainage fixture unit value.

c. See Sections 709.2 through 709.4 for methods of computing unit value of fixtures not listed in this table or for rating of devices with intermittent flows.

d. Trap size shall be consistent with the fixture outlet size.

e. For the purpose of computing loads on building drains and sewers, water closets and urinals shall not be rated at a lower drainage fixture unit unless the lower values are confirmed by testing.

f. For fixtures added to a dwelling unit bathroom group, add the dfu value of those additional fixtures to the bathroom group fixture count.

g. See Section 406.3 for sizing requirements for fixture drain, branch drain, and drainage stack for an automatic clothes washer standpipe.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 709 FIXTURE UNITS / 709.2 Fixtures not listed in Table 709.1.

709.2 Fixtures not listed in Table 709.1.

Fixtures not listed in Table 709.1 shall have a drainage fixture unit load based on the outlet size of the fixture in accordance with Table 709.2. The minimum trap size for unlisted fixtures shall be the size of the drainage outlet but not less than 1.25 inches (32 mm).

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 709 FIXTURE UNITS / 709.3 Values for continuous and semicontinuous flow.

709.3 Values for continuous and semicontinuous flow.

Drainage fixture unit values for continuous and semicontinuous flow into a drainage system shall be computed on the basis that 1 gpm (0.06 L/s) of flow is equivalent to two fixture units.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 709 FIXTURE UNITS / 709.4 Values for indirect waste receptor.

709.4 Values for indirect waste receptor.

The drainage fixture unit load of an indirect waste receptor receiving the discharge of indirectly connected fixtures shall be the sum of the drainage fixture unit values of the fixtures that discharge to the receptor, but not less than the drainage fixture unit value given for the indirect waste receptor in Table 709.1 or 709.2.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 709 FIXTURE UNITS / 709.4 Values for indirect waste receptor. / TABLE 709.2 DRAINAGE FIXTURE UNITS FOR FIXTURE DRAINS OR TRAPS

**TABLE 709.2
DRAINAGE FIXTURE UNITS FOR FIXTURE DRAINS OR TRAPS**

FIXTURE DRAIN OR TRAP SIZE (inches)	DRAINAGE FIXTURE UNIT VALUE
1¼	1
1½	2
2	3
2½	4
3	5
4	6

For SI: 1 inch = 25.4 mm.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 710 DRAINAGE SYSTEM SIZING

**SECTION 710
DRAINAGE SYSTEM SIZING**

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 710 DRAINAGE SYSTEM SIZING / 710.1 Maximum fixture unit load.

710.1 Maximum fixture unit load.

The maximum number of drainage fixture units connected to a given size of building sewer, building drain or horizontal branch of the building drain shall be determined using Table 710.1(1). The maximum number of drainage fixture units connected to a given size of horizontal branch or vertical soil or waste stack shall be determined using Table 710.1(2).

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 710 DRAINAGE SYSTEM SIZING / 710.1 Maximum fixture unit load. / TABLE 710.1(1) BUILDING DRAINS AND SEWERS

**TABLE 710.1(1)
BUILDING DRAINS AND SEWERS**

DIAMETER OF PIPE (inches)	MAXIMUM NUMBER OF DRAINAGE FIXTURE UNITS CONNECTED TO ANY PORTION OF THE BUILDING DRAIN OR THE BUILDING SEWER, INCLUDING BRANCHES OF THE BUILDING DRAIN ^a			
	Slope per foot			
	$\frac{1}{16}$ inch	$\frac{1}{8}$ inch	$\frac{1}{4}$ inch	$\frac{1}{2}$ inch
1¼	—	—	1	1
1½	—	—	3	3
2	—	—	21	26
2½	—	—	24	31
3	—	36	42	50
4	—	180	216	250
5	—	390	480	575
6	—	700	840	1,000
8	1,400	1,600	1,920	2,300
10	2,500	2,900	3,500	4,200
12	3,900	4,600	5,600	6,700
15	7,000	8,300	10,000	12,000

For SI: 1 inch = 25.4 mm, 1 inch per foot = 83.3 mm/m.

I-Quest 2006 Codes Complete Collection

- a. The minimum size of any building drain serving a water closet shall be 3 inches.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 710 DRAINAGE SYSTEM SIZING / 710.1 Maximum fixture unit load. / TABLE 710.1(2) HORIZONTAL FIXTURE BRANCHES AND STACKS^a

**TABLE 710.1(2)
HORIZONTAL FIXTURE BRANCHES AND STACKS^a**

DIAMETER OF PIPE (inches)	MAXIMUM NUMBER OF DRAINAGE FIXTURE UNITS (dfu)			
	Total for horizontal branch	Stacks ^b		
		Total discharge into one branch interval	Total for stack of three branch intervals or less	Total for stack greater than three branch intervals
1½	3	2	4	8
2	6	6	10	24
2½	12	9	20	42
3	20	20	48	72
4	160	90	240	500
5	360	200	540	1,100
6	620	350	960	1,900
8	1,400	600	2,200	3,600
10	2,500	1,000	3,800	5,600
12	2,900	1,500	6,000	8,400
15	7,000	Note c	Note c	Note c

For SI: 1 inch = 25.4 mm.

- a. Does not include branches of the building drain. Refer to Table 710.1(1).
 b. Stacks shall be sized based on the total accumulated connected load at each story or branch interval. As the total accumulated connected load decreases, stacks are permitted to be reduced in size. Stack diameters shall not be reduced to less than one-half of the diameter of the largest stack size required.
 c. Sizing load based on design criteria.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 710 DRAINAGE SYSTEM SIZING / 710.1 Maximum fixture unit load. / 710.1.1 Horizontal stack offsets.

710.1.1 Horizontal stack offsets.

Horizontal stack offsets shall be sized as required for building drains in accordance with Table 710.1(1), except as required by Section 711.4.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 710 DRAINAGE SYSTEM SIZING / 710.1 Maximum fixture unit load. / 710.1.2 Vertical stack offsets.

710.1.2 Vertical stack offsets.

Vertical stack offsets shall be sized as required for straight stacks in accordance with Table 710.1(2), except where required to be sized as a building drain in accordance with Section 711.1.1.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 710 DRAINAGE SYSTEM SIZING / 710.2 Future fixtures.

710.2 Future fixtures.

Where provision is made for the future installation of fixtures, those provided for shall be considered in determining the required sizes of drain pipes.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 711 OFFSETS IN DRAINAGE PIPING IN BUILDINGS OF FIVE STORIES OR MORE

**SECTION 711
OFFSETS IN DRAINAGE PIPING IN
BUILDINGS OF FIVE STORIES OR MORE**

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 711 OFFSETS IN DRAINAGE PIPING IN BUILDINGS OF FIVE STORIES OR MORE / 711.1 Horizontal branch connections above or below vertical stack offsets.

711.1 Horizontal branch connections above or below vertical stack offsets.

If a horizontal branch connects to the stack within 2 feet (610 mm) above or below a vertical stack offset, and the offset is located more than four branch intervals below the top of the stack, the offset shall be vented in accordance with Section 915.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 711 OFFSETS IN DRAINAGE PIPING IN BUILDINGS OF FIVE STORIES OR MORE / 711.1 Horizontal branch connections above or below vertical stack offsets. / 711.1.1 Omission of vents for vertical stack offsets.

711.1.1 Omission of vents for vertical stack offsets.

Vents for vertical offsets required by Section 711.1 shall not be required where the stack

and its offset are sized as a building drain [see Table 710.1(1)].

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 711 OFFSETS IN DRAINAGE PIPING IN BUILDINGS OF FIVE STORIES OR MORE / 711.2 Horizontal branch connections to horizontal stack offsets.

711.2 Horizontal branch connections to horizontal stack offsets.

Where a horizontal stack offset is located more than four branch intervals below the top of the stack, a horizontal branch shall not connect within the horizontal stack offset or within 2 feet (610 mm) above or below such offset.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 711 OFFSETS IN DRAINAGE PIPING IN BUILDINGS OF FIVE STORIES OR MORE / 711.3 Horizontal stack offsets.

711.3 Horizontal stack offsets.

A stack with a horizontal offset located more than four branch intervals below the top of the stack shall be vented in accordance with Section 915 and sized as follows:

1. The portion of the stack above the offset shall be sized as for a vertical stack based on the total number of drainage fixture units above the offset.
2. The offset shall be sized in accordance with Section 710.1.1.
3. The portion of the stack below the offset shall be sized as for the offset or based on the total number of drainage fixture units on the entire stack, whichever is larger [see Table 710.1(2), Column 5].

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 711 OFFSETS IN DRAINAGE PIPING IN BUILDINGS OF FIVE STORIES OR MORE / 711.3 Horizontal stack offsets. / 711.3.1 Omission of vents for horizontal stack offsets.

711.3.1 Omission of vents for horizontal stack offsets.

Vents for horizontal stack offsets required by Section 711.3 shall not be required where the stack and its offset are one pipe size larger than required for a building drain [see Table 710.1(1)] and the entire stack and offset are not less in cross-sectional area than that required for a straight stack plus the area of an offset vent as provided for in Section 915. Omission of offset vents in accordance with this section shall not constitute approval of horizontal branch connections within the offset or within 2 feet (610 mm) above or below the offset.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 711 OFFSETS IN DRAINAGE PIPING IN BUILDINGS OF FIVE STORIES OR MORE /

711.4 Offsets below lowest branch.

711.4 Offsets below lowest branch.

Where a vertical offset occurs in a soil or waste stack below the lowest horizontal branch, change in diameter of the stack because of the offset shall not be required. If a horizontal offset occurs in a soil or waste stack below the lowest horizontal branch, the required diameter of the offset and the stack below it shall be determined as for a building drain in accordance with Table 710.1(1).

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 712 SUMPS AND EJECTORS

**SECTION 712
SUMPS AND EJECTORS**

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 712 SUMPS AND EJECTORS / 712.1 Building subdrains.

712.1 Building subdrains.

Building subdrains that cannot be discharged to the sewer by gravity flow shall be discharged into a tightly covered and vented sump from which the liquid shall be lifted and discharged into the building gravity drainage system by automatic pumping equipment or other approved method. In other than existing structures, the sump shall not receive drainage from any piping within the building capable of being discharged by gravity to the building sewer.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 712 SUMPS AND EJECTORS / 712.2 Valves required.

712.2 Valves required.

A check valve and a full open valve located on the discharge side of the check valve shall be installed in the pump or ejector discharge piping between the pump or ejector and the gravity drainage system. Access shall be provided to such valves. Such valves shall be located above the sump cover required by Section 712.1 or, where the discharge pipe from the ejector is below grade, the valves shall be accessibly located outside the sump below grade in an access pit with a removable access cover.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 712 SUMPS AND EJECTORS / 712.3 Sump design.

712.3 Sump design.

The sump pump, pit and discharge piping shall conform to the requirements of Sections 712.3.1

through 712.3.5.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 712 SUMPS AND EJECTORS / 712.3 Sump design. / 712.3.1 Sump pump.

712.3.1 Sump pump.

The sump pump capacity and head shall be appropriate to anticipated use requirements.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 712 SUMPS AND EJECTORS / 712.3 Sump design. / 712.3.2 Sump pit.

712.3.2 Sump pit.

The sump pit shall be not less than 18 inches (457 mm) in diameter and 24 inches (610 mm) deep, unless otherwise approved. The pit shall be accessible and located such that all drainage flows into the pit by gravity. The sump pit shall be constructed of tile, concrete, steel, plastic or other approved materials. The pit bottom shall be solid and provide permanent support for the pump. The sump pit shall be fitted with a gas-tight removable cover adequate to support anticipated loads in the area of use. The sump pit shall be vented in accordance with Chapter 9.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 712 SUMPS AND EJECTORS / 712.3 Sump design. / 712.3.3 Discharge piping.

712.3.3 Discharge piping.

Discharge piping shall meet the requirements of Section 712.2.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 712 SUMPS AND EJECTORS / 712.3 Sump design. / 712.3.4 Maximum effluent level.

712.3.4 Maximum effluent level.

The effluent level control shall be adjusted and maintained to at all times prevent the effluent in the sump from rising to within 2 inches (51 mm) of the invert of the gravity drain inlet into the sump.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 712 SUMPS AND EJECTORS / 712.3 Sump design. / 712.3.5 Ejector connection to the drainage system.

712.3.5 Ejector connection to the drainage system.

Pumps connected to the drainage system shall connect to the building sewer or shall connect to a wye fitting in the building drain a minimum of 10 feet (3048 mm) from the base of any soil stack, waste stack or fixture drain. Where the discharge line connects into

horizontal drainage piping, the connector shall be made through a wye fitting into the top of the drainage piping.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 712 SUMPS AND EJECTORS / 712.4 Sewage pumps and sewage ejectors.

712.4 Sewage pumps and sewage ejectors.

A sewage pump or sewage ejector shall automatically discharge the contents of the sump to the building drainage system.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 712 SUMPS AND EJECTORS / 712.4 Sewage pumps and sewage ejectors. / 712.4.1 Macerating toilet systems.

712.4.1 Macerating toilet systems.

Macerating toilet systems shall comply with CSA B45.9 or ASME A112.3.4 and shall be installed in accordance with the manufacturer's installation instructions.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 712 SUMPS AND EJECTORS / 712.4 Sewage pumps and sewage ejectors. / 712.4.2 Capacity.

712.4.2 Capacity.

A sewage pump or sewage ejector shall have the capacity and head for the application requirements. Pumps or ejectors that receive the discharge of water closets shall be capable of handling spherical solids with a diameter of up to and including 2 inches (51 mm). Other pumps or ejectors shall be capable of handling spherical solids with a diameter of up to and including 1 inch (25.4 mm). The minimum capacity of a pump or ejector based on the diameter of the discharge pipe shall be in accordance with Table 712.4.2.

Exceptions:

1. Grinder pumps or grinder ejectors that receive the discharge of water closets shall have a minimum discharge opening of 1.25 inches (32 mm).
2. Macerating toilet assemblies that serve single water closets shall have a minimum discharge opening of 0.75 inch (19 mm).

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 712 SUMPS AND EJECTORS / 712.4 Sewage pumps and sewage ejectors. / 712.4.2 Capacity. / TABLE 712.4.2 MINIMUM CAPACITY OF SEWAGE PUMP OR SEWAGE EJECTOR

**TABLE 712.4.2
MINIMUM CAPACITY OF SEWAGE PUMP OR SEWAGE EJECTOR**

DIAMETER OF THE DISCHARGE PIPE (inches)	CAPACITY OF PUMP OR EJECTOR (gpm)
2	21
2½	30
3	46

For SI: 1 inch = 25.4 mm, 1 gallon per minute = 3.785 L/m.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING

**SECTION 713
HEALTH CARE PLUMBING**

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING / 713.1 Scope.

713.1 Scope.

This section shall govern those aspects of health care plumbing systems that differ from plumbing systems in other structures. Health care plumbing systems shall conform to this section in addition to the other requirements of this code. The provisions of this section shall apply to the special devices and equipment installed and maintained in the following occupancies: nursing homes; homes for the aged; orphanages; infirmaries; first aid stations; psychiatric facilities; clinics; professional offices of dentists and doctors; mortuaries; educational facilities; surgery, dentistry, research and testing laboratories; establishments manufacturing pharmaceutical drugs and medicines; and other structures with similar apparatus and equipment classified as plumbing.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING / 713.2 Bedpan washers and clinical sinks.

713.2 Bedpan washers and clinical sinks.

Bedpan washers and clinical sinks shall connect to the drainage and vent system in accordance with the requirements for a water closet. Bedpan washers shall also connect to a local vent.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING / 713.3 Indirect waste.

713.3 Indirect waste.

All sterilizers, steamers and condensers shall discharge to the drainage through an indirect waste pipe by means of an air gap. Where a battery of not more than three sterilizers discharges to an individual receptor, the distance between the receptor and a sterilizer shall not exceed 8 feet (2438 mm). The indirect waste pipe on a bedpan steamer shall be trapped.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING / 713.4 Vacuum system station.

713.4 Vacuum system station.

Ready access shall be provided to vacuum system station receptacles. Such receptacles shall be built into cabinets or recesses and shall be visible.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING / 713.5 Bottle system.

713.5 Bottle system.

Vacuum (fluid suction) systems intended for collecting, removing and disposing of blood, pus or other fluids by the bottle system shall be provided with receptacles equipped with an overflow prevention device at each vacuum outlet station.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING / 713.6 Central disposal system equipment.

713.6 Central disposal system equipment.

All central vacuum (fluid suction) systems shall provide continuous service. Systems equipped with collecting or control tanks shall provide for draining and cleaning of the tanks while the system is in operation. In hospitals, the system shall be connected to the emergency power system. The exhausts from a vacuum pump serving a vacuum (fluid suction) system shall discharge separately to open air above the roof.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING / 713.7 Central vacuum or disposal systems.

713.7 Central vacuum or disposal systems.

Where the waste from a central vacuum (fluid suction) system of the barometric-lag, collection-tank or bottle-disposal type is connected to the drainage system, the waste shall be directly connected to the sanitary drainage system through a trapped waste.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING / 713.7 Central vacuum or disposal systems. / 713.7.1 Piping.

713.7.1 Piping.

The piping of a central vacuum (fluid suction) system shall be of corrosion-resistant material with a smooth interior surface. A branch shall not be less than 0.5-inch (12.7 mm) nominal pipe size for one outlet and shall be sized in accordance with the number of vacuum outlets. A main shall not be less than 1-inch (25 mm) nominal pipe size. The pipe sizing shall be increased in accordance with the manufacturer's instructions as stations are increased.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING / 713.7 Central vacuum or disposal systems. / 713.7.2 Velocity.

713.7.2 Velocity.

The velocity of airflow in a central vacuum (fluid suction) system shall be less than 5,000 feet per minute (25 m/s).

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING / 713.8 Vent connections prohibited.

713.8 Vent connections prohibited.

Connections between local vents serving bedpan washers or sterilizer vents serving sterilizing apparatus and normal sanitary plumbing systems are prohibited. Only one type of apparatus shall be served by a local vent.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING / 713.9 Local vents and stacks for bedpan washers.

713.9 Local vents and stacks for bedpan washers.

Bedpan washers shall be vented to open air above the roof by means of one or more local vents. The local vent for a bedpan washer shall not be less than a 2-inch-diameter (51 mm) pipe. A local vent serving a single bedpan washer is permitted to drain to the fixture served.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING / 713.9 Local vents and stacks for bedpan washers. / 713.9.1 Multiple installations.

713.9.1 Multiple installations.

Where bedpan washers are located above each other on more than one floor, a local vent stack is permitted to be installed to receive the local vent on the various floors. Not more than three bedpan washers shall be connected to a 2-inch (51 mm) local vent stack, not more than six to a 3-inch (76 mm) local vent stack and not more than 12 to a 4-inch (102 mm) local vent stack. In multiple installations, the connections between a bedpan washer

local vent and a local vent stack shall be made with tee or tee-wye sanitary pattern drainage fittings installed in an upright position.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING / 713.9 Local vents and stacks for bedpan washers. / 713.9.2 Trap required.

713.9.2 Trap required.

The bottom of the local vent stack, except where serving only one bedpan washer, shall be drained by means of a trapped and vented waste connection to the sanitary drainage system. The trap and waste shall be the same size as the local vent stack.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING / 713.9 Local vents and stacks for bedpan washers. / 713.9.3 Trap seal maintenance.

713.9.3 Trap seal maintenance.

A water supply pipe not less than ¼ inch (6.4 mm) in diameter shall be taken from the flush supply of each bedpan washer on the discharge or fixture side of the vacuum breaker, shall be trapped to form not less than a 3-inch (76 mm) water seal, and shall be connected to the local vent stack on each floor. The water supply shall be installed so as to provide a supply of water to the local vent stack for cleansing and drain trap seal maintenance each time a bedpan washer is flushed.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING / 713.10 Sterilizer vents and stacks.

713.10 Sterilizer vents and stacks.

Multiple installations of pressure and nonpressure sterilizers shall have the vent connections to the sterilizer vent stack made by means of inverted wye fittings. Access shall be provided to vent connections for the purpose of inspection and maintenance.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING / 713.10 Sterilizer vents and stacks. / 713.10.1 Drainage.

713.10.1 Drainage.

The connection between sterilizer vent or exhaust openings and the sterilizer vent stack shall be designed and installed to drain to the funnel or basket-type waste fitting. In multiple installations, the sterilizer vent stack shall be drained separately to the lowest sterilizer funnel or basket-type waste fitting or receptor.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING / 713.11 Sterilizer vent stack sizes.

713.11 Sterilizer vent stack sizes.

Sterilizer vent stack sizes shall comply with Sections 713.11.1 through 713.11.4.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING / 713.11 Sterilizer vent stack sizes. / 713.11.1 Bedpan steamers.

713.11.1 Bedpan steamers.

The minimum size of a sterilizer vent serving a bedpan steamer shall be 1.50 inches (38 mm) in diameter. Multiple installations shall be sized in accordance with Table 713.11.1.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING / 713.11 Sterilizer vent stack sizes. / 713.11.1 Bedpan steamers. / TABLE 713.11.1 STACK SIZES FOR BEDPAN STEAMERS AND BOILING-TYPE STERILIZERS (Number of Connections of Various Sizes Permitted to Various-sized Sterilizer Vent Stacks)

**TABLE 713.11.1
STACK SIZES FOR BEDPAN STEAMERS AND
BOILING-TYPE STERILIZERS
(Number of Connections of Various Sizes
Permitted to Various-sized Sterilizer Vent Stacks)**

STACK SIZE (inches)	CONNECTION SIZE		
	1½"		2"
1½ ^a	1	or	0
2 ^a	2	or	1
2 ^b	1	and	1
3 ^a	4	or	2
3 ^b	2	and	2
4 ^a	8	or	4
4 ^b	4	and	4

For SI: 1 inch = 25.4 mm.

- a. Total of each size.
- b. Combination of sizes.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING / 713.11 Sterilizer vent stack sizes. / 713.11.2

Boiling-type sterilizers.

713.11.2 Boiling-type sterilizers.

The minimum size of a sterilizer vent stack shall be 2 inches (51 mm) in diameter where serving a utensil sterilizer and 1.5 inches (38 mm) in diameter where serving an instrument sterilizer. Combinations of boiling-type sterilizer vent connections shall be sized in accordance with Table 713.11.1.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING / 713.11 Sterilizer vent stack sizes. / 713.11.3 Pressure sterilizers.

713.11.3 Pressure sterilizers.

Pressure sterilizer vent stacks shall be 2.5 inches (64 mm) minimum. Those serving combinations of pressure sterilizer exhaust connections shall be sized in accordance with Table 713.11.3.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING / 713.11 Sterilizer vent stack sizes. / 713.11.3 Pressure sterilizers. / TABLE 713.11.3 STACK SIZES FOR PRESSURE STERILIZERS (Number of Connections of Various Sizes Permitted To Various-sized Vent Stacks)

**TABLE 713.11.3
STACK SIZES FOR PRESSURE STERILIZERS
(Number of Connections of Various Sizes Permitted
To Various-sized Vent Stacks)**

STACK SIZE (inches)	CONNECTION SIZE			
	¾"	1"	1¼"	1½"
1½ ^a	3 or	2 or	1	—
1½ ^b	2 and	1	—	—
2 ^a	6 or	3 or	2 or	1
2 ^b	3 and	2	—	—
2 ^b	2 and	1 and	1	—
2 ^b	1 and	1 and	—	1
3 ^a	15 or	7 or	5 or	3
3 ^b	1 and	1 and 5 and	2 and —	2 1

For SI: 1 inch = 25.4 mm.

- a. Total of each size.
- b. Combination of sizes.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 713 HEALTH CARE PLUMBING / 713.11 Sterilizer vent stack sizes. / 713.11.4 Pressure instrument washer sterilizer sizes.

713.11.4 Pressure instrument washer sterilizer sizes.

The minimum diameter of a sterilizer vent stack serving an instrument washer sterilizer shall be 2 inches (51 mm). Not more than two sterilizers shall be installed on a 2-inch (51 mm) stack, and not more than four sterilizers shall be installed on a 3-inch (76 mm) stack.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 714 COMPUTERIZED DRAINAGE DESIGN

**SECTION 714
COMPUTERIZED DRAINAGE DESIGN**

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 714 COMPUTERIZED DRAINAGE DESIGN / 714.1 Design of drainage system.

714.1 Design of drainage system.

The sizing, design and layout of the drainage system shall be permitted to be designed by approved computer design methods.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 714 COMPUTERIZED DRAINAGE DESIGN / 714.2 Load on drainage system.

714.2 Load on drainage system.

The load shall be computed from the simultaneous or sequential discharge conditions from fixtures, appurtenances and appliances or the peak usage design condition.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 714 COMPUTERIZED DRAINAGE DESIGN / 714.2 Load on drainage system. / 714.2.1 Fixture discharge profiles.

714.2.1 Fixture discharge profiles.

The discharge profiles for flow rates versus time from fixtures and appliances shall be in accordance with the manufacturer's specifications.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 714 COMPUTERIZED DRAINAGE DESIGN / 714.3 Selections of drainage pipe sizes.

714.3 Selections of drainage pipe sizes.

Pipe shall be sized to prevent full-bore flow.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 714 COMPUTERIZED DRAINAGE DESIGN / 714.3 Selections of drainage pipe sizes. / 714.3.1 Selecting pipe wall roughness.

714.3.1 Selecting pipe wall roughness.

Pipe size calculations shall be conducted with the pipe wall roughness factor (ks), in accordance with the manufacturer's specifications and as modified for aging roughness factors with deposits and corrosion.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 714 COMPUTERIZED DRAINAGE DESIGN / 714.3 Selections of drainage pipe sizes. / 714.3.2 Slope of horizontal drainage piping.

714.3.2 Slope of horizontal drainage piping.

Horizontal drainage piping shall be designed and installed at slopes in accordance with Table 704.1.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 715 BACKWATER VALVES

**SECTION 715
BACKWATER VALVES**

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 715 BACKWATER VALVES / 715.1 Sewage backflow.

715.1 Sewage backflow.

Where the flood level rims of plumbing fixtures are below the elevation of the manhole cover of the next upstream manhole in the public sewer, such fixtures shall be protected by a backwater valve installed in the building drain, branch of the building drain or horizontal branch serving such fixtures. Plumbing fixtures having flood level rims above the elevation of the manhole cover of the next upstream manhole in the public sewer shall not discharge through a backwater valve.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 715 BACKWATER VALVES / 715.2 Material.

715.2 Material.

All bearing parts of backwater valves shall be of corrosion-resistant material. Backwater valves shall comply with ASME A112.14.1, CSA B181.1 or CSA B181.2.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 715 BACKWATER VALVES / 715.3 Seal.

715.3 Seal.

Backwater valves shall be so constructed as to provide a mechanical seal against backflow.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 715 BACKWATER VALVES / 715.4 Diameter.

715.4 Diameter.

Backwater valves, when fully opened, shall have a capacity not less than that of the pipes in which they are installed.

2006 International Plumbing Code / CHAPTER 7 SANITARY DRAINAGE / SECTION 715 BACKWATER VALVES / 715.5 Location.

715.5 Location.

Backwater valves shall be installed so that access is provided to the working parts for service and repair.

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE

**CHAPTER 8
INDIRECT/SPECIAL WASTE**

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE / SECTION 801 GENERAL

**SECTION 801
GENERAL**

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE /

SECTION 801 GENERAL / 801.1 Scope.

801.1 Scope.

This chapter shall govern matters concerning indirect waste piping and special wastes. This chapter shall further control matters concerning food-handling establishments, sterilizers, clear-water wastes, swimming pools, methods of providing air breaks or air gaps, and neutralizing devices for corrosive wastes.

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE / SECTION 801 GENERAL / 801.2 Protection.

801.2 Protection.

All devices, appurtenances, appliances and apparatus intended to serve some special function, such as sterilization, distillation, processing, cooling, or storage of ice or foods, and that discharge to the drainage system, shall be provided with protection against backflow, flooding, fouling, contamination and stoppage of the drain.

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE / SECTION 802 INDIRECT WASTES

**SECTION 802
INDIRECT WASTES**

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE / SECTION 802 INDIRECT WASTES / 802.1 Where required.

802.1 Where required.

Food-handling equipment and clear-water waste shall discharge through an indirect waste pipe as specified in Sections 802.1.1 through 802.1.7. All health-care related fixtures, devices and equipment shall discharge to the drainage system through an indirect waste pipe by means of an air gap in accordance with this chapter and Section 713.3. Fixtures not required by this section to be indirectly connected shall be directly connected to the plumbing system in accordance with Chapter 7.

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE / SECTION 802 INDIRECT WASTES / 802.1 Where required. / 802.1.1 Food handling.

802.1.1 Food handling.

Equipment and fixtures utilized for the storage, preparation and handling of food shall discharge through an indirect waste pipe by means of an air gap.

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE / SECTION 802 INDIRECT WASTES / 802.1 Where required. / 802.1.2 Floor drains in food storage areas.

802.1.2 Floor drains in food storage areas.

Floor drains located within walk-in refrigerators or freezers in food service and food establishments shall be indirectly connected to the sanitary drainage system by means of an air gap. Where a floor drain is located within an area subject to freezing, the waste line serving the floor drain shall not be trapped and shall indirectly discharge into a waste receptor located outside of the area subject to freezing.

Exception: Where protected against backflow by a backwater valve, such floor drains shall be indirectly connected to the sanitary drainage system by means of an air break or an air gap.

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE / SECTION 802 INDIRECT WASTES / 802.1 Where required. / 802.1.3 Potable clear-water waste.

802.1.3 Potable clear-water waste.

Where devices and equipment, such as sterilizers and relief valves, discharge potable water to the building drainage system, the discharge shall be through an indirect waste pipe by means of an air gap.

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE / SECTION 802 INDIRECT WASTES / 802.1 Where required. / 802.1.4 Swimming pools.

802.1.4 Swimming pools.

Where wastewater from swimming pools, backwash from filters and water from pool deck drains discharge to the building drainage system, the discharge shall be through an indirect waste pipe by means of an air gap.

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE / SECTION 802 INDIRECT WASTES / 802.1 Where required. / 802.1.5 Nonpotable clear-water waste.

802.1.5 Nonpotable clear-water waste.

Where devices and equipment such as process tanks, filters, drips and boilers discharge nonpotable water to the building drainage system, the discharge shall be through an indirect waste pipe by means of an air break or an air gap.

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE / SECTION 802 INDIRECT WASTES / 802.1 Where required. / 802.1.6 Domestic dishwashing machines.

802.1.6 Domestic dishwashing machines.

Domestic dishwashing machines shall discharge indirectly through an air gap or air break into a standpipe or waste receptor in accordance with Section 802.2, or discharge into a wye-branch fitting on the tailpiece of the kitchen sink or the dishwasher connection of a food waste grinder. The waste line of a domestic dishwashing machine discharging into a kitchen sink tailpiece or food waste grinder shall connect to a deck-mounted air gap or the waste line shall rise and be securely fastened to the underside of the sink rim or counter.

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE / SECTION 802 INDIRECT WASTES / 802.1 Where required. / 802.1.7 Commercial dishwashing machines.

802.1.7 Commercial dishwashing machines.

The discharge from a commercial dishwashing machine shall be through an air gap or air break into a standpipe or waste receptor in accordance with Section 802.2.

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE / SECTION 802 INDIRECT WASTES / 802.2 Installation.

802.2 Installation.

All indirect waste piping shall discharge through an air gap or air break into a waste receptor or standpipe. Waste receptors and standpipes shall be trapped and vented and shall connect to the building drainage system. All indirect waste piping that exceeds 2 feet (610 mm) in developed length measured horizontally, or 4 feet (1219 mm) in total developed length, shall be trapped.

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE / SECTION 802 INDIRECT WASTES / 802.2 Installation. / 802.2.1 Air gap.

802.2.1 Air gap.

The air gap between the indirect waste pipe and the flood level rim of the waste receptor shall be a minimum of twice the effective opening of the indirect waste pipe.

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE / SECTION 802 INDIRECT WASTES / 802.2 Installation. / 802.2.2 Air break.

802.2.2 Air break.

An air break shall be provided between the indirect waste pipe and the trap seal of the waste receptor or standpipe.

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE / SECTION 802 INDIRECT WASTES / 802.3 Waste receptors.

802.3 Waste receptors.

Every waste receptor shall be of an approved type. A removable strainer or basket shall cover the waste outlet of waste receptors. Waste receptors shall be installed in ventilated spaces. Waste receptors shall not be installed in bathrooms or toilet rooms or in any inaccessible or unventilated space such as a closet or storeroom. Ready access shall be provided to waste receptors.

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE / SECTION 802 INDIRECT WASTES / 802.3 Waste receptors. / 802.3.1 Size of receptors.

802.3.1 Size of receptors.

A waste receptor shall be sized for the maximum discharge of all indirect waste pipes served by the receptor. Receptors shall be installed to prevent splashing or flooding.

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE / SECTION 802 INDIRECT WASTES / 802.3 Waste receptors. / 802.3.2 Open hub waste receptors.

802.3.2 Open hub waste receptors.

Waste receptors shall be permitted in the form of a hub or pipe extending not less than 1 inch (25.4 mm) above a water-impervious floor and are not required to have a strainer.

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE / SECTION 802 INDIRECT WASTES / 802.4 Standpipes.

802.4 Standpipes.

Standpipes shall be individually trapped. Standpipes shall extend a minimum of 18 inches (457 mm) and a maximum of 42 inches (1066 mm) above the trap weir. Access shall be provided to all standpipes and drains for rodding.

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE / SECTION 803 SPECIAL WASTES

SECTION 803

SPECIAL WASTES

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE / SECTION 803 SPECIAL WASTES / 803.1 Wastewater temperature.

803.1 Wastewater temperature.

Steam pipes shall not connect to any part of a drainage or plumbing system and water above 140°F (60°C) shall not be discharged into any part of a drainage system. Such pipes shall discharge into an indirect waste receptor connected to the drainage system.

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE / SECTION 803 SPECIAL WASTES / 803.2 Neutralizing device required for corrosive wastes.

803.2 Neutralizing device required for corrosive wastes.

Corrosive liquids, spent acids or other harmful chemicals that destroy or injure a drain, sewer, soil or waste pipe, or create noxious or toxic fumes or interfere with sewage treatment processes shall not be discharged into the plumbing system without being thoroughly diluted, neutralized or treated by passing through an approved dilution or neutralizing device. Such devices shall be automatically provided with a sufficient supply of diluting water or neutralizing medium so as to make the contents noninjurious before discharge into the drainage system. The nature of the corrosive or harmful waste and the method of its treatment or dilution shall be approved prior to installation.

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE / SECTION 803 SPECIAL WASTES / 803.3 System design.

803.3 System design.

A chemical drainage and vent system shall be designed and installed in accordance with this code. Chemical drainage and vent systems shall be completely separated from the sanitary systems. Chemical waste shall not discharge to a sanitary drainage system until such waste has been treated in accordance with Section 803.2.

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE / SECTION 804 MATERIALS, JOINTS AND CONNECTIONS

SECTION 804 MATERIALS, JOINTS AND CONNECTIONS

2006 International Plumbing Code / CHAPTER 8 INDIRECT/SPECIAL WASTE /

SECTION 804 MATERIALS, JOINTS AND CONNECTIONS / 804.1 General.

804.1 General.

The materials and methods utilized for the construction and installation of indirect waste pipes and systems shall comply with the applicable provisions of Chapter 7.

2006 International Plumbing Code / CHAPTER 9 VENTS

**CHAPTER 9
VENTS**

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 901 GENERAL

**SECTION 901
GENERAL**

**2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 901 GENERAL /
901.1 Scope.**

901.1 Scope.

The provisions of this chapter shall govern the materials, design, construction and installation of vent systems.

**2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 901 GENERAL /
901.2 Trap seal protection.**

901.2 Trap seal protection.

The plumbing system shall be provided with a system of vent piping that will permit the admission or emission of air so that the seal of any fixture trap shall not be subjected to a pneumatic pressure differential of more than 1 inch of water column (249 Pa).

**2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 901 GENERAL /
901.2 Trap seal protection. / 901.2.1 Venting required.**

901.2.1 Venting required.

Every trap and trapped fixture shall be vented in accordance with one of the venting methods specified in this chapter.

**2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 901 GENERAL /
901.3 Chemical waste vent system.**

901.3 Chemical waste vent system.

The vent system for a chemical waste system shall be independent of the sanitary vent system and shall terminate separately through the roof to the open air.

**2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 901 GENERAL /
901.4 Use limitations.**

901.4 Use limitations.

The plumbing vent system shall not be utilized for purposes other than the venting of the plumbing system.

**2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 901 GENERAL /
901.5 Tests.**

901.5 Tests.

The vent system shall be tested in accordance with Section 312.

**2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 901 GENERAL /
901.6 Engineered systems.**

901.6 Engineered systems.

Engineered venting systems shall conform to the provisions of Section 918.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 902 MATERIALS

**SECTION 902
MATERIALS**

**2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 902 MATERIALS /
902.1 Vents.**

902.1 Vents.

The materials and methods utilized for the construction and installation of venting systems shall comply with the applicable provisions of Section 702.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 902 MATERIALS /

902.2 Sheet copper.

902.2 Sheet copper.

Sheet copper for vent pipe flashings shall conform to ASTM B 152 and shall weigh not less than 8 ounces per square foot (2.5 kg/m²).

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 902 MATERIALS / 902.3 Sheet lead.

902.3 Sheet lead.

Sheet lead for vent pipe flashings shall weigh not less than 3 pounds per square foot (15 kg/m²) for field-constructed flashings and not less than 2.5 pounds per square foot (12 kg/m²) for prefabricated flashings.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 903 OUTDOOR VENT EXTENSION

**SECTION 903
OUTDOOR VENT EXTENSION**

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 903 OUTDOOR VENT EXTENSION / 903.1 Required vent extension.

903.1 Required vent extension.

The vent system serving each building drain shall have at least one vent pipe that extends to the outdoors.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 903 OUTDOOR VENT EXTENSION / 903.1 Required vent extension. / 903.1.1 Installation.

903.1.1 Installation.

The required vent shall be a dry vent that connects to the building drain or an extension of a drain that connects to the building drain. Such vent shall not be an island fixture vent as allowed by Section 913.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 903 OUTDOOR VENT EXTENSION / 903.1 Required vent extension. / 903.1.2 Size.

903.1.2 Size.

The required vent shall be sized in accordance with Section 916.2 based on the required

size of the building drain.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 903 OUTDOOR VENT EXTENSION / 903.2 Vent stack required.

903.2 Vent stack required.

A vent stack shall be required for every drainage stack that has five branch intervals or more.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 903 OUTDOOR VENT EXTENSION / 903.3 Vent termination.

903.3 Vent termination.

Every vent stack or stack vent shall terminate outdoors to the open air or to a stack-type air admittance valve in accordance with Section 917.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 903 OUTDOOR VENT EXTENSION / 903.4 Vent connection at base.

903.4 Vent connection at base.

Every vent stack shall connect to the base of the drainage stack. The vent stack shall connect at or below the lowest horizontal branch. Where the vent stack connects to the building drain, the connection shall be located downstream of the drainage stack and within a distance of 10 times the diameter of the drainage stack.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 903 OUTDOOR VENT EXTENSION / 903.5 Vent headers.

903.5 Vent headers.

Stack vents and vent stacks connected into a common vent header at the top of the stacks and extending to the open air at one point shall be sized in accordance with the requirements of Section 916.1. The number of fixture units shall be the sum of all fixture units on all stacks connected thereto, and the developed length shall be the longest vent length from the intersection at the base of the most distant stack to the vent terminal in the open air, as a direct extension of one stack.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 904 VENT TERMINALS

**SECTION 904
VENT TERMINALS**

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 904 VENT TERMINALS / 904.1 Roof extension.

904.1 Roof extension.

All open vent pipes that extend through a roof shall be terminated at least [NUMBER] inches (mm) above the roof, except that where a roof is to be used for any purpose other than weather protection, the vent extensions shall be run at least 7 feet (2134 mm) above the roof.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 904 VENT TERMINALS / 904.2 Frost closure.

904.2 Frost closure.

Where the 97.5-percent value for outside design temperature is 0°F (-18°C) or less, every vent extension through a roof or wall shall be a minimum of 3 inches (76 mm) in diameter. Any increase in the size of the vent shall be made inside the structure a minimum of 1 foot (305 mm) below the roof or inside the wall.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 904 VENT TERMINALS / 904.3 Flashings.

904.3 Flashings.

The juncture of each vent pipe with the roof line shall be made water tight by an approved flashing.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 904 VENT TERMINALS / 904.4 Prohibited use.

904.4 Prohibited use.

Vent terminals shall not be used as a flag pole or to support flag poles, television aerials or similar items, except when the piping has been anchored in an approved manner.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 904 VENT TERMINALS / 904.5 Location of vent terminal.

904.5 Location of vent terminal.

An open vent terminal from a drainage system shall not be located directly beneath any door, openable window, or other air intake opening of the building or of an adjacent building, and any such vent terminal shall not be within 10 feet (3048 mm) horizontally of such an opening unless it is at least 2 feet (610 mm) above the top of such opening.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 904 VENT TERMINALS / 904.6 Extension through the wall.

904.6 Extension through the wall.

Vent terminals extending through the wall shall terminate a minimum of 10 feet (3048 mm) from the lot line and 10 feet (3048 mm) above average ground level. Vent terminals shall not terminate under the overhang of a structure with soffit vents. Side wall vent terminals shall be protected to prevent birds or rodents from entering or blocking the vent opening.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 904 VENT TERMINALS / 904.7 Extension outside a structure.

904.7 Extension outside a structure.

In climates where the 97.5-percent value for outside design temperature is less than 0°F (-18°C), vent pipes installed on the exterior of the structure shall be protected against freezing by insulation, heat or both.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 905 VENT CONNECTIONS AND GRADES

**SECTION 905
VENT CONNECTIONS AND GRADES**

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 905 VENT CONNECTIONS AND GRADES / 905.1 Connection.

905.1 Connection.

All individual, branch and circuit vents shall connect to a vent stack, stack vent, air admittance valve or extend to the open air.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 905 VENT CONNECTIONS AND GRADES / 905.2 Grade.

905.2 Grade.

All vent and branch vent pipes shall be so graded and connected as to drain back to the drainage pipe by gravity.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 905 VENT CONNECTIONS AND GRADES / 905.3 Vent connection to drainage system.

905.3 Vent connection to drainage system.

Every dry vent connecting to a horizontal drain shall connect above the centerline of the horizontal drain pipe.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 905 VENT CONNECTIONS AND GRADES / 905.4 Vertical rise of vent.

905.4 Vertical rise of vent.

Every dry vent shall rise vertically to a minimum of 6 inches (152 mm) above the flood level rim of the highest trap or trapped fixture being vented.

Exception: Vents for interceptors located outdoors.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 905 VENT CONNECTIONS AND GRADES / 905.5 Height above fixtures.

905.5 Height above fixtures.

A connection between a vent pipe and a vent stack or stack vent shall be made at least 6 inches (152 mm) above the flood level rim of the highest fixture served by the vent. Horizontal vent pipes forming branch vents, relief vents or loop vents shall be at least 6 inches (152 mm) above the flood level rim of the highest fixture served.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 905 VENT CONNECTIONS AND GRADES / 905.6 Vent for future fixtures.

905.6 Vent for future fixtures.

Where the drainage piping has been roughed-in for future fixtures, a rough-in connection for a vent shall be installed. The vent size shall be not less than one-half the diameter of the rough-in drain to be served. The vent rough-in shall connect to the vent system, or shall be vented by other means as provided for in this chapter. The connection shall be identified to indicate that it is a vent.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 906 FIXTURE VENTS

**SECTION 906
FIXTURE VENTS**

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 906 FIXTURE VENTS / 906.1 Distance of trap from vent.

906.1 Distance of trap from vent.

Each fixture trap shall have a protecting vent located so that the slope and the developed length in the fixture drain from the trap weir to the vent fitting are within the requirements set forth in Table 906.1.

Exception: The developed length of the fixture drain from the trap weir to the vent fitting for self-siphoning fixtures, such as water closets, shall not be limited.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 906 FIXTURE VENTS / 906.1 Distance of trap from vent. / TABLE 906.1 MAXIMUM DISTANCE OF FIXTURE TRAP FROM VENT

**TABLE 906.1
MAXIMUM DISTANCE OF FIXTURE TRAP FROM VENT**

SIZE OF TRAP (inches)	SLOPE (inch per foot)	DISTANCE FROM TRAP (feet)
1¼	¼	5
1½	¼	6
2	¼	8
3	1/8	12
4	1/8	16

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm,
1 inch per foot = 83.3 mm/m.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 906 FIXTURE VENTS / 906.2 Venting of fixture drains.

906.2 Venting of fixture drains.

The total fall in a fixture drain due to pipe slope shall not exceed the diameter of the fixture drain, nor shall the vent connection to a fixture drain, except for water closets, be below the weir of the trap.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 906 FIXTURE VENTS / 906.3 Crown vent.

906.3 Crown vent.

A vent shall not be installed within two pipe diameters of the trap weir.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 907 INDIVIDUAL VENT

**SECTION 907
INDIVIDUAL VENT**

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 907 INDIVIDUAL VENT / 907.1 Individual vent permitted.

907.1 Individual vent permitted.

Each trap and trapped fixture is permitted to be provided with an individual vent. The individual vent shall connect to the fixture drain of the trap or trapped fixture being vented.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 908 COMMON VENT

**SECTION 908
COMMON VENT**

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 908 COMMON VENT / 908.1 Individual vent as common vent.

908.1 Individual vent as common vent.

An individual vent is permitted to vent two traps or trapped fixtures as a common vent. The traps or trapped fixtures being common vented shall be located on the same floor level.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 908 COMMON VENT / 908.2 Connection at the same level.

908.2 Connection at the same level.

Where the fixture drains being common vented connect at the same level, the vent connection shall be at the interconnection of the fixture drains or downstream of the interconnection.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 908 COMMON VENT / 908.3 Connection at different levels.

908.3 Connection at different levels.

Where the fixture drains connect at different levels, the vent shall connect as a vertical extension of the vertical drain. The vertical drain pipe connecting the two fixture drains shall be considered the vent for the lower fixture drain, and shall be sized in accordance with Table 908.3. The upper fixture shall not be a water closet.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 908 COMMON VENT / 908.3 Connection at different levels. / TABLE 908.3 COMMON VENT SIZES

**TABLE 908.3
COMMON VENT SIZES**

PIPE SIZE (inches)	MAXIMUM DISCHARGE FROM UPPER FIXTURE DRAIN (dfu)
1½	1
2	4
2½ to 3	6

For SI: 1 inch = 25.4 mm.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 909 WET VENTING

**SECTION 909
WET VENTING**

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 909 WET VENTING / 909.1 Horizontal wet vent permitted.

909.1 Horizontal wet vent permitted.

Any combination of fixtures within two bathroom groups located on the same floor level is permitted to be vented by a horizontal wet vent. The wet vent shall be considered the vent for the fixtures and shall extend from the connection of the dry vent along the direction of the flow in the drain pipe to the most downstream fixture drain connection to the horizontal branch drain. Only the fixtures within the bathroom groups shall connect to the wet-vented horizontal branch drain. Any additional fixtures shall discharge downstream of the horizontal wet vent.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 909 WET VENTING / 909.1 Horizontal wet vent permitted. / 909.1.1 Vertical wet vent permitted.

909.1.1 Vertical wet vent permitted.

Any combination of fixtures within two bathroom groups located on the same floor level is permitted to be vented by a vertical wet vent. The vertical wet vent shall be considered the vent for the fixtures and shall extend from the connection of the dry vent down to the lowest fixture drain connection. Each wet-vented fixture shall connect independently to the vertical wet vent. Water closet drains shall connect at the same elevation. Other fixture drains shall connect above or at the same elevation as the water closet fixture drains. The dry-vent connection to the vertical wet vent shall be an individual or common vent serving one or two

fixtures.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 909 WET VENTING / 909.2 Vent connection.

909.2 Vent connection.

The dry-vent connection to the wet vent shall be an individual vent or common vent to the lavatory, bidet, shower or bathtub. In vertical wet-vent systems, the most upstream fixture drain connection shall be a dry-vented fixture drain connection. In horizontal wet-vent systems, not more than one wet-vented fixture drain shall discharge upstream of the dry-vented fixture drain connection.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 909 WET VENTING / 909.3 Size.

909.3 Size.

The dry vent serving the wet vent shall be sized based on the largest required diameter of pipe within the wet- vent system served by the dry vent. The wet vent shall be of a minimum size as specified in Table 909.3, based on the fixture unit discharge to the wet vent.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 909 WET VENTING / 909.3 Size. / TABLE 909.3 WET VENT SIZE

**TABLE 909.3
WET VENT SIZE**

WET VENT PIPE SIZE (inches)	DRAINAGE FIXTURE UNIT LOAD (dfu)
1½	1
2	4
2½	6
3	12

For SI: 1 inch = 25.4 mm.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 910 WASTE STACK VENT

**SECTION 910
WASTE STACK VENT**

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 910 WASTE STACK VENT / 910.1 Waste stack vent permitted.

910.1 Waste stack vent permitted.

A waste stack shall be considered a vent for all of the fixtures discharging to the stack where installed in accordance with the requirements of this section.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 910 WASTE STACK VENT / 910.2 Stack installation.

910.2 Stack installation.

The waste stack shall be vertical, and both horizontal and vertical offsets shall be prohibited between the lowest fixture drain connection and the highest fixture drain connection. Every fixture drain shall connect separately to the waste stack. The stack shall not receive the discharge of water closets or urinals.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 910 WASTE STACK VENT / 910.3 Stack vent.

910.3 Stack vent.

A stack vent shall be provided for the waste stack. The size of the stack vent shall be not less than the size of the waste stack. Offsets shall be permitted in the stack vent, shall be located at least 6 inches (152 mm) above the flood level of the highest fixture and shall be in accordance with Section 905.2. The stack vent shall be permitted to connect with other stack vents and vent stacks in accordance with Section 903.5.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 910 WASTE STACK VENT / 910.4 Waste stack size.

910.4 Waste stack size.

The waste stack shall be sized based on the total discharge to the stack and the discharge within a branch interval in accordance with Table 910.4. The waste stack shall be the same size throughout its length.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 910 WASTE STACK VENT / 910.4 Waste stack size. / TABLE 910.4 WASTE STACK VENT SIZE

**TABLE 910.4
WASTE STACK VENT SIZE**

STACK SIZE (inches)	MAXIMUM NUMBER OF DRAINAGE FIXTURE UNITS (dfu)	
	Total discharge into one branch interval	Total discharge for stack

I-Quest 2006 Codes Complete Collection

1½	1	2
2	2	4
2½	No limit	8
3	No limit	24
4	No limit	50
5	No limit	75
6	No limit	100

For SI: 1 inch = 25.4 mm.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 911 CIRCUIT VENTING

**SECTION 911
CIRCUIT VENTING**

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 911 CIRCUIT VENTING / 911.1 Circuit vent permitted.

911.1 Circuit vent permitted.

A maximum of eight fixtures connected to a horizontal branch drain shall be permitted to be circuit vented. Each fixture drain shall connect horizontally to the horizontal branch being circuit vented. The horizontal branch drain shall be classified as a vent from the most downstream fixture drain connection to the most upstream fixture drain connection to the horizontal branch.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 911 CIRCUIT VENTING / 911.1 Circuit vent permitted. / 911.1.1 Multiple circuit-vented branches.

911.1.1 Multiple circuit-vented branches.

Circuit-vented horizontal branch drains are permitted to be connected together. Each group of a maximum of eight fixtures shall be considered a separate circuit vent and shall conform to the requirements of this section.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 911 CIRCUIT VENTING / 911.2 Vent connection.

911.2 Vent connection.

The circuit vent connection shall be located between the two most upstream fixture drains. The vent shall connect to the horizontal branch and shall be installed in accordance with Section 905. The circuit vent pipe shall not receive the discharge of any soil or waste.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 911 CIRCUIT VENTING / 911.3 Slope and size of horizontal branch.

911.3 Slope and size of horizontal branch.

The maximum slope of the vent section of the horizontal branch drain shall be one unit vertical in 12 units horizontal (8-percent slope). The entire length of the vent section of the horizontal branch drain shall be sized for the total drainage discharge to the branch.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 911 CIRCUIT VENTING / 911.3 Slope and size of horizontal branch. / 911.3.1 Size of multiple circuit vent.

911.3.1 Size of multiple circuit vent.

Each separate circuit-vented horizontal branch that is interconnected shall be sized independently in accordance with Section 911.3. The downstream circuit-vented horizontal branch shall be sized for the total discharge into the branch, including the upstream branches and the fixtures within the branch.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 911 CIRCUIT VENTING / 911.4 Relief vent.

911.4 Relief vent.

A relief vent shall be provided for circuit-vented horizontal branches receiving the discharge of four or more water closets and connecting to a drainage stack that receives the discharge of soil or waste from upper horizontal branches.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 911 CIRCUIT VENTING / 911.4 Relief vent. / 911.4.1 Connection and installation.

911.4.1 Connection and installation.

The relief vent shall connect to the horizontal branch drain between the stack and the most downstream fixture drain of the circuit vent. The relief vent shall be installed in accordance with Section 905.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 911 CIRCUIT VENTING / 911.4 Relief vent. / 911.4.2 Fixture drain or branch.

911.4.2 Fixture drain or branch.

The relief vent is permitted to be a fixture drain or fixture branch for fixtures located within the same branch interval as the circuit-vented horizontal branch. The maximum discharge to a relief vent shall be four fixture units.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 911 CIRCUIT VENTING / 911.5 Additional fixtures.

911.5 Additional fixtures.

Fixtures, other than the circuit-vented fixtures, are permitted to discharge to the horizontal branch drain. Such fixtures shall be located on the same floor as the circuit-vented fixtures and shall be either individually or common vented.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 912 COMBINATION DRAIN AND VENT SYSTEM

**SECTION 912
COMBINATION DRAIN AND VENT SYSTEM**

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 912 COMBINATION DRAIN AND VENT SYSTEM / 912.1 Type of fixtures.

912.1 Type of fixtures.

A combination drain and vent system shall not serve fixtures other than floor drains, sinks, lavatories and drinking fountains. Combination drain and vent systems shall not receive the discharge from a food waste grinder or clinical sink.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 912 COMBINATION DRAIN AND VENT SYSTEM / 912.2 Installation.

912.2 Installation.

The only vertical pipe of a combination drain and vent system shall be the connection between the fixture drain and the horizontal combination drain and vent pipe. The maximum vertical distance shall be 8 feet (2438 mm).

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 912 COMBINATION DRAIN AND VENT SYSTEM / 912.2 Installation. / 912.2.1 Slope.

912.2.1 Slope.

The horizontal combination drain and vent pipe shall have a maximum slope of one-half unit vertical in 12 units horizontal (4-percent slope). The minimum slope shall be in accordance with Table 704.1.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 912

COMBINATION DRAIN AND VENT SYSTEM / 912.2 Installation. / 912.2.2 Connection.

912.2.2 Connection.

The combination drain and vent system shall be provided with a dry vent connected at any point within the system or the system shall connect to a horizontal drain that is vented in accordance with one of the venting methods specified in this chapter. Combination drain and vent systems connecting to building drains receiving only the discharge from a stack or stacks shall be provided with a dry vent. The vent connection to the combination drain and vent pipe shall extend vertically a minimum of 6 inches (152 mm) above the flood level rim of the highest fixture being vented before offsetting horizontally.

**2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 912
COMBINATION DRAIN AND VENT SYSTEM / 912.2 Installation. / 912.2.3 Vent size.**

912.2.3 Vent size.

The vent shall be sized for the total drainage fixture unit load in accordance with Section 916.2.

**2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 912
COMBINATION DRAIN AND VENT SYSTEM / 912.2 Installation. / 912.2.4 Fixture branch or drain.**

912.2.4 Fixture branch or drain.

The fixture branch or fixture drain shall connect to the combination drain and vent within a distance specified in Table 906.1. The combination drain and vent pipe shall be considered the vent for the fixture.

**2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 912
COMBINATION DRAIN AND VENT SYSTEM / 912.3 Size.**

912.3 Size.

The minimum size of a combination drain and vent pipe shall be in accordance with Table 912.3.

**2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 912
COMBINATION DRAIN AND VENT SYSTEM / 912.3 Size. / TABLE 912.3 SIZE OF
COMBINATION DRAIN AND VENT PIPE**

**TABLE 912.3
SIZE OF COMBINATION DRAIN AND VENT PIPE**

DIAMETER PIPE	MAXIMUM NUMBER OF DRAINAGE FIXTURE UNITS (dfu)	
	Connecting to a horizontal branch or	Connecting to a building drain or

SIZE OF COMBINATION DRAIN AND VENT PIPE

DIAMETER PIPE (inches)	MAXIMUM NUMBER OF DRAINAGE FIXTURE UNITS (dfu)	
	Connecting to a horizontal branch or stack	Connecting to a building drain or building subdrain
2	3	4
2½	6	26
3	12	31
4	20	50
5	160	250
6	360	575

For SI: 1 inch = 25.4 mm.

**2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 913 ISLAND
FIXTURE VENTING**

**SECTION 913
ISLAND FIXTURE VENTING**

**2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 913 ISLAND
FIXTURE VENTING / 913.1 Limitation.**

913.1 Limitation.

Island fixture venting shall not be permitted for fixtures other than sinks and lavatories. Residential kitchen sinks with a dishwasher waste connection, a food waste grinder, or both, in combination with the kitchen sink waste, shall be permitted to be vented in accordance with this section.

**2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 913 ISLAND
FIXTURE VENTING / 913.2 Vent connection.**

913.2 Vent connection.

The island fixture vent shall connect to the fixture drain as required for an individual or common vent. The vent shall rise vertically to above the drainage outlet of the fixture being vented before offsetting horizontally or vertically downward. The vent or branch vent for multiple island fixture vents shall extend to a minimum of 6 inches (152 mm) above the highest island fixture being vented before connecting to the outside vent terminal.

**2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 913 ISLAND
FIXTURE VENTING / 913.3 Vent installation below the fixture flood level rim.**

913.3 Vent installation below the fixture flood level rim.

The vent located below the flood level rim of the fixture being vented shall be installed as required for drainage piping in accordance with Chapter 7, except for sizing. The vent shall be sized in accordance with Section 916.2. The lowest point of the island fixture vent shall connect full size to the drainage system. The connection shall be to a vertical drain pipe or to the top half of a horizontal drain pipe. Cleanouts shall be provided in the island fixture vent to permit rodding of all vent piping located below the flood level rim of the fixtures. Rodding in both directions shall be permitted through a cleanout.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 914 RELIEF VENTS—STACKS OF MORE THAN 10 BRANCH INTERVALS

**SECTION 914
RELIEF VENTS—STACKS OF MORE THAN
10 BRANCH INTERVALS**

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 914 RELIEF VENTS—STACKS OF MORE THAN 10 BRANCH INTERVALS / 914.1 Where required.

914.1 Where required.

Soil and waste stacks in buildings having more than 10 branch intervals shall be provided with a relief vent at each tenth interval installed, beginning with the top floor.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 914 RELIEF VENTS—STACKS OF MORE THAN 10 BRANCH INTERVALS / 914.2 Size and connection.

914.2 Size and connection.

The size of the relief vent shall be equal to the size of the vent stack to which it connects. The lower end of each relief vent shall connect to the soil or waste stack through a wye below the horizontal branch serving the floor, and the upper end shall connect to the vent stack through a wye not less than 3 feet (914 mm) above the floor.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 915 VENTS FOR STACK OFFSETS

**SECTION 915
VENTS FOR STACK OFFSETS**

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 915 VENTS FOR STACK OFFSETS / 915.1 Vent for horizontal offset of drainage stack.

915.1 Vent for horizontal offset of drainage stack.

Horizontal offsets of drainage stacks shall be vented where five or more branch intervals are located above the offset. The offset shall be vented by venting the upper section of the drainage stack and the lower section of the drainage stack.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 915 VENTS FOR STACK OFFSETS / 915.2 Upper section.

915.2 Upper section.

The upper section of the drainage stack shall be vented as a separate stack with a vent stack connection installed in accordance with Section 903.4. The offset shall be considered the base of the stack.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 915 VENTS FOR STACK OFFSETS / 915.3 Lower section.

915.3 Lower section.

The lower section of the drainage stack shall be vented by a yoke vent connecting between the offset and the next lower horizontal branch. The yoke vent connection shall be permitted to be a vertical extension of the drainage stack. The size of the yoke vent and connection shall be a minimum of the size required for the vent stack of the drainage stack.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 916 VENT PIPE SIZING

**SECTION 916
VENT PIPE SIZING**

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 916 VENT PIPE SIZING / 916.1 Size of stack vents and vent stacks.

916.1 Size of stack vents and vent stacks.

The minimum required diameter of stack vents and vent stacks shall be determined from the developed length and the total of drainage fixture units connected thereto in accordance with Table 916.1, but in no case shall the diameter be less than one-half the diameter of the drain served or less than 1¼ inches (32 mm).

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 916 VENT PIPE SIZING / 916.1 Size of stack vents and vent stacks. / TABLE 916.1

**TABLE 916.1
SIZE AND DEVELOPED LENGTH OF STACK VENTS AND VENT STACKS**

DIAMETER OF SOIL OR WASTE STACK (inches)	TOTAL FIXTURE UNITS BEING VENTED (dfu)	MAXIMUM DEVELOPED LENGTH OF VENT (feet) ^a DIAMETER OF VENT (inches)										
		1¼	1½	2	2½	3	4	5	6	8	10	12
1¼	2	30		—	—	—	—	—	—	—	—	—
1½	8	50	150									
1½	10	30	100									
2	12	30	75	200		—	—	—	—	—	—	—
2	20	26	50	150								
2½	42		30	100	300							
3	10	—	42	150	360	1,040	—	—	—	—	—	—
3	21		32	110	270	810						
3	53		27	94	230	680						
3	102	—	25	86	210	620	—	—	—	—	—	—
4	43			35	85	250	980					
4	140			27	65	200	750					
4	320	—	—	23	55	170	640	—	—	—	—	—
4	540			21	50	150	580					
5	190				28	82	320	990				
5	490	—	—	—	21	63	250	760	—	—	—	—
5	940				18	53	210	670				
5	1,400				16	49	190	590				
6	500	—	—	—	—	33	130	400	1,000	—	—	—
6	1,100					26	100	310	780			
6	2,000					22	84	260	660			
6	2,900	—	—	—	—	20	77	240	600	940	—	—
8	1,800						31	95	240	720		
8	3,400						24	73	190			

(continued)

DIAMETER OF SOIL OR WASTE STACK (inches)	TOTAL FIXTURE UNITS BEING VENTED (dfu)	MAXIMUM DEVELOPED LENGTH OF VENT (feet) ^a DIAMETER OF VENT (inches)										
		1¼	1½	2	2½	3	4	5	6	8	10	12
8	5,600			—	—	—	20	62	160	610		—
8	7,600	—	—				18	56	140	560		
10	4,000							31	78	310	960	
10	7,200					—		24	60	240	740	—
10	11,000	—	—	—	—			20	51	200	630	
10	15,000							18	46	180	570	
12	7,300	—					—	—	31	120	380	940

I-Quest 2006 Codes Complete Collection

DIAMETER OF SOIL OR WASTE STACK (inches)	TOTAL FIXTURE UNITS BEING VENTED (dfu)	MAXIMUM DEVELOPED LENGTH OF VENT (feet) ^a										
		DIAMETER OF VENT (inches)										
		1¼	1½	2	2½	3	4	5	6	8	10	12
12	13,000		—	—	—	—			24	94	300	720
12	20,000								20	79	250	610
12	26,000	—						—	18	72	230	500
15	15,000		—	—	—	—	—			40	130	310
15	25,000									31	96	240
15	38,000	—	—	—	—	—	—	—	—	26	81	200
15	50,000									24	74	180

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm.

a. The developed length shall be measured from the vent connection to the open air.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 916 VENT PIPE SIZING / 916.2 Vents other than stack vents or vent stacks.

916.2 Vents other than stack vents or vent stacks.

The diameter of individual vents, branch vents, circuit vents and relief vents shall be at least one-half the required diameter of the drain served. The required size of the drain shall be determined in accordance with Table 710.1(2). Vent pipes shall not be less than 1¼ inches (32 mm) in diameter. Vents exceeding 40 feet (12 192 mm) in developed length shall be increased by one nominal pipe size for the entire developed length of the vent pipe. Relief vents for soil and waste stacks in buildings having more than 10 branch intervals shall be sized in accordance with Section 914.2.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 916 VENT PIPE SIZING / 916.3 Developed length.

916.3 Developed length.

The developed length of individual, branch, circuit and relief vents shall be measured from the farthest point of vent connection to the drainage system to the point of connection to the vent stack, stack vent or termination outside of the building.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 916 VENT PIPE SIZING / 916.4 Multiple branch vents.

916.4 Multiple branch vents.

Where multiple branch vents are connected to a common branch vent, the common branch vent shall be sized in accordance with this section based on the size of the common horizontal drainage branch that is or would be required to serve the total drainage fixture unit (dfu) load

being vented.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 916 VENT PIPE SIZING / 916.4 Multiple branch vents. / 916.4.1 Branch vents exceeding 40 feet in developed length.

916.4.1 Branch vents exceeding 40 feet in developed length.

Branch vents exceeding 40 feet (12 192 mm) in developed length shall be increased by one nominal size for the entire developed length of the vent pipe.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 916 VENT PIPE SIZING / 916.5 Sump vents.

916.5 Sump vents.

Sump vent sizes shall be determined in accordance with Sections 916.5.1 and 916.5.2.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 916 VENT PIPE SIZING / 916.5 Sump vents. / 916.5.1 Sewage pumps and sewage ejectors other than pneumatic.

916.5.1 Sewage pumps and sewage ejectors other than pneumatic.

Drainage piping below sewer level shall be vented in a similar manner to that of a gravity system. Building sump vent sizes for sumps with sewage pumps or sewage ejectors, other than pneumatic, shall be determined in accordance with Table 916.5.1.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 916 VENT PIPE SIZING / 916.5 Sump vents. / 916.5.1 Sewage pumps and sewage ejectors other than pneumatic. / TABLE 916.5.1 SIZE AND LENGTH OF SUMP VENTS

**TABLE 916.5.1
SIZE AND LENGTH OF SUMP VENTS**

DISCHARGE CAPACITY OF PUMP (gpm)	MAXIMUM DEVELOPED LENGTH OF VENT (feet) ^a					
	Diameter of vent (inches)					
	1¼	1½	2	2½	3	4
10	No limit ^b	No limit	No limit	No limit	No limit	No limit
20	270	No limit	No limit	No limit	No limit	No limit
40	72	160	No limit	No limit	No limit	No limit
60	31	75	270	No limit	No limit	No limit
80	16	41	150	380	No limit	No limit
100	10 ^c	25	97	250	No limit	No limit
150	Not permitted	10 ^c	44	110	370	No limit

I-Quest 2006 Codes Complete Collection

DISCHARGE CAPACITY OF PUMP (gpm)	MAXIMUM DEVELOPED LENGTH OF VENT (feet) ^a					
	Diameter of vent (inches)					
	1¼	1½	2	2½	3	4
200	Not permitted	Not permitted	20	60	210	No limit
250	Not permitted	Not permitted	10	36	132	No limit
300	Not permitted	Not permitted	10 ^c	22	88	380
400	Not permitted	Not permitted	Not permitted	10 ^c	44	210
500	Not permitted	Not permitted	Not permitted	Not permitted	24	130

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 gallon per minute = 3.785 L/m.

- Developed length plus an appropriate allowance for entrance losses and friction due to fittings, changes in direction and diameter. Suggested allowances shall be obtained from NSB Monograph 31 or other approved sources. An allowance of 50 percent of the developed length shall be assumed if a more precise value is not available.
- Actual values greater than 500 feet.
- Less than 10 feet.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 916 VENT PIPE SIZING / 916.5 Sump vents. / 916.5.2 Pneumatic sewage ejectors.

916.5.2 Pneumatic sewage ejectors.

The air pressure relief pipe from a pneumatic sewage ejector shall be connected to an independent vent stack terminating as required for vent extensions through the roof. The relief pipe shall be sized to relieve air pressure inside the ejector to atmospheric pressure, but shall not be less than 1¼ inches (32 mm) in size.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 917 AIR ADMITTANCE VALVES

**SECTION 917
AIR ADMITTANCE VALVES**

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 917 AIR ADMITTANCE VALVES / 917.1 General.

917.1 General.

Vent systems utilizing air admittance valves shall comply with this section. Stack-type air admittance valves shall conform to ASSE 1050. Individual and branch-type air admittance valves shall conform to ASSE 1051.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 917 AIR ADMITTANCE VALVES / 917.2 Installation.

917.2 Installation.

The valves shall be installed in accordance with the requirements of this section and the manufacturer's installation instructions. Air admittance valves shall be installed after the DWV testing required by Section 312.2 or 312.3 has been performed.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 917 AIR ADMITTANCE VALVES / 917.3 Where permitted.

917.3 Where permitted.

Individual, branch and circuit vents shall be permitted to terminate with a connection to an individual or branch-type air admittance valve. Stack vents and vent stacks shall be permitted to terminate to stack-type air admittance valves. Individual and branch-type air admittance valves shall vent only fixtures that are on the same floor level and connect to a horizontal branch drain. The horizontal branch drain having individual and branch-type air admittance valves shall conform to Section 917.3.1 or 917.3.2. Stack-type air admittance valves shall conform to Section 917.3.3.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 917 AIR ADMITTANCE VALVES / 917.3 Where permitted. / 917.3.1 Location of branch.

917.3.1 Location of branch.

The horizontal branch drain shall connect to the drainage stack or building drain a maximum of four branch intervals from the top of the stack.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 917 AIR ADMITTANCE VALVES / 917.3 Where permitted. / 917.3.2 Relief vent.

917.3.2 Relief vent.

Where the horizontal branch is located more than four branch intervals from the top of the stack, the horizontal branch shall be provided with a relief vent that shall connect to a vent stack or stack vent, or extend outdoors to the open air. The relief vent shall connect to the horizontal branch drain between the stack and the most downstream fixture drain connected to the horizontal branch drain. The relief vent shall be sized in accordance with Section 916.2 and installed in accordance with Section 905. The relief vent shall be permitted to serve as the vent for other fixtures.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 917 AIR ADMITTANCE VALVES / 917.3 Where permitted. / 917.3.3 Stack.

917.3.3 Stack.

Stack-type air admittance valves shall not serve as the vent terminal for vent stacks or stack vents that serve drainage stacks exceeding six branch intervals.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 917 AIR ADMITTANCE VALVES / 917.4 Location.

917.4 Location.

Individual and branch-type air admittance valves shall be located a minimum of 4 inches (102 mm) above the horizontal branch drain or fixture drain being vented. Stack-type air admittance valves shall be located not less than 6 inches (152 mm) above the flood level rim of the highest fixture being vented. The air admittance valve shall be located within the maximum developed length permitted for the vent. The air admittance valve shall be installed a minimum of 6 inches (152 mm) above insulation materials.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 917 AIR ADMITTANCE VALVES / 917.5 Access and ventilation.

917.5 Access and ventilation.

Access shall be provided to all air admittance valves. The valve shall be located within a ventilated space that allows air to enter the valve.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 917 AIR ADMITTANCE VALVES / 917.6 Size.

917.6 Size.

The air admittance valve shall be rated in accordance with the standard for the size of the vent to which the valve is connected.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 917 AIR ADMITTANCE VALVES / 917.7 Vent required.

917.7 Vent required.

Within each plumbing system, a minimum of one stack vent or vent stack shall extend outdoors to the open air.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 917 AIR ADMITTANCE VALVES / 917.8 Prohibited installations.

917.8 Prohibited installations.

Air admittance valves shall not be installed in nonneutralized special waste systems as

described in Chapter 8. Valves shall not be located in spaces utilized as supply or return air plenums.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 918 ENGINEERED VENT SYSTEMS

**SECTION 918
ENGINEERED VENT SYSTEMS**

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 918 ENGINEERED VENT SYSTEMS / 918.1 General.

918.1 General.

Engineered vent systems shall comply with this section and the design, submittal, approval, inspection and testing requirements of Section 105.4.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 918 ENGINEERED VENT SYSTEMS / 918.2 Individual branch fixture and individual fixture header vents.

918.2 Individual branch fixture and individual fixture header vents.

The maximum developed length of individual fixture vents to vent branches and vent headers shall be determined in accordance with Table 918.2 for the minimum pipe diameters at the indicated vent airflow rates.

The individual vent airflow rate shall be determined in accordance with the following:

$$Q_{h,b} = N_{n,b} Q_v \quad \text{(Equation 9-1)}$$

For SI: $Q_{h,b} = N_{n,b} Q_v$ (0.4719 L/s)

where:

$N_{n,b}$ = Number of fixtures per header (or vent branch) ÷ total number of fixtures connected to vent stack.

$Q_{h,b}$ = Vent branch or vent header airflow rate (cfm).

Q_v = Total vent stack airflow rate (cfm).

$$Q_v \text{ (gpm)} = 27.8 \left(\frac{rs}{s} \right)^{2/3} (1 - r_s) D^{8/3}$$

$$Q_v \text{ (cfm)} = 0.134 Q_v \text{ (gpm)}$$

where:

D = Drainage stack diameter (inches).

Q_w = Design discharge load (gpm).

r_s = Waste water flow area to total area.

$$= \frac{Q_w}{278 D^{8/3}}$$

Individual vent airflow rates are obtained by equally distributing $Q_{h,b}$ into one-half the total number of fixtures on the branch or header for more than two fixtures; for an odd number of total fixtures, decrease by one; for one fixture, apply the full value of $Q_{h,b}$.

Individual vent developed length shall be increased by 20 percent of the distance from the vent stack to the fixture vent connection on the vent branch or header.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 918 ENGINEERED VENT SYSTEMS / 918.2 Individual branch fixture and individual fixture header vents. / TABLE 918.2 MINIMUM DIAMETER AND MAXIMUM LENGTH OF INDIVIDUAL BRANCH FIXTURE VENTS AND INDIVIDUAL FIXTURE HEADER VENTS FOR SMOOTH PIPES

**TABLE 918.2
MINIMUM DIAMETER AND MAXIMUM LENGTH OF INDIVIDUAL BRANCH FIXTURE VENTS
AND
INDIVIDUAL FIXTURE HEADER VENTS FOR SMOOTH PIPES**

DIAMETER OF VENT PIPE (inches)	INDIVIDUAL VENT AIRFLOW RATE (cubic feet per minute)																			
	Maximum developed length of vent (feet)																			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
½	95	25	13	8	5	4	3	2	1	1	1	1	1	1	1	1	1	1	1	1
¾	100	88	47	30	20	15	10	9	7	6	5	4	3	3	3	2	2	2	2	1
1	—	—	100	94	65	48	37	29	24	20	17	14	12	11	9	8	7	7	6	6
1¼	—	—	—	—	—	—	—	100	87	73	62	53	46	40	36	32	29	26	23	21
1½	—	—	—	—	—	—	—	—	—	—	—	100	96	84	75	65	60	54	49	45
2	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	100

For SI: 1 inch = 25.4 mm, 1 cubic foot per minute = 0.4719 L/s, 1 foot = 304.8 mm.

2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 919

COMPUTERIZED VENT DESIGN

SECTION 919 COMPUTERIZED VENT DESIGN

**2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 919
COMPUTERIZED VENT DESIGN / 919.1 Design of vent system.**

919.1 Design of vent system.

The sizing, design and layout of the vent system shall be permitted to be determined by approved computer program design methods.

**2006 International Plumbing Code / CHAPTER 9 VENTS / SECTION 919
COMPUTERIZED VENT DESIGN / 919.2 System capacity.**

919.2 System capacity.

The vent system shall be based on the air capacity requirements of the drainage system under a peak load condition.

**2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND
SEPARATORS**

CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS

**2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND
SEPARATORS / SECTION 1001 GENERAL**

SECTION 1001 GENERAL

**2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND
SEPARATORS / SECTION 1001 GENERAL / 1001.1 Scope.**

1001.1 Scope.

This chapter shall govern the material and installation of traps, interceptors and separators.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1002 TRAP REQUIREMENTS

**SECTION 1002
TRAP REQUIREMENTS**

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1002 TRAP REQUIREMENTS / 1002.1 Fixture traps.

1002.1 Fixture traps.

Each plumbing fixture shall be separately trapped by a water-seal trap, except as otherwise permitted by this code. The vertical distance from the fixture outlet to the trap weir shall not exceed 24 inches (610 mm) and the horizontal distance shall not exceed 30 inches (610 mm) measured from the centerline of the fixture outlet to the centerline of the inlet of the trap. The height of a clothes washer standpipe above a trap shall conform to Section 802.4. A fixture shall not be double trapped.

Exceptions:

1. This section shall not apply to fixtures with integral traps.
2. A combination plumbing fixture is permitted to be installed on one trap, provided that one compartment is not more than 6 inches (152 mm) deeper than the other compartment and the waste outlets are not more than 30 inches (762 mm) apart.
3. A grease trap intended to serve as a fixture trap in accordance with the manufacturer's installation instructions shall be permitted to serve as the trap for a single fixture or a combination sink of not more than three compartments where the vertical distance from the fixture outlet to the inlet of the interceptor does not exceed 30 inches (762 mm) and the developed length of the waste pipe from the most upstream fixture outlet to the inlet of the interceptor does not exceed 60 inches (1524 mm).

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1002 TRAP REQUIREMENTS / 1002.2 Design of traps.

1002.2 Design of traps.

Fixture traps shall be self-scouring. Fixture traps shall not have interior partitions, except where such traps are integral with the fixture or where such traps are constructed of an approved material that is resistant to corrosion and degradation. Slip joints shall be made with an approved elastomeric gasket and shall be installed only on the trap inlet, trap outlet and within the trap seal.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1002 TRAP REQUIREMENTS / 1002.3 Prohibited traps.

1002.3 Prohibited traps.

The following types of traps are prohibited:

1. Traps that depend on moving parts to maintain the seal.
2. Bell traps.
3. Crown-vented traps.
4. Traps not integral with a fixture and that depend on interior partitions for the seal, except those traps constructed of an approved material that is resistant to corrosion and degradation.
5. "S" traps.
6. Drum traps.

Exception: Drum traps used as solids interceptors and drum traps serving chemical waste systems shall not be prohibited.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1002 TRAP REQUIREMENTS / 1002.4 Trap seals.

1002.4 Trap seals.

Each fixture trap shall have a liquid seal of not less than 2 inches (51 mm) and not more than 4 inches (102 mm), or deeper for special designs relating to accessible fixtures. Where a trap seal is subject to loss by evaporation, a trap seal primer valve shall be installed. A trap seal primer valve shall conform to ASSE 1018 or ASSE 1044.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1002 TRAP REQUIREMENTS / 1002.5 Size of fixture traps.

1002.5 Size of fixture traps.

Fixture trap size shall be sufficient to drain the fixture rapidly and not less than the size indicated in Table 709.1. A trap shall not be larger than the drainage pipe into which the trap discharges.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1002 TRAP REQUIREMENTS / 1002.6 Building traps.

1002.6 Building traps.

Building (house) traps shall be prohibited, except where local conditions necessitate such traps. Building traps shall be provided with a cleanout and a relief vent or fresh air intake on the inlet side of the trap. The size of the relief vent or fresh air intake shall not be less than one-half the

diameter of the drain to which the relief vent or air intake connects. Such relief vent or fresh air intake shall be carried above grade and shall be terminated in a screened outlet located outside the building.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1002 TRAP REQUIREMENTS / 1002.7 Trap setting and protection.

1002.7 Trap setting and protection.

Traps shall be set level with respect to the trap seal and, where necessary, shall be protected from freezing.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1002 TRAP REQUIREMENTS / 1002.8 Recess for trap connection.

1002.8 Recess for trap connection.

A recess provided for connection of the underground trap, such as one serving a bathtub in slab-type construction, shall have sides and a bottom of corrosion-resistant, insect- and verminproof construction.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1002 TRAP REQUIREMENTS / 1002.9 Acid-resisting traps.

1002.9 Acid-resisting traps.

Where a vitrified clay or other brittleware, acid-resisting trap is installed underground, such trap shall be embedded in concrete extending 6 inches (152 mm) beyond the bottom and sides of the trap.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1002 TRAP REQUIREMENTS / 1002.10 Plumbing in mental health centers.

1002.10 Plumbing in mental health centers.

In mental health centers, pipes and traps shall not be exposed.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1003 INTERCEPTORS AND SEPARATORS

**SECTION 1003
INTERCEPTORS AND SEPARATORS**

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1003 INTERCEPTORS AND SEPARATORS / 1003.1 Where required.

1003.1 Where required.

Interceptors and separators shall be provided to prevent the discharge of oil, grease, sand and other substances harmful or hazardous to the building drainage system, the public sewer, the private sewage disposal system or the sewage treatment plant or processes.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1003 INTERCEPTORS AND SEPARATORS / 1003.2 Approval.

1003.2 Approval.

The size, type and location of each interceptor and of each separator shall be designed and installed in accordance with the manufacturer's instructions and the requirements of this section based on the anticipated conditions of use. Wastes that do not require treatment or separation shall not be discharged into any interceptor or separator.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1003 INTERCEPTORS AND SEPARATORS / 1003.3 Grease interceptors.

1003.3 Grease interceptors.

Grease interceptors shall comply with the requirements of Sections 1003.3.1 through 1003.3.5.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1003 INTERCEPTORS AND SEPARATORS / 1003.3 Grease interceptors. / 1003.3.1 Grease interceptors and automatic grease removal devices required.

1003.3.1 Grease interceptors and automatic grease removal devices required.

A grease interceptor or automatic grease removal device shall be required to receive the drainage from fixtures and equipment with grease-laden waste located in food preparation areas, such as in restaurants, hotel kitchens, hospitals, school kitchens, bars, factory cafeterias and clubs. Fixtures and equipment shall include pot sinks, prerinse sinks; soup kettles or similar devices; wok stations; floor drains or sinks into which kettles are drained; automatic hood wash units and dishwashers without prerinse sinks. Grease interceptors and automatic grease removal devices shall receive waste only from fixtures and equipment that allow fats, oils or grease to be discharged.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1003 INTERCEPTORS AND SEPARATORS / 1003.3 Grease interceptors. / 1003.3.2 Food waste grinders.

1003.3.2 Food waste grinders.

Where food waste grinders connect to grease interceptors, a solids interceptor shall separate the discharge before connecting to the grease interceptor. Solids interceptors and grease interceptors shall be sized and rated for the discharge of the food waste grinder. Emulsifiers, chemicals, enzymes and bacteria shall not discharge into the food waste grinder.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1003 INTERCEPTORS AND SEPARATORS / 1003.3 Grease interceptors. / 1003.3.3 Grease interceptors and automatic grease removal devices not required.

1003.3.3 Grease interceptors and automatic grease removal devices not required.

A grease interceptor or an automatic grease removal device shall not be required for individual dwelling units or any private living quarters.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1003 INTERCEPTORS AND SEPARATORS / 1003.3 Grease interceptors. / 1003.3.4 Grease interceptors and automatic grease removal devices.

1003.3.4 Grease interceptors and automatic grease removal devices.

Grease interceptors or automatic grease removal devices shall conform to PDI G101, ASME A112.14.3 or ASME A112.14.4 and shall be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1003 INTERCEPTORS AND SEPARATORS / 1003.3 Grease interceptors. / 1003.3.4 Grease interceptors and automatic grease removal devices. / 1003.3.4.1 Grease interceptor capacity.

1003.3.4.1 Grease interceptor capacity.

Grease interceptors shall have the grease retention capacity indicated in Table 1003.3.4.1 for the flow-through rates indicated.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1003 INTERCEPTORS AND SEPARATORS / 1003.3 Grease

interceptors. / 1003.3.4 Grease interceptors and automatic grease removal devices. / 1003.3.4.1 Grease interceptor capacity. / TABLE 1003.3.4.1 CAPACITY OF GREASE INTERCEPTORS a

**TABLE 1003.3.4.1
CAPACITY OF GREASE INTERCEPTORS a**

TOTAL FLOW-THROUGH RATING (gpm)	GREASE RETENTION CAPACITY (pounds)
4	8
6	12
7	14
9	18
10	20
12	24
14	28
15	30
18	36
20	40
25	50
35	70
50	100
75	150
100	200

For SI: 1 gallon per minute = 3.785 L/m, 1 pound = 0.454 kg.

- a. For total flow-through ratings greater than 100 (gpm) , double the flow-through rating to determine the grease retention capacity (pounds).

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1003 INTERCEPTORS AND SEPARATORS / 1003.3 Grease interceptors. / 1003.3.4 Grease interceptors and automatic grease removal devices. / 1003.3.4.2 Rate of flow controls.

1003.3.4.2 Rate of flow controls.

Grease interceptors shall be equipped with devices to control the rate of water flow so that the water flow does not exceed the rated flow. The flow-control device shall be vented and terminate not less than 6 inches (152 mm) above the flood rim level or be installed in accordance with the manufacturer's instructions.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1003 INTERCEPTORS AND SEPARATORS / 1003.3 Grease interceptors. / 1003.3.5 Automatic grease removal devices.

1003.3.5 Automatic grease removal devices.

Where automatic grease removal devices are installed, such devices shall be located downstream of each fixture or multiple fixtures in accordance with the manufacturer's instructions. The automatic grease removal device shall be sized to pretreat the measured or calculated flows for all connected fixtures or equipment. Ready access shall be provided for inspection and maintenance.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1003 INTERCEPTORS AND SEPARATORS / 1003.4 Oil separators required.

1003.4 Oil separators required.

At repair garages, car-washing facilities, at factories where oily and flammable liquid wastes are produced and in hydraulic elevator pits, separators shall be installed into which all oil-bearing, grease-bearing or flammable wastes shall be discharged before emptying into the building drainage system or other point of disposal.

Exception: An oil separator is not required in hydraulic elevator pits where an approved alarm system is installed.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1003 INTERCEPTORS AND SEPARATORS / 1003.4 Oil separators required. / 1003.4.1 Separation of liquids.

1003.4.1 Separation of liquids.

A mixture of treated or untreated light and heavy liquids with various specific gravities shall be separated in an approved receptacle.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1003 INTERCEPTORS AND SEPARATORS / 1003.4 Oil separators required. / 1003.4.2 Oil separator design.

1003.4.2 Oil separator design.

Oil separators shall be designed in accordance with Sections 1003.4.2.1 and 1003.4.2.2.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1003 INTERCEPTORS AND SEPARATORS / 1003.4 Oil separators required. / 1003.4.2 Oil separator design. / 1003.4.2.1 General design requirements.

1003.4.2.1 General design requirements.

Oil separators shall have a depth of not less than 2 feet (610 mm) below the invert of the discharge drain. The outlet opening of the separator shall have not less than an 18-inch (457 mm) water seal.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1003 INTERCEPTORS AND SEPARATORS / 1003.4 Oil separators required. / 1003.4.2 Oil separator design. / 1003.4.2.2 Garages and service stations.

1003.4.2.2 Garages and service stations.

Where automobiles are serviced, greased, repaired or washed or where gasoline is dispensed, oil separators shall have a minimum capacity of 6 cubic feet (0.168 m³) for the first 100 square feet (9.3 m²) of area to be drained, plus 1 cubic foot (0.28 m³) for each additional 100 square feet (9.3 m²) of area to be drained into the separator. Parking garages in which servicing, repairing or washing is not conducted, and in which gasoline is not dispensed, shall not require a separator. Areas of commercial garages utilized only for storage of automobiles are not required to be drained through a separator.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1003 INTERCEPTORS AND SEPARATORS / 1003.5 Sand interceptors in commercial establishments.

1003.5 Sand interceptors in commercial establishments.

Sand and similar interceptors for heavy solids shall be designed and located so as to be provided with ready access for cleaning, and shall have a water seal of not less than 6 inches (152 mm).

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1003 INTERCEPTORS AND SEPARATORS / 1003.6 Laundries.

1003.6 Laundries.

Laundry facilities not installed within an individual dwelling unit or intended for individual family use shall be equipped with an interceptor with a wire basket or similar device, removable for cleaning, that prevents passage into the drainage system of solids 0.5 inch (12.7 mm) or larger in size, string, rags, buttons or other materials detrimental to the public sewage system.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1003 INTERCEPTORS AND SEPARATORS / 1003.7 Bottling establishments.

1003.7 Bottling establishments.

Bottling plants shall discharge process wastes into an interceptor that will provide for the separation of broken glass or other solids before discharging waste into the drainage system.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1003 INTERCEPTORS AND SEPARATORS / 1003.8 Slaughterhouses.

1003.8 Slaughterhouses.

Slaughtering room and dressing room drains shall be equipped with approved separators. The separator shall prevent the discharge into the drainage system of feathers, entrails and other materials that cause clogging.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1003 INTERCEPTORS AND SEPARATORS / 1003.9 Venting of interceptors and separators.

1003.9 Venting of interceptors and separators.

Interceptors and separators shall be designed so as not to become air bound where tight covers are utilized. Each interceptor or separator shall be vented where subject to a loss of trap seal.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1003 INTERCEPTORS AND SEPARATORS / 1003.10 Access and maintenance of interceptors and separators.

1003.10 Access and maintenance of interceptors and separators.

Access shall be provided to each interceptor and separator for service and maintenance. Interceptors and separators shall be maintained by periodic removal of accumulated grease, scum, oil, or other floating substances and solids deposited in the interceptor or separator.

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1004 MATERIALS, JOINTS AND CONNECTIONS

**SECTION 1004
MATERIALS, JOINTS AND CONNECTIONS**

2006 International Plumbing Code / CHAPTER 10 TRAPS, INTERCEPTORS AND SEPARATORS / SECTION 1004 MATERIALS, JOINTS AND CONNECTIONS / 1004.1 General.

1004.1 General.

The materials and methods utilized for the construction and installation of traps, interceptors and separators shall comply with this chapter and the applicable provisions of Chapters 4 and 7. The fittings shall not have ledges, shoulders or reductions capable of retarding or obstructing flow of the piping.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE

**CHAPTER 11
STORM DRAINAGE**

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1101
GENERAL**

**SECTION 1101
GENERAL**

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1101
GENERAL / 1101.1 Scope.**

1101.1 Scope.

The provisions of this chapter shall govern the materials, design, construction and installation of storm drainage.

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1101
GENERAL / 1101.2 Where required.**

1101.2 Where required.

All roofs, paved areas, yards, courts and courtyards shall drain into a separate storm sewer system, or a combined sewer system, or to an approved place of disposal. For one- and two-family dwellings, and where approved, storm water is permitted to discharge onto flat areas, such as streets or lawns, provided that the storm water flows away from the building.

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1101
GENERAL / 1101.3 Prohibited drainage.**

1101.3 Prohibited drainage.

Storm water shall not be drained into sewers intended for sewage only.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1101 GENERAL / 1101.4 Tests.

1101.4 Tests.

The conductors and the building storm drain shall be tested in accordance with Section 312.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1101 GENERAL / 1101.5 Change in size.

1101.5 Change in size.

The size of a drainage pipe shall not be reduced in the direction of flow.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1101 GENERAL / 1101.6 Fittings and connections.

1101.6 Fittings and connections.

All connections and changes in direction of the storm drainage system shall be made with approved drainage-type fittings in accordance with Table 706.3. The fittings shall not obstruct or retard flow in the system.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1101 GENERAL / 1101.7 Roof design.

1101.7 Roof design.

Roofs shall be designed for the maximum possible depth of water that will pond thereon as determined by the relative levels of roof deck and overflow weirs, scuppers, edges or serviceable drains in combination with the deflected structural elements. In determining the maximum possible depth of water, all primary roof drainage means shall be assumed to be blocked.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1101 GENERAL / 1101.8 Cleanouts required.

1101.8 Cleanouts required.

Cleanouts shall be installed in the storm drainage system and shall comply with the provisions of this code for sanitary drainage pipe cleanouts.

Exception: Subsurface drainage system.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1101 GENERAL / 1101.9 Backwater valves.

1101.9 Backwater valves.

Backwater valves installed in a storm drainage system shall conform to Section 715.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1102 MATERIALS

**SECTION 1102
MATERIALS**

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1102 MATERIALS / 1102.1 General.

1102.1 General.

The materials and methods utilized for the construction and installation of storm drainage systems shall comply with this section and the applicable provisions of Chapter 7.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1102 MATERIALS / 1102.2 Inside storm drainage conductors.

1102.2 Inside storm drainage conductors.

Inside storm drainage conductors installed above ground shall conform to one of the standards listed in Table 702.1.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1102 MATERIALS / 1102.3 Underground building storm drain pipe.

1102.3 Underground building storm drain pipe.

Underground building storm drain pipe shall conform to one of the standards listed in Table 702.2.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1102 MATERIALS / 1102.4 Building storm sewer pipe.

1102.4 Building storm sewer pipe.

Building storm sewer pipe shall conform to one of the standards listed in Table 1102.4.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1102 MATERIALS / 1102.4 Building storm sewer pipe. / TABLE 1102.4 BUILDING STORM SEWER PIPE

**TABLE 1102.4
BUILDING STORM SEWER PIPE**

MATERIAL	STANDARD
Acrylonitrile butadiene styrene (ABS) plastic pipe	ASTM D 2661; ASTM D 2751; ASTM F 628; CSA B181.1; CSA B182.1
Asbestos-cement pipe	ASTM C 428
Cast-iron pipe	ASTM A 74; ASTM A 888; CISPI 301
Concrete pipe	ASTM C 14; ASTM C 76; CSA A257.1M; CSA A257.2M
Copper or copper-alloy tubing (Type K, L, M or DWV)	ASTM B 75; ASTM B 88; ASTM B 251; ASTM B 306
Polyvinyl chloride (PVC) plastic pipe (Type DWV, SDR26, SDR35, SDR41, PS50 or PS100)	ASTM D 2665; ASTM D 3034; ASTM F 891; CSA B182.4; CSA B181.2; CSA B182.2
Vitrified clay pipe	ASTM C 4; ASTM C 700
Stainless steel drainage systems, Type 316L	ASME A112.3.1

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1102 MATERIALS / 1102.5 Subsoil drain pipe.

1102.5 Subsoil drain pipe.

Subsoil drains shall be open-jointed, horizontally split or perforated pipe conforming to one of the standards listed in Table 1102.5.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1102 MATERIALS / 1102.5 Subsoil drain pipe. / TABLE 1102.5 SUBSOIL DRAIN PIPE

**TABLE 1102.5
SUBSOIL DRAIN PIPE**

MATERIAL	STANDARD
Asbestos-cement pipe	ASTM C 508
Cast-iron pipe	ASTM A 74; ASTM A 888; CISPI 301
Polyethylene (PE) plastic pipe	ASTM F 405; CSA B182.1; CSA B182.6; CSA B182.8
Polyvinyl chloride (PVC) Plastic pipe (type sewer pipe, PS25, PS50 or PS100)	ASTM D 2729; ASTM F 891; CSA B182.2; CSA B182.4
Stainless steel drainage systems, Type 316L	ASME A112.3.1
Vitrified clay pipe	ASTM C 4; ASTM C 700

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1102 MATERIALS / 1102.6 Roof drains.

1102.6 Roof drains.

Roof drains shall conform to ASME A112.21.2M or ASME A112.3.1.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1102 MATERIALS / 1102.7 Fittings.

1102.7 Fittings.

Pipe fittings shall be approved for installation with the piping material installed, and shall conform to the respective pipe standards or one of the standards listed in Table 1102.7. The fittings shall not have ledges, shoulders or reductions capable of retarding or obstructing flow in the piping. Threaded drainage pipe fittings shall be of the recessed drainage type.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1102 MATERIALS / 1102.7 Fittings. / TABLE 1102.7 PIPE FITTINGS

**TABLE 1102.7
PIPE FITTINGS**

MATERIAL	STANDARD
Acrylonitrile butadiene styrene (ABS) plastic	ASTM D 2661; ASTM D 3311; CSA B181.1
Cast-iron	ASME B16.4; ASME B16.12; ASTM A 888; CISPI 301; ASTM A 74
Coextruded composite ABS sewer and drain DR-PS in PS35, PS50, PS100, PS140, PS200	ASTM D 2751
Coextruded composite ABS DWV Schedule 40 IPS pipe (solid or cellular core)	ASTM D 2661; ASTM D 3311; ASTM F 628
Coextruded composite PVC DWV Schedule 40 IPS-DR, PS140, PS200 (solid or cellular core)	ASTM D 2665; ASTM D 3311; ASTM F 891
Coextruded composite PVC sewer and drain DR-PS in PS35, PS50, PS100, PS140, PS200	ASTM D 3034
Copper or copper alloy	ASME B16.15; ASME B16.18; ASME B16.22; ASME B16.23; ASME B16.26; ASME B16.29
Gray iron and ductile iron	AWWA C110
Malleable iron	ASME B16.3
Plastic, general	ASTM F 409
Polyvinyl chloride (PVC) plastic	ASTM D 2665; ASTM D 3311; ASTM F 1866
Steel	ASME B16.9; ASME B16.11; ASME B16.28
Stainless steel drainage Systems, Type 316L	ASME A112.3.2

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1103 TRAPS

**SECTION 1103
TRAPS**

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1103 TRAPS / 1103.1 Main trap.

1103.1 Main trap.

Leaders and storm drains connected to a combined sewer shall be trapped. Individual storm water traps shall be installed on the storm water drain branch serving each conductor, or a single trap shall be installed in the main storm drain just before its connection with the combined building sewer or the public sewer.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1103 TRAPS / 1103.2 Material.

1103.2 Material.

Storm water traps shall be of the same material as the piping system to which they are attached.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1103 TRAPS / 1103.3 Size.

1103.3 Size.

Traps for individual conductors shall be the same size as the horizontal drain to which they are connected.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1103 TRAPS / 1103.4 Cleanout.

1103.4 Cleanout.

An accessible cleanout shall be installed on the building side of the trap.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1104 CONDUCTORS AND CONNECTIONS

**SECTION 1104
CONDUCTORS AND CONNECTIONS**

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1104 CONDUCTORS AND CONNECTIONS / 1104.1 Prohibited use.

1104.1 Prohibited use.

Conductor pipes shall not be used as soil, waste or vent pipes, and soil, waste or vent pipes shall not be used as conductors.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1104 CONDUCTORS AND CONNECTIONS / 1104.2 Combining storm with sanitary drainage.

1104.2 Combining storm with sanitary drainage.

The sanitary and storm drainage systems of a structure shall be entirely separate except where combined sewer systems are utilized. Where a combined sewer is utilized, the building storm drain shall be connected in the same horizontal plane through a single-wye fitting to the combined sewer at least 10 feet (3048 mm) downstream from any soil stack.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1104 CONDUCTORS AND CONNECTIONS / 1104.3 Floor drains.

1104.3 Floor drains.

Floor drains shall not be connected to a storm drain.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1105 ROOF DRAINS

**SECTION 1105
ROOF DRAINS**

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1105 ROOF DRAINS / 1105.1 Strainers.

1105.1 Strainers.

Roof drains shall have strainers extending not less than 4 inches (102 mm) above the surface of the roof immediately adjacent to the roof drain. Strainers shall have an available inlet area, above roof level, of not less than one and one-half times the area of the conductor or leader to which the drain is connected.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1105 ROOF DRAINS / 1105.2 Flat decks.

1105.2 Flat decks.

Roof drain strainers for use on sun decks, parking decks and similar areas that are normally serviced and maintained shall comply with Section 1105.1 or shall be of the flat-surface type, installed level with the deck, with an available inlet area not less than two times the area of the conductor or leader to which the drain is connected.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1105 ROOF DRAINS / 1105.3 Roof drain flashings.

1105.3 Roof drain flashings.

The connection between roofs and roof drains which pass through the roof and into the interior of the building shall be made water tight by the use of approved flashing material.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1106 SIZE OF CONDUCTORS, LEADERS AND STORM DRAINS

**SECTION 1106
SIZE OF CONDUCTORS, LEADERS
AND STORM DRAINS**

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1106 SIZE OF CONDUCTORS, LEADERS AND STORM DRAINS / 1106.1 General.

1106.1 General.

The size of the vertical conductors and leaders, building storm drains, building storm sewers, and any horizontal branches of such drains or sewers shall be based on the 100-year hourly rainfall rate indicated in Figure 1106.1 or on other rainfall rates determined from approved local weather data.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1106 SIZE OF CONDUCTORS, LEADERS AND STORM DRAINS / 1106.1 General. / FIGURE 1106.1 100-YEAR, 1-HOUR RAINFALL (INCHES) EASTERN UNITED STATES

**FIGURE 1106.1
100-YEAR, 1-HOUR RAINFALL (INCHES) EASTERN UNITED STATES**




For SI: 1 inch = 25.4 mm.

Source: National Weather Service, National Oceanic and Atmospheric Administration, Washington D.C.

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1106
SIZE OF CONDUCTORS, LEADERS AND STORM DRAINS / 1106.1 General. /
FIGURE 1106.1—continued 100-YEAR, 1-HOUR RAINFALL (INCHES) CENTRAL
UNITED STATES**

FIGURE 1106.1—continued

100-YEAR, 1-HOUR RAINFALL (INCHES) CENTRAL UNITED STATES

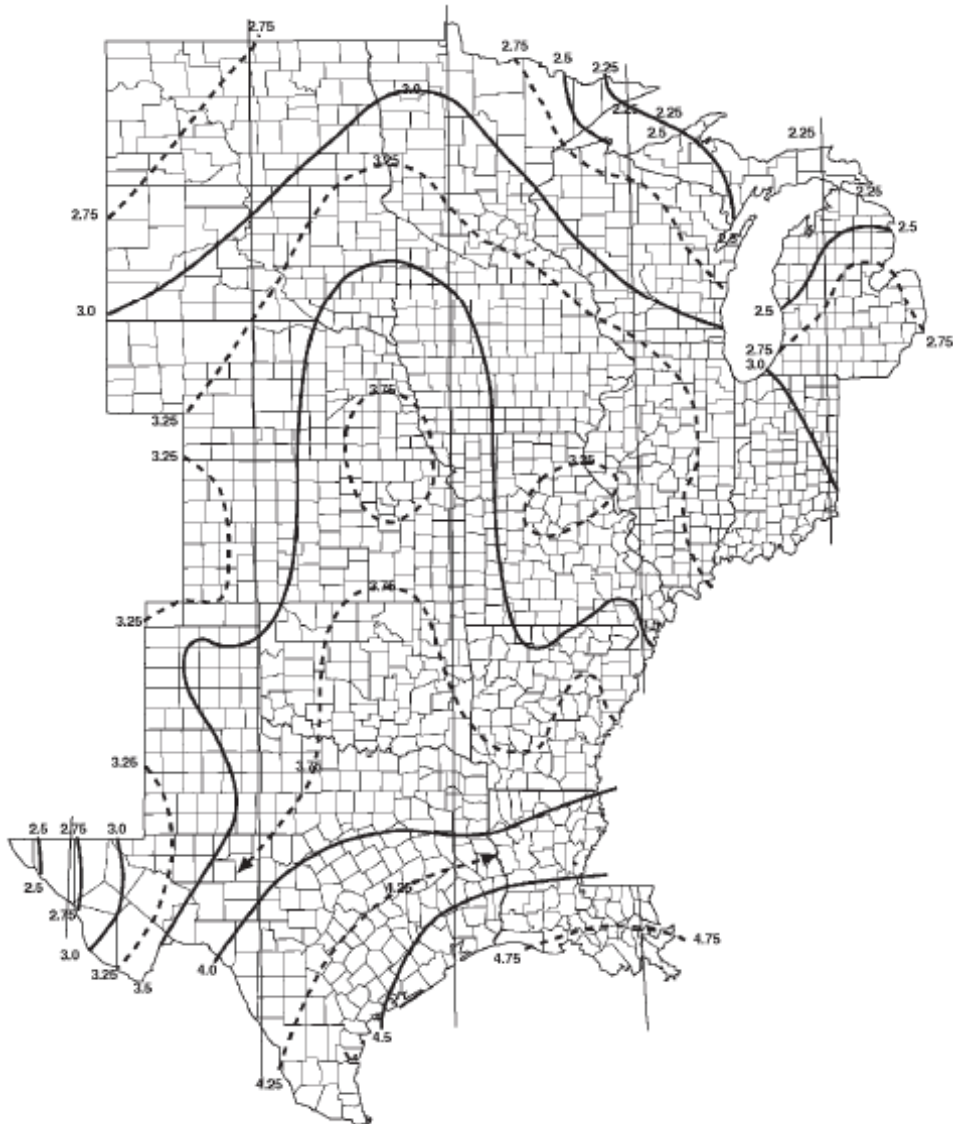


For SI: 1 inch = 25.4 mm.

Source: National Weather Service, National Oceanic and Atmospheric Administration, Washington D.C.

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1106
SIZE OF CONDUCTORS, LEADERS AND STORM DRAINS / 1106.1 General. /
FIGURE 1106.1—continued 100-YEAR, 1-HOUR RAINFALL (INCHES) WESTERN
UNITED STATES**

FIGURE 1106.1—continued

100-YEAR, 1-HOUR RAINFALL (INCHES) WESTERN UNITED STATES

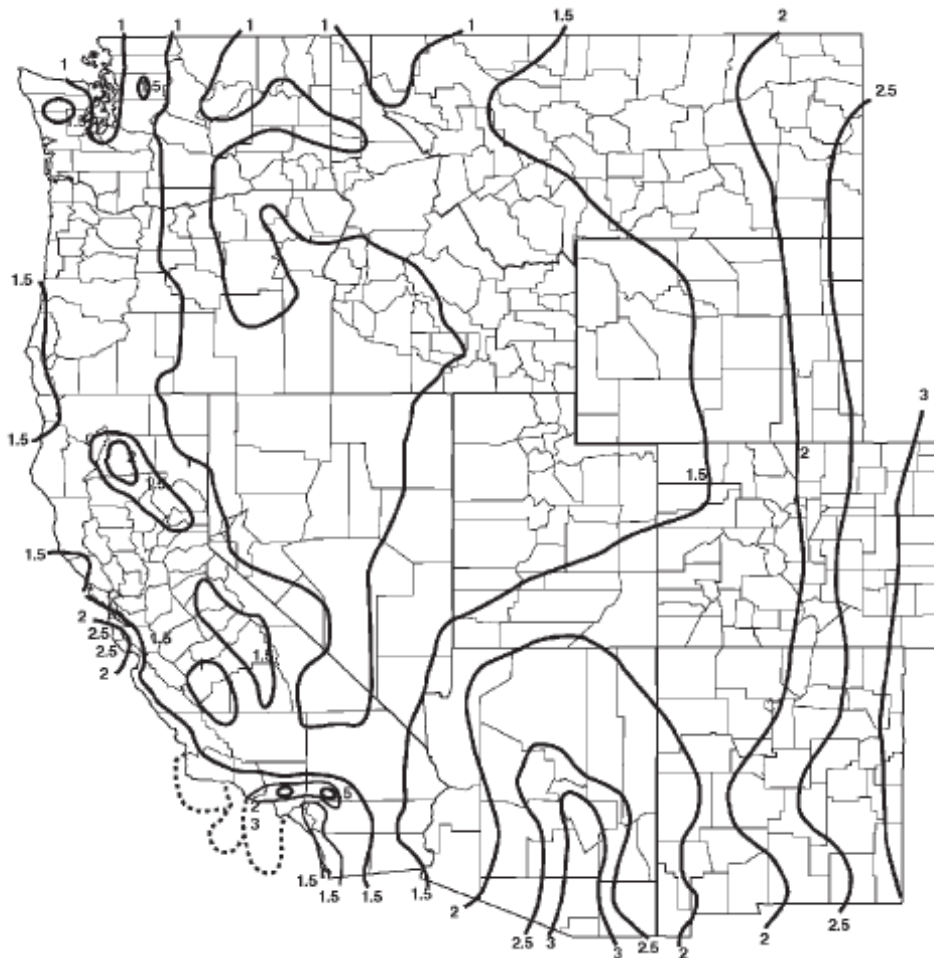


For SI: 1 inch = 25.4 mm.

Source: National Weather Service, National Oceanic and Atmospheric Administration, Washington D.C.

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1106
SIZE OF CONDUCTORS, LEADERS AND STORM DRAINS / 1106.1 General. /
FIGURE 1106.1—continued 100-YEAR, 1-HOUR RAINFALL (INCHES) ALASKA**

**FIGURE 1106.1—continued
100-YEAR, 1-HOUR RAINFALL (INCHES) ALASKA**

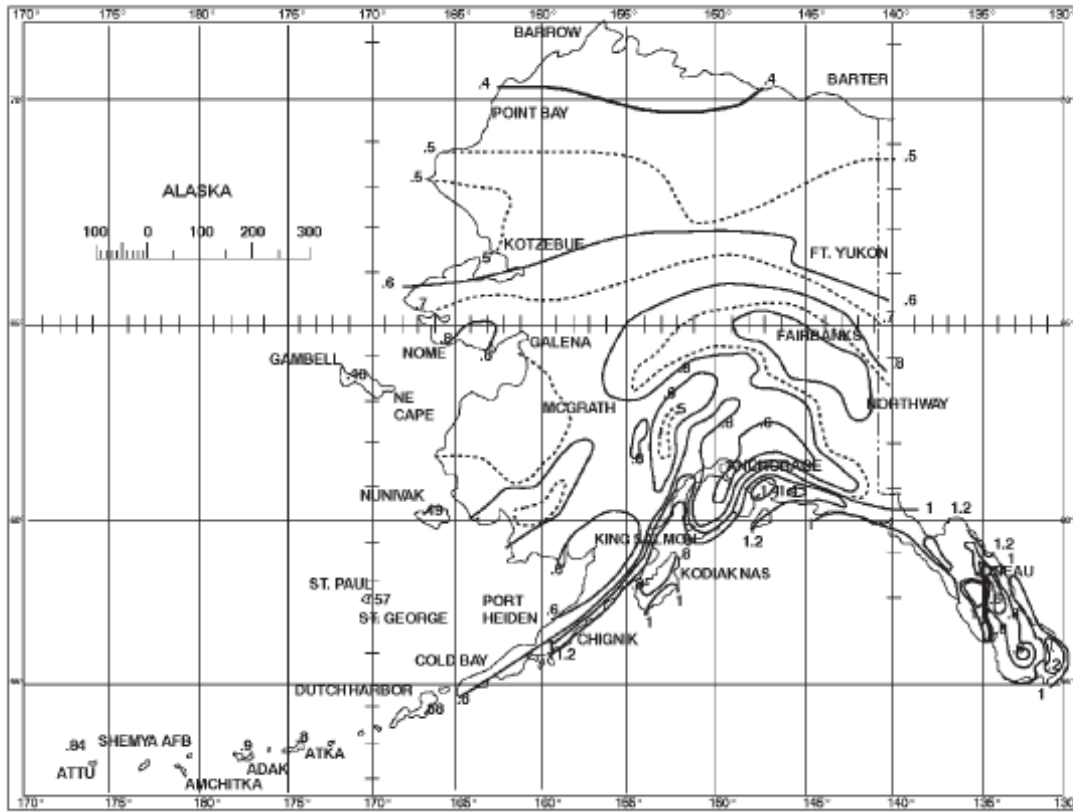


For SI: 1 inch = 25.4 mm.

Source: National Weather Service, National Oceanic and Atmospheric Administration, Washington D.C.

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1106
SIZE OF CONDUCTORS, LEADERS AND STORM DRAINS / 1106.1 General. /
FIGURE 1106.1—continued 100-YEAR, 1-HOUR RAINFALL (INCHES) HAWAII**

**FIGURE 1106.1—continued
100-YEAR, 1-HOUR RAINFALL (INCHES) HAWAII**

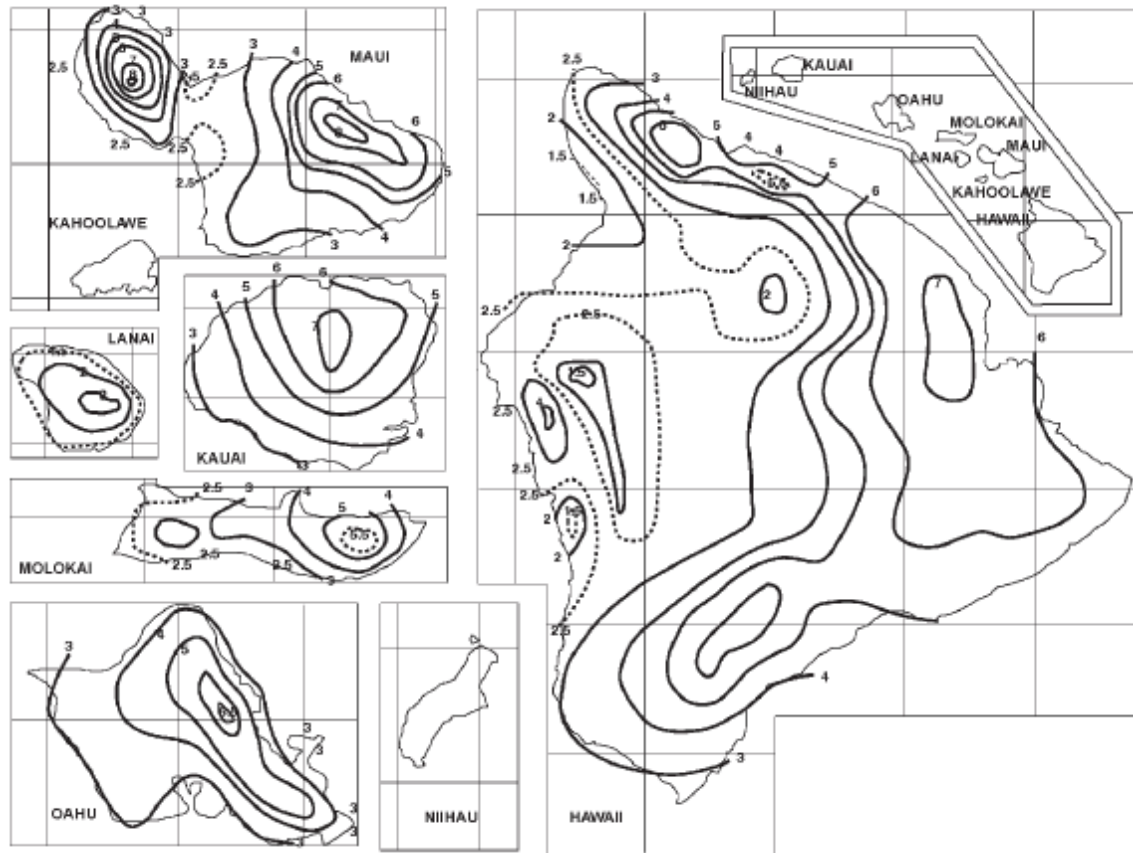

For SI: 1 inch = 25.4 mm.

Source: National Weather Service, National Oceanic and Atmospheric Administration, Washington D.C.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1106 SIZE OF CONDUCTORS, LEADERS AND STORM DRAINS / 1106.2 Vertical conductors and leaders.

1106.2 Vertical conductors and leaders.

Vertical conductors and leaders shall be sized for the maximum projected roof area, in accordance with Table 1106.2.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1106 SIZE OF CONDUCTORS, LEADERS AND STORM DRAINS / 1106.2 Vertical conductors and leaders. / TABLE 1106.2 SIZE OF VERTICAL CONDUCTORS AND LEADERS

**TABLE 1106.2
SIZE OF VERTICAL CONDUCTORS AND LEADERS**

DIAMETER OF OF LEADER (inches) ^a	HORIZONTALLY PROJECTED ROOF AREA (square feet)											
	Rainfall rate (inches per hour)											
	1	2	3	4	5	6	7	8	9	10	11	12
2	2,880	1,440	960	720	575	480	410	360	320	290	260	240
3	8,800	4,400	2,930	2,200	1,760	1,470	1,260	1,100	980	880	800	730
4	18,400	9,200	6,130	4,600	3,680	3,070	2,630	2,300	2,045	1,840	1,675	1,530
5	34,600	17,300	11,530	8,650	6,920	5,765	4,945	4,325	3,845	3,460	3,145	2,880
6	54,000	27,000	17,995	13,500	10,800	9,000	7,715	6,750	6,000	5,400	4,910	4,500
8	116,000	58,000	38,660	29,000	23,200	19,315	16,570	14,500	12,890	11,600	10,545	9,600

For SI: 1 inch = 25.4 mm, 1 square foot = 0.0929 m².

- a. Sizes indicated are the diameter of circular piping. This table is applicable to piping of other shapes provided the cross-sectional shape fully encloses a circle of the diameter indicated in this table.

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1106
SIZE OF CONDUCTORS, LEADERS AND STORM DRAINS / 1106.3 Building storm
drains and sewers.**

1106.3 Building storm drains and sewers.

The size of the building storm drain, building storm sewer and their horizontal branches having a slope of one-half unit or less vertical in 12 units horizontal (4-percent slope) shall be based on the maximum projected roof area in accordance with Table 1106.3. The minimum slope of horizontal branches shall be one-eighth unit vertical in 12 units horizontal (1-percent slope) unless otherwise approved.

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1106
SIZE OF CONDUCTORS, LEADERS AND STORM DRAINS / 1106.3 Building storm
drains and sewers. / TABLE 1106.3 SIZE OF HORIZONTAL STORM DRAINAGE PIPING**

**TABLE 1106.3
SIZE OF HORIZONTAL STORM DRAINAGE PIPING**

SIZE OF HORIZONTAL PIPING (inches)	HORIZONTALLY PROJECTED ROOF AREA (square feet)					
	Rainfall rate (inches per hour)					
	1	2	3	4	5	6
¹ / ₈ unit vertical in 12 units horizontal (1-percent slope)						
3	3,288	1,644	1,096	822	657	548
4	7,520	3,760	2,506	1,800	1,504	1,253
5	13,360	6,680	4,453	3,340	2,672	2,227

I-Quest 2006 Codes Complete Collection

SIZE OF HORIZONTAL PIPING (inches)	HORIZONTALLY PROJECTED ROOF AREA (square feet)					
	Rainfall rate (inches per hour)					
	1	2	3	4	5	6
6	21,400	10,700	7,133	5,350	4,280	3,566
8	46,000	23,000	15,330	11,500	9,200	7,600
10	82,800	41,400	27,600	20,700	16,580	13,800
12	133,200	66,600	44,400	33,300	26,650	22,200
15	218,000	109,000	72,800	59,500	47,600	39,650
¼ unit vertical in 12 units horizontal (2-percent slope)						
3	4,640	2,320	1,546	1,160	928	773
4	10,600	5,300	3,533	2,650	2,120	1,766
5	18,880	9,440	6,293	4,720	3,776	3,146
6	30,200	15,100	10,066	7,550	6,040	5,033
8	65,200	32,600	21,733	16,300	13,040	10,866
10	116,800	58,400	38,950	29,200	23,350	19,450
12	188,000	94,000	62,600	47,000	37,600	31,350
15	336,000	168,000	112,000	84,000	67,250	56,000
½ unit vertical in 12 units horizontal (4-percent slope)						
3	6,576	3,288	2,295	1,644	1,310	1,096
4	15,040	7,520	5,010	3,760	3,010	2,500
5	26,720	13,360	8,900	6,680	5,320	4,450
6	42,800	21,400	13,700	10,700	8,580	7,140
8	92,000	46,000	30,650	23,000	18,400	15,320
10	171,600	85,800	55,200	41,400	33,150	27,600
12	266,400	133,200	88,800	66,600	53,200	44,400
15	476,000	238,000	158,800	119,000	95,300	79,250

For SI: 1 inch = 25.4 mm, 1 square foot = 0.0929 m²

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1106 SIZE OF CONDUCTORS, LEADERS AND STORM DRAINS / 1106.4 Vertical walls.

1106.4 Vertical walls.

In sizing roof drains and storm drainage piping, one-half of the area of any vertical wall that diverts rainwater to the roof shall be added to the projected roof area for inclusion in calculating the required size of vertical conductors, leaders and horizontal storm drainage piping.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1106 SIZE OF CONDUCTORS, LEADERS AND STORM DRAINS / 1106.5 Parapet wall scupper location.

1106.5 Parapet wall scupper location.

Parapet wall roof drainage scupper and overflow scupper location shall comply with the requirements of the *International Building Code*.

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1106
SIZE OF CONDUCTORS, LEADERS AND STORM DRAINS / 1106.6 Size of roof
gutters.**

1106.6 Size of roof gutters.

The size of semicircular gutters shall be based on the maximum projected roof area in accordance with Table 1106.6.

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1106
SIZE OF CONDUCTORS, LEADERS AND STORM DRAINS / 1106.6 Size of roof
gutters. / TABLE 1106.6 SIZE OF SEMICIRCULAR ROOF GUTTERS**

**TABLE 1106.6
SIZE OF SEMICIRCULAR ROOF GUTTERS**

DIAMETER OF GUTTERS (inches)	HORIZONTALLY PROJECTED ROOF AREA (square feet)					
	Rainfall rate (inches per hour)					
	1	2	3	4	5	6
$\frac{1}{16}$ unit vertical in 12 units horizontal (0.5-percent slope)						
3	680	340	226	170	136	113
4	1,440	720	480	360	288	240
5	2,500	1,250	834	625	500	416
6	3,840	1,920	1,280	960	768	640
7	5,520	2,760	1,840	1,380	1,100	918
8	7,960	3,980	2,655	1,990	1,590	1,325
10	14,400	7,200	4,800	3,600	2,880	2,400
$\frac{1}{8}$ unit vertical 12 units horizontal (1-percent slope)						
3	960	480	320	240	192	160
4	2,040	1,020	681	510	408	340
5	3,520	1,760	1,172	880	704	587
6	5,440	2,720	1,815	1,360	1,085	905
7	7,800	3,900	2,600	1,950	1,560	1,300
8	11,200	5,600	3,740	2,800	2,240	1,870
10	20,400	10,200	6,800	5,100	4,080	3,400
$\frac{1}{4}$ unit vertical in 12 units horizontal (2-percent slope)						
3	1,360	680	454	340	272	226
4	2,880	1,440	960	720	576	480
5	5,000	2,500	1,668	1,250	1,000	834
6	7,680	3,840	2,560	1,920	1,536	1,280
7	11,040	5,520	3,860	2,760	2,205	1,840
8	15,920	7,960	5,310	3,980	3,180	2,655
10	28,800	14,400	9,600	7,200	5,750	4,800
$\frac{1}{2}$ unit vertical in 12 units horizontal (4-percent slope)						
3	1,920	960	640	480	384	320
4	4,080	2,040	1,360	1,020	816	680
5	7,080	3,540	2,360	1,770	1,415	1,180
6	11,080	5,540	3,695	2,770	2,220	1,850

I-Quest 2006 Codes Complete Collection

DIAMETER OF GUTTERS (inches)	HORIZONTALLY PROJECTED ROOF AREA (square feet)					
	Rainfall rate (inches per hour)					
	1	2	3	4	5	6
7	15,600	7,800	5,200	3,900	3,120	2,600
8	22,400	11,200	7,460	5,600	4,480	3,730
10	40,000	20,000	13,330	10,000	8,000	6,660

For SI: 1 inch = 25.4 mm, 1 square foot = 0.0929 m²

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1107
SECONDARY (EMERGENCY) ROOF DRAINS**

**SECTION 1107
SECONDARY (EMERGENCY) ROOF DRAINS**

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1107
SECONDARY (EMERGENCY) ROOF DRAINS / 1107.1 Secondary drainage required.**

1107.1 Secondary drainage required.

Secondary (emergency) roof drains or scuppers shall be provided where the roof perimeter construction extends above the roof in such a manner that water will be entrapped if the primary drains allow buildup for any reason.

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1107
SECONDARY (EMERGENCY) ROOF DRAINS / 1107.2 Separate systems required.**

1107.2 Separate systems required.

Secondary roof drain systems shall have the end point of discharge separate from the primary system. Discharge shall be above grade, in a location that would normally be observed by the building occupants or maintenance personnel.

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1107
SECONDARY (EMERGENCY) ROOF DRAINS / 1107.3 Sizing of secondary drains.**

1107.3 Sizing of secondary drains.

Secondary (emergency) roof drain systems shall be sized in accordance with Section 1106 based on the rainfall rate for which the primary system is sized in Tables 1106.2, 1106.3 and 1106.6. Scuppers shall be sized to prevent the depth of ponding water from exceeding that for which the roof was designed as determined by Section 1101.7. Scuppers shall not have an opening dimension of less than 4 inches (102 mm). The flow through the primary system shall

not be considered when sizing the secondary roof drain system.

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1108
COMBINED SANITARY AND STORM SYSTEM**

**SECTION 1108
COMBINED SANITARY AND STORM SYSTEM**

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1108
COMBINED SANITARY AND STORM SYSTEM / 1108.1 Size of combined drains and
sewers.**

1108.1 Size of combined drains and sewers.

The size of a combination sanitary and storm drain or sewer shall be computed in accordance with the method in Section 1106.3. The fixture units shall be converted into an equivalent projected roof or paved area. Where the total fixture load on the combined drain is less than or equal to 256 fixture units, the equivalent drainage area in horizontal projection shall be taken as 4,000 square feet (372 m²). Where the total fixture load exceeds 256 fixture units, each additional fixture unit shall be considered the equivalent of 15.6 square feet (1.5 m²) of drainage area. These values are based on a rainfall rate of 1 inch (25 mm) per hour.

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1109
VALUES FOR CONTINUOUS FLOW**

**SECTION 1109
VALUES FOR CONTINUOUS FLOW**

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1109
VALUES FOR CONTINUOUS FLOW / 1109.1 Equivalent roof area.**

1109.1 Equivalent roof area.

Where there is a continuous or semicontinuous discharge into the building storm drain or building storm sewer, such as from a pump, ejector, air conditioning plant or similar device, each gallon per minute (L/m) of such discharge shall be computed as being equivalent to 96 square feet (9 m²) of roof area, based on a rainfall rate of 1 inch (25.4 mm) per hour.

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1110
CONTROLLED FLOW ROOF DRAIN SYSTEMS**

**SECTION 1110
CONTROLLED FLOW ROOF DRAIN SYSTEMS**

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1110
CONTROLLED FLOW ROOF DRAIN SYSTEMS / 1110.1 General.**

1110.1 General.

The roof of a structure shall be designed for the storage of water where the storm drainage system is engineered for controlled flow. The controlled flow roof drain system shall be an engineered system in accordance with this section and the design, submittal, approval, inspection and testing requirements of Section 105.4. The controlled flow system shall be designed based on the required rainfall rate in accordance with Section 1106.1.

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1110
CONTROLLED FLOW ROOF DRAIN SYSTEMS / 1110.2 Control devices.**

1110.2 Control devices.

The control devices shall be installed so that the rate of discharge of water per minute shall not exceed the values for continuous flow as indicated in Section 1109.1.

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1110
CONTROLLED FLOW ROOF DRAIN SYSTEMS / 1110.3 Installation.**

1110.3 Installation.

Runoff control shall be by control devices. Control devices shall be protected by strainers.

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1110
CONTROLLED FLOW ROOF DRAIN SYSTEMS / 1110.4 Minimum number of roof
drains.**

1110.4 Minimum number of roof drains.

Not less than two roof drains shall be installed in roof areas 10,000 square feet (929 m²) or less and not less than four roof drains shall be installed in roofs over 10,000 square feet (929 m²) in area.

**2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1111
SUBSOIL DRAINS**

SECTION 1111

SUBSOIL DRAINS

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1111 SUBSOIL DRAINS / 1111.1 Subsoil drains.

1111.1 Subsoil drains.

Subsoil drains shall be open-jointed, horizontally split or perforated pipe conforming to one of the standards listed in Table 1102.5. Such drains shall not be less than 4 inches (102 mm) in diameter. Where the building is subject to backwater, the subsoil drain shall be protected by an accessibly located backwater valve. Subsoil drains shall discharge to a trapped area drain, sump, dry well or approved location above ground. The subsoil sump shall not be required to have either a gas-tight cover or a vent. The sump and pumping system shall comply with Section 1113.1.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1112 BUILDING SUBDRAINS

SECTION 1112 BUILDING SUBDRAINS

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1112 BUILDING SUBDRAINS / 1112.1 Building subdrains.

1112.1 Building subdrains.

Building subdrains located below the public sewer level shall discharge into a sump or receiving tank, the contents of which shall be automatically lifted and discharged into the drainage system as required for building sumps. The sump and pumping equipment shall comply with Section 1113.1.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1113 SUMPS AND PUMPING SYSTEMS

SECTION 1113 SUMPS AND PUMPING SYSTEMS

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1113 SUMPS AND PUMPING SYSTEMS / 1113.1 Pumping system.

1113.1 Pumping system.

The sump pump, pit and discharge piping shall conform to Sections 1113.1.1 through 1113.1.4.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1113 SUMPS AND PUMPING SYSTEMS / 1113.1 Pumping system. / 1113.1.1 Pump capacity and head.

1113.1.1 Pump capacity and head.

The sump pump shall be of a capacity and head appropriate to anticipated use requirements.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1113 SUMPS AND PUMPING SYSTEMS / 1113.1 Pumping system. / 1113.1.2 Sump pit.

1113.1.2 Sump pit.

The sump pit shall not be less than 18 inches (457 mm) in diameter and 24 inches (610 mm) deep, unless otherwise approved. The pit shall be accessible and located such that all drainage flows into the pit by gravity. The sump pit shall be constructed of tile, steel, plastic, cast-iron, concrete or other approved material, with a removable cover adequate to support anticipated loads in the area of use. The pit floor shall be solid and provide permanent support for the pump.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1113 SUMPS AND PUMPING SYSTEMS / 1113.1 Pumping system. / 1113.1.3 Electrical.

1113.1.3 Electrical.

Electrical service outlets, when required, shall meet the requirements of the ICC *Electrical Code*.

2006 International Plumbing Code / CHAPTER 11 STORM DRAINAGE / SECTION 1113 SUMPS AND PUMPING SYSTEMS / 1113.1 Pumping system. / 1113.1.4 Piping.

1113.1.4 Piping.

Discharge piping shall meet the requirements of Section 1102.2, 1102.3 or 1102.4 and shall include a gate valve and a full flow check valve. Pipe and fittings shall be the same size as, or larger than, pump discharge tapping.

Exception: In one- and two-family dwellings, only a check valve shall be required, located on the discharge piping from the pump or ejector.

2006 International Plumbing Code / CHAPTER 12 SPECIAL PIPING AND STORAGE SYSTEMS

CHAPTER 12 SPECIAL PIPING AND STORAGE SYSTEMS

2006 International Plumbing Code / CHAPTER 12 SPECIAL PIPING AND STORAGE SYSTEMS / SECTION 1201 GENERAL

SECTION 1201 GENERAL

2006 International Plumbing Code / CHAPTER 12 SPECIAL PIPING AND STORAGE SYSTEMS / SECTION 1201 GENERAL / 1201.1 Scope.

1201.1 Scope.

The provisions of this chapter shall govern the design and installation of piping and storage systems for nonflammable medical gas systems and nonmedical oxygen systems. All maintenance and operations of such systems shall be in accordance with the *International Fire Code*.

2006 International Plumbing Code / CHAPTER 12 SPECIAL PIPING AND STORAGE SYSTEMS / SECTION 1202 MEDICAL GASES

SECTION 1202 MEDICAL GASES

2006 International Plumbing Code / CHAPTER 12 SPECIAL PIPING AND STORAGE SYSTEMS / SECTION 1202 MEDICAL GASES / [F] 1202.1 Nonflammable medical gases.

[F] 1202.1 Nonflammable medical gases.

Nonflammable medical gas systems, inhalation anesthetic systems and vacuum piping systems shall be designed and installed in accordance with NFPA 99C.

Exceptions:

1. This section shall not apply to portable systems or cylinder storage.
2. Vacuum system exhaust shall comply with the *International Mechanical Code*.

2006 International Plumbing Code / CHAPTER 12 SPECIAL PIPING AND STORAGE SYSTEMS / SECTION 1203 OXYGEN SYSTEMS

**SECTION 1203
OXYGEN SYSTEMS**

2006 International Plumbing Code / CHAPTER 12 SPECIAL PIPING AND STORAGE SYSTEMS / SECTION 1203 OXYGEN SYSTEMS / [F] 1203.1 Design and installation.

[F] 1203.1 Design and installation.

Nonmedical oxygen systems shall be designed and installed in accordance with NFPA 50 and NFPA 51.

2006 International Plumbing Code / CHAPTER 13 REFERENCED STANDARDS

**CHAPTER 13
REFERENCED STANDARDS**

This chapter lists the standards that are referenced in various sections of this document. The standards are listed herein by the promulgating agency of the standard, the standard identification, the effective date and title, and the section or sections of this document that reference the standard. The application of the referenced standards shall be as specified in Section 102.8.

ANSI

American National Standards Institute
25 West 43rd Street, Fourth Floor
New York, NY 10036

Standard Reference Number	Title	§
Z4.3—95	Minimum Requirements for Nonsewered Waste-Disposal Systems.	
Z21.22—99 (R2003)	Relief Valves for Hot Water Supply Systems with Addenda Z21.22a-2000(R2003) and Z21.22b-2001(R2003).	
Z124.1—95	Plastic Bathtub Units	
Z124.2—95	Plastic Shower Receptors and Shower Stalls.	
Z124.3—95	Plastic Lavatories	
Z124.4—96	Plastic Water Closet Bowls and Tanks.	
Z124.6—97	Plastic Sinks	
Z124.9-94	Plastic Urinal Fixtures	

I-Quest 2006 Codes Complete Collection

ARI

Air-Conditioning & Refrigeration Institute
 4100 North Fairfax Drive, Suite 200
 Arlington, VA 22203

Standard Reference Number	Title	§
1010—02	Self-contained, Mechanically Refrigerated Drinking-water Coolers.	

ASME

American Society of Mechanical Engineers
 Three Park Avenue
 New York, NY 10016-5990

Standard Reference Number	Title	§
A112.1.2—1991(R2002)	Air Gaps in Plumbing Systems	
A112.1.3—2000	Air Gap Fittings for Use with Plumbing Fixtures, Appliances and Appurtenances	608.13.
A112.3.1—1993	Performance Standard and Installation Procedures for Stainless Steel Drainage Systems for Sanitary, Storm and Chemical Applications, Above and Below Ground	412.1, Table 702.4, Table 702.4, 1102.4, Table 1
A112.3.4—2000	Macerating Toilet Systems and Related Components.	
A112.4.1—1993(R2002)	Water Heater Relief Valve Drain Tubes.	
A112.4.3—1999	Plastic Fittings for Connecting Water Closets to the Sanitary Drainage System	
A112.6.1M—1997(R2002)	Floor-Affixed Supports for Off-the-floor Plumbing Fixtures for Public Use.	
A112.6.2—2000	Framing-Affixed Supports for Off-the-floor Water Closets with Concealed Tanks	
A112.6.3—2001	Floor and Trench Drains	
A112.6.7—2001	Enameled and Epoxy-coated Cast-iron and PVC Plastic Sanitary Floor Sinks	
A112.14.1—2003	Backwater Valves	
A112.14.3—2000	Grease Interceptors	
A112.14.4—2001	Grease Removal Devices	
A112.18.1—2003	Plumbing Fixture Fittings	
A112.18.2—2002	Plumbing Fixture Waste Fittings.	
A112.18.3—2002	Performance Requirements for Backflow Protection Devices and Systems in Plumbing Fixture Fittings	
A112.18.6—2003	Flexible Water Connectors	
A112.18.7—1999	Deck mounted Bath/Shower Transfer Valves with Integral Backflow Protection	
A112.19.1M—1994(R1999)	Enameled Cast Iron Plumbing Fixtures with 1998 and 2000 supplements	407.1, 410.1
A112.19.2M—2003	Vitreous China Plumbing Fixtures and Hydraulic Requirements for Water Closets and Urinals	401.2, 405.9, 416.1, 418.1
A112.19.3—2000	Stainless Steel Plumbing Fixtures (Designed for Residential Use) with 2002 Supplement	405.9, 415.1
A112.19.4M—1994(R1999)	Porcelain Enameled Formed Steel Plumbing Fixtures with 1998 and 2000 Supplement	407.1

I-Quest 2006 Codes Complete Collection

A112.19.5—1999	Trim for Water-closet Bowls, Tanks and Urinals.	
A112.19.6—1995	Hydraulic Performance Requirements for Water Closets and Urinals.	
A112.19.7M—1995	Whirlpool Bathtub Appliances	
A112.19.8M—1987(R1996)	Suction Fittings for Use in Swimming Pools, Wading Pools, Spas, Hot Tubs and Whirlpool Bathtub Appliances.	
A112.19.9M—1991(R2002)	Non-Vitreous Ceramic Plumbing Fixtures with 2002 Supplement.	407.1, 408.1 416.1, 417.1
A112.19.12—2000	Wall Mounted and Pedestal Mounted, Adjustable and Pivoting Lavatory and Sink Carrier Systems	
A112.19.13—2001	Electrohydraulic Water Closets	
A112.19.15—2001	Bathtub/Whirlpool Bathtubs with Pressure Sealed Doors.	
A112.21.2M—1983	Roof Drains	
A112.36.2M—1991(R2002)	Cleanouts	
B1.20.1—1983(R2001)	Pipe Threads, General Purpose (inch).	605.10.3, 605.1 605.1 705, 706
B16.3—1998	Malleable Iron Threaded Fittings Classes 150 and 300.	Table 605.1
B16.4—1998	Gray Iron Threaded Fittings Classes 125 and 250.	Table 605.1
B16.9—2003	Factory-made Wrought Steel Buttwelding Fittings.	Table 605.1
B16.11—2001	Forged Fittings, Socket-welding and Threaded.	Table 605.1
B16.12—1998	Cast-iron Threaded Drainage Fittings.	Table 605.1
B16.15—1985(R1994)	Cast Bronze Threaded Fittings	Table 605.1
B16.18—2001	Cast Copper Alloy Solder Joint Pressure Fittings.	Table 605.1
B16.22—2001	Wrought Copper and Copper Alloy Solder Joint Pressure Fittings.	Table 605.1
B16.23—2002	Cast Copper Alloy Solder Joint Drainage Fittings DWV.	Table 605.1
B16.26—1988	Cast Copper Alloy Fittings for Flared Copper Tubes.	Table 605.1
B16.28—1994	Wrought Steel Buttwelding Short Radius Elbows and Returns.	Table 605.1
B16.29—2001	Wrought Copper and Wrought Copper Alloy Solder Joint Drainage Fittings (DWV)	Table 605.1

ASSE

American Society of Sanitary Engineering
901 Canterbury Road, Suite A
Westlake, OH 44145

Standard Reference Number	Title	Page
1001—02	Performance Requirements for Atmospheric Type Vacuum Breakers.	425.2, Table 6
1002—99	Performance Requirements for Antisiphon Fill Valves (Ballcocks) for Gravity Water Closet Flush Tanks.	425.3.

I-Quest 2006 Codes Complete Collection

1003—01	Performance Requirements for Water Pressure Reducing Valves.	
1004—90	Performance Requirements for Backflow Prevention Requirements for Commercial Dishwashing Machines.	
1005—99	Performance Requirements for Water Heater Drain Valves.	
1006—89	Performance Requirements for Residential Use Dishwashers.	
1007—92	Performance Requirements for Home Laundry Equipment.	
1008—89	Performance Requirements for Household Food Waste Disposer Units.	
1009—90	Performance Requirements for Commercial Food Waste Grinder Units.	
1010—96	Performance Requirements for Water Hammer Arresters.	
1011—93	Performance Requirements for Hose Connection Vacuum Breakers.	Table 6
1012—02	Performance Requirements for Backflow Preventers with Intermediate Atmospheric Vent	Table 6
1013—99	Performance Requirements for Reduced Pressure Principle Backflow Preventers and Reduced Pressure Fire Protection Principle Backflow Preventers	Table 6
1014—90	Performance Requirements for Handheld Showers.	
1015—99	Performance Requirements for Double Check Backflow Prevention Assemblies and Double Check Fire Protection Backflow Prevention Assemblies	Table 6
1016—96	Performance Requirements for Individual Thermostatic, Pressure Balancing and Combination Control Valves for Individual Fixture Fittings.	
1017—99	Performance Requirements for Temperature Actuated Mixing Valves for Hot Water Distribution Systems	424.1
1018—01	Performance Requirements for Trap Seal Primer Valves; Potable Water Supplied	
1019—97	Performance Requirements for Vacuum Breaker Wall Hydrants, Freeze Resistant, Automatic Draining Type.	Table 6
1020—98	Performance Requirements for Pressure Vacuum Breaker Assembly.	Table 6
1022—03	Performance Requirements for Backflow Preventer for Carbonated Beverage Machines	Table 6
1024—04	Performance Requirements for Dual Check Valve Type Backflow Preventers (for Residential Supply Service or Individual Outlets).	605.3.
1035—02	Performance Requirements for Laboratory Faucet Backflow Preventers.	Table 6
1037—90	Performance Requirements for Pressurized Flushing Devices for Plumbing Fixtures	
1044—01	Performance Requirements for Trap Seal Primer Devices Drainage Types and Electronic Design Types	
1047—99	Performance Requirements for Reduced Pressure Detector Fire Protection Backflow Prevention Assemblies.	Table 6
1048—99	Performance Requirements for Double Check Detector Fire Protection Backflow Prevention Assemblies.	Table 6
1050—02	Performance Requirements for Stack Air Admittance Valves for Sanitary Drainage Systems	
1051—02	Performance Requirements for Individual and Branch Type Air Admittance Valve for Sanitary Drainage Systems-Fixture and Branch Devices.	
1052—93	Performance Requirements for Hose Connection Backflow Preventers.	Table 6
1055—97	Performance Requirements for Chemical Dispensing Systems.	
1056—01	Performance Requirements for Spill Resistant Vacuum Breaker.	Table 6
1060—96	Performance Requirements for Outdoor Enclosures for Backflow Prevention Assemblies	

I-Quest 2006 Codes Complete Collection

1062—97	Performance Requirements for Temperature Actuated, Flow Reduction Valves to Individual Fixture Fittings.	
1066—97	Performance Requirements for Individual Pressure Balancing In-line Valves for Individual Fixture Fittings.	
1069—05	Performance Requirements for Automatic Temperature Control Mixing Valves	
1070—04	Performance Requirements for Water-temperature Limiting Devices.	408.3, 416.1
5013—98	Performance Requirements for Testing Reduced Pressure Principle Backflow Prevention Assembly (RPA) and Reduced Pressure Fire Protection Principle Backflow Preventers (RFP).	
5015—98	Performance Requirements for Testing Double Check Valve Backflow Prevention Assembly (DCVA)	
5020—98	Performance Requirements for Testing Pressure Vacuum Breaker Assembly (PVBA)	
5047—98	Performance Requirements for Testing Reduced Pressure Detector Fire Protection Backflow Prevention Assemblies (RPDA).	
5048—98	Performance Requirements for Testing Double Check Valve Detector Assembly (DCDA)	
5052—98	Performance Requirements for Testing Hose Connection Backflow Preventers	
5056—98	Performance Requirements for Testing Spill Resistant Vacuum Breaker. . .	

ASTM

ASTM International
100 Barr Harbor Drive
West Conshohocken, PA 19428-2959

Standard Reference Number	Title	§
A 53/A 53M—02	Specification for Pipe, Steel, Black and Hot-dipped, Zinc-coated Welded and Seamless	Table 605.1
A 74—04a	Specification for Cast-iron Soil Pipe and Fittings.	Table 702.1 Table 702.2 708.2, Table 1102.5
A 312/A 312M—04a	Specification for Seamless and Welded Austenitic Stainless Steel Pipes. .	Table 605.1 Table 6
A 733—03	Specification for Welded and Seamless Carbon Steel and Austenitic Stainless Steel Pipe Nipples	
A 778—01	Specification for Welded Unannealed Austenitic Stainless Steel Tubular Products	Table 605.1
A 888—04a	Specification for Hubless Cast-iron Soil Pipe and Fittings for Sanitary and Storm Drain, Waste, and Vent Piping Application.	Table 702.1 Table 702.3 Table 1102.4,
B 32—03	Specification for Solder Metal	605.14.3, 605
B 42—02e01	Specification for Seamless Copper Pipe, Standard Sizes.	Table 605.1
B 43—(2004)	Specification for Seamless Red Brass Pipe, Standard Sizes.	Table 605.1
B 75—02	Specification for Seamless Copper Tube.	Table 605.1

I-Quest 2006 Codes Complete Collection

		Table 702.:
		Table 702.3
B 88—03	Specification for Seamless Copper Water Tube.	Table 605.:
		Table 702.:
		Table 702.3
B 152/B 152M—00	Specification for Copper Sheet, Strip Plate and Rolled Bar.	402.3, 425.
B 251—02e01	Specification for General Requirements for Wrought Seamless Copper and Copper-alloy Tube	Table 605 Table 702.:
		Table 702.3
B 302—02	Specification for Threadless Copper Pipe, Standard Sizes.	Table 605.
B 306—02	Specification for Copper Drainage Tube (DWV).	Table 702.:
B 447—02	Specification for Welded Copper Tube.	Table 605.
B 687—99	Specification for Brass, Copper and Chromium-plated Pipe Nipples.	
B 813—00e01	Specification for Liquid and Paste Fluxes for Soldering of Copper and Copper Alloy Tube	605.14.3, 605
B 828—02	Practice for Making Capillary Joints by Soldering of Copper and Copper Alloy Tube and Fittings	605.14.3, 605
C 4—03	Specification for Clay Drain Tile and Perforated Clay Drain Tile.	Table 702.3,
C 14—03	Specification for Concrete Sewer, Storm Drain and Culvert Pipe.	Table 702.3
C 76—04a	Specification for Reinforced Concrete Culvert, Storm Drain and Sewer Pipe	Table 702.3
C 296—00	Specification for Asbestos-cement Pressure Pipe.	
C 425—04	Specification for Compression Joints for Vitrified Clay Pipe and Fittings.	:
C 428—97(2002)	Specification for Asbestos-cement Nonpressure Sewer Pipe.	Table 702.:
C 443—03	Specification for Joints for Concrete Pipe and Manholes, Using Rubber Gaskets	
C 508—00	Specification for Asbestos-cement Underdrain Pipe.	
C 564—04a	Specification for Rubber Gaskets for Cast-iron Soil Pipe and Fittings.	705.5.2, 7
C 700—02	Specification for Vitrified Clay Pipe, Extra Strength, Standard Strength, and Perforated	Table 702.3,
C 1053—00	Specification for Borosilicate Glass Pipe and Fittings for Drain, Waste, and Vent (DWV) Applications	Table 702.
C 1173—02	Specification for Flexible Transition Couplings for Underground Piping System	705.7.1, 70
C 1277—04	Specification for Shielded Coupling Joining Hubless Cast-iron Soil Pipe and Fittings	
C 1440—99e01	Specification for Thermoplastic Elastomeric (TPE) Gasket Materials for Drain, Waste, and Vent (DWV), Sewer, Sanitary and Storm Plumbing Systems	
C 1460—04	Specification for Shielded Transition Couplings for Use with Dissimilar DWV Pipe and Fittings Above Ground.	
C 1461—02	Specification for Mechanical Couplings Using Thermoplastic Elastomeric (TPE) Gaskets for Joining Drain, Waste and Vent (DWV) Sewer, Sanitary and Storm Plumbing Systems for Above and Below Ground Use.	
C 1540—02	Specification for Heavy Duty Shielded Couplings Joining Hubless Cast-iron Soil Pipe and Fittings	
C 1563—04	Standard Test Method for Gaskets for Use in Connection with Hubs and	

I-Quest 2006 Codes Complete Collection

	Spigot Cast Iron Soil Pipe and Fittings for Sanitary Drain, Waste, Vent and Storm Piping Applications	
D 1527—99e01	Specification for Acrylonitrile-Butadiene-Styrene (ABS) Plastic Pipe, Schedules 40 and 80	
D 1785—04	Specification for Poly (Vinyl Chloride) (PVC) Plastic Pipe, Schedules 40, 80 and 120	
D 1869—95(2000)	Specification for Rubber Rings for Asbestos-cement Pipe.	605.11,
D 2235—01	Specification for Solvent Cement for Acrylonitrile-Butadiene-Styrene (ABS) Plastic Pipe and Fittings	605.10.2, 70
D 2239—03	Specification for Polyethylene (PE) Plastic Pipe (SIDR-PR) Based on Controlled Inside Diameter	
D 2241—04a	Specification for Poly (Vinyl Chloride) (PVC) Pressure-rated Pipe (SDR-Series)	
D 2282—99e01	Specification for Acrylonitrile-Butadiene-Styrene (ABS) Plastic Pipe (SDR-PR)	
D 2464—99	Specification for Threaded Poly (Vinyl Chloride) (PVC) Plastic Pipe Fittings, Schedule 80	Table 605.5
D 2466—02	Specification for Poly (Vinyl Chloride) (PVC) Plastic Pipe Fittings, Schedule 40	Table 605.5
D 2467—04	Specification for Poly (Vinyl Chloride) (PVC) Plastic Pipe Fittings, Schedule 80	Table 605.5
D 2468—96a	Specification for Acrylonitrile-Butadiene-Styrene (ABS) Plastic Pipe Fittings, Schedule 40	Table 605.5
D 2564—02	Specification for Solvent Cements for Poly (Vinyl Chloride) (PVC) Plastic Piping Systems	605.21.2, 70
D 2609—02	Specification for Plastic Insert Fittings for Polyethylene (PE) Plastic Pipe.	Table 605.5
D 2657—97	Standard Practice for Heat Fusion-joining of Polyolefin Pipe and Fitting.	605.19.2, 605.
D 2661—02	Specification for Acrylonitrile-Butadiene-Styrene (ABS) Schedule 40 Plastic Drain, Waste, and Vent Pipe and Fittings.	Table 702. Table 702. 705.2.2, 705.7.2,
D 2662—96a	Specification for Polybutylene (PB) Plastic Pipe (SDR-PR) Based on Controlled Inside Diameter	
D 2665—04ae01	Specification for Poly (Vinyl Chloride) (PVC) Plastic Drain, Waste, and Vent Pipe and Fittings	Table 702. Table 702. Table 1102.4
D 2666—96a	Specification for Polybutylene (PB) Plastic Tubing.	
D 2672—96a(2003)	Specification for Joints for IPS PVC Pipe Using Solvent Cement.	
D 2729—96a	Specification for Poly (Vinyl Chloride) (PVC) Sewer Pipe and Fittings.	
D 2737—03	Specification for Polyethylene (PE) Plastic Tubing.	
D 2751—96a	Specification for Acrylonitrile-Butadiene-Styrene (ABS) Sewer Pipe and Fittings	Table 702.3
D 2846/D 2846M—99	Specification for Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Hot and Cold Water Distribution Systems.	Table 605.:
D 2855—96(2002)	Standard Practice for Making Solvent-cemented Joints with Poly (Vinyl Chloride) (PVC) Pipe and Fittings.	605.21.2, 70
D 2949—01a	Specification for 3.25-in Outside Diameter Poly (Vinyl Chloride) (PVC) Plastic Drain, Waste, and Vent Pipe and Fittings.	Table 702.:
D 3034—04	Specification for Type PSM Poly (Vinyl Chloride) (PVC) Sewer Pipe and Fittings	Table 702.:
D 3139—98	Specification for Joints for Plastic Pressure Pipes Using Flexible	

I-Quest 2006 Codes Complete Collection

	Elastomeric Seals	605.
D 3212—96a(2003)	Specification for Joints for Drain and Sewer Plastic Pipes Using Flexible Elastomeric Seals	705.2.1, 70
D 3309—96a(2002)	Specification for Polybutylene (PB) Plastic Hot and Cold Water Distribution Systems	Table 605.: 605.
D 3311—02	Specification for Drain, Waste and Vent (DWV) Plastic Fittings Patterns.	Table 702.4
D 4068—01	Specification for Chlorinated Polyethylene (CPE) Sheeting for Concealed Water-Containment Membrane	
D 4551—96(2001)	Specification for Poly (Vinyl Chloride) (PVC) Plastic Flexible Concealed Water-Containment Membrane	
F 405—97	Specification for Corrugated Polyethylene (PE) Tubing and Fittings.	
F 409—02	Specification for Thermoplastic Accessible and Replaceable Plastic Tube and Tubular Fittings	424.1.2
F 437—99	Specification for Threaded Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 80.	Table 605.5
F 438—04	Specification for Socket-type Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 40.	Table 605.5
F 439—02e01	Specification for Socket-type Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 80.	Table 605.5
F 441/F 441M—02	Specification for Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe, Schedules 40 and 80	Table 605.:
F 442/F 442M—99	Specification for Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe (SDR-PR)	Table 605.3
F 477—02e01	Specification for Elastomeric Seals (Gaskets) for Joining Plastic Pipe.	(
F 493—04	Specification for Solvent Cements for Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe and Fittings.	
F 628—01	Specification for Acrylonitrile-Butadiene-Styrene (ABS) Schedule 40 Plastic Drain, Waste, and Vent Pipe with a Cellular Core.	Table 702.: Table 702.: 705.2.2, 705.7.2,
F 656—02	Specification for Primers for Use in Solvent Cement Joints of Poly (Vinyl Chloride) (PVC) Plastic Pipe and Fittings.	605.21.2, 70:
F 714—03	Specification for Polyethylene (PE) Plastic Pipe (SDR-PR) Based on Outside Diameter	
F 876—04	Specification for Cross-linked Polyethylene (PEX) Tubing.	
F 877—02e01	Specification for Cross-linked Polyethylene (PEX) Plastic Hot and Cold Water Distribution Systems	Table 605.: Table 605.5, ~
F 891—00e01	Specification for Coextruded Poly (Vinyl Chloride) (PVC) Plastic Pipe with a Cellular Core	Table 702.: Table 702.: Table 1102.4,
F 1281—03	Specification for Cross-linked Polyethylene/Aluminum/Cross-Linked Polyethylene (PEX-AL-PEX) Pressure Pipe.	Table 605.
F 1282—03	Specification for Polyethylene/Aluminum/Polyethylene (PE-AL-PE) Composite Pressure Pipe	Table 605.
F 1412—01	Specification for Polyolefin Pipe and Fittings for Corrosive Waste Drainage	Table 702.:
F 1488—03	Specification for Coextruded Composite Pipe.	Table 702.:
F 1807—04	Specification for Metal Insert Fittings Utilizing a Copper Crimp Ring for SDR9 Cross-linked Polyethylene (PEX) Tubing.	Table 6
F 1866—98	Specification for Poly (Vinyl Chloride) (PVC) Plastic Schedule 40	

I-Quest 2006 Codes Complete Collection

Chattanooga, TN 37421

Standard Reference Number	Title	§
301—04a	Specification for Hubless Cast-iron Soil Pipe and Fittings for Sanitary and Storm Drain, Waste and Vent Piping Applications.	Table 702.1 Table 702.2 Table 1102.4,
310—04	Specification for Coupling for Use in Connection with Hubless Cast-iron Soil Pipe and Fittings for Sanitary and Storm Drain, Waste and Vent Piping Applications	

CSA

Canadian Standards Association
178 Rexdale Blvd.
Rexdale (Toronto), Ontario, Canada M9W 1R3

Standard Reference Number	Title	§
B45.1—02	Ceramic Plumbing Fixtures	408.1, 416.1
B45.2—02	Enameled Cast-iron Plumbing Fixtures.	407.1, 415.1
B45.3—02	Porcelain Enameled Steel Plumbing Fixtures.	407.1
B45.4—02	Stainless-steel Plumbing Fixtures.	415.1, 416.1
B45.5—02	Plastic Plumbing Fixtures	407.1, 416.2
B45.9—99	Macerating Systems and Related Components.	
B45.10—01	Hydromassage Bathtubs	
B64.1.2—01	Vacuum Breakers, Pressure Type (PVB).	Table 6
B64.2.1—01	Vacuum Breakers, Hose Connection Type (HCVB) with Manual Draining Feature	Table 6
B64.2.1.1—01	Vacuum Breakers, Hose Connection Dual Check Type (HCDVB).	Table 6
B64.3.1—01	Backflow Preventers, Dual Check Valve Type with Atmospheric Port for Carbonators (DCAPC)	Table 6
B64.4.1—01	Backflow Preventers, Reduced Pressure Principle Type for Fire Sprinklers (RPF)	Table 6
B64.5—01	Backflow Preventers, Double Check Type (DCVA).	Table 6
B64.5.1—01	Backflow Preventers, Double Check Type for Fire Systems (DCVAF).	Table 6
B64.6—01	Backflow Preventers, Dual Check Valve Type (DuC).	605.3.
B64.7—94	Vacuum Breakers, Laboratory Faucet Type (LFVB).	Table 6
B64.10/B64.10.1—01	Manual for the Selection and Installation of Backflow Prevention Devices/Manual for the Maintenance and Field Testing of Backflow Prevention Devices	
B79—94(2000)	Floor, Area and Shower Drains, and Cleanouts for Residential Construction	
B125—01	Plumbing Fittings	424.1, 424.3, 425.5, 607.
B137.1—02	Polyethylene Pipe, Tubing and Fittings for Cold Water Pressure Services.	
B137.2—02	PVC Injection-moulded Gasketed Fittings for Pressure Applications.	Table 605.5
B137.3—02	Rigid Poly (Vinyl Chloride) (PVC) Pipe for Pressure Applications.	Table 605.5 701

I-Quest 2006 Codes Complete Collection

B137.5—02	Cross-linked Polyethylene (PEX) Tubing Systems for Pressure Applications—with Revisions through September 1992.	Table 605.
B137.6—02	CPVC Pipe, Tubing and Fittings for Hot and Cold Water Distribution Systems—with Revisions through May 1986.	Table 605.
B137.11—02	Polypropylene (PP-R) Pipe and Fittings for Pressure Applications.	Table 605.:
B181.1—02	ABS Drain, Waste and Vent Pipe and Pipe Fittings.	Table 702.· Table 702.4, 70
B181.2—02	PVC Drain, Waste, and Vent Pipe and Pipe Fittings—with Revisions through December 1993	Table 702.· 705.8.2, 7
B182.1—02	Plastic Drain and Sewer Pipe and Pipe Fittings.	705.8.2, 7
B182.2—02	PVC Sewer Pipe and Fittings (PSM Type).	Table 702.3
B182.4—02	Profile PVC Sewer Pipe and Fittings.	Table 702.3,
B182.6—02	Profile Polyethylene Sewer Pipe and Fittings for Leak-proof Sewer Applications	
B182.8—02	Profile Polyethylene Storm Sewer and Drainage Pipe and Fittings.	
CAN3-B137.8M—99	Polybutylene (PB) Piping for Pressure Applications—with Revisions through July 1992	Table 605.: 605.
CAN/CSA-A257.1M—92	Circular Concrete Culvert, Storm Drain, Sewer Pipe and Fittings.	Table 702.3
CAN/CSA-A257.2M—92	Reinforced Circular Concrete Culvert, Storm Drain, Sewer Pipe and Fittings	Table 702.3
CAN/CSA-A257.3M—92	Joints for Circular Concrete Sewer and Culvert Pipe, Manhole Sections and Fittings Using Rubber Gaskets.	
CAN/CSA-B64.1.1—01	Vacuum Breakers, Atmospheric Type (AVB).	425.2, Table 6
CAN/CSA-B64.2—01	Vacuum Breakers, Hose Connection Type (HCVB).	Table 6
CAN/CSA-B64.2.2—01	Vacuum Breakers, Hose Connection Type (HCVB) with Automatic Draining Feature	Table 6
CAN/CSA-B64.3—01	Backflow Preventers, Dual Check Valve Type with Atmospheric Port (DCAP)	Table 6(
CAN/CSA-B64.4—01	Backflow Preventers, Reduced Pressure Principle Type (RP).	Table 6(
CAN/CSA-B64.10—01	Manual for the Selection, Installation, Maintenance and Field Testing of Backflow Prevention Devices	
CAN/CSA-B137.9—02	Polyethylene/Aluminum/Polyethylene Composite Pressure Pipe Systems	
CAN/CSA-B137.10M—02	Cross-linked Polyethylene/Aluminum/Polyethylene Composite Pressure Pipe Systems	Table 605.
CAN/CSA-B181.3—02	Polyolefin Laboratory Drainage Systems.	Table 702.
CAN/CSA-B182.4—02	Profile PVC Sewer Pipe and Fittings.	Table 702.3,
CAN/CSA-B602—02	Mechanical Couplings for Drain, Waste and Vent Pipe and Sewer Pipe.	705.2.1, ; 705.7.1, 70!



International Code Council
5203 Leesburg Pike, Suite 600
Falls Church, VA 22041

I-Quest 2006 Codes Complete Collection

Standard Reference Number	Title	§
IBC—06	International Building Code®	201.3, 305.4 307.3, 308.2 310.3, 403. 404.1, 407.3 6
ICC EC—06	ICC Electrical Code®—Administrative Provisions.	201.3, 502.1, 5
IEBC—06	International Existing Building Code®.	
IECC—06	International Energy Conservation Code®.	313.1,
IFC—06	International Fire Code®	
IFGC—06	International Fuel Gas Code®	101.1,
IMC—06	International Mechanical Code®.	201.3, 307.6 502.1,
IPSDC—06	International Private Sewage Disposal Code®.	
IRC—06	International Residential Code®.	

ISEA

Industry Safety Equipment Association
1901 N. Moore Street, Suite 808
Arlington, VA 22209

Standard Reference Number	Title	§
Z358.1—03	Emergency Eyewash and Shower Equipment.	

NFPA

National Fire Protection Association
Batterymarch Park
Quincy, MA 02269

Standard Reference Number	Title	§
50—01	Bulk Oxygen Systems at Consumer Sites.	
51—02	Design and Installation of Oxygen-fuel Gas Systems for Welding, Cutting and Allied Processes	
70—05	National Electrical Code	502.1, 5
99C—02	Gas and Vacuum Systems	

NSF

NSF International
789 Dixboro Road
Ann Arbor, MI 48105

Standard Reference Number	Title	§
3—2003	Commercial Warewashing Equipment.	
14—2003	Plastic Piping System Components and Related Materials.	
18—2004	Manual Food and Beverage Dispensing Equipment.	
42—2002e	Drinking Water Treatment Units—Aesthetic Effects.	

I-Quest 2006 Codes Complete Collection

44—2004	Residential Cation Exchange Water Softeners.	
53—2002e	Drinking Water Treatment Units—Health Effects.	
58—2004	Reverse Osmosis Drinking Water Treatment Systems.	
61—2003e	Drinking Water System Components—Health Effects.	424.1, 605.3
62—2004	Drinking Water Distillation Systems.	

PDI

Plumbing and Drainage Institute
800 Turnpike Street, Suite 300
North Andover, MA 01845

Standard Reference Number	Title	§
G101(2003)	Testing and Rating Procedure for Grease Interceptors with Appendix of Sizing and Installation Data	

UL

Underwriters Laboratories, Inc.
333 Pfingsten Road
Northbrook, IL 60062-2096

Standard Reference Number	Title	§
UL508—99	Industrial Control Equipment	

2006 International Plumbing Code / APPENDIX A PLUMBING PERMIT FEE SCHEDULE

**APPENDIX A
PLUMBING PERMIT FEE SCHEDULE**

2006 International Plumbing Code / APPENDIX A PLUMBING PERMIT FEE SCHEDULE / Permit Issuance

Permit Issuance

- | | |
|---|----------|
| 1. For issuing each permit | \$ _____ |
| 2. For issuing each supplemental permit | _____ |

**2006 International Plumbing Code / APPENDIX A PLUMBING PERMIT FEE
SCHEDULE / Unit Fee Schedule**

Unit Fee Schedule

1. For each plumbing fixture or trap or set of fixtures on one trap (including water, drainage piping and backflow protection thereof) _____
2. For each building sewer and each trailer park sewer _____
3. Rainwater systems—per drain (inside building) _____
4. For each cesspool (where permitted) _____
5. For each private sewage disposal system _____
6. For each water heater and/or vent _____
7. For each industrial waste pretreatment interceptor including its trap and vent, excepting kitchen-type grease interceptors functioning as fixture traps _____
8. For installation, alteration or repair of water-piping and/or water-treating equipment, each _____
9. For repair or alteration of drainage or vent piping, each fixture _____
10. For each lawn sprinkler system on any one meter including backflow protection devices therefor _____
11. For atmospheric-type vacuum breakers not included in Item 2:
 - 1 to 5 _____
 - over 5, each _____
12. For each backflow protective device other than atmospheric-type vacuum breakers:
 - 2 inches (51 mm) and smaller _____
 - Over 2 inches (51 mm) _____

**2006 International Plumbing Code / APPENDIX A PLUMBING PERMIT FEE
SCHEDULE / Other Inspections and Fees**

Other Inspections and Fees

1. Inspections outside of normal business hours _____ per hour

I-Quest 2006 Codes Complete Collection

(minimum charge two hours)

2. Reinspection fee assessed under provisions of Section 107.3.3 _____ each
3. Inspections for which no fee is specifically indicated _____ per hour
(minimum charge one-half hour)
4. Additional plan review required by changes, additions or revisions to approved plans (minimum charge one-half hour) _____ per hour

2006 International Plumbing Code / APPENDIX B RATES OF RAINFALL FOR VARIOUS CITIES

**APPENDIX B
RATES OF RAINFALL FOR VARIOUS CITIES**

Rainfall rates, in inches per hour, are based on a storm of one-hour duration and a 100-year return period. The rainfall rates shown in the appendix are derived from Figure 1106.1.

Alabama:

Birmingham. 3.8
Huntsville. 3.6
Mobile. 4.6
Montgomery. 4.2

Alaska:

Fairbanks. 1.0
Juneau. 0.6

Arizona:

Flagstaff. 2.4
Nogales. 3.1
Phoenix. 2.5
Yuma. 1.6

I-Quest 2006 Codes Complete Collection

Arkansas:

Fort Smith. 3.6
Little Rock. 3.7
Texarkana. 3.8

California:

Barstow. 1.4
Crescent City. 1.5
Fresno. 1.1
Los Angeles. 2.1
Needles. 1.6
Placerville. 1.5
San Fernando. 2.3
San Francisco. 1.5
Yreka. 1.4

Colorado:

Craig. 1.5
Denver. 2.4
Durango. 1.8
Grand Junction. 1.7
Lamar. 3.0
Pueblo. 2.5

Connecticut:

Hartford. 2.7
New Haven. 2.8
Putnam. 2.6

Delaware:

Georgetown. 3.0

I-Quest 2006 Codes Complete Collection

Wilmington. 3.1

District of Columbia:

Washington. 3.2

Florida:

Jacksonville. 4.3

Key West. 4.3

Miami. 4.7

Pensacola. 4.6

Tampa. 4.5

Georgia:

Atlanta. 3.7

Dalton. 3.4

Macon. 3.9

Savannah. 4.3

Thomasville. 4.3

Hawaii:

Hilo. 6.2

Honolulu. 3.0

Wailuku. 3.0

Idaho:

Boise. 0.9

Lewiston. 1.1

Pocatello. 1.2

Illinois:

Cairo. 3.3

Chicago. 3.0

Peoria. 3.3

I-Quest 2006 Codes Complete Collection

Rockford. 3.2

Springfield. 3.3

Indiana:

Evansville. 3.2

Fort Wayne. 2.9

Indianapolis. 3.1

Iowa:

Davenport. 3.3

Des Moines. 3.4

Dubuque. 3.3

Sioux City. 3.6

Kansas:

Atwood. 3.3

Dodge City. 3.3

Topeka. 3.7

Wichita. 3.7

Kentucky:

Ashland. 3.0

Lexington. 3.1

Louisville. 3.2

Middlesboro. 3.2

Paducah. 3.3

Louisiana:

Alexandria. 4.2

Lake Providence. 4.0

New Orleans. 4.8

Shreveport. 3.9

I-Quest 2006 Codes Complete Collection

Maine:

Bangor. 2.2
Houlton. 2.1
Portland. 2.4

Maryland:

Baltimore. 3.2
Hagerstown. 2.8
Oakland. 2.7
Salisbury. 3.1

Massachusetts:

Boston. 2.5
Pittsfield. 2.8
Worcester. 2.7

Michigan:

Alpena. 2.5
Detroit. 2.7
Grand Rapids. 2.6
Lansing. 2.8
Marquette. 2.4
Sault Ste. Marie. 2.2

Minnesota:

Duluth. 2.8
Grand Marais. 2.3
Minneapolis. 3.1
Moorhead. 3.2
Worthington. 3.5

Mississippi:

I-Quest 2006 Codes Complete Collection

Biloxi. 4.7
Columbus. 3.9
Corinth. 3.6
Natchez. 4.4
Vicksburg. 4.1

Missouri:

Columbia. 3.2
Kansas City. 3.6
Springfield. 3.4
St. Louis. 3.2

Montana:

Ekalaka. 2.5
Havre. 1.6
Helena. 1.5
Kalispell. 1.2
Missoula. 1.3

Nebraska:

North Platte. 3.3
Omaha. 3.8
Scottsbluff. 3.1
Valentine. 3.2

Nevada:

Elko. 1.0
Ely. 1.1
Las Vegas. 1.4
Reno. 1.1

New Hampshire:

I-Quest 2006 Codes Complete Collection

Berlin. 2.5

Concord. 2.5

Keene. 2.4

New Jersey:

Atlantic City. 2.9

Newark. 3.1

Trenton. 3.1

New Mexico:

Albuquerque. 2.0

Hobbs. 3.0

Raton. 2.5

Roswell. 2.6

Silver City. 1.9

New York:

Albany. 2.5

Binghamton. 2.3

Buffalo. 2.3

Kingston. 2.7

New York. 3.0

Rochester. 2.2

North Carolina:

Asheville. 4.1

Charlotte. 3.7

Greensboro. 3.4

Wilmington. 4.2

North Dakota:

Bismarck. 2.8

I-Quest 2006 Codes Complete Collection

Devils Lake. 2.9

Fargo. 3.1

Williston. 2.6

Ohio:

Cincinnati. 2.9

Cleveland. 2.6

Columbus. 2.8

Toledo. 2.8

Oklahoma:

Altus. 3.7

Boise City. 3.3

Durant. 3.8

Oklahoma City. 3.8

Oregon:

Baker. 0.9

Coos Bay. 1.5

Eugene. 1.3

Portland. 1.2

Pennsylvania:

Erie. 2.6

Harrisburg. 2.8

Philadelphia. 3.1

Pittsburgh. 2.6

Scranton. 2.7

Rhode Island:

Block Island. 2.75

Providence. 2.6

I-Quest 2006 Codes Complete Collection

South Carolina:

Charleston. 4.3
Columbia. 4.0
Greenville. 4.1

South Dakota:

Buffalo. 2.8
Huron. 3.3
Pierre. 3.1
Rapid City. 2.9
Yankton. 3.6

Tennessee:

Chattanooga. 0.5
Knoxville. 3.2
Memphis. 3.7
Nashville. 3.3

Texas:

Abilene. 3.6
Amarillo. 3.5
Brownsville. 4.5
Dallas. 4.0
Del Rio. 4.0
El Paso. 2.3
Houston. 4.6
Lubbock. 3.3
Odessa. 3.2
Pecos. 3.0
San Antonio. 4.2

I-Quest 2006 Codes Complete Collection

Utah:

Brigham City.1.2
Roosevelt.1.3
Salt Lake City.1.3
St. George. 1.7

Vermont:

Barre. 2.3
Bratteboro. 2.7
Burlington.2.1
Rutland. 2.5

Virginia:

Bristol.2.7
Charlottesville. 2.8
Lynchburg. 3.2
Norfolk. 3.4
Richmond.3.3

Washington:

Omak. 1.1
Port Angeles.1.1
Seattle. 1.4
Spokane.1.0
Yakima.1.1

West Virginia:

Charleston. 2.8
Morgantown.2.7

Wisconsin:

Ashland. 2.5

I-Quest 2006 Codes Complete Collection

Eau Claire. 2.9
Green Bay. 2.6
La Crosse. 3.1
Madison. 3.0
Milwaukee. 3.0

Wyoming:

Cheyenne. 2.2
Fort Bridger. 1.3
Lander. 1.5
New Castle. 2.5
Sheridan. 1.7
Yellowstone Park. 1.4

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS

**APPENDIX C
GRAY WATER RECYCLING SYSTEMS**

Note: Section 301.3 of this code requires all plumbing fixtures that receive water or waste to discharge to the sanitary drainage system of the structure. In order to allow for the utilization of a gray water system, Section 301.3 should be revised to read as follows:

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / 301.3 Connections to drainage system.

301.3 Connections to drainage system.

All plumbing fixtures, drains, appurtenances and appliances used to receive or discharge liquid wastes or sewage shall be directly connected to the sanitary drainage system of the building or premises, in accordance with the requirements of this code. This section shall not be construed to prevent indirect waste systems required by Chapter 8.

Exception: Bathtubs, showers, lavatories, clothes washers and laundry trays shall not be required to discharge to the sanitary drainage system where such fixtures discharge to an

approved gray water system for flushing of water closets and urinals or for subsurface landscape irrigation.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C101 GENERAL

**SECTION C101
GENERAL**

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C101 GENERAL / C101.1 Scope.

C101.1 Scope.

The provisions of this appendix shall govern the materials, design, construction and installation of gray water systems for flushing of water closets and urinals and for subsurface landscape irrigation (see Figures 1 and 2).

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C101 GENERAL / C101.2 Definition.

C101.2 Definition.

The following term shall have the meaning shown herein.

GRAY WATER. Waste discharged from lavatories, bathtubs, showers, clothes washers and laundry trays.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C101 GENERAL / C101.3 Permits.

C101.3 Permits.

Permits shall be required in accordance with Section 106.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C101 GENERAL / C101.4 Installation.

C101.4 Installation.

In addition to the provisions of Section C101, systems for flushing of water closets and urinals shall comply with Section C102 and systems for subsurface landscape irrigation shall comply with Section C103. Except as provided for in Appendix C, all systems shall comply with the provisions of the *International Plumbing Code*.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C101 GENERAL / C101.5 Materials.

C101.5 Materials.

Above-ground drain, waste and vent piping for gray water systems shall conform to one of the standards listed in Table 702.1. Gray water underground building drainage and vent pipe shall conform to one of the standards listed in Table 702.2.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C101 GENERAL / C101.6 Tests.

C101.6 Tests.

Drain, waste and vent piping for gray water systems shall be tested in accordance with Section 312.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C101 GENERAL / C101.7 Inspections.

C101.7 Inspections.

Gray water systems shall be inspected in accordance with Section 107.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C101 GENERAL / C101.8 Potable water connections.

C101.8 Potable water connections.

Only connections in accordance with Section C102.3 shall be made between a gray water recycling system and a potable water system.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C101 GENERAL / C101.9 Waste water connections.

C101.9 Waste water connections.

Gray water recycling systems shall receive only the waste discharge of bathtubs, showers, lavatories, clothes washers or laundry trays.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C101 GENERAL / C101.10 Collection reservoir.

C101.10 Collection reservoir.

Gray water shall be collected in an approved reservoir constructed of durable, nonabsorbent and corrosion-resistant materials. The reservoir shall be a closed and gas-tight vessel. Access

openings shall be provided to allow inspection and cleaning of the reservoir interior.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C101 GENERAL / C101.11 Filtration.

C101.11 Filtration.

Gray water entering the reservoir shall pass through an approved filter such as a media, sand or diatomaceous earth filter.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C101 GENERAL / C101.11 Filtration. / C101.11.1 Required valve.

C101.11.1 Required valve.

A full-open valve shall be installed downstream of the last fixture connection to the gray water discharge pipe before entering the required filter.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C101 GENERAL / C101.12 Overflow.

C101.12 Overflow.

The collection reservoir shall be equipped with an overflow pipe having the same or larger diameter as the influent pipe for the gray water. The overflow pipe shall be indirectly connected to the sanitary drainage system.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C101 GENERAL / C101.13 Drain.

C101.13 Drain.

A drain shall be located at the lowest point of the collection reservoir and shall be indirectly connected to the sanitary drainage system. The drain shall be the same diameter as the overflow pipe required in Section C101.12.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C101 GENERAL / C101.14 Vent required.

C101.14 Vent required.

The reservoir shall be provided with a vent sized in accordance with Chapter 9 and based on the diameter of the reservoir influent pipe.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C102 SYSTEMS FOR FLUSHING WATER CLOSETS AND

URINALS

SECTION C102 SYSTEMS FOR FLUSHING WATER CLOSETS AND URINALS

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C102 SYSTEMS FOR FLUSHING WATER CLOSETS AND URINALS / C102.1 Collection reservoir.

C102.1 Collection reservoir.

The holding capacity of the reservoir shall be a minimum of twice the volume of water required to meet the daily flushing requirements of the fixtures supplied with gray water, but not less than 50 gallons (189 L). The reservoir shall be sized to limit the retention time of gray water to a maximum of 72 hours.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C102 SYSTEMS FOR FLUSHING WATER CLOSETS AND URINALS / C102.2 Disinfection.

C102.2 Disinfection.

Gray water shall be disinfected by an approved method that employs one or more disinfectants such as chlorine, iodine or ozone.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C102 SYSTEMS FOR FLUSHING WATER CLOSETS AND URINALS / C102.3 Makeup water.

C102.3 Makeup water.

Potable water shall be supplied as a source of makeup water for the gray water system. The potable water supply shall be protected against backflow in accordance with Section 608. There shall be a full-open valve located on the makeup water supply line to the collection reservoir.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C102 SYSTEMS FOR FLUSHING WATER CLOSETS AND URINALS / C102.4 Coloring.

C102.4 Coloring.

The gray water shall be dyed blue or green with a food grade vegetable dye before such water is supplied to the fixtures.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C102 SYSTEMS FOR FLUSHING WATER CLOSETS AND URINALS / C102.5 Materials.

C102.5 Materials.

Distribution piping shall conform to one of the standards listed in Table 605.4.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C102 SYSTEMS FOR FLUSHING WATER CLOSETS AND URINALS / C102.6 Identification.

C102.6 Identification.

Distribution piping and reservoirs shall be identified as containing nonpotable water. Piping identification shall be in accordance with Section 608.8.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS

**SECTION C103
SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS**

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.1 Collection reservoir.

C103.1 Collection reservoir.

Reservoirs shall be sized to limit the retention time of gray water to a maximum of 24 hours.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.1 Collection reservoir. / C103.1.1 Identification.

C103.1.1 Identification.

The reservoir shall be identified as containing nonpotable water.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.2 Valves required.

C103.2 Valves required.

A check valve and a full-open valve located on the discharge side of the check valve shall be installed on the effluent pipe of the collection reservoir.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.3 Makeup water.

C103.3 Makeup water.

Makeup water shall not be required for subsurface landscape irrigation systems. Where makeup water is provided, the installation shall be in accordance with Section C102.3.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.4 Disinfection.

C103.4 Disinfection.

Disinfection shall not be required for gray water used for subsurface landscape irrigation systems.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.5 Coloring.

C103.5 Coloring.

Gray water used for subsurface landscape irrigation systems shall not be required to be dyed.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.6 Estimating gray water discharge.

C103.6 Estimating gray water discharge.

The system shall be sized in accordance with the gallons-per-day-per-occupant number based on the type of fixtures connected to the gray water system. The discharge shall be calculated by the following equation:

$$C = A \times B$$

A = Number of occupants:

Residential—Number of occupants shall be determined by the actual number of occupants, but not less than two occupants for one bedroom and one occupant for each

I-Quest 2006 Codes Complete Collection

additional bedroom.

Commercial—Number of occupants shall be determined by the *International Building Code*[®].

B = Estimated flow demands for each occupant:

Residential—25 gallons per day (94.6 lpd) per occupant for showers, bathtubs and lavatories and 15 gallons per day (56.7 lpd) per occupant for clothes washers or laundry trays.

Commercial—Based on type of fixture or water use records minus the discharge of fixtures other than those discharging gray water.

C = Estimated gray water discharge based on the total number of occupants.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.7 Percolation tests.

C103.7 Percolation tests.

The permeability of the soil in the proposed absorption system shall be determined by percolation tests or permeability evaluation.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.7 Percolation tests. / C103.7.1 Percolation tests and procedures.

C103.7.1 Percolation tests and procedures.

At least three percolation tests in each system area shall be conducted. The holes shall be spaced uniformly in relation to the bottom depth of the proposed absorption system. More percolation tests shall be made where necessary, depending on system design.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.7 Percolation tests. / C103.7.1 Percolation tests and procedures. / C103.7.1.1 Percolation test hole.

C103.7.1.1 Percolation test hole.

The test hole shall be dug or bored. The test hole shall have vertical sides and a horizontal dimension of 4 inches to 8 inches (102 mm to 203 mm). The bottom and sides of the hole shall be scratched with a sharp-pointed instrument to expose the natural soil. All loose material shall be removed from the hole and the bottom shall be covered with 2

inches (51 mm) of gravel or coarse sand.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.7 Percolation tests. / C103.7.1 Percolation tests and procedures. / C103.7.1.2 Test procedure, sandy soils.

C103.7.1.2 Test procedure, sandy soils.

The hole shall be filled with clear water to a minimum of 12 inches (305 mm) above the bottom of the hole for tests in sandy soils. The time for this amount of water to seep away shall be determined, and this procedure shall be repeated if the water from the second filling of the hole seeps away in 10 minutes or less. The test shall proceed as follows: Water shall be added to a point not more than 6 inches (152 mm) above the gravel or coarse sand. Thereupon, from a fixed reference point, water levels shall be measured at 10-minute intervals for a period of 1 hour. Where 6 inches (152 mm) of water seeps away in less than 10 minutes, a shorter interval between measurements shall be used, but in no case shall the water depth exceed 6 inches (152 mm). Where 6 inches (152 mm) of water seeps away in less than 2 minutes, the test shall be stopped and a rate of less than 3 minutes per inch (7.2 s/mm) shall be reported. The final water level drop shall be used to calculate the percolation rate. Soils not meeting the above requirements shall be tested in accordance with Section C103.7.1.3.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.7 Percolation tests. / C103.7.1 Percolation tests and procedures. / C103.7.1.3 Test procedure, other soils.

C103.7.1.3 Test procedure, other soils.

The hole shall be filled with clear water, and a minimum water depth of 12 inches (305 mm) shall be maintained above the bottom of the hole for a 4-hour period by refilling whenever necessary or by use of an automatic siphon. Water remaining in the hole after 4 hours shall not be removed. Thereafter, the soil shall be allowed to swell not less than 16 hours or more than 30 hours. Immediately after the soil swelling period, the measurements for determining the percolation rate shall be made as follows: Any soil sloughed into the hole shall be removed and the water level shall be adjusted to 6 inches (152 mm) above the gravel or coarse sand. Thereupon, from a fixed reference point, the water level shall be measured at 30-minute intervals for a period of 4 hours, unless two successive water level drops do not vary by more than 0.62 inch (1.59 mm). At least three water level drops shall be observed and recorded. The hole shall be filled with clear water to a point not more than 6 inches (152 mm) above the gravel or coarse sand whenever it becomes nearly empty. Adjustments of the water level shall not be made during the three measurement periods except to the limits of the last measured water level drop. When the first 6 inches (152 mm) of water seeps away in less than 30

minutes, the time interval between measurements shall be 10 minutes and the test run for 1 hour. The water depth shall not exceed 5 inches (127 mm) at any time during the measurement period. The drop that occurs during the final measurement period shall be used in calculating the percolation rate.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.7 Percolation tests. / C103.7.1 Percolation tests and procedures. / C103.7.1.4 Mechanical test equipment.

C103.7.1.4 Mechanical test equipment.

Mechanical percolation test equipment shall be of an approved type.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.7 Percolation tests. / C103.7.2 Permeability evaluation.

C103.7.2 Permeability evaluation.

Soil shall be evaluated for estimated percolation based on structure and texture in accordance with accepted soil evaluation practices. Borings shall be made in accordance with Section C103.7.1 for evaluating the soil.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.8 Subsurface landscape irrigation site location.

C103.8 Subsurface landscape irrigation site location.

The surface grade of all soil absorption systems shall be located at a point lower than the surface grade of any water well or reservoir on the same or adjoining property. Where this is not possible, the site shall be located so surface water drainage from the site is not directed toward a well or reservoir. The soil absorption system shall be located with a minimum horizontal distance between various elements as indicated in Table C103.8. Private sewage disposal systems in compacted areas, such as parking lots and driveways, are prohibited. Surface water shall be diverted away from any soil absorption site on the same or neighboring lots.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.8 Subsurface landscape irrigation site location. / TABLE C103.8 LOCATION OF GRAY WATER SYSTEM

**TABLE C103.8
LOCATION OF GRAY WATER SYSTEM**

I-Quest 2006 Codes Complete Collection
shall be diverted away from any soil absorption site on the same or neighboring lots.

**TABLE C103.8
LOCATION OF GRAY WATER SYSTEM**

ELEMENT	MINIMUM HORIZONTAL DISTANCE	
	HOLDING TANK (feet)	IRRIGATION DISPOSAL FIELD (feet)
Buildings	5	2
Property line adjoining private property	5	5
Water wells	50	100
Streams and lakes	50	50
Seepage pits	5	5
Septic tanks	0	5
Water service	5	5
Public water main	10	10

For SI: 1 foot = 304.8 mm.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.9 Installation.

C103.9 Installation.

Absorption systems shall be installed in accordance with Sections C103.9.1 through C103.9.5 to provide landscape irrigation without surfacing of gray water.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.9 Installation. / C103.9.1 Absorption area.

C103.9.1 Absorption area.

The total absorption area required shall be computed from the estimated daily gray water discharge and the design-loading rate based on the percolation rate for the site. The required absorption area equals the estimated gray water discharge divided by the design-loading rate from Table C103.9.1.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.9 Installation. / TABLE C103.9.1 DESIGN LOADING RATE

**TABLE C103.9.1
DESIGN LOADING RATE**

I-Quest 2006 Codes Complete Collection

PERCOLATION RATE (minutes per inch)	DESIGN LOADING FACTOR (gallons per square foot per day)
0 to less than 10	1.2
10 to less than 30	0.8
30 to less than 45	0.72
45 to 60	0.4

For SI: 1 minute per inch = min/25.4 mm,
1 gallon per square foot = 40.7 L/m².

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.9 Installation. / C103.9.2 Seepage trench excavations.

C103.9.2 Seepage trench excavations.

Seepage trench excavations shall be a minimum of 1 foot (304 mm) to a maximum of 5 feet (1524 mm) wide. Trench excavations shall be spaced a minimum of 2 feet (610 mm) apart. The soil absorption area of a seepage trench shall be computed by using the bottom of the trench area (width) multiplied by the length of pipe. Individual seepage trenches shall be a maximum of 100 feet (30 480 mm) in developed length.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.9 Installation. / C103.9.3 Seepage bed excavations.

C103.9.3 Seepage bed excavations.

Seepage bed excavations shall be a minimum of 5 feet (1524 mm) wide and have more than one distribution pipe. The absorption area of a seepage bed shall be computed by using the bottom of the trench area. Distribution piping in a seepage bed shall be uniformly spaced a maximum of 5 feet (1524 mm) and a minimum of 3 feet (914 mm) apart, and a maximum of 3 feet (914 mm) and a minimum of 1 foot (305 mm) from the sidewall or headwall.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.9 Installation. / C103.9.4 Excavation and construction.

C103.9.4 Excavation and construction.

The bottom of a trench or bed excavation shall be level. Seepage trenches or beds shall not be excavated where the soil is so wet that such material rolled between the hands forms a soil wire. All smeared or compacted soil surfaces in the sidewalls or bottom of seepage trench or bed excavations shall be scarified to the depth of smearing or compaction and the loose material removed. Where rain falls on an open excavation, the soil shall be left until sufficiently dry so a soil wire will not form when soil from the excavation bottom is rolled

between the hands. The bottom area shall then be scarified and loose material removed.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.9 Installation. / C103.9.5 Aggregate and backfill.

C103.9.5 Aggregate and backfill.

A minimum of 6 inches of aggregate ranging in size from ½ to 2½ inches (12.7 mm to 64 mm) shall be laid into the trench below the distribution piping elevation. The aggregate shall be evenly distributed a minimum of 2 inches (51 mm) over the top of the distribution pipe. The aggregate shall be covered with approved synthetic materials or 9 inches (229 mm) of uncompacted marsh hay or straw. Building paper shall not be used to cover the aggregate. A minimum of 9 inches (229 mm) of soil backfill shall be provided above the covering.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.10 Distribution piping.

C103.10 Distribution piping.

Distribution piping shall be not less than 3 inches (76 mm) in diameter. Materials shall comply with Table C103.10. The top of the distribution pipe shall be not less than 8 inches (203 mm) below the original surface. The slope of the distribution pipes shall be a minimum of 2 inches (51 mm) and a maximum of 4 inches (102 mm) per 100 feet (30 480 mm).

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.10 Distribution piping. / TABLE C103.10 DISTRIBUTION PIPE

**TABLE C103.10
DISTRIBUTION PIPE**

MATERIAL	STANDARD
Polyethylene (PE) plastic pipe	ASTM F 405
Polyvinyl chloride (PVC) plastic pipe	ASTM D 2729
Polyvinyl chloride (PVC) plastic pipe with pipe stiffness of PS 35 and PS 50	ASTM F 1488


2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / SECTION C103 SUBSURFACE LANDSCAPE IRRIGATION SYSTEMS / C103.11 Joints.

C103.11 Joints.

Joints in distribution pipe shall be made in accordance with Section 705 of this code.

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / FIGURE 1 GRAY WATER RECYCLING SYSTEM FOR SUBSURFACE LANDSCAPE IRRIGATION


**FIGURE 1
GRAY WATER RECYCLING SYSTEM FOR SUBSURFACE LANDSCAPE IRRIGATION**

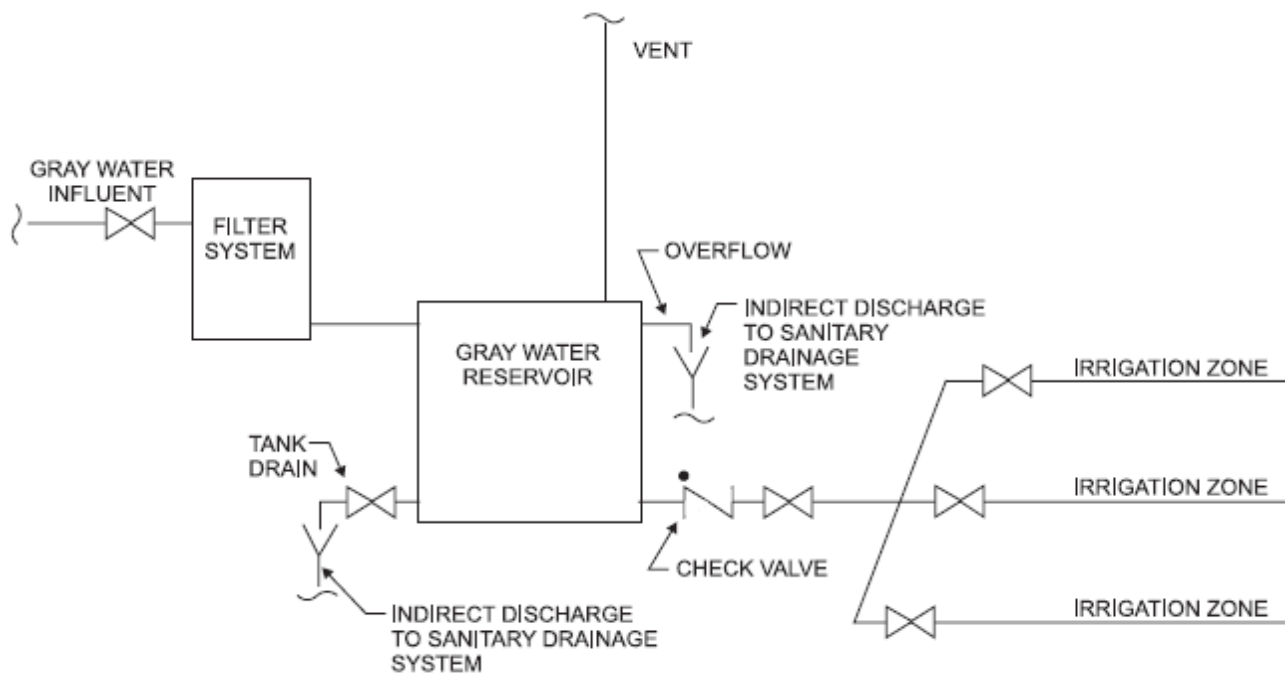

2006 International Plumbing Code / APPENDIX C GRAY WATER RECYCLING SYSTEMS / FIGURE 2 GRAY WATER RECYCLING SYSTEM FOR FLUSHING WATER CLOSETS AND URINALS

**FIGURE 2
GRAY WATER RECYCLING SYSTEM FOR FLUSHING WATER CLOSETS AND**

URINALS

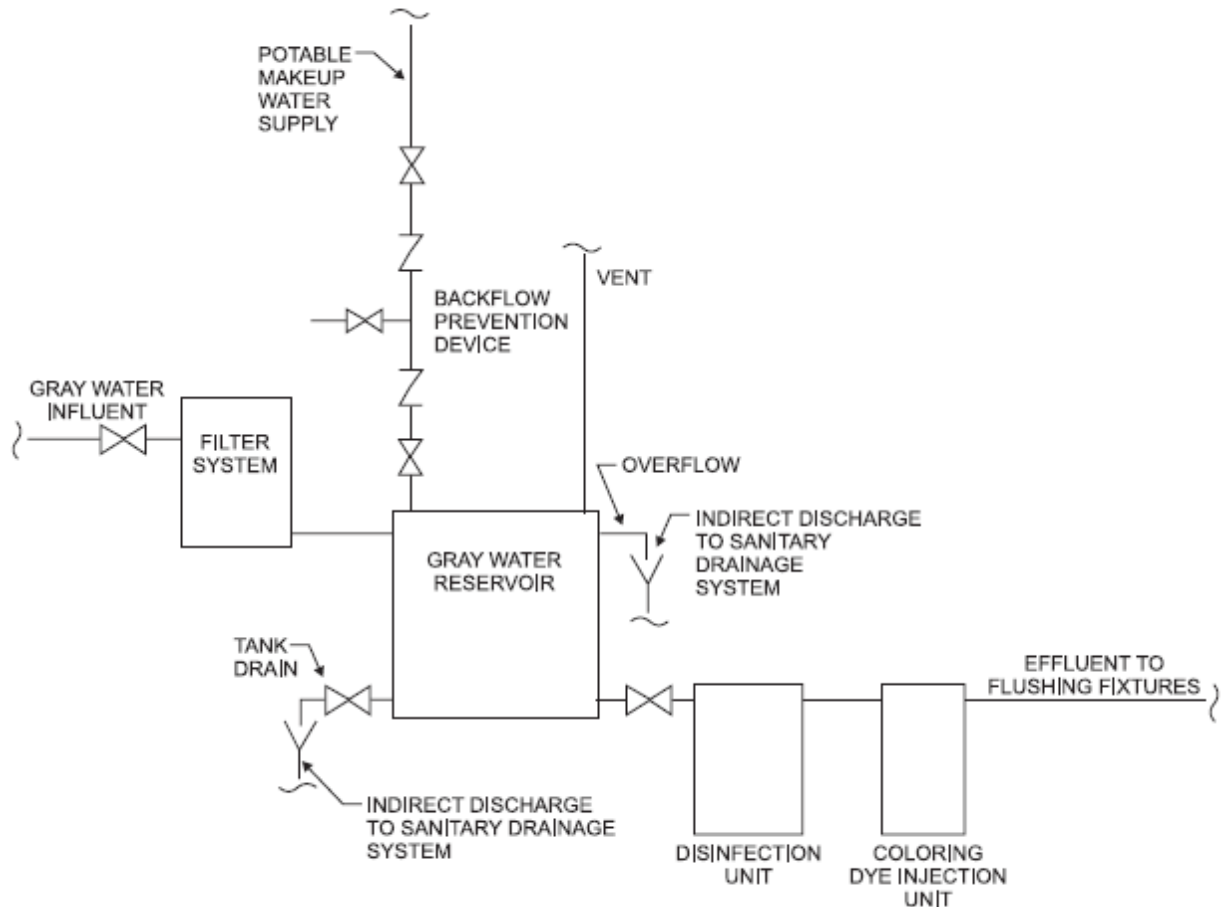

2006 International Plumbing Code / APPENDIX D DEGREE DAY AND DESIGN TEMPERATURES

APPENDIX D DEGREE DAY AND DESIGN TEMPERATURES

2006 International Plumbing Code / APPENDIX D DEGREE DAY AND DESIGN TEMPERATURES / TABLE D101 DEGREE DAY AND DESIGN TEMPERATURES_a FOR CITIES IN THE UNITED STATES

**TABLE D101
DEGREE DAY AND DESIGN TEMPERATURES^a FOR CITIES IN THE UNITED STATES**

STATE	STATION ^b	HEATING DEGREE DAYS (yearly total)	DESIGN TEMPERATURES			DEGREES NORTH LATITUDE ^c
			Winter	Summer		
			97½%	Dry bulb 2½%	Wet bulb 2½%	
AL	Birmingham	2,551	21	94	77	33°30'
	Huntsville	3,070	16	96	77	34°40'
	Mobile	1,560	29	93	79	30°40'
	Montgomery	2,291	25	95	79	32°20'
AK	Anchorage	10,864	-18	68	59	61°10'
	Fairbanks	14,279	-47	78	62	64°50'
	Juneau	9,075	1	70	59	58°20'
	Nome	14,171	-27	62	56	64°30'
AZ	Flagstaff	7,152	4	82	60	35°10'
	Phoenix	1,765	34	107	75	33°30'
	Tuscon	1,800	32	102	71	33°10'
	Yuma	974	39	109	78	32°40'
AR	Fort Smith	3,292	17	98	79	35°20'
	Little Rock	3,219	20	96	79	34°40'
	Texarkana	2,533	23	96	79	33°30'
CA	Fresno	2,611	30	100	71	36°50'
	Long Beach	1,803	43	80	69	33°50'
	Los Angeles	2,061	43	80	69	34°00'
	Los Angeles ^d	1,349	40	89	71	34°00'
	Oakland	2,870	36	80	64	37°40'
	Sacramento	2,502	32	98	71	38°30'
	San Diego	1,458	44	80	70	32°40'
	San Francisco	3,015	38	77	64	37°40'
	San Francisco ^d	3,001	40	71	62	37°50'
CO	Alamosa	8,529	-16	82	61	37°30'
	Colorado Springs	6,423	2	88	62	38°50'
	Denver	6,283	1	91	63	39°50'
	Grand Junction	5,641	7	94	63	39°10'
	Pueblo	5,462	0	95	66	38°20'
CT	Bridgeport	5,617	9	84	74	41°10'
	Hartford	6,235	7	88	75	41°50'
	New Haven	5,897	7	84	75	41°20'
DE	Wilmington	4,930	14	89	76	39°40'
DC	Washington	4,224	17	91	77	38°50'
FL	Daytona	879	35	90	79	29°10'
	Fort Myers	442	44	92	79	26°40'
	Jacksonville	1,239	32	94	79	30°30'
	Key West	108	57	90	79	24°30'

I-Quest 2006 Codes Complete Collection

STATE	STATION ^b	HEATING DEGREE DAYS (yearly total)	DESIGN TEMPERATURES			DEGREES NORTH LATITUDE ^c
			Winter	Summer		
			97½%	Dry bulb 2½%	Wet bulb 2½%	
	Miami	214	47	90	79	25°50'
	Orlando	766	38	93	78	28°30'
	Pensacola	1,463	29	93	79	30°30'
	Tallahassee	1,485	30	92	78	30°20'
	Tampa	683	40	91	79	28°00'
	West Palm Beach	253	45	91	79	26°40'

(continued)

STATE	STATION ^b	HEATING DEGREE DAYS (yearly total)	DESIGN TEMPERATURES			DEGREES NORTH LATITUDE ^c
			Winter	Summer		
			97½%	Dry bulb 2½%	Wet bulb 2½%	
GA	Athens	2,929	22	92	77	34°00'
	Atlanta	2,961	22	92	76	33°40'
	Augusta	2,397	23	95	79	33°20'
	Columbus	2,383	24	93	78	32°30'
	Macon	2,136	25	93	78	32°40'
	Rome	3,326	22	93	78	34°20'
	Savannah	1,819	27	93	79	32°10'
HI	Hilo	0	62	83	74	19°40'
	Honolulu	0	63	86	75	21°20'
ID	Boise	5,809	10	94	66	43°30'
	Lewiston	5,542	6	93	66	46°20'
	Pocatello	7,033	-1	91	63	43°00'
IL	Chicago (Midway)	6,155	0	91	75	41°50'
	Chicago (O'Hare)	6,639	-4	89	76	42°00'
	Chicago ^d	5,882	2	91	77	41°50'
	Moline	6,408	-4	91	77	41°30'
	Peoria	6,025	-4	89	76	40°40'
	Rockford	6,830	-4	89	76	42°10'
	Springfield	5,429	2	92	77	39°50'
IN	Evansville	4,435	9	93	78	38°00'
	Fort Wayne	6,205	1	89	75	41°00'
	Indianapolis	5,699	2	90	76	39°40'
	South Bend	6,439	1	89	75	41°40'
IA	Burlington	6,114	-3	91	77	40°50'
	Des Moines	6,588	-5	91	77	41°30'
	Dubuque	7,376	-7	88	75	42°20'
	Sioux City	6,951	-7	92	77	42°20'
	Waterloo	7,320	-10	89	77	42°30'
KS	Dodge City	4,986	5	97	73	37°50'
	Goodland	6,141	0	96	70	39°20'
	Topeka	5,182	4	96	78	

I-Quest 2006 Codes Complete Collection

STATE	STATION ^b	HEATING DEGREE DAYS (yearly total)	DESIGN TEMPERATURES			DEGREES NORTH LATITUDE ^c
			Winter	Summer		
			97½%	Dry bulb 2½%	Wet bulb 2½%	
	Wichita	4,620	7	98	76	39°00' 37°40'
KY	Covington	5,265	6	90	75	39°00'
	Lexington	4,683	8	91	76	38°00'
	Louisville	4,660	10	93	77	38°10'
LA	Alexandria	1,921	27	94	79	31°20'
	Baton Rouge	1,560	29	93	80	30°30'
	Lake Charles	1,459	31	93	79	30°10'
	New Orleans	1,385	33	92	80	30°00'
	Shreveport	2,184	25	96	79	32°30'
ME	Caribou	9,767	-13	81	69	46°50'
	Portland	7,511	-1	84	72	43°40'
MD	Baltimore	4,654	13	91	77	39°10'
	Baltimore ^d	4,111	17	89	78	39°20'
	Frederick	5,087	12	91	77	39°20'

(continued)

STATE	STATION ^b	HEATING DEGREE DAYS (yearly total)	DESIGN TEMPERATURES			DEGREES NORTH LATITUDE ^c
			Winter	Summer		
			97½%	Dry bulb 2½%	Wet bulb 2½%	
MA	Boston	5,634	9	88	74	42°20'
	Pittsfield	7,578	-3	84	72	42°30'
	Worcester	6,969	4	84	72	42°20'
MI	Alpena	8,506	-6	85	72	45°00'
	Detroit (City)	6,232	6	88	74	42°20'
	Escanaba ^d	8,481	-7	83	71	45°40'
	Flint	7,377	1	87	74	43°00'
	Grand Rapids	6,894	5	88	74	42°50'
	Lansing	6,909	1	87	74	42°50'
	Marquette ^d	8,393	-8	81	70	46°30'
	Muskegon	6,696	6	84	73	43°10'
Sault Ste. Marie	9,048	-8	81	70	46°30'	
MN	Duluth	10,000	-16	82	70	46°50'
	Minneapolis	8,382	-12	89	5	44°50'
	Rochester	8,295	-12	87	75	44°00'
MS	Jackson	2,239	25	95	78	32°20'
	Meridian	2,289	23	95	79	32°20'
	Vicksburg ^d	2,041	26	95	80	32°20'
MO	Columbia	5,046	4	94	77	39°00'
	Kansas City	4,711	6	96	77	39°10'
	St. Joseph	5,484	2	93	79	

I-Quest 2006 Codes Complete Collection

STATE	STATION ^b	HEATING DEGREE DAYS (yearly total)	DESIGN TEMPERATURES			DEGREES NORTH LATITUDE ^c
			Winter	Summer		
			97½%	Dry bulb 2½%	Wet bulb 2½%	
	St. Louis	4,900	6	94	77	39°50'
	St. Louis ^d	4,484	8	94	77	38°50'
	Springfield	4,900	9	93	77	38°40'
						37°10'
MT	Billings	7,049	-10	91	66	45°50'
	Great Falls	7,750	-15	88	62	47°30'
	Helena	8,129	-16	88	62	46°40'
	Missoula	8,125	-6	88	63	46°50'
NE	Grand Island	6,530	-3	94	74	41°00'
	Lincoln ^d	5,864	-2	95	77	40°50'
	Norfolk	6,979	-4	93	77	42°00'
	North Platte	6,684	-4	94	72	41°10'
	Omaha	6,612	-3	91	77	41°20'
	Scottsbluff	6,673	-3	92	68	41°50'
NV	Elko	7,433	-2	92	62	40°50'
	Ely	7,733	-4	87	59	39°10'
	Las Vegas	2,709	28	106	70	36°10'
	Reno	6,332	10	92	62	39°30'
	Winnemucca	6,761	3	94	62	40°50'
NH	Concord	7,383	-3	87	73	43°10'
NJ	Atlantic City	4,812	13	89	77	39°30'
	Newark	4,589	14	91	76	40°40'
	Trenton ^d	4,980	14	88	76	40°10'
NM	Albuquerque	4,348	16	94	65	35°00'
	Raton	6,228	1	89	64	36°50'
	Roswell	3,793	18	98	70	33°20'
	Silver City	3,705	10	94	64	32°40'

(continued)

STATE	STATION ^b	HEATING DEGREE DAYS (yearly total)	DESIGN TEMPERATURES			DEGREES NORTH LATITUDE ^c
			Winter	Summer		
			97½%	Dry bulb 2½%	Wet bulb 2½%	
NY	Albany	6,875	-1	88	74	42°50'
	Albany ^d	6,201	1	88	74	42°50'
	Binghamton	7,286	1	83	72	42°10'
	Buffalo	7,062	6	85	73	43°00'
	NY (Central Park) ^d	4,871	15	89	75	40°50'
	NY (Kennedy)	5,219	15	87	75	40°40'
	NY(LaGuardia)	4,811	15	89	75	40°50'
	Rochester	6,748	5	88	73	40°50'
	Schenectady ^d	6,650	1	87	74	43°10'
	Syracuse	6,756	2	87	73	42°50'

I-Quest 2006 Codes Complete Collection

STATE	STATION ^b	HEATING DEGREE DAYS (yearly total)	DESIGN TEMPERATURES			DEGREES NORTH LATITUDE ^c
			Winter	Summer		
			97½%	Dry bulb 2½%	Wet bulb 2½%	
						43°10'
NC	Charlotte	3,181	22	93	76	35°10'
	Greensboro	3,805	18	91	76	36°10'
	Raleigh	3,393	20	92	77	35°50'
	Winston-Salem	3,595	20	91	75	36°10'
ND	Bismarck	8,851	-19	91	71	46°50'
	Devils Lake ^d	9,901	-21	88	71	48°10'
	Fargo	9,226	-18	89	74	46°50'
	Williston	9,243	-21	88	70	48°10'
OH	Akron-Canton	6,037	6	86	73	41°00'
	Cincinnati ^d	4,410	6	90	75	39°10'
	Cleveland	6,351	5	88	74	41°20'
	Columbus	5,660	5	90	75	40°00'
	Dayton	5,622	4	89	75	39°50'
	Mansfield	6,403	5	87	74	40°50'
	Sandusky ^d	5,796	6	91	74	41°30'
	Toledo	6,494	1	88	75	41°40'
	Youngstown	6,417	4	86	73	41°20'
OK	Oklahoma City	3,725	13	97	77	35°20'
	Tulsa	3,860	13	98	78	36°10'
OR	Eugene	4,726	22	89	67	44°10'
	Medford	5,008	23	94	68	42°20'
	Portland	4,635	23	85	67	45°40'
	Portland ^d	4,109	24	86	67	45°30'
	Salem	4,754	23	88	68	45°00'
PA	Allentown	5,810	9	88	75	40°40'
	Erie	6,451	9	85	74	42°10'
	Harrisburg	5,251	11	91	76	40°10'
	Philadelphia	5,144	14	90	76	39°50'
	Pittsburgh	5,987	5	86	73	40°30'
	Pittsburgh ^d	5,053	7	88	73	40°30'
	Reading ^d	4,945	13	89	75	40°20'
	Scranton	6,254	5	87	73	41°20'
Williamsport	5,934	7	89	74	41°10'	
RI	Providence	5,954	9	86	74	41°40'
SC	Charleston	2,033	27	91	80	32°50'
	Charleston ^d	1,794	28	92	80	32°50'
	Columbia	2,484	24	95	78	34°00'

(continued)

		HEATING DEGREE	DESIGN TEMPERATURES			DEGREES
			Winter	Summer		
COPYRIGHT © 2006 by INTERNATIONAL CODE COUNCIL, INC.						

I-Quest 2006 Codes Complete Collection

(continued)

STATE	STATION ^b	HEATING DEGREE DAYS (yearly total)	DESIGN TEMPERATURES			DEGREES NORTH LATITUDE ^c
			Winter	Summer		
			97½%	Dry bulb 2½%	Wet bulb 2½%	
SD	Huron	8,223	-14	93	75	44°30'
	Rapid City	7,345	-7	92	69	44°00'
	Sioux Falls	7,839	-11	91	75	43°40'
TN	Bristol	4,143	14	89	75	36°30'
	Chattanooga	3,254	18	93	77	35°00'
	Knoxville	3,494	19	92	76	35°50'
	Memphis	3,232	18	95	79	35°00'
	Nashville	3,578	14	94	77	36°10'
TX	Abilene	2,624	20	99	74	32°30'
	Austin	1,711	28	98	77	30°20'
	Dallas	2,363	22	100	78	32°50'
	El Paso	2,700	24	98	68	31°50'
	Houston	1,396	32	94	79	29°40'
	Midland	2,591	21	98	72	32°00'
	San Angelo	2,255	22	99	74	31°20'
	San Antonio	1,546	30	97	76	29°30'
	Waco	2,030	26	99	78	31°40'
	Wichita Falls	2,832	18	101	76	34°00'
	UT	Salt Lake City	6,052	8	95	65
VT	Burlington	8,269	-7	85	72	44°30'
VA	Lynchburg	4,166	16	90	76	37°20'
	Norfolk	3,421	22	91	78	36°50'
	Richmond	3,865	17	92	78	37°30'
	Roanoke	4,150	16	91	74	37°20'
WA	Olympia	5,236	22	83	66	47°00'
	Seattle-Tacoma	5,145	26	80	64	47°30'
	Seattle ^d	4,424	27	82	67	47°40'
	Spokane	6,655	2	90	64	47°40'
WV	Charleston	4,476	11	90	75	38°20'
	Elkins	5,675	6	84	72	38°50'
	Huntington	4,446	10	91	77	38°20'
	Parkersburg ^d	4,754	11	90	76	39°20'
WI	Green Bay	8,029	-9	85	74	44°30'
	La Crosse	7,589	-9	88	75	43°50'
	Madison	7,863	-7	88	75	43°10'
	Milwaukee	7,635	-4	87	74	43°00'
WY	Casper	7,410	-5	90	61	42°50'
	Cheyenne	7,381	-1	86	62	41°10'
	Lander	7,870	-11	88	63	42°50'
	Sheridan	7,680	-8	91	65	44°50'

I-Quest 2006 Codes Complete Collection

- a. All data were extracted from the 1985 ASHRAE Handbook, Fundamentals Volume.
- b. Design data developed from airport temperature observations unless noted.
- c. Latitude is given to the nearest 10 minutes. For example, the latitude for Miami, Florida, is given as 25°50', or 25 degrees 50 minutes.
- d. Design data developed from office locations within an urban area, not from airport temperature observations.

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM

APPENDIX E SIZING OF WATER PIPING SYSTEM

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E101 GENERAL

SECTION E101 GENERAL

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E101 GENERAL / E101.1 Scope.

E101.1 Scope.

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E101 GENERAL / E101.1 Scope. / E101.1.1

E101.1.1

This appendix outlines two procedures for sizing a water piping system (see Sections E103.3 and E201.1). The design procedures are based on the minimum static pressure available from the supply source, the head charges in the system caused by friction and elevation, and the rates of flow necessary for operation of various fixtures.

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E101 GENERAL / E101.1 Scope. / E101.1.2

E101.1.2

Because of the variable conditions encountered in hydraulic design, it is impractical to specify definite and detailed rules for sizing of the water piping system. Accordingly, other

sizing or design methods conforming to good engineering practice standards are acceptable alternatives to those presented herein.

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E102 INFORMATION REQUIRED

**SECTION E102
INFORMATION REQUIRED**

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E102 INFORMATION REQUIRED / E102.1 Preliminary.

E102.1 Preliminary.

Obtain the necessary information regarding the minimum daily static service pressure in the area where the building is to be located. If the building supply is to be metered, obtain information regarding friction loss relative to the rate of flow for meters in the range of sizes likely to be used. Friction loss data can be obtained from most manufacturers of water meters.

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E102 INFORMATION REQUIRED / E102.2 Demand load.

E102.2 Demand load.

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E102 INFORMATION REQUIRED / E102.2 Demand load. / E102.2.1

E102.2.1

Estimate the supply demand of the building main and the principal branches and risers of the system by totaling the corresponding demand from the applicable part of Table E103.3(3).

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E102 INFORMATION REQUIRED / E102.2 Demand load. / E102.2.2

E102.2.2

Estimate continuous supply demands in gallons per minute (L/m) for lawn sprinklers, air conditioners, etc., and add the sum to the total demand for fixtures. The result is the estimated supply demand for the building supply.

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E103 SELECTION OF PIPE SIZE

**SECTION E103
SELECTION OF PIPE SIZE**

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E103 SELECTION OF PIPE SIZE / E103.1 General.

E103.1 General.

Decide from Table 604.3 what is the desirable minimum residual pressure that should be maintained at the highest fixture in the supply system. If the highest group of fixtures contains flush valves, the pressure for the group should not be less than 15 pounds per square inch (psi) (103.4 kPa) flowing. For flush tank supplies, the available pressure should not be less than 8 psi (55.2 kPa) flowing, except blowout action fixtures must not be less than 25 psi (172.4 kPa) flowing.

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E103 SELECTION OF PIPE SIZE / E103.2 Pipe sizing.

E103.2 Pipe sizing.

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E103 SELECTION OF PIPE SIZE / E103.2 Pipe sizing. / E103.2.1

E103.2.1

Pipe sizes can be selected according to the following procedure or by other design methods conforming to acceptable engineering practice and approved by the administrative authority. The sizes selected must not be less than the minimum required by this code.

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E103 SELECTION OF PIPE SIZE / E103.2 Pipe sizing. / E103.2.2

E103.2.2

Water pipe sizing procedures are based on a system of pressure requirements and losses, the sum of which must not exceed the minimum pressure available at the supply source. These pressures are as follows:

1. Pressure required at fixture to produce required flow. See Sections 604.3 and 604.5.
2. Static pressure loss or gain (due to head) is computed at 0.433 psi per foot (9.8

kPa/m) of elevation change.

Example: Assume that the highest fixture supply outlet is 20 feet (6096 mm) above or below the supply source. This produces a static pressure differential of 20 feet by 0.433 psi/foot (2096 mm by 9.8 kPa/m) and an 8.66 psi (59.8 kPa) loss.

3. Loss through water meter. The friction or pressure loss can be obtained from meter manufacturers.
4. Loss through taps in water main.
5. Losses through special devices such as filters, softeners, backflow prevention devices and pressure regulators. These values must be obtained from the manufacturers.
6. Loss through valves and fittings. Losses for these items are calculated by converting to equivalent length of piping and adding to the total pipe length.
7. Loss due to pipe friction can be calculated when the pipe size, the pipe length and the flow through the pipe are known. With these three items, the friction loss can be determined. For piping flow charts not included, use manufacturers' tables and velocity recommendations.

Note: For the purposes of all examples, the following metric conversions are applicable:

1 cubic foot per minute = 0.4719 L/s

1 square foot = 0.0929 m²

1 degree = 0.0175 rad

1 pound per square inch = 6.895 kPa

1 inch = 25.4 mm

1 foot = 304.8 mm

1 gallon per minute = 3.785 L/m

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E103 SELECTION OF PIPE SIZE / E103.3 Segmented loss method.

E103.3 Segmented loss method.

The size of water service mains, branch mains and risers by the segmented loss method, must be determined according to water supply demand [gpm (L/m)], available water pressure [psi (kPa)] and friction loss caused by the water meter and developed length of pipe [feet (m)], including equivalent length of fittings. This design procedure is based on the following

I-Quest 2006 Codes Complete Collection

parameters:

- Calculates the friction loss through each length of the pipe.
- Based on a system of pressure losses, the sum of which must not exceed the minimum pressure available at the street main or other source of supply.
- Pipe sizing based on estimated peak demand, total pressure losses caused by difference in elevation, equipment, developed length and pressure required at most remote fixture, loss through taps in water main, losses through fittings, filters, backflow prevention devices, valves and pipe friction.

Because of the variable conditions encountered in hydraulic design, it is impractical to specify definite and detailed rules for sizing of the water piping system. Current sizing methods do not address the differences in the probability of use and flow characteristics of fixtures between types of occupancies. Creating an exact model of predicting the demand for a building is impossible and final studies assessing the impact of water conservation on demand are not yet complete. The following steps are necessary for the segmented loss method.

1. **Preliminary.** Obtain the necessary information regarding the minimum daily static service pressure in the area where the building is to be located. If the building supply is to be metered, obtain information regarding friction loss relative to the rate of flow for meters in the range of sizes to be used. Friction loss data can be obtained from manufacturers of water meters. It is essential that enough pressure be available to overcome all system losses caused by friction and elevation so that plumbing fixtures operate properly. Section 604.6 requires the water distribution system to be designed for the minimum pressure available taking into consideration pressure fluctuations. The lowest pressure must be selected to guarantee a continuous, adequate supply of water. The lowest pressure in the public main usually occurs in the summer because of lawn sprinkling and supplying water for air-conditioning cooling towers. Future demands placed on the public main as a result of large growth or expansion should also be considered. The available pressure will decrease as additional loads are placed on the public system.
2. **Demand load.** Estimate the supply demand of the building main and the principal branches and risers of the system by totaling the corresponding demand from the applicable part of Table E103.3(3). When estimating peak demand sizing methods typically use water supply fixture units (w.s.f.u.) [see Table E103.3(2)]. This numerical factor measures the load-producing effect of a single plumbing fixture of a given kind. The use of such fixture units can be applied to a single basic probability curve (or table), found in the various sizing methods [Table E103.3(3)]. The fixture units are then converted into gallons per minute (L/m) flow rate for estimating demand.
 - 2.1. Estimate continuous supply demand in gallons per minute (L/m) for lawn sprinklers, air conditioners, etc., and add the sum to the total demand for fixtures. The result is the estimated supply demand for the building supply. Fixture units cannot be applied to constant use fixtures such as hose bibbs, lawn sprinklers and air conditioners. These types of fixtures must be

assigned the gallon per minute (L/m) value.

3. **Selection of pipe size.** This water pipe sizing procedure is based on a system of pressure requirements and losses, the sum of which must not exceed the minimum pressure available at the supply source. These pressures are as follows:
 - 3.1. Pressure required at the fixture to produce required flow. See Section 604.3 and Section 604.5.
 - 3.2. Static pressure loss or gain (because of head) is computed at 0.433 psi per foot (9.8 kPa/m) of elevation change.
 - 3.3. Loss through a water meter. The friction or pressure loss can be obtained from the manufacturer.
 - 3.4. Loss through taps in water main [see Table E103.3(4)].
 - 3.5. Losses through special devices such as filters, softeners, backflow prevention devices and pressure regulators. These values must be obtained from the manufacturers.
 - 3.6. Loss through valves and fittings [see Tables E103.3(5) and E103.3(6)]. Losses for these items are calculated by converting to equivalent length of piping and adding to the total pipe length.
 - 3.7. Loss caused by pipe friction can be calculated when the pipe size, the pipe length and the flow through the pipe are known. With these three items, the friction loss can be determined using Figures E103.3(2) through E103.3(7). When using charts, use pipe inside diameters. For piping flow charts not included, use manufacturers' tables and velocity recommendations. Before attempting to size any water supply system, it is necessary to gather preliminary information which includes available pressure, piping material, select design velocity, elevation differences and developed length to most remote fixture. The water supply system is divided into sections at major changes in elevation or where branches lead to fixture groups. The peak demand must be determined in each part of the hot and cold water supply system which includes the corresponding water supply fixture unit and conversion to gallons per minute (L/m) flow rate to be expected through each section. Sizing methods require the determination of the "most hydraulically remote" fixture to compute the pressure loss caused by pipe and fittings. The hydraulically remote fixture represents the most downstream fixture along the circuit of piping requiring the most available pressure to operate properly. Consideration must be given to all pressure demands and losses, such as friction caused by pipe, fittings and equipment, elevation and the residual pressure required by Table 604.3. The two most common and frequent complaints about the water supply system operation are lack of adequate pressure and noise.

Problem: What size Type L copper water pipe, service and distribution will be required to serve a two-story factory building having on each floor, back-to-back, two toilet rooms each equipped with hot and cold water? The highest fixture is 21 feet (6401 mm) above the street main, which is tapped with a 2-inch (51 mm) corporation cock at which point the minimum pressure is 55 psi (379.2 kPa). In the building basement, a 2-inch (51 mm) meter with a maximum pressure drop of 11 psi (75.8 kPa) and 3-inch (76 mm) reduced pressure principle backflow preventer with a maximum pressure drop of 9 psi (621 kPa) are to be installed. The system is shown by Figure E103.3(1). To be determined are the pipe sizes for the service main and the cold and hot water distribution pipes.

Solution: A tabular arrangement such as shown in Table E103.3(1) should first be constructed. The steps to be followed are indicated by the tabular arrangement itself as they are in sequence, columns 1 through 10 and lines A through L.

Step 1

Columns 1 and 2: Divide the system into sections breaking at major changes in elevation or where branches lead to fixture groups. After point B [see Figure E103.3(1)], separate consideration will be given to the hot and cold water piping. Enter the sections to be considered in the service and cold water piping in Column 1 of the tabular arrangement. Column 1 of Table E103.3(1) provides a line-by-line recommended tabular arrangement for use in solving pipe sizing.

The objective in designing the water supply system is to ensure an adequate water supply and pressure to all fixtures and equipment. Column 2 provides the pounds per square inch (psi) to be considered separately from the minimum pressure available at the main. Losses to take into consideration are the following: the differences in elevations between the water supply source and the highest water supply outlet, meter pressure losses, the tap in main loss, special fixture devices such as water softeners and backflow prevention devices and the pressure required at the most remote fixture outlet. The difference in elevation can result in an increase or decrease in available pressure at the main. Where the water supply outlet is located above the source, this results in a loss in the available pressure and is subtracted from the pressure at the water source. Where the highest water supply outlet is located below the water supply source, there will be an increase in pressure that is added to the available pressure of the water source.

Column 3: According to Table E103.3(3), determine the gpm (L/m) of flow to be expected in each section of the system. These flows range from 28.6 to 108 gpm. Load values for fixtures must be determined as water supply fixture units and then converted to a gallon-per-minute (gpm) rating to determine peak demand. When calculating peak demands, the water supply fixture units are added and then converted to the gallon-per-minute rating. For continuous flow fixtures such as hose bibbs and lawn sprinkler systems, add the gallon-per-minute demand to the intermittent demand of fixtures. For example, a total of 120 water supply fixture units is converted to a demand of 48 gallons per minute. Two hose bibbs \times 5 gpm demand = 10 gpm. Total gpm rating = 48.0 gpm + 10 gpm = 58.0 gpm demand.

Step 2

Line A: Enter the minimum pressure available at the main source of supply in Column 2. This is 55 psi (379.2 kPa). The local water authorities generally keep records of pressures at different times of day and year. The available pressure can also be checked from nearby buildings or from fire department hydrant checks.

Line B: Determine from Table 604.3 the highest pressure required for the fixtures on the system, which is 15 psi (103.4 kPa), to operate a flushometer valve. The most remote fixture outlet is necessary to compute the pressure loss caused by pipe and fittings, and represents the most downstream fixture along the circuit of piping requiring the available pressure to operate properly as indicated by Table 604.3.

Line C: Determine the pressure loss for the meter size given or assumed. The total water flow from the main through the service as determined in Step 1 will serve to aid in the meter selected. There are three common types of water meters; the pressure losses are determined by the American Water Works Association Standards for displacement type, compound type and turbine type. The maximum pressure loss of such devices takes into consideration the meter size, safe operating capacity (gpm) and maximum rates for continuous operations (gpm). Typically, equipment imparts greater pressure losses than piping.

Line D: Select from Table E103.3(4) and enter the pressure loss for the tap size given or assumed. The loss of pressure through taps and tees in pounds per square inch (psi) are based on the total gallon-per-minute flow rate and size of the tap.

Line E: Determine the difference in elevation between the main and source of supply and the highest fixture on the system. Multiply this figure, expressed in feet, by 0.43 psi (2.9 kPa). Enter the resulting psi loss on Line E. The difference in elevation between the water supply source and the highest water supply outlet has a significant impact on the sizing of the water supply system. The difference in elevation usually results in a loss in the available pressure because the water supply outlet is generally located above the water supply source. The loss is caused by the pressure required to lift the water to the outlet. The pressure loss is subtracted from the pressure at the water source. Where the highest water supply outlet is located below the water source, there will be an increase in pressure which is added to the available pressure of the water source.

Lines F, G and H: The pressure losses through filters, backflow prevention devices or other special fixtures must be obtained from the manufacturer or estimated and entered on these lines. Equipment such as backflow prevention devices, check valves, water softeners, instantaneous or tankless water heaters, filters and strainers can impart a much greater pressure loss than the piping. The pressure losses can range from 8 psi to 30 psi.

Step 3

Line I: The sum of the pressure requirements and losses that affect the overall system (Lines B through H) is entered on this line. Summarizing the steps, all of the system losses are subtracted from the minimum water pressure. The remainder is the pressure available

I-Quest 2006 Codes Complete Collection

for friction, defined as the energy available to push the water through the pipes to each fixture. This force can be used as an average pressure loss, as long as the pressure available for friction is not exceeded. Saving a certain amount for available water supply pressures as an area incurs growth, or because of aging of the pipe or equipment added to the system is recommended.

Step 4

Line J: Subtract Line I from Line A. This gives the pressure that remains available from overcoming friction losses in the system. This figure is a guide to the pipe size that is chosen for each section, incorporating the total friction losses to the most remote outlet (measured length is called developed length).

Exception: When the main is above the highest fixture, the resulting psi must be considered a pressure gain (static head gain) and omitted from the sums of Lines B through H and added to Line J.

The maximum friction head loss that can be tolerated in the system during peak demand is the difference between the static pressure at the highest and most remote outlet at no-flow conditions and the minimum flow pressure required at that outlet. If the losses are within the required limits, then every run of pipe will also be within the required friction head loss. Static pressure loss is the most remote outlet in feet \times 0.433 = loss in psi caused by elevation differences.

Step 5

Column 4: Enter the length of each section from the main to the most remote outlet (at Point E). Divide the water supply system into sections breaking at major changes in elevation or where branches lead to fixture groups.

Step 6

Column 5: When selecting a trial pipe size, the length from the water service or meter to the most remote fixture outlet must be measured to determine the developed length. However, in systems having a flush valve or temperature controlled shower at the top most floors the developed length would be from the water meter to the most remote flush valve on the system. A rule of thumb is that size will become progressively smaller as the system extends farther from the main source of supply. Trial pipe size may be arrived at by the following formula:

Line J: (Pressure available to overcome pipe friction) \times 100/equivalent length of run total developed length to most remote fixture \times percentage factor of 1.5 (note: a percentage factor is used only as an estimate for friction losses imposed for fittings for initial trial pipe size) = psi (average pressure drops per 100 feet of pipe).

For trial pipe size see Figure E103.3(3) (Type L copper) based on 2.77 psi and a 108 gpm = 2½ inches. To determine the equivalent length of run to the most remote outlet, the developed length is determined and added to the friction losses for fittings and valves. The

I-Quest 2006 Codes Complete Collection

developed lengths of the designated pipe sections are as follows:

A - B 54 ft

B - C 8 ft

C - D 13 ft

D - E 150 ft

Total developed length = 225 ft

The equivalent length of the friction loss in fittings and valves must be added to the developed length (most remote outlet). Where the size of fittings and valves is not known, the added friction loss should be approximated. A general rule that has been used is to add 50 percent of the developed length to allow for fittings and valves. For example, the equivalent length of run equals the developed length of run ($225 \text{ ft} \times 1.5 = 338 \text{ ft}$). The total equivalent length of run for determining a trial pipe size is 338 feet.

Example: 9.36 (pressure available to overcome pipe friction) $\times 100 / 338$ (equivalent length of run $= 225 \times 1.5$) $= 2.77$ psi (average pressure drop per 100 feet of pipe).

Step 7

Column 6: Select from Table E103.3(6) the equivalent lengths for the trial pipe size of fittings and valves on each pipe section. Enter the sum for each section in Column 6. (The number of fittings to be used in this example must be an estimate.) The equivalent length of piping is the developed length plus the equivalent lengths of pipe corresponding to friction head losses for fittings and valves. Where the size of fittings and valves is not known, the added friction head losses must be approximated. An estimate for this example is found in Table E.1.

Step 8

Column 7: Add the figures from Column 4 and Column 6, and enter in Column 7. Express the sum in hundreds of feet.

Step 9

Column 8: Select from Figure E103.3(3) the friction loss per 100 feet (30 480 mm) of pipe for the gallon-per-minute flow in a section (Column 3) and trial pipe size (Column 5). Maximum friction head loss per 100 feet is determined on the basis of total pressure available for friction head loss and the longest equivalent length of run. The selection is based on the gallon-per-minute demand, the uniform friction head loss, and the maximum design velocity. Where the size indicated by hydraulic table indicates a velocity in excess of the selected velocity, a size must be selected which produces the required velocity.

Step 10

Column 9: Multiply the figures in Columns 7 and 8 for each section and enter in Column 9.

Total friction loss is determined by multiplying the friction loss per 100 feet (30 480 mm) for each pipe section in the total developed length by the pressure loss in fittings expressed as equivalent length in feet. Note: Section C-F should be considered in the total pipe friction losses only if greater loss occurs in Section C-F than in pipe section D-E. Section C-F is not considered in the total developed length. Total friction loss in equivalent length is determined in Table E.2.

Step 11

Line K: Enter the sum of the values in Column 9. The value is the total friction loss in equivalent length for each designated pipe section.

Step 12

Line L: Subtract Line J from Line K and enter in Column 10.

The result should always be a positive or plus figure. If it is not, repeat the operation using Columns 5, 6, 8 and 9 until a balance or near balance is obtained. If the difference between Lines J and K is a high positive number, it is an indication that the pipe sizes are too large and should be reduced, thus saving materials. In such a case, the operations using Columns 5, 6, 8 and 9 should again be repeated.

The total friction losses are determined and subtracted from the pressure available to overcome pipe friction for trial pipe size. This number is critical as it provides a guide to whether the pipe size selected is too large and the process should be repeated to obtain an economically designed system.

Answer: The final figures entered in Column 5 become the design pipe size for the respective sections. Repeating this operation a second time using the same sketch but considering the demand for hot water, it is possible to size the hot water distribution piping. This has been worked up as a part of the overall problem in the tabular arrangement used for sizing the service and water distribution piping. Note that consideration must be given to the pressure losses from the street main to the water heater (Section A-B) in determining the hot water pipe sizes.

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E103 SELECTION OF PIPE SIZE / E103.3 Segmented loss method. / TABLE E.1

TABLE E.1

COLD WATER PIPE SECTION	FITTINGS/VALVES	PRESSURE LOSS EXPRESSED AS EQUIVALENT LENGTH OF TUBE (feet)	HOT WATER PIPE SECTION	FITTINGS/VALVES	PRESSURE LOSS EXPRESSED AS EQUIVALENT OF TUBE (feet)
----------------------------	-----------------	---	------------------------------	-----------------	---

I-Quest 2006 Codes Complete Collection

COLD WATER PIPE SECTION	FITTINGS/VALVES	PRESSURE LOSS EXPRESSED AS EQUIVALENT LENGTH OF TUBE (feet)	HOT WATER PIPE SECTION	FITTINGS/VALVES	PRESSURE LOSS EXPRESSED AS EQUIVALENT OF TUBE (feet)
A-B	3-2½" Gate valves	3	A-B	3-2½" Gate valves	3
	1-2½" Side branch tee	12		1-2½" Side branch tee	12
B-C	1-2½" Straight run tee	0.5	B-C	1-2" Straight run tee	7
				1-2" 90-degree ell	0.5
C-F	1-2½" Side branch tee	12	C-F	1-1½" Side branch tee	7
C-D	1-2½" 90-degree ell	7	C-D	1-½" 90-degree ell	4
D-E	1-2½" Side branch tee	12	D-E	1-1½" Side branch tee	7

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E103 SELECTION OF PIPE SIZE / E103.3 Segmented loss method. / TABLE E.2


TABLE E.2

PIPE SECTIONS	FRICTION LOSS EQUIVALENT LENGTH (feet)	
	Cold Water	Hot Water
A-B	$0.69 \times 3.2 = 2.21$	$0.69 \times 3.2 = 2.21$
B-C	$0.085 \times 3.1 = 0.26$	$0.16 \times 1.4 = 0.22$
C-D	$0.20 \times 1.9 = 0.38$	$0.17 \times 3.2 = 0.54$
D-E	$1.62 \times 1.9 = 3.08$	$1.57 \times 3.2 = 5.02$
Total pipe friction losses (Line K)	5.93	7.99

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E103 SELECTION OF PIPE SIZE / E103.3 Segmented loss method. / FIGURE E103.3(1) EXAMPLE-SIZING

**FIGURE E103.3(1)
EXAMPLE-SIZING**

I-Quest 2006 Codes Complete Collection

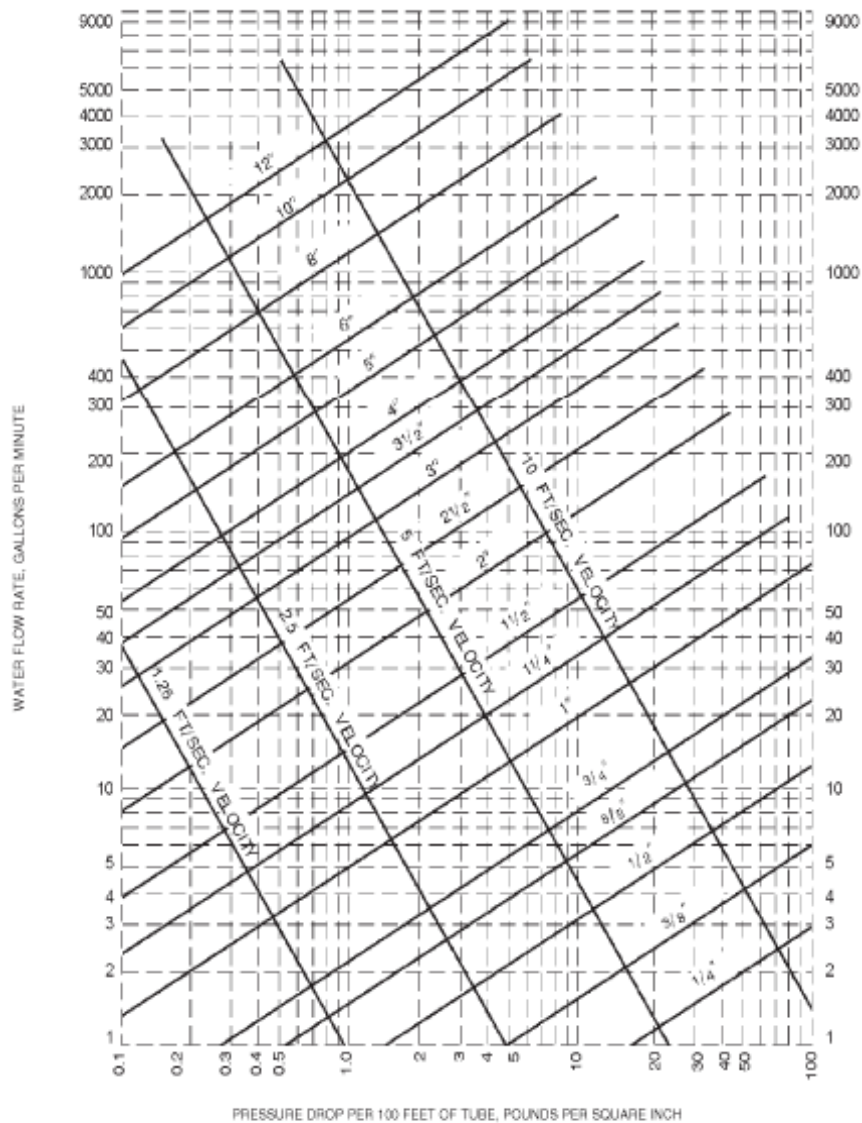


Note: Fluid velocities in excess of 5 to 6 feet/second are not usually recommended.

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 gpm = 3.785 L/m, 1 psi = 6.895 kPa,
1 foot per second = 0.305 m/s.

- a. This chart applies to smooth new copper tubing with recessed (streamline) soldered joints and to the actual sizes of types indicated on the diagram.

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E103 SELECTION OF PIPE SIZE / E103.3 Segmented loss method. / FIGURE E103.3(3) FRICTION LOSS IN SMOOTH PIPEa (TYPE L, ASTM B 88 COPPER TUBING)

FIGURE E103.3(3)
FRICION LOSS IN SMOOTH PIPE^a (TYPE L, ASTM B 88 COPPER TUBING)

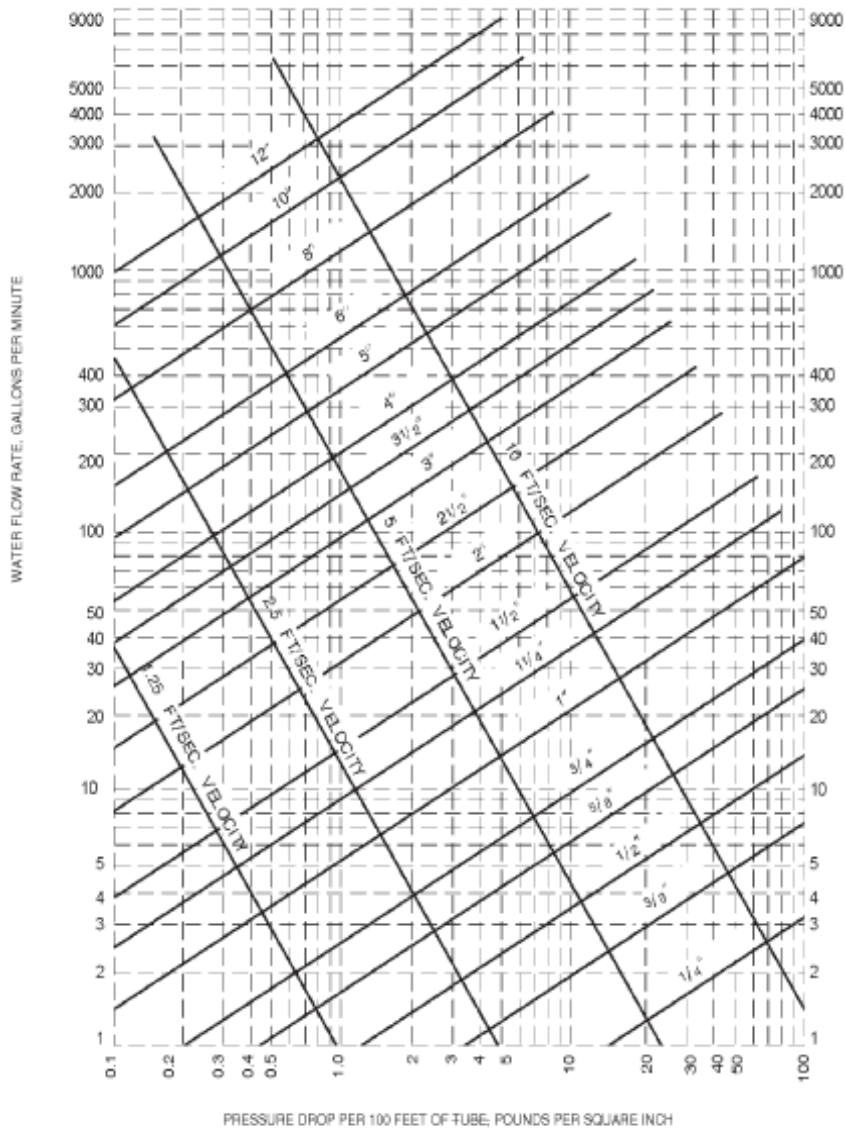

Note: Fluid velocities in excess of 5 to 8 feet/second are not usually recommended.


For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 gpm = 3.785 L/m, 1 psi = 6.895 kPa,
 1 foot per second = 0.305 m/s.

- a. This chart applies to smooth new copper tubing with recessed (streamline) soldered joints and to the actual sizes of types indicated on the diagram.

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING

**SYSTEM / SECTION E103 SELECTION OF PIPE SIZE / E103.3 Segmented loss method.
/ FIGURE E103.3(4) FRICTION LOSS IN SMOOTH PIPE^a (TYPE M, ASTM B 88
COPPER TUBING)**

**FIGURE E103.3(4)
FRICTION LOSS IN SMOOTH PIPE^a (TYPE M, ASTM B 88 COPPER TUBING)**

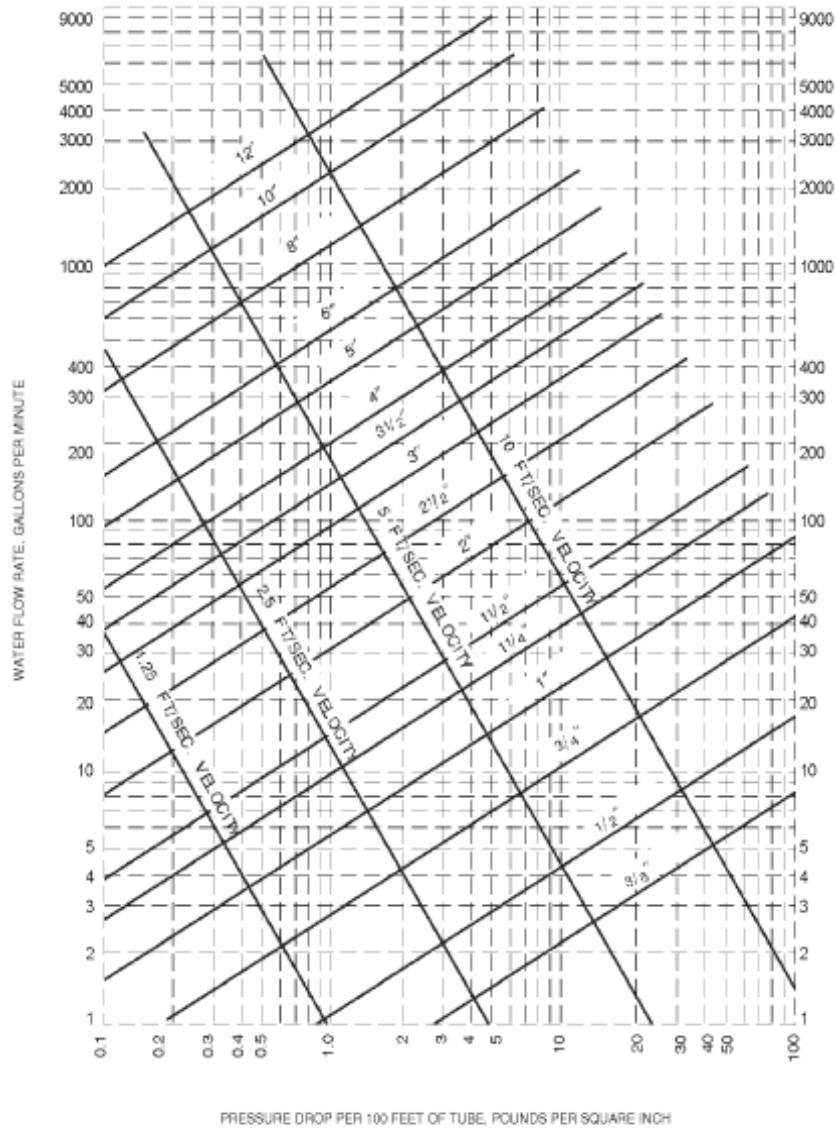


Note: Fluid velocities in excess of 5 to 8 feet/second are not usually recommended.

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 gpm = 3.785 L/m, 1 psi = 6.895 kPa,
1 foot per second = 0.305 m/s.

- a. This chart applies to smooth new copper tubing with recessed (streamline) soldered joints and to the actual sizes of types indicated on the diagram.

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E103 SELECTION OF PIPE SIZE / E103.3 Segmented loss method. / FIGURE E103.3(5) FRICTION LOSS IN FAIRLY SMOOTH PIPE^a

**FIGURE E103.3(5)
FRICTION LOSS IN FAIRLY SMOOTH PIPE^a**

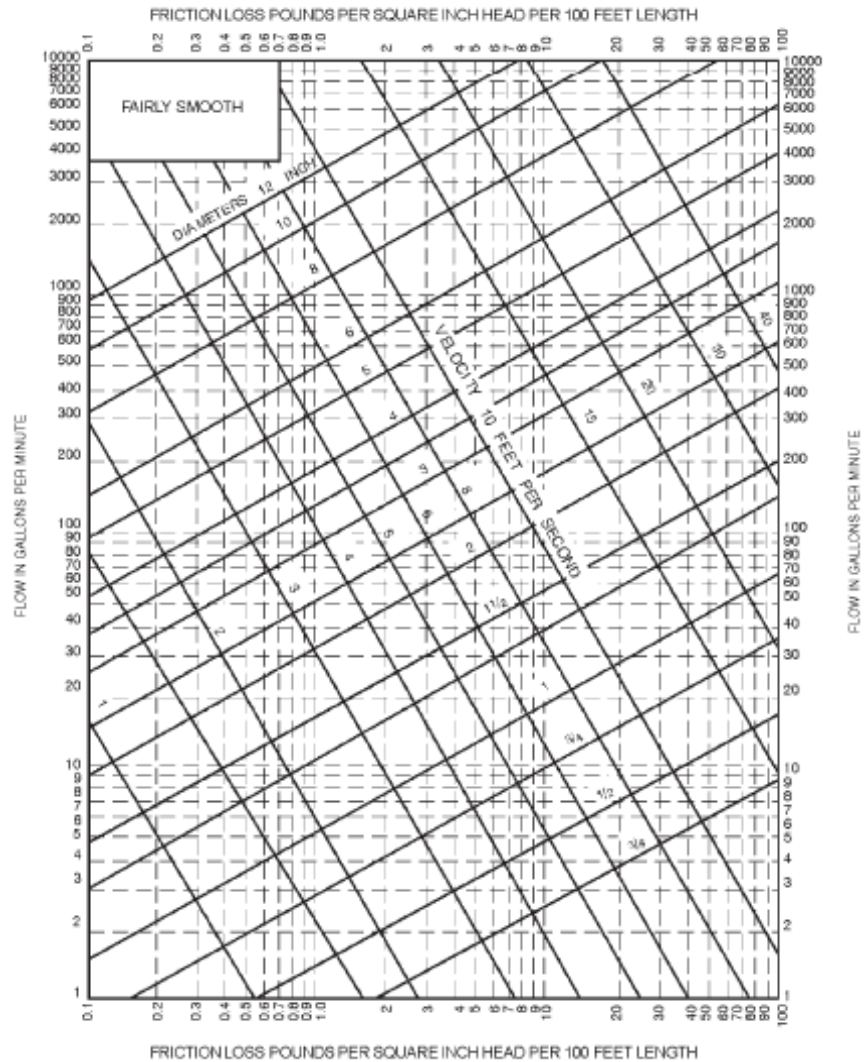


For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 gpm = 3.785 L/m, 1 psi = 6.895 kPa,
1 foot per second = 0.305 m/s.

a. This chart applies to smooth new steel (fairly smooth) pipe and to actual diameters of standard-weight pipe.

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E103 SELECTION OF PIPE SIZE / E103.3 Segmented loss method. / FIGURE E103.3(6) FRICTION LOSS IN FAIRLY ROUGH PIPE^a

**FIGURE E103.3(6)
FRICTION LOSS IN FAIRLY ROUGH PIPE^a**

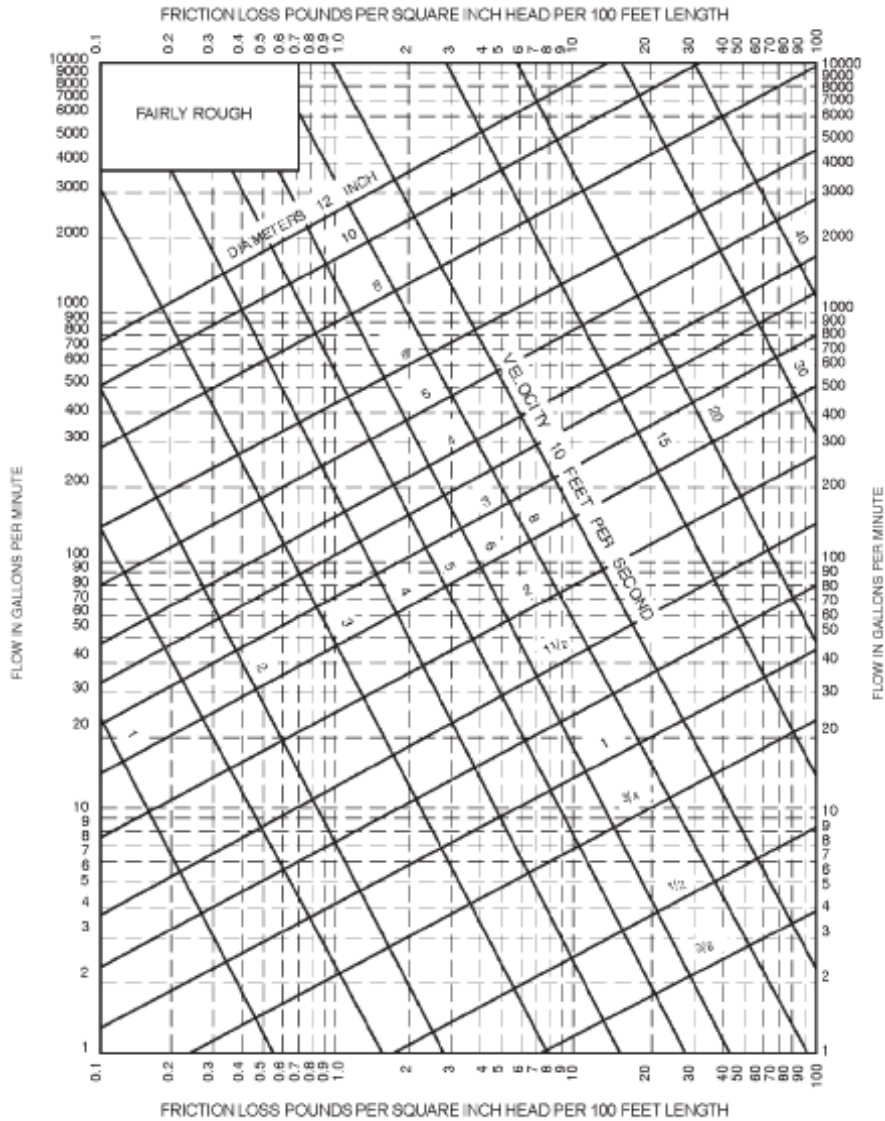


For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 gpm = 3.785 L/m, 1 psi = 6.895 kPa,
1 foot per second = 0.305 m/s.

- a. This chart applies to fairly rough pipe and to actual diameters which in general will be less than the actual diameters of the new pipe of the same kind.

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E103 SELECTION OF PIPE SIZE / E103.3 Segmented loss method. / FIGURE E103.3(7) FRICTION LOSS IN FAIRLY ROUGH PIPE^a

**FIGURE E103.3(7)
FRICTION LOSS IN FAIRLY ROUGH PIPE^a**

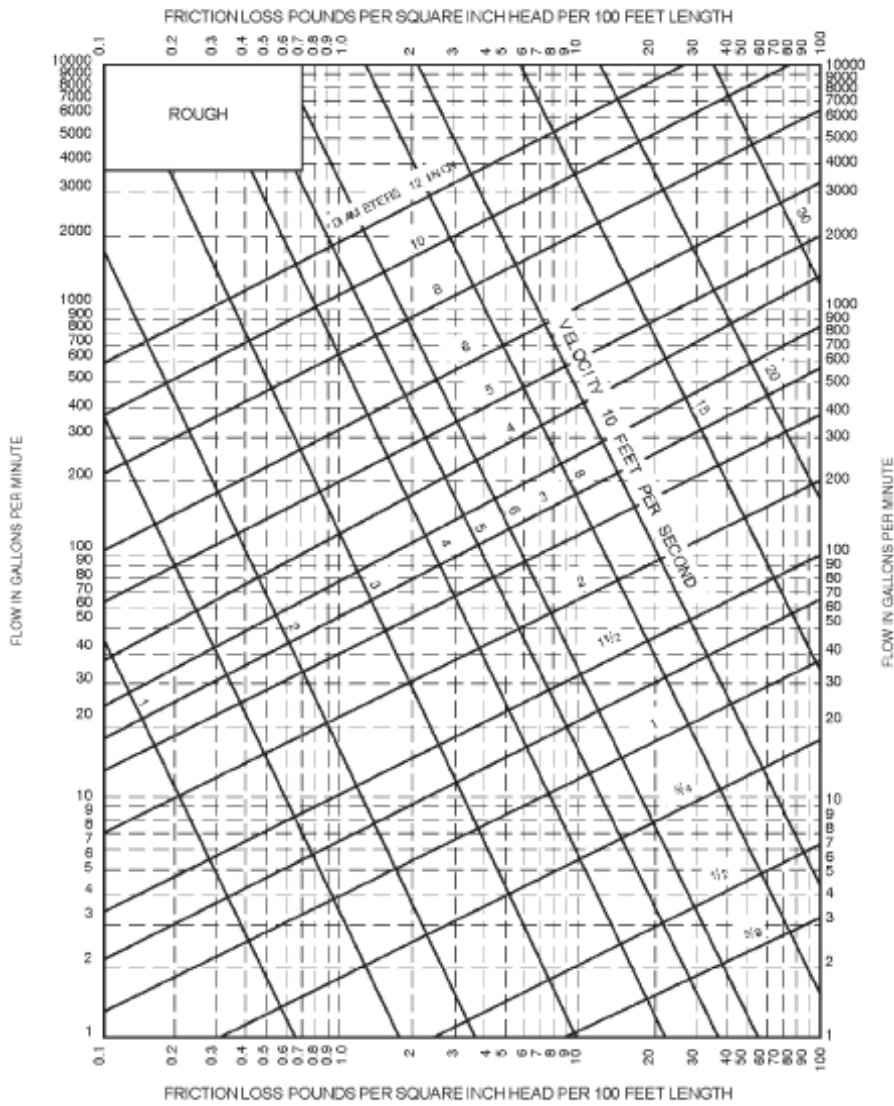

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 gpm = 3.785 L/m, 1 psi = 6.895 kPa,
1 foot per second = 0.305 m/s.

a. This chart applies to very rough pipe and existing pipe and to their actual diameters.

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E103 SELECTION OF PIPE SIZE / E103.3 Segmented loss method. / TABLE E103.3(1) RECOMMENDED TABULAR ARRANGEMENT FOR USE IN SOLVING PIPE SIZING PROBLEMS

**TABLE E103.3(1)
RECOMMENDED TABULAR ARRANGEMENT FOR USE IN SOLVING PIPE SIZING PROBLEMS**

COLUMN	1		2	3	4	5	6	7
Line	Description		Lb per square inch (psi)	Gal. per min through section	Length of section (feet)	Trial pipe size (inches)	Equivalent length of fittings and valves (feet)	Total equivalent length col. and col. 6 (100 feet)
A	Service and cold water distribution piping ^a	Minimum pressure available at main.	55.00					
B		Highest pressure required at a fixture (Table 604.3). 15.00						
C		Meter loss 2" meter.	11.00					
D		Tap in main loss 2" tap (Table E103A).	1.61					
E		Static head loss						
F		21 × 43 psi.	9.03					
G		Special fixture loss backflow preventer.	9.00					
H		Special fixture loss—						
I		Filter.	0.00					
J		Special fixture loss—	0.00					
		Other.	0.00					
		Total overall losses and requirements (Sum of Lines B through H).	45.64					
		Pressure available to overcome pipe friction (Line A minus Lines B to H).	9.36					
	DESIGNATION	AB.	288	108.0	54	2½	15.00	0.69
	Pipe section (from diagram)	BC.	264	104.5	8	2½	0.5	0.85
	Cold water	CD.	132	77.0	13	2½	7.00	0.20
	Distribution piping	CF ^b	132	77.0	150	2½	12.00	1.62
		DE ^b	132	77.0	150	2½	12.00	1.62
K	Total pipe friction losses (cold)			—	—	—	—	—
L	Difference (Line J minus Line K)			—	—	—	—	—
	Pipe section (from diagram)	A'B'.	288	108.0	54	2½	12.00	0.69
	Diagram	B'C'.	24	38.0	8	2	7.5	0.16
		12	28.6	13		4.0	0.17

I-Quest 2006 Codes Complete Collection

COLUMN	1		2	3	4	5	6	7
Line	Description		Lb per square inch (psi)	Gal. per min through section	Length of section (feet)	Trial pipe size (inches)	Equivalent length of fittings and valves (feet)	Total equivalent length col. and col. 6 (100 feet)
	Hot water Distribution Piping	C'D' ^a12 C'F' ^b12 D'E' ^b12		28.6 28.6	150 150	1½ 1½ 1½	7.00 7.00	1.57 1.57
K	Total pipe friction losses (hot)			—	—	—	—	—
L	Difference (Line J minus Line K)			—	—	—	—	—

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 psi = 6.895 kPa, 1 gpm = 3.785 L/m.

- a. To be considered as pressure gain for fixtures below main (to consider separately, omit from "I" and add to "J").
- b. To consider separately, in K use C-F only if greater loss than above.

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E103 SELECTION OF PIPE SIZE / E103.3 Segmented loss method. / TABLE E103.3(2) LOAD VALUES ASSIGNED TO FIXTURES^a

**TABLE E103.3(2)
LOAD VALUES ASSIGNED TO FIXTURES^a**

FIXTURE	OCCUPANCY	TYPE OF SUPPLY CONTROL	LOAD VALUES, IN WATER SUPPLY FIXTURE UN		
			Cold	Hot	T _h
Bathroom group	Private	Flush tank	2.7	1.5	3
Bathroom group	Private	Flush valve	6.0	3.0	8
Bathtub	Private	Faucet	1.0	1.0	1
Bathtub	Public	Faucet	3.0	3.0	4
Bidet	Private	Faucet	1.5	1.5	2
Combination fixture	Private	Faucet	2.25	2.25	3
Dishwashing machine	Private	Automatic	—	1.4	1
Drinking fountain	Offices, etc.	¾" valve	0.25	—	0
Kitchen sink	Private	Faucet	1.0	1.0	1
Kitchen sink	Hotel, restaurant	Faucet	3.0	3.0	4
Laundry trays (1 to 3)	Private	Faucet	1.0	1.0	1
Lavatory	Private	Faucet	0.5	0.5	0
Lavatory	Public	Faucet	1.5	1.5	2
Service sink	Offices, etc.	Faucet	2.25	2.25	3
Shower head	Public	Mixing valve	3.0	3.0	4
Shower head	Private	Mixing valve	1.0	1.0	1

I-Quest 2006 Codes Complete Collection

FIXTURE	OCCUPANCY	TYPE OF SUPPLY CONTROL	LOAD VALUES, IN WATER SUPPLY FIXTURE UNITS		
			Cold	Hot	Total
Urinal	Public	1" flush valve	10.0	—	10.0
Urinal	Public	¾" flush valve	5.0	—	5.0
Urinal	Public	Flush tank	3.0	—	3.0
Washing machine (8 lb)	Private	Automatic	1.0	1.0	2.0
Washing machine (8 lb)	Public	Automatic	2.25	2.25	4.5
Washing machine (15 lb)	Public	Automatic	3.0	3.0	6.0
Water closet	Private	Flush valve	6.0	—	6.0
Water closet	Private	Flush tank	2.2	—	2.2
Water closet	Public	Flush valve	10.0	—	10.0
Water closet	Public	Flush tank	5.0	—	5.0
Water closet	Public or private	Flushometer tank	2.0	—	2.0

For SI: 1 inch = 25.4 mm, 1 pound = 0.454 kg.

- a. For fixtures not listed, loads should be assumed by comparing the fixture to one listed using water in similar quantities and at similar rates. The assigned loads for fixtures with both hot and cold water supplies are given for separate hot and cold water loads and for total load. The separate hot and cold water loads being three-fourths of the total load for the fixture in each case.

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E103 SELECTION OF PIPE SIZE / E103.3 Segmented loss method. / TABLE E103.3(3) TABLE FOR ESTIMATING DEMAND

**TABLE E103.3(3)
TABLE FOR ESTIMATING DEMAND**

SUPPLY SYSTEMS PREDOMINANTLY FOR FLUSH TANKS			SUPPLY SYSTEMS PREDOMINANTLY FOR FLUSH VALVES		
Load	Demand		Load	Demand	
(Water supply fixture units)	(Gallons per minute)	(Cubic feet per minute)	(Water supply fixture units)	(Gallons per minute)	(Cubic feet per minute)
1	3.0	0.04104	—	—	—
2	5.0	0.0684	—	—	—
3	6.5	0.86892	—	—	—
4	8.0	1.06944	—	—	—
5	9.4	1.256592	5	15.0	2.0052
6	10.7	1.430376	6	17.4	2.326032
7	11.8	1.577424	7	19.8	2.646364
8	12.8	1.711104	8	22.2	2.967696
9	13.7	1.831416	9	24.6	3.288528
10	14.6	1.951728	10	27.0	3.60936

I-Quest 2006 Codes Complete Collection

SUPPLY SYSTEMS PREDOMINANTLY FOR FLUSH TANKS			SUPPLY SYSTEMS PREDOMINANTLY FOR FLUSH VALVES		
Load	Demand		Load	Demand	
(Water supply fixture units)	(Gallons per minute)	(Cubic feet per minute)	(Water supply fixture units)	(Gallons per minute)	(Cubic feet per minute)
11	15.4	2.058672	11	27.8	3.716304
12	16.0	2.13888	12	28.6	3.823248
13	16.5	2.20572	13	29.4	3.930192
14	17.0	2.27256	14	30.2	4.037136
15	17.5	2.3394	15	31.0	4.14408
16	18.0	2.90624	16	31.8	4.241024
17	18.4	2.459712	17	32.6	4.357968
18	18.8	2.513184	18	33.4	4.464912
19	19.2	2.566656	19	34.2	4.571856
20	19.6	2.620128	20	35.0	4.6788
25	21.5	2.87412	25	38.0	5.07984
30	23.3	3.114744	30	42.0	5.61356
35	24.9	3.328632	35	44.0	5.88192
40	26.3	3.515784	40	46.0	6.14928
45	27.7	3.702936	45	48.0	6.41664
50	29.1	3.890088	50	50.0	6.684
60	32.0	4.27776	60	54.0	7.21872
70	35.0	4.6788	70	58.0	7.75344
80	38.0	5.07984	80	61.2	8.181216
90	41.0	5.48088	90	64.3	8.595624
100	43.5	5.81508	100	67.5	9.0234
120	48.0	6.41664	120	73.0	9.75864
140	52.5	7.0182	140	77.0	10.29336
160	57.0	7.61976	160	81.0	10.82808
180	61.0	8.15448	180	85.5	11.42964
200	65.0	8.6892	200	90.0	12.0312
225	70.0	9.3576	225	95.5	12.76644
250	75.0	10.026	250	101.0	13.50168

(continued)

SUPPLY SYSTEMS PREDOMINANTLY FOR FLUSH TANKS			SUPPLY SYSTEMS PREDOMINANTLY FOR FLUSH VALVES		
Load	Demand		Load	Demand	
(Water supply fixture units)	(Gallons per minute)	(Cubic feet per minute)	(Water supply fixture units)	(Gallons per minute)	(Cubic feet per minute)

I-Quest 2006 Codes Complete Collection

SUPPLY SYSTEMS PREDOMINANTLY FOR FLUSH TANKS			SUPPLY SYSTEMS PREDOMINANTLY FOR FLUSH VALVES		
Load	Demand		Load	Demand	
(Water supply fixture units)	(Gallons per minute)	(Cubic feet per minute)	(Water supply fixture units)	(Gallons per minute)	(Cubic feet per minute)
275	80.0	10.6944	275	104.5	13.96956
300	85.0	11.3628	300	108.0	14.43744
400	105.0	14.0364	400	127.0	16.97736
500	124.0	16.57632	500	143.0	19.11624
750	170.0	22.7256	750	177.0	23.66136
1,000	208.0	27.80544	1,000	208.0	27.80544
1,250	239.0	31.94952	1,250	239.0	31.94952
1,500	269.0	35.95992	1,500	269.0	35.95992
1,750	297.0	39.70296	1,750	297.0	39.70296
2,000	325.0	43.446	2,000	325.0	43.446
2,500	380.0	50.7984	2,500	380.0	50.7984
3,000	433.0	57.88344	3,000	433.0	57.88344
4,000	535.0	70.182	4,000	525.0	70.182
5,000	593.0	79.27224	5,000	593.0	79.27224

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E103 SELECTION OF PIPE SIZE / E103.3 Segmented loss method. / TABLE E103.3(4) LOSS OF PRESSURE THROUGH TAPS AND TEES IN POUNDS PER SQUARE INCH (psi)

**TABLE E103.3(4)
LOSS OF PRESSURE THROUGH TAPS AND TEES IN POUNDS PER SQUARE INCH (psi)**

GALLONS PER MINUTE	SIZE OF TAP OR TEE (inches)						
	$\frac{5}{8}$	$\frac{3}{4}$	1	1 $\frac{1}{4}$	1 $\frac{1}{2}$	2	3
10	1.35	0.64	0.18	0.08	—	—	—
20	5.38	2.54	0.77	0.31	0.14	—	—
30	12.10	5.72	1.62	0.69	0.33	0.10	—
40	—	10.20	3.07	1.23	0.58	0.18	—
50	—	15.90	4.49	1.92	0.91	0.28	—
60	—	—	6.46	2.76	1.31	0.40	—
70	—	—	8.79	3.76	1.78	0.55	0.10
80	—	—	11.50	4.90	2.32	0.72	0.13
90	—	—	14.50	6.21	2.94	0.91	0.16
100	—	—	17.94	7.67	3.63	1.12	0.21
120	—	—	25.80	11.00	5.23	1.61	0.30
140	—	—	35.20	15.00	7.12	2.20	0.41

I-Quest 2006 Codes Complete Collection

GALLONS PER MINUTE	SIZE OF TAP OR TEE (inches)						
	$\frac{5}{8}$	$\frac{3}{4}$	1	1 $\frac{1}{4}$	1 $\frac{1}{2}$	2	3
150	—	—	—	17.20	8.16	2.52	0.47
160	—	—	—	19.60	9.30	2.92	0.54
180	—	—	—	24.80	11.80	3.62	0.68
200	—	—	—	30.70	14.50	4.48	0.84
225	—	—	—	38.80	18.40	5.60	1.06
250	—	—	—	47.90	22.70	7.00	1.31
275	—	—	—	—	27.40	7.70	1.59
300	—	—	—	—	32.60	10.10	1.88

For SI: 1 inch = 25.4 mm, 1 pound per square inch = 6.895 kpa, 1 gallon per minute = 3.785 L/m.

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E103 SELECTION OF PIPE SIZE / E103.3 Segmented loss method. / TABLE E103.3(5) ALLOWANCE IN EQUIVALENT LENGTHS OF PIPE FOR FRICTION LOSS IN VALVES AND THREADED FITTINGS (feet)

**TABLE E103.3(5)
ALLOWANCE IN EQUIVALENT LENGTHS OF PIPE FOR FRICTION LOSS IN VALVES AND THREADED FITTINGS (feet)**

FITTING OR VALVE	PIPE SIZE (inches)							
	$\frac{1}{2}$	$\frac{3}{4}$	1	1 $\frac{1}{4}$	1 $\frac{1}{2}$	2	2 $\frac{1}{2}$	3
45-degree elbow	1.2	1.5	1.8	2.4	3.0	4.0	5.0	6.0
90-degree elbow	2.0	2.5	3.0	4.0	5.0	7.0	8.0	10.0
Tee, run	0.6	0.8	0.9	1.2	1.5	2.0	2.5	3.0
Tee, branch	3.0	4.0	5.0	6.0	7.0	10.0	12.0	15.0
Gate valve	0.4	0.5	0.6	0.8	1.0	1.3	1.6	2.0
Balancing valve	0.8	1.1	1.5	1.9	2.2	3.0	3.7	4.5
Plug-type cock	0.8	1.1	1.5	1.9	2.2	3.0	3.7	4.5
Check valve, swing	5.6	8.4	11.2	14.0	16.8	22.4	28.0	33.6
Globe valve	15.0	20.0	25.0	35.0	45.0	55.0	65.0	80.0
Angle valve	8.0	12.0	15.0	18.0	22.0	28.0	34.0	40.0

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 degree = 0.0175 rad.

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E103 SELECTION OF PIPE SIZE / E103.3 Segmented loss method.

/ TABLE E103.3(6) PRESSURE LOSS IN FITTINGS AND VALVES EXPRESSED AS EQUIVALENT LENGTH OF TUBE^a (feet)

**TABLE E103.3(6)
PRESSURE LOSS IN FITTINGS AND VALVES EXPRESSED AS EQUIVALENT LENGTH OF TUBE^a (feet)**

NOMINAL OR STANDARD SIZE (inches)	FITTINGS				Coupling	VALVES			
	Standard Ell		90-Degree Tee			Ball	Gate	Butterfly	Check
	90 Degree	45 Degree	Side Branch	Straight Run					
$\frac{3}{8}$	0.5	—	1.5	—	—	—	—	—	1.5
$\frac{1}{2}$	1	0.5	2	—	—	—	—	—	2
$\frac{5}{8}$	1.5	0.5	2	—	—	—	—	—	2.5
$\frac{3}{4}$	2	0.5	3	—	—	—	—	—	3
1	2.5	1	4.5	—	—	0.5	—	—	4.5
$1\frac{1}{4}$	3	1	5.5	0.5	0.5	0.5	—	—	5.5
$1\frac{1}{2}$	4	1.5	7	0.5	0.5	0.5	—	—	6.5
2	5.5	2	9	0.5	0.5	0.5	0.5	7.5	9
$2\frac{1}{2}$	7	2.5	12	0.5	0.5	—	1	10	11.5
3	9	3.5	15	1	1	—	1.5	15.5	14.5
$3\frac{1}{2}$	9	3.5	14	1	1	—	2	—	12.5
4	12.5	5	21	1	1	—	2	16	18.5
5	16	6	27	1.5	1.5	—	3	11.5	23.5
6	19	7	34	2	2	—	3.5	13.5	26.5
8	29	11	50	3	3	—	5	12.5	39

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 degree = 0.01745 rad.

- a. Allowances are for streamlined soldered fittings and recessed threaded fittings. For threaded fittings, double the allowances shown in the table. The equivalent lengths presented above are based on a C factor of 150 in the Hazen-Williams friction loss formula. The lengths shown are rounded to the nearest half-foot.

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E201 SELECTION OF PIPE SIZE

**SECTION E201
SELECTION OF PIPE SIZE**

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E201 SELECTION OF PIPE SIZE / E 201.1 Size of water-service

mains, branch mains and risers.

E 201.1 Size of water-service mains, branch mains and risers.

The minimum size water service pipe shall be $\frac{3}{4}$ inch (19.1 mm). The size of water service mains, branch mains and risers shall be determined according to water supply demand [gpm (L/m)], available water pressure [psi (kPa)] and friction loss due to the water meter and developed length of pipe [feet (m)], including equivalent length of fittings. The size of each water distribution system shall be determined according to the procedure outlined in this section or by other design methods conforming to acceptable engineering practice and approved by the code official:

1. Supply load in the building water-distribution system shall be determined by total load on the pipe being sized, in terms of water-supply fixture units (w.s.f.u.), as shown in Table E103.3(2). For fixtures not listed, choose a w.s.f.u. value of a fixture with similar flow characteristics.
2. Obtain the minimum daily static service pressure [psi (kPa)] available (as determined by the local water authority) at the water meter or other source of supply at the installation location. Adjust this minimum daily static pressure [psi (kPa)] for the following conditions:
 - 2.1. Determine the difference in elevation between the source of supply and the highest water supply outlet. Where the highest water supply outlet is located above the source of supply, deduct 0.5 psi (3.4 kPa) for each foot (0.3 m) of difference in elevation. Where the highest water supply outlet is located below the source of supply, add 0.5 psi (3.4 kPa) for each foot (0.3 m) of difference in elevation.
 - 2.2. Where a water pressure reducing valve is installed in the water distribution system, the minimum daily static water pressure available is 80 percent of the minimum daily static water pressure at the source of supply or the set pressure downstream of the pressure reducing valve, whichever is smaller.
 - 2.3. Deduct all pressure losses due to special equipment such as a backflow preventer, water filter and water softener. Pressure loss data for each piece of equipment shall be obtained through the manufacturer of such devices.
 - 2.4. Deduct the pressure in excess of 8 psi (55 kPa) due to installation of the special plumbing fixture, such as temperature controlled shower and flushometer tank water closet.
Using the resulting minimum available pressure, find the corresponding pressure range in Table E201.1.
3. The maximum developed length for water piping is the actual length of pipe between the source of supply and the most remote fixture, including either hot (through the water heater) or cold water branches multiplied by a factor of 1.2 to compensate for pressure loss through fittings.
Select the appropriate column in Table E201.1 equal to or greater than the calculated

I-Quest 2006 Codes Complete Collection

maximum developed length.

4. To determine the size of water service pipe, meter and main distribution pipe to the building using the appropriate table, follow down the selected "maximum developed length" column to a fixture unit equal to, or greater than the total installation demand calculated by using the "combined" water supply fixture unit column of Table E201.1. Read the water service pipe and meter sizes in the first left-hand column and the main distribution pipe to the building in the second left-hand column on the same row.
5. To determine the size of each water distribution pipe, start at the most remote outlet on each branch (either hot or cold branch) and, working back toward the main distribution pipe to the building, add up the water supply fixture unit demand passing through each segment of the distribution system using the related hot or cold column of Table E201.1. Knowing demand, the size of each segment shall be read from the second left-hand column of the same table and maximum developed length column selected in Steps 1 and 2, under the same or next smaller size meter row. In no case does the size of any branch or main need to be larger than the size of the main distribution pipe to the building established in Step 4.

2006 International Plumbing Code / APPENDIX E SIZING OF WATER PIPING SYSTEM / SECTION E201 SELECTION OF PIPE SIZE / E 201.1 Size of water-service mains, branch mains and risers. / TABLE E201.1 MINIMUM SIZE OF WATER METERS, MAINS AND DISTRIBUTION PIPING BASED ON WATER SUPPLY FIXTURE UNIT VALUES (w.s.f.u.)

**TABLE E201.1
MINIMUM SIZE OF WATER METERS, MAINS AND DISTRIBUTION PIPING
BASED ON WATER SUPPLY FIXTURE UNIT VALUES (w.s.f.u.)**

METER AND SERVICE PIPE (inches)	DISTRIBUTION PIPE (inches)	MAXIMUM DEVELOPMENT LENGTH (feet)										
		40	60	80	100	150	200	250	300	400	500	
Pressure Range 30 to 39 psi												
¾	½ ^a	2.5	2	1.5	1.5	1	1	0.5	0.5	0	0	
¾	¾	9.5	7.5	6	5.5	4	3.5	3	2.5	2	1.5	
¾	1	32	25	20	16.5	11	9	7.8	6.5	5.5	4.5	
1	1	32	32	27	21	13.5	10	8	7	5.5	5	
¾	1¼	32	32	32	32	30	24	20	17	13	10.5	
1	1¼	80	80	70	61	45	34	27	22	16	12	
1½	1¼	80	80	80	75	54	40	31	25	17.5	13	
1	1½	87	87	87	87	84	73	64	56	45	36	
1½	1½	151	151	151	151	117	92	79	69	54	43	
2	1½	151	151	151	151	128	99	83	72	56	45	
1	2	87	87	87	87	87	87	87	87	87	86	
1½	2	275	275	275	275	258	223	196	174	144	122	

I-Quest 2006 Codes Complete Collection

METER AND SERVICE PIPE (inches)	DISTRIBUTION PIPE (inches)	MAXIMUM DEVELOPMENT LENGTH (feet)									
		Pressure Range 30 to 39 psi									
		40	60	80	100	150	200	250	300	400	500
2	2	365	365	365	365	318	266	229	201	160	134
2	2½	533	533	533	533	533	495	448	409	353	311

METER AND SERVICE PIPE (inches)	DISTRIBUTION PIPE (inches)	MAXIMUM DEVELOPMENT LENGTH (feet)									
		Pressure Range 40 to 49 psi									
		40	60	80	100	150	200	250	300	400	500
¾	½ ^a	3	2.5	2	1.5	1.5	1	1	0.5	0.5	0.5
¾	¾	9.5	9.5	8.5	7	5.5	4.5	3.5	3	2.5	2
¾	1	32	32	32	26	18	13.5	10.5	9	7.5	6
1	1	32	32	32	32	21	15	11.5	9.5	7.5	6.5
¾	1¼	32	32	32	32	32	32	32	27	21	16.5
1	1¼	80	80	80	80	65	52	42	35	26	20
1½	1¼	80	80	80	80	75	59	48	39	28	21
1	1½	87	87	87	87	87	87	87	78	65	55
1½	1½	151	151	151	151	151	130	109	93	75	63
2	1½	151	151	151	151	151	139	115	98	77	64
1	2	87	87	87	87	87	87	87	87	87	87
1½	2	275	275	275	275	275	275	264	238	198	169
2	2	365	365	365	365	365	349	304	270	220	185
2	2½	533	533	533	533	533	533	533	528	456	403

(continued)

METER AND SERVICE PIPE (inches)	DISTRIBUTION PIPE (inches)	MAXIMUM DEVELOPMENT LENGTH (feet)									
		Pressure Range 50 to 60 psi									
		40	60	80	100	150	200	250	300	400	500
¾	½ ^a	3	3	2.5	2	1.5	1	1	1	0.5	0.5
¾	¾	9.5	9.5	9.5	8.5	6.5	5	4.5	4	3	2.5
¾	1	32	32	32	32	25	18.5	14.5	12	9.5	8
1	1	32	32	32	32	30	22	16.5	13	10	8
¾	1¼	32	32	32	32	32	32	32	32	29	24
1	1¼	80	80	80	80	80	68	57	48	35	28
1½	1¼	80	80	80	80	80	75	63	53	39	29
1	1½	87	87	87	87	87	87	87	87	82	70
1½	1½	151	151	151	151	151	151	139	120	94	79

I-Quest 2006 Codes Complete Collection

METER AND SERVICE PIPE (inches)	DISTRIBUTION PIPE (inches)	MAXIMUM DEVELOPMENT LENGTH (feet)									
		40	60	80	100	150	200	250	300	400	500
Pressure Range 50 to 60 psi		40	60	80	100	150	200	250	300	400	500
2	1½	151	151	151	151	151	151	146	126	97	81
1	2	87	87	87	87	87	87	87	87	87	87
1½	2	275	275	275	275	275	275	275	275	247	213
2	2	365	365	365	365	365	365	365	329	272	232
2	2½	533	533	533	533	533	533	533	533	353	486

METER AND SERVICE PIPE (inches)	DISTRIBUTION PIPE (inches)	MAXIMUM DEVELOPMENT LENGTH (feet)									
		40	60	80	100	150	200	250	300	400	500
Pressure Range Over 60		40	60	80	100	150	200	250	300	400	500
¾	½ ^a	3	3	3	2.5	2	1.5	1.5	1	1	0.5
¾	¾	9.5	9.5	9.5	9.5	7.5	6	5	4.5	3.5	3
¾	1	32	32	32	32	32	24	19.5	15.5	11.5	9.5
1	1	32	32	32	32	32	28	28	17	12	9.5
¾	1¼	32	32	32	32	32	32	32	32	32	30
1	1¼	80	80	80	80	80	80	80	69	60	46
1½	1¼	80	80	80	80	80	80	80	76	65	50
1	1½	87	87	87	87	87	87	87	87	87	84
1½	1½	151	151	151	151	151	151	151	144	114	94
2	1½	151	151	151	151	151	151	151	151	118	97
1	2	87	87	87	87	87	87	87	87	87	87
1½	2	275	275	275	275	275	275	275	275	275	252
2	2	365	368	368	368	368	368	368	368	318	273
2	2½	533	533	533	533	533	533	533	533	533	533

For SI: 1 inch = 25.4, 1 foot = 304.8 mm.

a. Minimum size for building supply is ¾-inch pipe.

2006 International Plumbing Code / APPENDIX F STRUCTURAL SAFETY

**APPENDIX F
STRUCTURAL SAFETY**

2006 International Plumbing Code / APPENDIX F STRUCTURAL SAFETY / SECTION F101 CUTTING, NOTCHING AND BORING IN WOOD MEMBERS

**SECTION F101
CUTTING, NOTCHING AND
BORING IN WOOD MEMBERS**

2006 International Plumbing Code / APPENDIX F STRUCTURAL SAFETY / SECTION F101 CUTTING, NOTCHING AND BORING IN WOOD MEMBERS / [B] F101.1 Joist notching.

[B] F101.1 Joist notching.

Notches on the ends of joists shall not exceed one-fourth the joist depth. Holes bored in joists shall not be within 2 inches (51 mm) of the top or bottom of the joist, and the diameter of any such hole shall not exceed one-third the depth of the joist. Notches in the top or bottom of joists shall not exceed one sixth the depth and shall not be located in the middle third of the span.

2006 International Plumbing Code / APPENDIX F STRUCTURAL SAFETY / SECTION F101 CUTTING, NOTCHING AND BORING IN WOOD MEMBERS / [B] F101.2 Stud cutting and notching.

[B] F101.2 Stud cutting and notching.

In exterior walls and bearing partitions, any wood stud is permitted to be cut or notched to a depth not exceeding 25 percent of its width. Cutting or notching of studs to a depth not greater than 40 percent of the width of the stud is permitted in nonbearing partitions supporting no loads other than the weight of the partition.

2006 International Plumbing Code / APPENDIX F STRUCTURAL SAFETY / SECTION F101 CUTTING, NOTCHING AND BORING IN WOOD MEMBERS / [B] F101.3 Bored holes.

[B] F101.3 Bored holes.

A hole not greater in diameter than 40 percent of the stud width is permitted to be bored in any wood stud. Bored holes not greater than 60 percent of the width of the stud is permitted in nonbearing partitions or in any wall where each bored stud is doubled, provided not more than two such successive doubled studs are so bored. In no case shall the edge of the bored hole be nearer than 0.625 inch (15.9 mm) to the edge of the stud. Bored holes shall not be located at the same section of stud as a cut or notch.

2006 International Plumbing Code / APPENDIX F STRUCTURAL SAFETY / SECTION

**F101 CUTTING, NOTCHING AND BORING IN WOOD MEMBERS / [B] F101.4
Cutting, notching and boring holes in structural steel framing.**

[B] F101.4 Cutting, notching and boring holes in structural steel framing.

The cutting, notching and boring of holes in structural steel framing members shall be as prescribed by the registered design professional.

**2006 International Plumbing Code / APPENDIX F STRUCTURAL SAFETY / SECTION
F101 CUTTING, NOTCHING AND BORING IN WOOD MEMBERS / [B] F101.5
Cutting, notching and boring holes in cold-formed steel framing.**

[B] F101.5 Cutting, notching and boring holes in cold-formed steel framing.

Flanges and lips of load-bearing cold-formed steel framing members shall not be cut or notched. Holes in webs of load-bearing cold-formed steel framing members shall be permitted along the centerline of the web of the framing member and shall not exceed the dimensional limitations, penetration spacing or minimum hole edge distance as prescribed by the registered design professional. Cutting, notching and boring holes of steel floor/roof decking shall be as prescribed by the registered design professional.

**2006 International Plumbing Code / APPENDIX F STRUCTURAL SAFETY / SECTION
F101 CUTTING, NOTCHING AND BORING IN WOOD MEMBERS / [B] F101.6
Cutting, notching and boring holes in nonstructural cold-formed steel wall framing.**

[B] F101.6 Cutting, notching and boring holes in nonstructural cold-formed steel wall framing.

Flanges and lips of nonstructural cold-formed steel wall studs shall not be cut or notched. Holes in webs of nonstructural cold-formed steel wall studs shall be permitted along the centerline of the web of the framing member, shall not exceed 1.5 inches (38 mm) in width or 4 inches (102 mm) in length, and the holes shall not be spaced less than 24 inches (610 mm) center to center from another hole or less than 10 inches (254 mm) from the bearing end.

2006 International Plumbing Code / APPENDIX G VACUUM DRAINAGE SYSTEM

**APPENDIX G
VACUUM DRAINAGE SYSTEM**

**2006 International Plumbing Code / APPENDIX G VACUUM DRAINAGE SYSTEM /
SECTION G101 VACUUM DRAINAGE SYSTEM**

**SECTION G101
VACUUM DRAINAGE SYSTEM**

**2006 International Plumbing Code / APPENDIX G VACUUM DRAINAGE SYSTEM /
SECTION G101 VACUUM DRAINAGE SYSTEM / G101.1 Scope.**

G101.1 Scope.

This appendix provides general guidelines for the requirements for vacuum drainage systems.

**2006 International Plumbing Code / APPENDIX G VACUUM DRAINAGE SYSTEM /
SECTION G101 VACUUM DRAINAGE SYSTEM / G101.2 General requirements.**

G101.2 General requirements.

**2006 International Plumbing Code / APPENDIX G VACUUM DRAINAGE SYSTEM /
SECTION G101 VACUUM DRAINAGE SYSTEM / G101.2 General requirements. /
G101.2.1 System design.**

G101.2.1 System design.

Vacuum drainage systems shall be designed in accordance with manufacturer's recommendations. The system layout, including piping layout, tank assemblies, vacuum pump assembly and other components/designs necessary for proper function of the system shall be per manufacturer's recommendations. Plans, specifications and other data for such systems shall be submitted to the local administrative authority for review and approval prior to installation.

**2006 International Plumbing Code / APPENDIX G VACUUM DRAINAGE SYSTEM /
SECTION G101 VACUUM DRAINAGE SYSTEM / G101.2 General requirements. /
G101.2.2 Fixtures.**

G101.2.2 Fixtures.

Gravity-type fixtures used in vacuum drainage systems shall comply with Chapter 4 of this code.

**2006 International Plumbing Code / APPENDIX G VACUUM DRAINAGE SYSTEM /
SECTION G101 VACUUM DRAINAGE SYSTEM / G101.2 General requirements. /
G101.2.3 Drainage fixture units.**

G101.2.3 Drainage fixture units.

Fixture units for gravity drainage systems which discharge into or receive discharge from

vacuum drainage systems shall be based on values in Chapter 7 of this code.

2006 International Plumbing Code / APPENDIX G VACUUM DRAINAGE SYSTEM / SECTION G101 VACUUM DRAINAGE SYSTEM / G101.2 General requirements. / G101.2.4 Water supply fixture units.

G101.2.4 Water supply fixture units.

Water supply fixture units shall be based on values in Chapter 6 of this code with the addition that the fixture unit of a vacuum-type water closet shall be "1."

2006 International Plumbing Code / APPENDIX G VACUUM DRAINAGE SYSTEM / SECTION G101 VACUUM DRAINAGE SYSTEM / G101.2 General requirements. / G101.2.5 Traps and cleanouts.

G101.2.5 Traps and cleanouts.

Gravity-type fixtures shall be provided with traps and cleanouts in accordance with Chapters 7 and 10 of this code.

2006 International Plumbing Code / APPENDIX G VACUUM DRAINAGE SYSTEM / SECTION G101 VACUUM DRAINAGE SYSTEM / G101.2 General requirements. / G101.2.6 Materials.

G101.2.6 Materials.

Vacuum drainage pipe, fitting and valve materials shall be as recommended by the vacuum drainage system manufacturer and as permitted by this code.

2006 International Plumbing Code / APPENDIX G VACUUM DRAINAGE SYSTEM / SECTION G101 VACUUM DRAINAGE SYSTEM / G101.3 Testing and demonstrations.

G101.3 Testing and demonstrations.

After completion of the entire system installation, the system shall be subjected to a vacuum test of 19 inches (483 mm) of mercury and shall be operated to function as required by the administrative authority and the manufacturer. Recorded proof of all tests shall be submitted to the administrative authority.

2006 International Plumbing Code / APPENDIX G VACUUM DRAINAGE SYSTEM / SECTION G101 VACUUM DRAINAGE SYSTEM / G101.4 Written instructions.

G101.4 Written instructions.

Written instructions for the operations, maintenance, safety and emergency procedures shall be provided by the building owner as verified by the administrative authority.