

CHAPTER 18 • New

CHAPTER 19 • Existing



Exhibit 18/19.88 Smoke barrier duct penetration protected by smoke damper.



Exhibit 18/19.89 Placard with warning against penetration of smoke barrier.

permitted if an engineered smoke control system required a damper at this point. Openings for transfer grilles require automatic-closing dampers.

Exhibit 18/19.90 and Exhibit 18/19.91 illustrate some of the detailed requirements of 18/19.3.7 for subdividing building spaces through the use of smoke barriers.

In Exhibit 18/19.92, the smoke barrier requirement for a building with an atrium is satisfied by running the smoke barrier partition directly through the building from one outside wall to the opposite outside wall

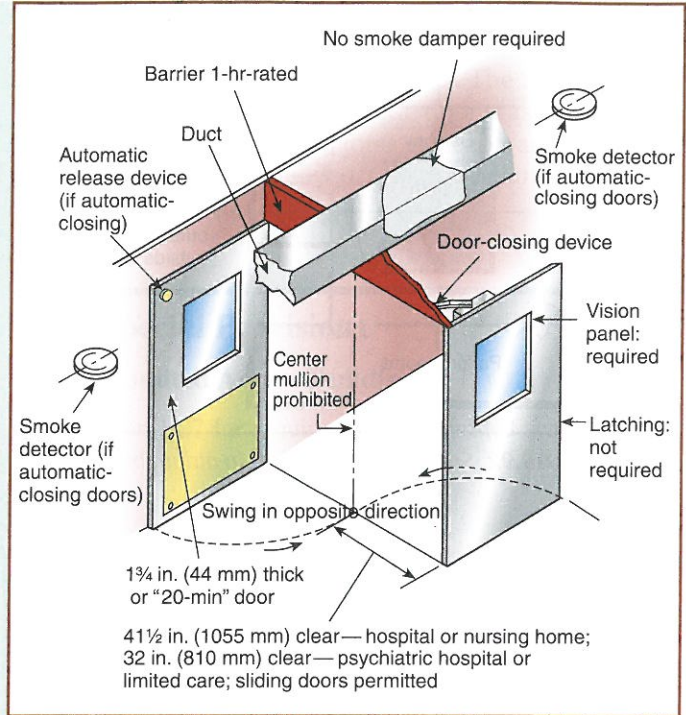


Exhibit 18/19.90 Details of new smoke barrier.

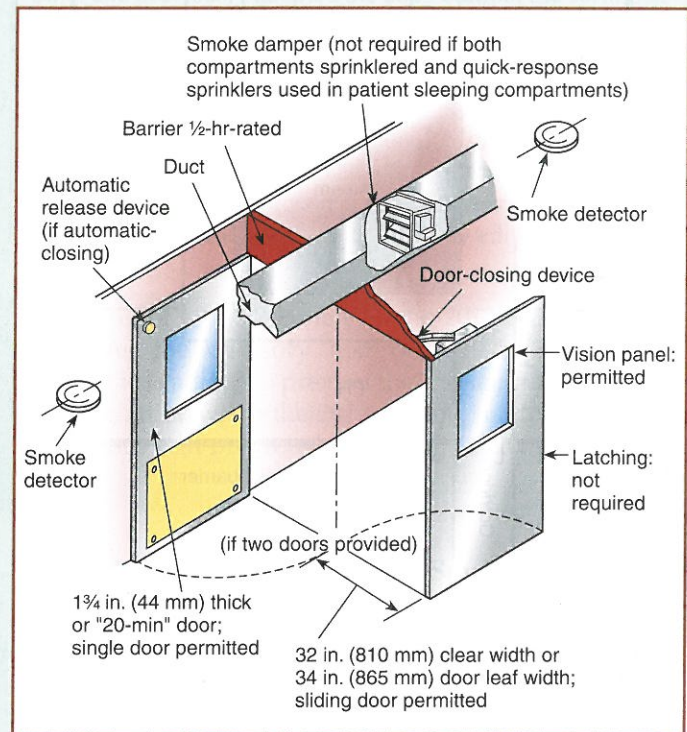


Exhibit 18/19.91 Details of existing smoke barrier.