


SEE ELECTRONIC SECURITY SYSTEM  
INSTALLATION DESIGN PACKAGE FOR  
ADDITIONAL SECURITY SYSTEM  
REQUIREMENTS.

- SPECIFIC NOTES (SPECIAL SYSTEMS PLAN):**
- ◇ FIRE ALARM SMOKE SENSOR SHALL INITIATE ALTERNATE ELEVATOR RECALL.
  - ◇ FIRE ALARM SMOKE SENSOR SHALL INITIATE PRIMARY ELEVATOR RECALL.
  - ◇ FIRE ALARM HEAT SENSOR SHALL INITIATE ELEVATOR SHUT DOWN SEQUENCE.
  - ◇ ADDRESSABLE FIRE ALARM RELAY FOR ROLL-DOWN SHUTTER.
  - ◇ ADDRESSABLE FIRE ALARM RELAY TO OPEN AUTOMATIC DOORS DURING ATRIUM SMOKE EVACUATION SEQUENCE.
  - ◇ PROVIDE PENDANT-MOUNTED, OMNI-DIRECTIONAL SPEAKER (SOUNDSPHERE).
  - ◇ PROVIDE SPEAKER IN CEILING FOR PAGING SYSTEM AND / OR AUDIO VISUAL SYSTEM.
  - ◇ PROVIDE SURFACE-MOUNTED, WEATHERPROOF, TRUMPET TYPE SPEAKER FOR PAGING SYSTEM.
  - ◇ PROVIDE DUCT-MOUNTED SMOKE SENSORS IN THE SUPPLY AND RETURN OF EACH AHU. PROVIDE ADDRESSABLE FIRE ALARM RELAY TO SHUT DOWN AHU FROM FIRE ALARM SYSTEM.
  - ◇ PROVIDE ROUGHINS FOR ACCESS CONTROL SYSTEM AND ASSOCIATED INTERFACE TO AUTOMATIC DOOR. SEE MAIN ENTRANCE ROUGH-IN DETAIL.
  - ◇ PROVIDE ROUGHINS FOR ACCESS CONTROL SYSTEM. SEE TYPICAL DOOR ROUGH-IN DETAIL.
  - ◇ PROVIDE ROUGH-IN FOR CCTV CAMERA.
  - ◇ PROVIDE ROUGH-IN FOR PRESSURE MAT.
  - ◇ PROVIDE ROUGH-IN FOR INTERCOM SYSTEM MASTER STATION / DOOR STATION.
  - ◇ PROVIDE ROUGH-IN FOR BALANCED MAGNETIC SWITCH.
  - ◇ COORDINATE INSTALLATION WITH CEILING INSTALLATION. IF NO CEILING WILL BE INSTALLED, DEVICES MUST BE PENDANT MOUNTED FROM STRUCTURE AT 10 FEET A.F.F.
  - ◇ PROVIDE ADDRESSABLE RELAY FOR ATRIUM EXHAUST FAN CONTROL.

**1 SPECIAL SYSTEM PLAN - THIRD FLOOR**

SCALE 1/8" = 1'-0"

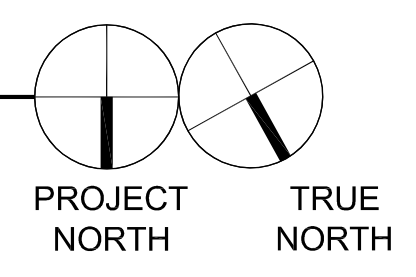

**IMC**  
CONSULTING ENGINEERS  
INC.  
3120 20th STREET  
METAIRIE, LOUISIANA 70002

These drawings are conceptual in nature and are not suitable for construction. It is the intent of these documents to clearly delineate the baseline minimum scale, scope and quality of the project. It is the responsibility of the design-builder that his proposal provides for a complete and functional facility responding to relative Army National Guard criteria, recognized industry standards and applicable building codes regardless of the content of these conceptual drawings. Further, it will be the responsibility of the successful design-builder and his architect of record to prepare complete construction documents responding to the full intent of the conceptual drawings and specifications.

**BROADMOOR**  
DESIGN GROUP  
PROFESSIONAL ARCHITECTURAL CORPORATION  
METAIRIE, LOUISIANA 70002  
2740 NORTH ARNOLD ROAD  
(504) 885-5401

**BltchKnevel**  
ARCHITECTS  
NEW ORLEANS, LOUISIANA 70130  
757 ST. CHARLES AVENUE  
(504) 524-4834

**LOUISIANA ARMY NATIONAL GUARD  
141st FIELD ARTILLERY BATTALION  
READINESS CENTER**  
JACKSON BARRACKS NEW ORLEANS, LOUISIANA



2/22/06	PROG. REVIEW #1
3/10/06	PROG. REVIEW #2
3/27/06	PROG. REVIEW #3
4/10/06	PROG. REVIEW #4
5/3/06	PRELIM. DESIGN

MARK DATE DESCRIPTION  
DRAWING ISSUED: 05/03/2006

NOB PROJECT NO.: 220027

**PRELIMINARY DESIGN**

DRAWING TITLE:  
**SPECIAL SYSTEM PLAN-  
THIRD FLOOR**

DRAWING NUMBER:

**E143**  
SHEET 94 OF 106