



## Standard Test Methods for Asphalt Roll Roofing, Cap Sheets, and Shingles<sup>1</sup>

This standard is issued under the fixed designation D 228; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

### 1. Scope

1.1 These test methods cover the procedures for the physical testing and analyses of roofing and shingles composed of asphalt saturated or glass fiber felt coated to various extents with asphalt and having the coated portion surfaced with powders, laminates or granules.

1.2 The values stated in SI units are to be regarded as the standard. The values given in parentheses are for information only.

1.3 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

### 2. Referenced Documents

#### 2.1 ASTM Standards:

- D 95 Test Method for Water in Petroleum Products and Bituminous Materials by Distillation<sup>2</sup>
- D 224 Specification for Smooth-Surfaced Asphalt Roll Roofing (Organic Felt)<sup>3</sup>
- D 225 Specification for Asphalt Shingles (Organic Felt) Surfaced with Mineral Granules<sup>3</sup>
- D 249 Specification for Asphalt Roll Roofing (Organic Felt) Surfaced with Mineral Granules<sup>3</sup>
- D 371 Specification for Asphalt Roll Roofing (Organic Felt) Surfaced with Mineral Granules; Wide Selvage<sup>3</sup>
- D 1079 Terminology Relating to Roofing, Waterproofing, and Bituminous Materials<sup>3</sup>
- D 2178 Specification for Asphalt Glass Felt Used in Roofing and Waterproofing<sup>3</sup>
- D 2626 Specification for Asphalt-Saturated and Coated Organic Felt Base Sheet Used in Roofing<sup>3</sup>
- D 3018 Specification for Class A Asphalt Shingles Surfaced with Mineral Granules<sup>3</sup>
- D 3462 Specification for Asphalt Shingles Made from Glass Felt and Surfaced with Mineral Granules<sup>3</sup>
- D 3909 Specification for Asphalt Roll Roofing (Glass Felt)

Surfaced with Mineral Granules<sup>3</sup>

D 4601 Specification for Asphalt-Coated Glass Fiber Base Sheet Used in Roofing<sup>3</sup>

D 4897 Specification for Asphalt-Coated Glass-Fiber Venting Base Sheet Used in Roofing<sup>3</sup>

D 6380 Specification for Asphalt Roll Roofing (Organic Felt)<sup>3</sup>

### 3. Terminology

3.1 For definitions of terms used in this test method, see Terminology D 1079.

### 4. Significance and Use

4.1 These test methods cover the sampling, physical testing, and compositional analyses of asphalt roofing products fabricated with asphalt coatings. Other components may include, but are not limited to, felts, mats, films, foils, mineral stabilizers, papers, and mineral surfacing.

4.2 Five random samples are required from lots equal to or less than 1000 packages. The number of samples required for lots greater than 1000 packages is dependent on the variation in the unit mass within the lot and is determined by the two-step sampling plan in 6.5.

4.3 The results of a visual examination, physical testing and compositional analysis are required for each sample. The analytical data are further used to compute the probable minimum and the probable range for the average mass of each of the components.

### 5. Types of Roofing

5.1 Asphalt coated roll roofing and shingles are divided into the following types for the purposes of this test method (see Fig. 1).

5.1.1 *Type 1*—A single thickness of glass felt, coated with asphalt and mineral surfacing such as in Specifications D 2178, D 3462, D 3909, D 4601 and D 4897. The backing material (designated “Fine Mineral Surfacing” in Fig. 1) shall be permitted to be any suitable material that prevents these products from sticking together while packaged.

5.1.2 *Type 2*—A single thickness of asphalt saturated felt coated with asphalt and mineral surfacing such as in Specifications D 224, D 225, D 249, D 2626, and some of the products in Specification D 6380. The backing material (designated “Fine Mineral Surfacing” in Fig. 1) shall be permitted to be any suitable material that prevents these products from sticking

<sup>1</sup> These test methods are under the jurisdiction of ASTM Committee D08 on Roofing, Waterproofing, and Bituminous Materials and are the direct responsibility of Subcommittee D08.02 on Prepared Roofing, Shingles, and Siding Materials.

Current edition approved Dec. 12, 2000. Published February 2001. Originally published as D 228 – 25. Last previous edition D 228 – 00a.

<sup>2</sup> *Annual Book of ASTM Standards*, Vol 05.01.

<sup>3</sup> *Annual Book of ASTM Standards*, Vol 04.04.

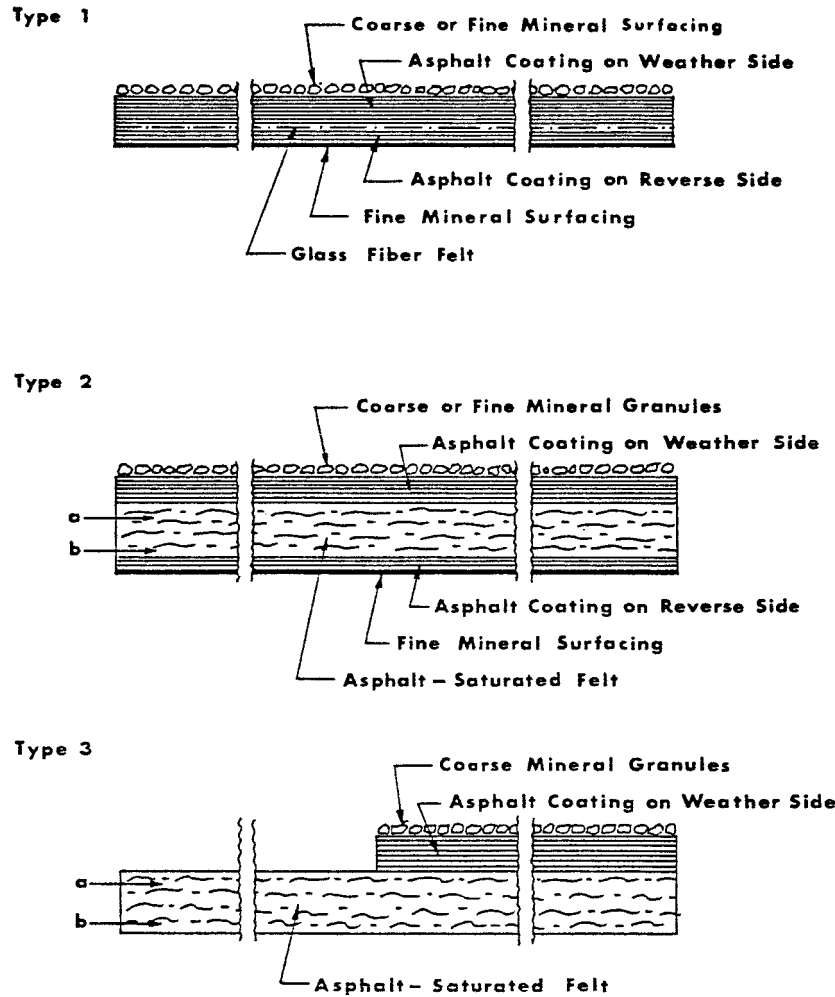


FIG. 1 Types of Asphalt-Coated Roll Roofing and Shingles

together while packaged.

5.1.3 *Type 3*—Similar to Type 2, but asphalt coated and surfaced with mineral granules for part of one side of the saturated felt such as in Specification D 371.

## 6. Sampling

6.1 The rolls or bundles selected in accordance with this section constitute the representative sample used in Sections 7 and 8. See Fig. 2.

6.2 The lot is defined as a shipment or fraction thereof representing a product of the same kind, class, and mass.

6.3 Select five rolls or packages from the lot at random. Determine the average net mass per  $\text{g/m}^2$  ( $\text{lb}/100 \text{ ft}^2$ ) and the standard deviation in accordance with 7.1 to 7.8.

6.4 If the lot is 1000 or fewer rolls or packages proceed to Section 7. If the lot is 1001 or greater in number, follow the second part of the sampling plan in 6.5.

6.5 Calculate the required number of samples based on the standard deviation ( $s$ ) of the preliminary sampling by:


$$n = \frac{t^2 s^2}{d^2} \quad (1)$$

where:

$n$  = total number of samples required ( $n - 5$  more rolls or packages must be selected at random as samples),

$t$  = test statistic for number of samples in the preliminary test series for 4° and a 95 % confidence that the calculated average mass will not exceed  $d$  ( $t = 2.776$ ), and

$d$  =  $100 \text{ g/m}^2$  ( $2 \text{ lb}/100 \text{ ft}^2$ ) (the mean mass obtained from the analysis should be within  $\pm 100 \text{ g/m}^2$  of the true value, with 95 % confidence).

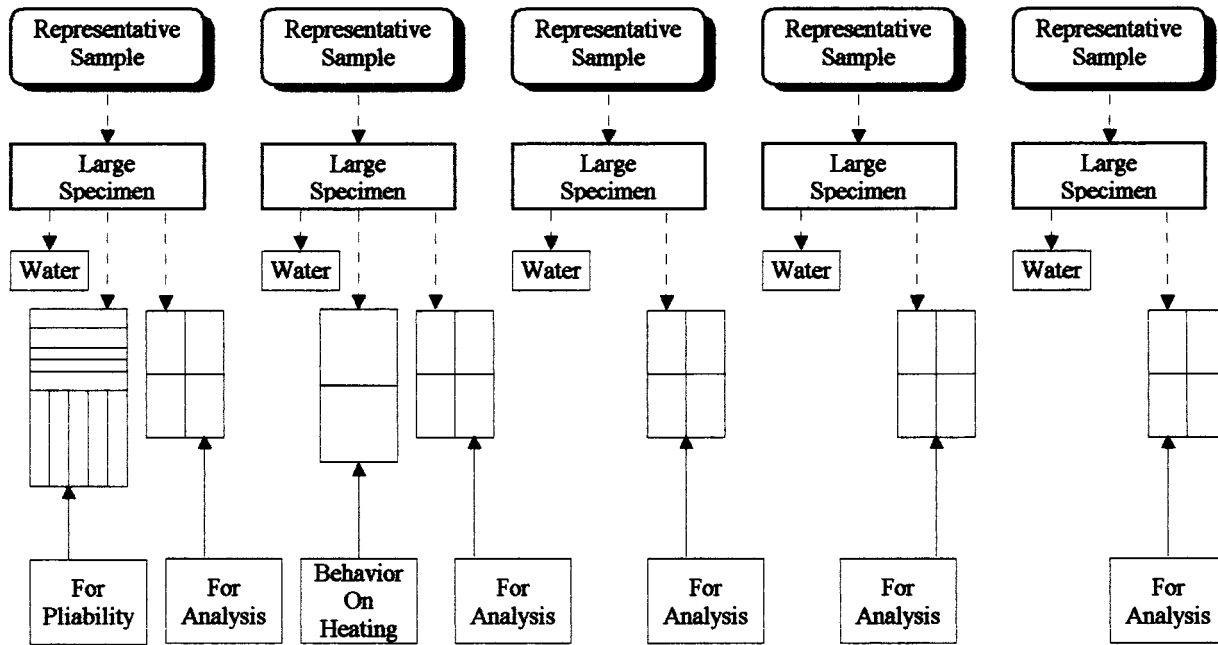

In Section 6, initial "Representative Samples" are selected (typically 5 per lot). These are full bundles or rolls. These are the samples used in Section 7.  
 In Section 8, one large "Specimen" is taken from each Representative Sample (full shingles from Section 7.5 or a portion of each roll selected in Section 6). These are confirmed to be within 1.5 % of the mass per area (from Section 7.6) for the corresponding Representative Sample.  
 In Section 9, (where product standards require measurement of water content per D 95) 50 gram samples are taken from each "Large Specimen" for determination of water.  
 In Section 10, 5 MD and 5 CD small test specimens are cut from one of the "Large Specimens" for evaluation of pliability.  
 In Section 11, 2 test specimens are cut from one of the "Large Specimens" for evaluation of Behavior on Heating.  
 In Section 12, small test specimens (3 for glass felt, 4 for organic felt) are cut from each of the "Large Specimens" for "analysis" by Section 13 (for glass felt) or by Section 14 (for organic felt).

**FIG. 2 Sample selection summary and flow diagram**  
 (See individual sections for sample selection details)

**7. As Received Mass and Area Determinations, All Types of Roofing**

7.1 *Gross Mass*—Determine and record the mass of each roll or package in the sample to the nearest 0.1 kg (0.2 lb).

7.2 *Net Mass*—Disassemble each package or unroll each roll; shake off any loose surfacing and determine and record the net mass of all the shingles or the entire roll to the nearest 0.1 kg (0.2 lb.). Where a product standard requires it, the loose surfacing is to be collected and the mass determined.

7.3 *Packaging and Fixture Mass*—Determine and record the mass to the nearest 0.1 kg (0.2 lb) of the packaging and all associated fixtures shipped with the roll or package, such as nails and adhesive.

7.4 *Dimensions of Roll Products*—Measure and record the length and width of each roll of roofing and the selvage width to the nearest 3 mm (1/8 in.).

7.5 *Shingle Count and Dimensions*—From each of the representative sample packages generated in Section 6, count and record the number of shingles in each package. Select one shingle randomly from each package. Measure the width, length, and cutout dimensions for each of these selected shingles to the nearest 1 mm (1/32 in.). Calculate and record the average for each of these measurements.

7.6 Calculate the area of the roofing and the net mass of the roofing per g/m<sup>2</sup> (lb/100 ft<sup>2</sup>) in each roll or package (without packaging, cut outs or loose surfacing).

7.7 Calculate and record the average net mass of the roofing in g/m<sup>2</sup> (lb/100 ft<sup>2</sup>).

7.8 Calculate and record the estimate of the standard deviation by:

$$s = \sqrt{\frac{\sum X^2}{n-1} - \frac{(\sum X)^2}{n(n-1)}} \tag{2}$$

where:

- $s$  = unbiased estimate of the standard deviation,
- $\sum X^2$  = sum of the squares of the individual mass determinations,
- $(\sum X)^2$  = square of the sum of the individual mass determinations, and
- $n$  = number of samples.

7.9 Calculate the 95 % confidence interval for the average mass by:

$$\frac{\sum X}{n} \pm \frac{ts}{\sqrt{n}} \tag{3}$$

where:

- $\sum X$  = sum of the individual mass determinations, and
- $t$  = appropriate  $t$  statistic for 95 % confidence and  $n - 1$  dF (  $t = 2.776$  for  $n = 5$ ; consult standard reference table for other values of  $n$ ).

**8. Selection of Representative Specimens, All Roofing Types**

8.1 Several product standards reference sampling as designated in accordance with these Test Methods for tests which are not specifically covered by Test Methods D 228. Unless

otherwise specified in these test methods, the samples or specimens for testing shall all be selected from the representative sample (roll or package selected in Section 6) which has the individual net mass per unit area closest to the average net mass per unit area for the combined representative samples as determined in Section 7. If more than one roll or package needs to be selected to provide sufficient specimens for all the tests dictated within the product standard, any additional specimens shall be selected from the representative sample that has the net mass per unit area that is next closest to the average net mass per unit area of the combined representative samples.

NOTE 1—It is the intent of these test methods that whenever not specifically directed to select specimens in some other manner, specimens shall be selected from the representative sample which is the closest in mass per unit area to the average mass per unit area of the combined representative samples.

8.2 For roll products, select a specimen of roofing, the full sheet width and at least 1m (3 ft) in length from each roll, starting a minimum of three wraps into the roll. For shingle products, the shingles from 7.5 shall be used.

8.3 Determine the mass of each specimen and calculate the mass in  $\text{g/m}^2$  ( $\text{lb}/100 \text{ ft}^2$ ).

8.4 Discard all specimens that differ by more than 1.5 % from the net mass determined in 7.6, select replacements, and determine the mass as in 8.3.

8.5 Continue this process until five representative specimens are obtained, no more than one from each package or roll, that reflect that roll or package's average net weight as determined in 7.6.

8.6 If fewer than five specimens are available, use all the available specimens and adjust the final calculations to reflect the lower number of samples tested.

## ALL ROOFING TYPES

### 9. Moisture

9.1 Determine the water in each sample in accordance with Test Method D 95; use 50 g (0.11 lb) of product for each determination, cut up to fit in the flask. Report the water content as a percent of the dry (water free) product mass.

## ASPHALT ROLL ROOFING AND CAP SHEETS

### 10. Pliability

10.1 From a large specimen selected in Section 8, cut ten small test specimens 25.4 mm (1 in.) in width by 203 mm (8 in.) in length, five in the direction of and five across the length of the roll. Immerse in water at 25°C (77°F) for 25 to 30 min; then remove and immediately bend each specimen, with the weather side up, at a uniform speed through 90° in approximately 2 s over the rounded edge of a block. The block shall be 76.2 mm (3 in.) square by 50.8 mm (2 in.) thick with rounded corners of 12.7 mm ( $\frac{1}{2}$  in.) radius for Type 2 roofing and 19 mm ( $\frac{3}{4}$  in.) radius for Types 1, 3, and 4 roofing. When bending, hold the specimens by hand tightly against the upper face of the block, and bend the projecting end of the specimen over the rounded corner without exerting any stress other than that required to keep the specimen in contact with the block and to avoid kinking. For felts, any surface rupture exceeding 3 mm

( $\frac{1}{8}$  in.), as measured while bent over the block, is considered a failure. For coated products, failure is defined as cracking of the filled coating asphalt which exposes the reinforcement of the specimen. The cracking shall be visible to the naked eye when the specimen is viewed in the bent condition on the mandrel block. Separation of granules or other superficial fissures which do not extend through the filled coating asphalt surface to the reinforcement do not constitute cracking. Fracture through the specimen is considered a failure. Report the number of specimens failing.

## ASPHALT ROLL ROOFING, CAP SHEETS, AND SHINGLES

### 11. Weight Loss and Behavior on Heating

11.1 Cut two test specimens, each approximately 100 by 100 mm (4 by 4 in.) from a large specimen selected in accordance with Section 8. Condition the smaller specimens for 24 h in a desiccator, weigh to the nearest 0.1 g, and then by means of a thin wire fastened through holes punctured near one edge, suspend them vertically in the center of an air oven maintained at  $80 \pm 3^\circ\text{C}$  ( $176 \pm 5^\circ\text{F}$ ) with the cross machine direction vertical. The internal dimensions of the oven shall be not less than 305 by 305 by 305 mm (12 by 12 by 12 in.). The oven shall be electrically heated with forced draft. Insert a thermometer in the center of the oven to such a depth that its bulb is in line with the center of the specimens. Maintain the specimens at the prescribed temperature for  $2 \text{ h} \pm 5 \text{ min}$ , then cool in a desiccator and weigh each specimen. Calculate the average loss of volatile matter as percentage of the final specimen mass. Record any change in appearance of the specimen such as blistering, absorption of the asphalt coatings, or sliding of coating or granular surfacing. Record the extent of the latter to the nearest 1.6 mm ( $\frac{1}{16}$  in.).

## METHODS OF ANALYSIS

### 12. Preparation and Selection of Small Specimens for Analyses

12.1 *Materials of Uniform Composition*—Each of the 5 large specimens selected in Section 8 is to have small specimens cut for composition analysis. Cut 50 by  $100 \pm 1$ -mm ( $2 \text{ by } 4 \pm \frac{1}{32}$ -in.) small specimens from each of the large specimens. Compare the equivalent mass per unit area of the small specimens to the mass per unit area previously generated for the large specimens (Section 8). For products that contain organic felt, 4 small specimens must be cut from each large specimen that are within 1.5 % of the equivalent mass per unit area of the large specimen. For products that contain only glass felt, 3 small specimens must be cut from each of the corresponding large specimens that are within 1.5 % of the equivalent mass per unit area of the large specimen. The small specimens from each large specimen are to be kept together as a unit, separate from the small specimens cut from the other large specimens. The “top” of each product is the surface that is applied toward the weather.

12.2 *Materials of Nonuniform Composition*—Cut 50 by  $100 \pm 1$ -mm ( $2 \text{ by } 4 \pm \frac{1}{32}$ -in.) small test specimens that are representative of the different materials, types of surfacing or

thickness present in the five large specimens from Section 8. By proportion, select small specimens that are within 1.5 % of the equivalent mass per unit area of each of the large specimens. In the case of laminated shingles, determine the weight per unit area and the relative area proportion for each ply configuration (proportion of each configuration for products which have additional combinations of single, double, triple, and so forth, layers). This relative proportion is to be determined from the average surface area measured on 4 consecutive shingles from one of the representative samples, measuring only the portion of the shingle that is exposed to the weather when applied in conformance with the manufacturer’s application instructions. The small specimens are to be cut so they represent the same proportion of each layer configuration as the entire exposed area of that large specimen. The balance of this analytical method assumes that a roofing product of uniform composition is being tested. Use the same procedures for the small specimen representative samples of the nonuniform products. At least five sets of four small representative specimens are required for each composition of products containing organic or asbestos felts; five sets of three small specimens are required for each composition containing glass felts.

NOTE 2—As an example, if a laminated shingle has some areas that are single thick and some that are double thick, determine what the relative percentages of single thickness and double thickness are for the exposed area of the shingle. The small test specimens shall be cut to represent the same proportion.

**13. Analysis of Glass Felt Products**

13.1 *Total Net Mass*—Identify the specimen from each set of three small specimens cut in Section 12 that is the closest to representing the unit mass of the large specimen from which it was obtained. Record the mass of each specimen so selected, to the nearest 0.01 g, as *Total Net Mass*. The top section of Fig.

3 shows the selection process for the five representative specimens for a fiberglass based product (note the weights for three small specimens).

13.2 *Total Asphalt*:

13.2.1 Wrap each of the small specimens identified in 13.1 in two layers of predried filter paper (Note 3), and secure each wrapped small specimen with a soft copper wire. Mark and record the mass of each wrapped specimen, to the nearest 0.01 g, as “Total Mass + Tare.”

NOTE 3—Predry hardened Whatman No. 50, 185-mm (7.3-in.) diameter filter paper for 60 min ± 10 % in a 80°C (176°F) oven. Store paper in desiccator until needed.

13.2.2 Extract the asphalt from each specimen from 13.2.1 in a soxhlet or similar extractor with 1,1,1 trichloroethane (Note 4) until the extract is clear. This can require up to 30 extraction hours. Dry the extracted specimens in a hood at room temperature. Final dry each specimen in a 105°C (221°F) ± 5 % forced draft oven for 60 min ± 10 %. Cool the specimens in a desiccator to room temperature and record the mass of each, to the nearest 0.01 g, as “Extraction Residue + Tare.”

NOTE 4—1,1,1 trichloroethane is recommended because it is less toxic than alternate solvents and does not burn. Any suitable solvent can be used.

13.2.3 Record the difference in the mass measured in 13.2.1 and the mass measured in 13.2.2 as the “Total Asphalt.”

13.3 *Mineral Matter in the Extraction Residue*:

13.3.1 One at a time, open each package from 13.2.2 over a nest of No. 6 (3.25 mm), No. 70 (212 µm) sieves and a pan. Retain the glass felt after removing, and putting in the sieve nest, as much of the fine mineral matter that is in or on the glass felt. Dust all mineral matter off the filter papers into the sieve nest and discard the cleaned papers and the wire.

13.3.2 Tap and shake the sieve nest until no change is noted

**Selection of Representative Specimens (Section 12)**

Small Specimen: Sample	1	2	3	Large Specimen Mass From Section 8
A grams,	22.64	22.59	22.70	22.65
percent of mean	100.0	99.7	100.2	...
B grams,	22.84	22.68	22.73	22.74
percent of mean	100.4	99.7	100.0	...
C grams,	22.67	22.63	22.60	22.64
percent of mean	100.1	100.0	99.8	...
D grams,	22.36	22.31	22.47	22.36
percent of mean	100.0	99.8	100.5	...
E grams,	22.78	22.89	23.01	22.87
percent of mean	99.6	100.1	100.6	...

Note that these are examples of typical data

**Analysis (Section 13)**

Selected Small Specimen	A1	B3	C2	D1	E2
Total net mass (13.1)	22.64	22.73	22.63	22.36	22.89
Total mass + tare (13.2.1)	24.65	25.61	25.00	25.08	24.86
Extract, residue and tare (13.2.2)	20.61	21.37	20.98	20.94	20.60
Total asphalt (13.2.3)	4.04	4.24	4.02	4.14	4.26
Coarse mineral matter (13.3.2)	9.89	9.99	10.16	9.74	10.06
Fine mineral matter (13.3.2)	7.29	7.90	7.38	7.71	7.06
Percent FMM in FMM + total asphalt	64.3	65.1	64.7	65.1	62.4
Glass felt (13.4.2)	0.44	0.47	0.46	0.51	0.49

**FIG. 3 Analysis of Roofing Products that Contain Glass Felts Work Sheet**

in the contents of each sieve. Record the mass of the material retained on the No. 70 (212 μm) sieve, to the nearest 0.01 g, as the “Coarse Mineral Matter.” Record the mass of the material in the pan of the nest, to the nearest 0.01 g, as the “Unadjusted Fine Mineral Matter.”

13.4 *Felt in Glass Felt Products:*

13.4.1 Determine the unadjusted mass of the glass felt from 13.3.1 to the nearest 0.01 g.

13.4.2 Clean the felt from 13.4.1 in an ultrasonic cleaning bath (Note 5), dry the cleaned felt in a forced draft 105°C (221°F) oven for 60 min ± 10 %, and determine its mass to the nearest 0.01 g.

13.4.3 Add the difference between the masses determined in 13.4.1 and 13.4.2 to the mass of the fine mineral matter in 13.3.2.

NOTE 5—Steps 13.4.2 and 13.4.3 may be omitted if ultrasonic cleaning equipment is unavailable or was not used.

14. Analysis of Roofing Products with Organic or Asbestos Felts

14.1 *Total Net Mass*—Identify the specimen from each set of four small specimens cut in Section 12 that is the closest to representing the unit mass of the large specimen from which it was obtained. Record the mass of each specimen, to the nearest 0.01 g, as *Total Net Mass*. The top section of Fig. 5 shows the selection process for the five representative specimens for an organic based product (note the weights for four small specimens).

14.2 *Total Asphalt:*

14.2.1 Wrap each of the small specimens identified in 14.1 in two layers of predried filter paper, and secure each wrapped small specimen with a soft copper wire. Mark and record the mass of each wrapped specimen, to the nearest 0.01 g, as “Total Mass + Tare.”

14.2.2 Extract the asphalt from each specimen from 14.2.1 in a soxhlet or similar extractor with 1,1,1 trichloroethane until the extract is clear. This can require up to 30 extraction hours. Dry the extracted specimens in a hood at room temperature. Final dry each specimen in a 105°C (221°F) ± 5 % forced draft oven for 60 min ± 10 %. Cool the specimens in a desiccator to room temperature and record the mass of each, to the nearest 0.01 g, as “Extraction Residue + Tare.”

14.2.3 Record the difference in the mass measured in 14.2.1 and the mass measured in 14.2.2 as the “Total Asphalt.”

14.3 *Mineral Matter in the Extraction Residue:*

14.3.1 One at a time, open and test each package from 14.2.2 over a nest of No. 6 (3.25 mm), No. 70 (212 μm) sieves and a pan. Dust off into the sieve nest the fine mineral matter that is on the felt. Save the felt recovered for the dry felt determination in 14.4 and the ash of the desaturated felt in Section 15. Dust all mineral matter off the filter papers into the sieve nest and discard the cleaned papers and the wire.

14.3.2 Tap and shake the sieve nest until no change is noted in the controls of each sieve. Record the mass of the material retained on the No. 70 (212 μm) sieve, to the nearest 0.01 g, as the “Total Coarse Mineral Matter.” Record the mass of the material in the pan of the nest, to the nearest 0.01 g, as the “Total Unadjusted Fine Mineral Matter.”

14.4 *Unadjusted Total Dry Felt Mass*—Dry each felt from 14.3.1 in a 105°C (221°F) ± 5 % forced draft oven for 60 min ± 10 %, cool in a desiccator and record the mass as the “Unadjusted Dry Felt.” Save the felt for work in Section 15.

14.5 *Top Coating Analysis:*

14.5.1 *Total Top Mass*—Identify the small specimen of the four cut in Section 12 that is the second closest to representing the unit mass of the large specimen from which it was obtained. (The first was used in 14.1.) Warm the small specimen for not more than 5 min at a temperature of not more than 65°C (150°F), and with a sharp knife or spatula, pull off the back coating and part of the saturated felt in the horizontal plane indicated by the arrow b in Fig. 1.

14.5.2 Repeat all the steps in 14.2 through 14.4 to record the “Total Top Mass,” “Total Top Asphalt,” “Top Coarse Mineral Matter,” “Top Unadjusted Fine Mineral Matter,” and “Unadjusted Top Felt.”

14.6 *Percent Saturation:*

14.6.1 Warm the last two of the small specimens of each small specimen set from Section 12 for not more than 5 min at a temperature of not more than 65°C (150°F), and with a sharp knife or spatula separate them into three horizontal sections at approximately the planes indicated by the arrows a and b in Fig. 1. Remove both the top and back coatings, with the attached surfacing, and a thin layer of felt, so that a thin layer of asphalt saturated felt core is obtained free of other materials. Discard the top and back coating sections.

14.6.2 Wrap each specimen in one layer of predried filter paper secured with a copper wire. Record the mass of the wrapped felt, to the nearest 0.01 g, as “Saturated Felt + Tare.”

Physical Tests	Mean	Standard Deviation	95 % Confidence Limits			
			Samples		Mean	
Behavior on heating (Section 11)						
Mass loss, %	0.12	0.02	0.07	0.17	0.10	0.14
Appearance change	none					
Composition, Pounds per 100 ft <sup>2</sup>						
Glass felt	1.84	0.096	1.59	2.09	1.72	1.96
Total asphalt	16.43	0.392	15.42	17.44	15.94	16.92
Coarse mineral matter	39.56	0.572	38.09	41.03	38.85	40.27
Fine mineral matter	29.64	1.192	26.57	32.70	28.16	31.11
Fine mineral matter as a percent based on the total asphalt and fine minerals	64.3	1.01	61.7	66.9	63.1	65.6
Moisture, percentage of dry mass	0.0	0.0	0.0	0.0	0.0	0.0

FIG. 4 Report Glass Felt Roofing Shingles

Selection of Representative Specimens (Section 12)

Small Specimen	1	2	3	4	Large Specimen Mass From Section 8
A grams,	26.05	25.29	25.88	25.55	25.69
percent of mean	101.44	98.4	100.73	99.5	...
B grams,	26.56	26.45	24.94	24.36	25.58
percent of mean	103.83	103.4	97.5	95.2	...
C grams,	23.56	23.64	23.54	24.36	23.78
percent of mean	99.1	99.4	99.0	102.4	...
D grams,	26.00	23.45	22.98	26.17	24.65
percent of mean	105.47	95.1	93.2	106.2	...
E grams,	24.94	26.03	26.05	25.55	25.64
percent of mean	97.3	101.5	101.59	99.6	...

Analysis Unadjusted Total Specimen (14.2)

Selected Small Specimen, Grams/5000 mm <sup>2</sup>	A4	B3	C2	D2	E4
Total net mass + tare (14.2.1)	28.55	27.94	26.64	26.45	28.55
Extract, residue + tare (14.2.2)	20.70	20.21	19.49	18.47	20.62
Total asphalt (14.2.3)	7.85	7.73	7.15	7.98	7.93
Coarse mineral matter (14.3.2)	8.71	8.25	8.01	6.93	8.34
Unadjusted fine mineral matter	6.32	6.17	5.94	5.77	6.56
Unadjusted dry felt (14.4.1)	2.67	2.79	2.54	2.77	2.72

Analysis Unadjusted Top Coating (14.5)

Selected Small Specimen With Back Coating and Attached Felt Removed, grams/5000 mm <sup>2</sup>	A	B	C	D	E
Top mass + tare	18.51	18.54	17.99	18.47	19.1
Extract, residue + tare	12.99	13.52	13.27	13.37	14.01
Top specimen asphalt	5.52	5.02	4.72	5.10	5.09
Coarse mineral matter	5.66	6.16	6.20	5.93	6.55
Unadjusted fine mineral matter	2.30	2.61	2.38	2.65	2.76
Unadjusted top dry felt	2.03	1.75	1.69	1.78	1.70

Percent Saturation (14.6)

Selected Small Specimen With Front and Back Coating Re- moved, grams/5000 mm <sup>2</sup>	A	B	C	D	E
Saturated felt + tare	7.07	7.94	8.42	9.6	10.57
Felt + tare	4.72	4.70	4.86	5.07	5.81
Dry Felt	1.72	1.70	1.86	2.07	2.81
Percent Saturation	136.62	190.5	191.39	218.8	169.39
Saturated felt + tare	8.04	8.08	7.35	8.89	10.09
Felt + tare	4.68	4.84	4.45	5.58	5.63
Dry felt	1.68	1.84	1.45	2.58	2.63
Percent saturation	200.0	176.1	200.0	128.3	169.5
Mean percent saturation	168.31	183.3	195.69	173.5	169.48

Percent Ash in the Extracted Felt (Section 15)

Specimen	A	B	C	D	E
Total Specimen	13.35	11.04	13.41	11.41	10.37
Top specimen	9.37	11.43	10.72	21.08	11.86
Percent saturations	6.63	5.15	5.21	8.66	8.11
Correction Factors					
Total specimen	6.72	6.88	8.2	2.75	2.75
Top specimen	2.74	6.28	5.51	12.42	3.85

FIG. 5 Analysis of Organic Felt Shingle Products Worksheet

14.6.3 Extract each specimen from 14.6.2 in a soxhlet extractor with 1,1,1 trichloroethane until the extract is clear. Dry each package in a hood to remove most of the solvent, finish the drying in a forced draft vented oven at 105°C (221°F) ± 5 % for 60 min ± 10 %, cool in a desiccator and record the mass, to the nearest 0.01 g, as “Desaturated Felt + Tare.”

14.6.4 Carefully unwrap the felt pieces from 14.6.2, redry, cool in a desiccator and record the mass, to the nearest 0.01 g,

as the “Desaturated Felt.” Save the felts for the work in Section 15.

15. Ash of Desaturated Felt

15.1 Ash the desaturated felts obtained in 14.4, 14.5.2, and 14.6.4 separately in predried tared crucibles, either over an open flame or in a muffle furnace, until all carbon has been consumed. After cooling, add to each ash approximately five

times its mass of saturated ammonium carbonate solution, let digest for 60 min ± 10 % at room temperature in a covered beaker or crucible, dry in an oven at 105 to 110°C (221 to 230°F) to constant mass, and record the net mass as “ash.”

15.2 The percentage of ash in the center portion (from 14.6.4) is assumed to be the true percentage of ash of the felt. The difference between this ash and the percentage of ash of the felts recovered in 14.4 and 14.5.2 is presumed to be included mineral matter from the coating. This percentage difference is converted to mass and added to the mass of fine mineral matter to obtain the “Total Dry Felt” and “Top Dry Felt.” The corresponding correction is made to the mass of extracted felt from extraction of total and the top coating analyses.

**16. Calculation**

16.1 Use the adjusted mass of the dry felt from each total sample to calculate the mass of the dry felt in g/m<sup>2</sup> (lb/100 ft<sup>2</sup>) (Note 6).

NOTE 6—Multiply the mass in grams by 3.97 to obtain the mass in lb/100 ft<sup>2</sup> for a 2 by 4-in. sample. Use 200 as the factor to obtain g/m<sup>2</sup>.

16.2 Calculate the percent saturation in each small sample as 100 times the difference between the masses in 14.6.2 and 14.6.3 divided by the mass in 14.6.4. Use the mean of at least two determinations in all further calculations.

16.3 Calculate the mass of the saturant by multiplying the dry felt mass in 16.1 by the mean percent saturation from 15.2 divided by 100.

16.4 Calculate the mass of the saturant in the top coating analysis by multiplying the adjusted mass of the top dry felt by the mean percent saturation divided by 100. Convert the mass calculated to the mass in g/m<sup>2</sup> (lb/100 ft<sup>2</sup>).

16.5 Calculate the mass of asphalt in each total sample by converting the mass in 14.2.3 to g/m<sup>2</sup> (lb/100 ft<sup>2</sup>).

16.6 Calculate the mass of asphalt in each top sample by converting the mass in 14.5.2 to g/m<sup>2</sup> (lb/100 ft<sup>2</sup>).

16.7 Deduct the saturant mass in 16.3 from the asphalt mass in the total sample in 15.5 to obtain the total unfilled asphalt coating.

16.8 Deduct each saturant mass in 16.4 from each top asphalt mass in 16.6 to obtain each total unfilled top coating.

16.9 Deduct each top coating mass in 16.8 from each total unfilled coating mass in 16.7 to obtain each back unfilled coating mass.

16.10 Convert each mass of the total coarse mineral matter and the total unadjusted fine mineral matter from 14.3.2 to g/m<sup>2</sup>(lb/100 ft<sup>2</sup>).

16.11 Convert each mass of the top coarse mineral matter and the top unadjusted fine mineral matter from 14.5.2 to g/m<sup>2</sup> (lb/100 ft<sup>2</sup>).

16.12 Deduct each mass of the top coarse mineral matter in 16.11 from the total coarse mineral matter in 16.10 to obtain the unadjusted mass of the bottom surfacing.

16.13 Deduct each mass of the top unadjusted fine mineral matter in 16.11 from each total unadjusted fine mineral matter in 16.10 to obtain the unadjusted mass of the fine mineral matter in the back coating.

**17. Adjusting Back Coating Fine Mineral Matter and Back Surfacing**

17.1 Fine mineral matter from the back surfacing frequently includes fine mineral matter from the back coating. To adjust both the back coating fine mineral matter and the back surfacing, assume that the percent of the fine mineral matter, based on the combined masses of the top asphalt coating and the top fine mineral matter, is a constant. Adjust the fine mineral matter in the back coating by reducing it to the same percentage of fine mineral matter as found in the top filled coating. Add the excess fine mineral matter to the “Total Coarse Mineral Matter” less the “Top Coarse Mineral Matter” to obtain the “Back Surfacing” (Note 7).

NOTE 7—The accuracy of this procedure depends on the screen grading of the back surfacing used on the product and a negative quantity of back surfacing is sometimes determined with this test method due to normal mass variations between specimens.

**18. Report**

18.1 Report the data on a form similar to Figs. 3 and 4 for Type 1 products and Figs. 5 and 6 for Types 2 and 3 products or in any manner convenient to the user. Report all percentages to the nearest 0.1 %. Report all mass per unit area data to the nearest 0.5 g/m<sup>2</sup> (0.01 lb/100 ft<sup>2</sup>).

18.2 Figs. 3-6 show the sources of the data and some of the steps in the calculations from the raw data.

**19. Precision and Bias**

19.1 *Precision*—Interlaboratory round robin tests show that the variation within a product can be greater than the variation between laboratories. Data from two laboratories can be compared statistically using the following procedure:

19.1.1 Calculate the mean variance of each set of data using:

$$V = \frac{s^2}{n} \tag{4}$$

where:

*V* = mean variance,

*s* = estimated standard deviation, and

*n* = number of samples.

19.1.2 Calculate the “effective number of degrees of freedom” using:

$$f = \frac{(V_A + V_B)^2}{\frac{(V_A)^2}{n_A + 1} + \frac{(V_B)^2}{n_B + 1}} - 2 \tag{5}$$

where:

*f* = effective number of degrees of freedom,

*V<sub>A</sub>* and *V<sub>B</sub>* = mean variance of each data set as calculated in 18.1.1, and

*n<sub>A</sub>* and *n<sub>B</sub>* = number of samples in each set.

19.1.3 Look up the value for *t* in Table 1, the student’s *t*-distribution for the effective number of degrees of freedom at a significance level of 0.05.

19.1.4 Compute the maximum probable difference between the averages of each set using:

$$u = '0.975 \times (V_A + V_B)^{0.5} \tag{6}$$

19.1.5 There is no significant difference between the data

**Small Specimen**

Pounds per 100 Square Feet	A	B	C	D	E
Dry felt	9.88	10.42	9.25	10.69	10.55
Saturant	16.64	19.10	18.11	18.55	17.88
Top surfacing	22.46	24.44	24.60	23.53	25.98
Top coating	18.07	18.78	16.14	20.84	20.42
Top coating asphalt	8.72	7.99	6.33	9.44	9.21
Top coating filler	9.35	10.78	9.81	11.40	11.21
Back coating	12.02	8.43	10.04	8.11	9.72
Back coating asphalt	5.80	3.58	3.94	3.67	4.38
Back coating filler	6.22	4.84	6.10	4.43	5.34
Back surfacing	22.33	17.80	15.66	11.34	16.83
Total Net mass	101.39	98.97	93.81	93.06	101.38

**Average Total Analysis**

Pounds per 100 Square Feet	Mean	Sample Range, $p = 0.05$		Range of Means, $p = 0.05$	
		min	max	min	max
Dry felt	10.16	8.80	11.52	9.50	10.82
Saturant	18.06	15.94	20.18	17.03	19.08
Top surfacing	24.21	21.18	27.23	22.75	25.67
Top coating	18.85	14.49	23.21	16.75	20.95
Top coating asphalt	8.34	5.46	11.22	6.95	9.73
Top coating filler	10.51	8.46	12.57	9.52	11.51
Back coating	9.66	6.08	13.23	7.94	11.38
Back coating asphalt	4.27	2.19	6.36	3.27	5.28
Back coating filler	5.39	3.60	7.17	4.52	6.25
Back surfacing	16.79	7.68	25.90	12.39	21.18
Total Net Weight	97.723	88.42	107.03	93.23	102.22

FIG. 6 Total Analysis (With All Adjustments)

TABLE 1 Student's *t*-Distribution, 0.05 Significance Level

<i>f</i>	<i>t</i> <sub>0.975</sub>	<i>f</i>	<i>t</i> <sub>0.975</sub>	<i>f</i>	<i>t</i> <sub>0.975</sub>
6	2.447	11	2.201	16	2.120
7	2.365	12	2.179	17	2.110
8	2.306	13	2.160	18	2.101
9	2.262	14	2.145	19	2.093
10	2.228	15	2.131	20	2.086

sets if the difference between the averages of each set is less than *u*.

19.1.6 In case of dispute, if the difference between the data averages is significant, retesting by both laboratories, or testing by an independent referee laboratory, is recommended.

19.2 *Bias*—There is no known bias in this test method.

**20. Keywords**

20.1 analysis; asphalt; cap sheets; composition; physical testing; roll roofing; sampling; shingles

*The American Society for Testing and Materials takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.*

*This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.*

*This standard is copyrighted by ASTM, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org).*