



Designation: C 1321 – 98

# Standard Practice for Installation and Use of Interior Radiation Control Coating Systems (IRCCS) in Building Construction<sup>1</sup>

This standard is issued under the fixed designation C 1321; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

## 1. Scope


1.1 This practice has been prepared for use by the designer, specifier, and applicator of IRCCS (Interior Radiation Control Coating Systems) for use in building construction. The scope is limited to recommendations related to the use and installation of IRCCS, including a surface(s) normally having a far-infrared emittance of 0.25 or less that is sprayed or painted.<sup>2</sup> Some examples that this practice is intended to address include: (1) low emittance surfaces in vented building envelope cavities intended to retard radiant transfer across the vented airspace; (2) low emittance surfaces at interior building surfaces intended to retard radiant transfer to or from building inhabitants; and (3) low emittance surfaces at interior building surfaces intended to reduce radiant transfer to or from heating or cooling systems. See Fig. 1 and Fig. 2 for typical applications.

1.2 This practice covers the installation process from pre-installation inspection through post-installation. It does not cover the production of the Interior Radiation Control Coating Materials.

1.3 This practice is not intended to replace the manufacturer's installation instructions, but it shall be used in conjunction with such instructions. This practice is not intended to supersede local, state, or federal codes.

1.4 This practice assumes that the installer possesses a good working knowledge of the application codes and regulations, safety practices, tools, equipment, and methods necessary for the installation of Interior Coating Materials. It also assumes that the installer understands the fundamentals of building construction that affect the installation of an IRCCS.

1.5 When the installation or use of Interior Radiation Control Coating Materials, accessories, and systems may pose safety or health problems, the manufacturer shall provide the user appropriate current information regarding any known problems associated with the recommended use of the compa-

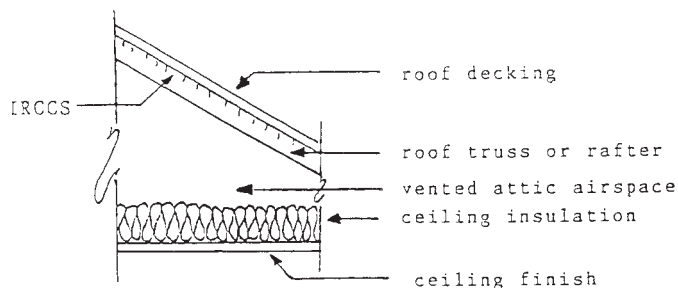


NOTE 1—Apply IRCCS to cover the exposed roof deck area. The low-emittance surface of the IRCCS must face the interior of the attic.

FIG. 1 Typical Residential Use

ny's products and shall also recommend protective measures to be employed in their safe utilization. The user shall establish appropriate safety and health practices and determine the applicability of regulatory requirements prior to use.

1.6 This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use. Specific precautionary statements are contained in Sections 5 and 7.

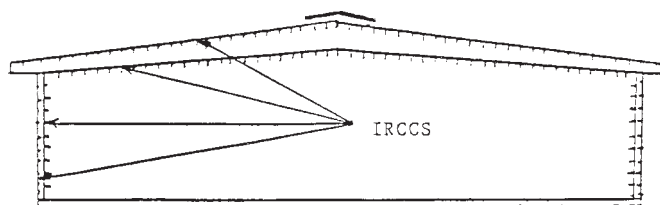

NOTE 1—Apply the IRCCS to cover the entire interior surface area. The low-emittance surface of the IRCCS must face the interior of the bldg.

FIG. 2 Typical Industrial, Commercial, and Agricultural Use

## 2. Referenced Documents

### 2.1 ASTM Standards:

C 168 Terminology Relating to Thermal Insulating Materials<sup>3</sup>

<sup>1</sup> This practice is under the jurisdiction of ASTM Committee C-16 on Thermal Insulation and is the direct responsibility of Subcommittee C16.21 on Reflective Insulation.

Current edition approved March 10, 1998. Published June 1998. Originally published as C 1321-96. Last previous edition C 1321-96.

<sup>2</sup> The as-manufactured emittance of Interior Radiation Control Coating product, as determined on a typical substrate, should be stated on the label (see 7.2.1).

<sup>3</sup> Annual Book of ASTM Standards, Vol 04.06.

C 1371 Test Method for Determination of Emittance of Materials Near Room Temperature Using Portable Emis-someter<sup>3</sup>

E 84 Test Method for Surface Burning Characteristics Building Materials<sup>4</sup>

E 96 Test Methods for Water Vapor Transmission of Mate-rials<sup>3</sup>

2.2 *NFPA Standards*:<sup>5</sup>

NFPA 54 National Fuel Gas Code

NFPA 211 Standard for Chimneys, Fireplaces and Vents

2.3 *Other Documents*:

CPSC Product Safety Fact Sheet No. 18 “The Home Elec-trical System”<sup>6</sup>

### 3. Terminology

3.1 *Definitions*—For definitions of terms used in this prac-tice, refer to Terminology C 168.

3.2 *Definitions of Terms Specific to This Standard*:

3.2.1 *applicator*—the person or persons who apply interior reflective coating materials in buildings.

3.2.2 *conditioned space*—any space in a building that is served by a heating or cooling system.

3.2.3 *Interior Radiation Control Coating Systems (IRCCS)*—a building construction consisting of a low emit-tance (normally 0.25 or less) surface bounded by an open air space. An IRCCS is used for the sole purpose of limiting heat transfer by radiation and is not specifically intended to reduce heat transfer by convection or conduction.

3.2.4 *open air space*—a vented building cavity (for ex-ample, a vented attic) or a large conditioned or unconditioned building space.

3.2.5 *Discussion*—A large building space is defined as one whose minimum dimension exceeds two feet.

3.2.6 *owner*—the person, partnership, corporation, agency, or other entity who owns the building in which the IRCCS is to be applied whether such ownership is by virtue of deed, contract, or any other instrument for acquiring legal title under the laws of the state in which the building is located.

### 4. Significance and Use

4.1 This practice recognizes that effectiveness, safety, and durability of an IRCCS depends not only on the quality of the materials, but also on the proper installation.

4.2 Improper installation of an IRCCS can reduce its ther-mal effectiveness, cause fire risks and other unsafe conditions, and promote deterioration of the structure in which it is installed. Specific hazards that can result from improper installation include: heat buildup in recessed lighting fixtures, deterioration of failure of electrical wiring components, and deterioration of wood structures and paint failure due to moisture accumulation.

4.3 This practice provides recommendations for the instal-lation of IRCCS materials in a safe and effective manner.

Actual conditions in existing buildings may vary greatly and in some cases additional care should be taken to ensure safe and effective installation.

4.4 This practice presents requirements that are general in nature and considered practical. They are not intended as specific recommendations. The user should consult the manu-facturer for recommended application methods.

### 5. Safety Precautions

5.1 The applicator shall wear proper clothing and equipment as recommended by the manufacturer and shall follow local codes and safety regulations for building construction sites. (For example, hard hats, safety goggles, and respiratory pro-tection may be required, depending on site conditions.)

5.2 Ventilation should be provided to insure that mist and overspray are immediately dispersed from the application area. If natural ventilation is not adequate, OSHA approved fans may be placed in windows or doors adjacent to the application area to improve ventilation.

5.3 Manufacturers’ instructions shall be consulted for all applicable handling and safety recommendations.

### 6. Pre-Installation Inspection and Preparation

6.1 *Inspections*:

6.1.1 Inspect the roof, walls, ceilings, and floors to identify areas where previous or existing moisture problems have caused paint peeling, warpage, stain, visible fungus growth, rotting, or other structural damage. Do not apply IRCCS in such areas until the owner has been informed and has certified these conditions have been corrected and their source(s) eliminated.

6.1.2 In areas where the IRCCS is to be applied, compo-nents of the electrical system shall be in good condition. If there is reason to believe the electrical system is faulty, do not apply the IRCCS in such areas until the owner has been informed and qualified inspection and repair have been per-formed.

NOTE 1—The CPSC Product Safety Fact Sheet No. 18 has identified the following signs of potential electrical deficiencies: lights dimming, fuses blowing, circuit breakers tripping frequently, electrical sparks and glowing from receptacles, light flickering, and cover plates on switches and outlets that are warm or hot to the touch. Useful safety information is also contained in the NFPA 54 and NFPA 211.

6.1.3 In areas where an IRCCS is to be applied, the applicator shall locate and plan the application around ven-tilation openings. The applicator shall not apply the IRCCS in a way that may plug or otherwise obstruct existing ventilation openings.

6.2 *Preparations*:

6.2.1 All electrical wiring at or near the IRCCS applica-tion surfaces shall be protected to ensure that the IRCCS material cannot contact the electrical wiring system.

6.2.2 Where attic ventilation may be compromised by the installation of an IRCCS or the subsequent application of fibrous insulation, vent baffles shall be installed at the soffits of the attic such that attic ventilation airflows are maintained in accordance with applicable building codes.

6.2.3 All materials shall be mixed for at least 2 min immediately before spraying. Manufacturer’s instructions shall

<sup>4</sup> *Annual Book of ASTM Standards*, Vol 04.07.

<sup>5</sup> Available from National Fire Protection Association, Batterymarch Park, Quincy, MA 02269.

<sup>6</sup> Available from U.S. Consumer Product Safety Commission, Washington, DC 20207.

be consulted for type of mixing equipment and mixing methods to be employed. If material is to be sprayed from a pressure pot, the pot shall be equipped with an air driven agitator.

## 7. Installation Guidelines

### 7.1 Material Handling:

7.1.1 The IRCCS materials shall be applied, handled, and stored in accordance with manufacturer's instructions.

7.1.2 The IRCCS materials shall not be applied in direct contact with corrosive building materials.

### 7.2 Performance Considerations:

7.2.1 The performance of the IRCCS depends on adherence to manufacturer's recommendations. Manufacturer's installation instructions and local building codes shall be followed. The manufacturer shall provide product sheet(s) that specify the product's intended use(s), application method(s), health and safety considerations, and material properties to include: (1) the IRCCS surface emittance determined in accordance with Test Method C 1371; (2) the applied material water vapor transmission rate, if applicable, in accordance with Test Methods E 96 and; (3) the applied material surface burning characteristics in accordance with Test Method E 84.

7.2.2 The performance of the IRCCS is dependent on the maintenance of an open airspace facing the low emittance surface.

7.2.3 The performance of the IRCCS may be adversely affected by foreign materials on the low emittance surface. After application, foreign materials shall be removed using manufacturer's instructions, taking care not to damage the IRCCS surface.

7.2.3.1 IRCCS may provide a high resistance to water vapor transmission. An IRCCS shall not be applied so as to lead to moisture accumulation and deterioration in the structure.

7.3 *Post-installation*—The applicator shall provide a signed and dated statement describing the IRCCS applicator, installed in accordance with Practice C 1321 and the area covered.

## 8. Keywords

8.1 low emittance; paint—high reflectance; paint—high temperature; paint—low emittance; paint—spray-applied; radiation; radiation control coating; radiation control coating—interior

*The American Society for Testing and Materials takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.*

*This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, 100 Barr Harbor Drive, West Conshohocken, PA 19428.*