



Designation: E- 1121 – 9302

An American National Standard

Standard Practice for Measuring Payback for Investments in Buildings and Building Systems¹

This standard is issued under the fixed designation E 1121; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 This practice provides a recommended procedure for calculating and applying the payback method in evaluating building designs and building systems.

2. Referenced Documents

2.1 *ASTM Standards:*

¹ This practice is under the jurisdiction of ASTM Committee E-6 E06 on Performance of Buildings and is the direct responsibility of Subcommittee E06.81 on Building Economics.

Current edition approved June 15, 1993; Oct. 10, 2002. Published August 1993; November 2002. Originally published as E 1121 – 86. Last previous edition E 1121 – 986.

E 833 Terminology of Building Economics²

E 917 Practice for Measuring Life-Cycle Costs of Buildings and Building Systems²

E 964 Practice for Measuring Benefit-to-Cost and Savings-to-Investment Ratios for Buildings and Building Systems²

E 1057 Practice for Measuring Internal Rate of Return and Adjusted Internal Rate of Return for Investments in Buildings and Building Systems²

E 1074 Practice for Measuring Net Benefits for Investments in Buildings and Building Systems²

E 1185 Guide for Selecting Economic Methods for Evaluating Investments in Buildings and Building Systems²

2.2 *ASTM Adjuncts*:—

~~*Discount Factor Tables*~~,² Adjunct to Practice E 917³—

~~*Computer Program and User's Guide to Building Maintenance, Repair, and Replacement Database for Life-Cycle Cost*~~

² *Annual Book of ASTM Standards*, Vol 04.11.

³ Available from ASTM Headquarters. Order ~~PCN 12-509170-10~~; ADJE091703.

*Analysis, Adjunct to Practices E 917, E 964, E 1057, and E 1121.*⁴

3. Terminology

3.1 *Definitions* Definitions—For definitions of terms used in this practice, refer to Terminology E 833.

4. Summary of Practice

4.1 This practice is organized as follows:

4.1.1 *Section 2, Referenced Documents*—Lists ASTM standards and adjuncts referenced in this practice.

4.1.2 *Section 3, Definitions*—Addresses definitions of terms used in this practice.

4.1.3 *Section 4, Summary of Practice*—Outlines the contents of the practice.

4.1.4 *Section 5, Significance and Use*—Explains the significance and use of this practice.

4.1.5 *Section 6, Procedures*—Describes step-by-step the procedures for making economic evaluations of buildings.

4.1.6 *Section 7, Objectives, Alternatives, and Constraints*—Identifies and gives examples of objectives, alternatives, and constraints for a payback evaluation.

4.1.7 *Section 8, Data and Assumptions*—Identifies data needed and assumptions that may be required in a payback evaluation.

4.1.8 *Section 9, Compute Payback Period*—Presents alternative approaches for finding the payback period.

4.1.9 *Section 10, Applications*—Explains the circumstances for which the payback method is appropriate.

4.1.10 *Section 11, Limitations*—Discusses the limitations of the payback method.

5. Significance and Use

5.1 The payback method is part of a family of economic evaluation methods that provide measures of economic performance of an investment. Included in this family of evaluation methods are life-cycle costing, benefit-to-cost and savings-to-investment ratios, net benefits, and internal rates of return.

5.2 The payback method accounts for all monetary values associated with an investment up to the time at which cumulative net benefits, discounted to present value, just pay off initial investment costs.

5.3 Use the method to find if a project recovers its investment cost and other accrued costs within its service life or within a specified maximum acceptable payback period (MAPP) less than its service life. It is important to note that the decision to use the payback method should be made with care. (See Section 11 on Limitations.)

6. Procedures

6.1 The recommended steps for making an economic evaluation of buildings or building components are summarized as follows:

6.1.1 Identify objectives, alternatives, and constraints,

6.1.2 Select an economic evaluation method,

6.1.3 Compile data and establish assumptions,

6.1.4 Convert cash flows to a common time basis, and

6.1.5 Compute the economic measure and compare alternatives.

6.2 Only the step in 6.1.5, as applied to measuring payback, is examined in detail in this practice. For elaboration on the steps in 6.1.1-6.1.4, consult Practices E 964 and E 917, and Guide E 1185.

7. Objectives, Alternatives, and Constraints

7.1 Specify the kind of building decision to be made. Make explicit the objectives of the decision maker. And identify the alternative approaches for reaching the objectives and any constraints to reaching the objectives.

7.2 An example of a building investment problem that might be evaluated with the payback method is the installation of storm windows. The objective is to see if the costs of the storm windows are recovered within the MAPP. The alternatives are (1) to do nothing to the existing windows or (2) to install storm windows. One constraint might be limited available funds for purchasing the storm windows. If the payback period computed from expected energy savings and window investment costs is equal to or less than the specified MAPP, the investment is considered acceptable using this method.

7.3 Whereas the payback method is appropriate for solving the problem cited in 7.2, for certain kinds of economic problems, such as determining the economically efficient level of insulation, Practices E 917 and E 1074 are the appropriate methods.

8. Data and Assumptions

8.1 Data needed to make payback calculations can be collected from published and unpublished sources, estimated, or ~~assumed~~. (See the adjunct entitled *Computer Program and User's Guide to Building Maintenance, Repair, and Replacement Database for Life-Cycle Cost Analysis*.) assumed.

8.2 Both engineering data (for example, heating loads, equipment service life, and equipment efficiencies) and economic data (for example, tax rates, depreciation rates and periods, system costs, energy costs, discount rate, project life, price escalation rates, and financing costs) will be needed.

8.3 The economic measure of a project's worth varies considerably depending on the data and assumptions. Use sensitivity analysis to test the outcome for a range of the less certain values in order to identify the critical parameters.

9. Compute Payback Period

9.1 The payback method finds the length of time (usually specified in years) between the date of the initial project investment and the date when the present value of cumulative future earnings or savings, net of cumulative future costs, just equals the initial investment. This is called the payback period. When a zero discount rate is used, this result is referred to as the “simple” payback (SPB). The payback period can be determined mathematically, from present-value tables, or graphically.

9.2 Mathematical Solution:

9.2.1 To determine the payback period, find the minimum solution value of PB in Eq 1.

$$\sum_{t=1}^{PB} [(B_t - \tilde{C}_t)/(1+i)^t] = C_0 \quad (1)$$

$$B_t - TC_t$$

where:

B_t = dollar value of benefits (including earnings, cost reductions or savings, and resale values, if any, and adjusted for any tax effects) in period t for the building or system being evaluated less the counterpart benefits in period t for the mutually exclusive alternative against which it is being compared.

\tilde{C}_t = dollar value of costs (excluding initial investment cost, but including operation, maintenance, and replacement costs, adjusted for any tax effects) in period t for the building or system being evaluated less the counterpart cost in period t for the mutually exclusive alternative against which it is being compared.

$B_t - \tilde{C}_t$ = net cash flows in year t ,

C_0 = initial project investment costs, as of the base time,

i = discount rate per time period t , and

$\frac{1}{(1+i)^t}$ = formula for determining the single present value factor,

NOTE 1— Eq 1 and all others that follow assume the convention of discounting from the end of the year. Cash flows are assumed to be spread evenly over the last year of payback so that partial year answers can be interpolated.

9.2.2 Uniform Net Cash Flows:

9.2.2.1 For the case where $(B_t - \tilde{C}_t)$ is the same from year to year, denoted by $(B - \tilde{C})$, the payback period (PB) corresponding to any discount rate (i) other than zero can be found using Eq 2.

$$PB = \frac{\log[1/(1 - (SPB \cdot i))]}{\log(1+i)} \quad (2)$$

$$PB = \frac{\log[1/(1 - (SPB \cdot i))]}{\log(1+i)} \quad (2)$$

where

$$SPB = C_0/(B - \tilde{C}) \quad (3)$$

$$SPB = C_0/(B - \tilde{C}) \quad (3)$$

When the discount rate is equal to zero,

$$PB = SPB \quad (4)$$

$$PB = SPB \quad (4)$$

However, PB is undefined when $(SPB \cdot i) \geq 1$; that is, the project will never pay for itself at that discount rate.

9.2.2.2 A calculation using Eq 2 is presented for the following investment problem. What would be the payback period for a project investment of \$12 000, earning uniform annual net cash flows of \$4500 for six years? A 10 % discount rate applies. First solve for the SPB: \$12 000/\$4500 = 2.6667. Eq 2 would yield the following:

$$PB = \frac{\log[1/(1 - (2.6667 \cdot 0.10))]}{\log 1.10} = (\log 1.3636/\log 1.1000) = (0.1347/0.0414) = 3.25$$

$$PB = \frac{\log[1/(1 - (2.6667 \cdot 0.10))]}{\log 1.10} = (\log 1.3636/\log 1.1000) = (0.1347/0.0414) = 3.25$$

9.2.2.3 Since the payback period (3.25 years) is less than the six years over which the project earns constant net benefit returns, and since a shorter MAPP has not been specified, the project is considered acceptable.

9.2.3 Unequal Net Cash Flows:

9.2.3.1 For problems with unequal annual net cash flows, a common approach to calculating the payback period is to accumulate the present value of net cash flows year-by-year until the sum just equals or exceeds the original investment costs. The number of years required for the two to become equal is the payback period.

9.2.3.2 This approach is illustrated in Table 1. A project with seven years of unequal cash flows (Column 2) is evaluated at a discount rate of 12 %. The net cash flow in each year is discounted at 12 % to present value (Column 3). Each year's addition to the present value is accumulated in Column 4. The present value of net benefits (PVNB) in Column 6 is derived by subtracting the investment costs (Column 5) from the cumulative, discounted, future net cash flows (Column 4). The present value of net cash flows equals investment costs at some point in the fifth year. The payback period can be interpolated as follows:

$$PB = 4 \text{ years} + \frac{0 - (-\$3011)}{\$4933 - (-\$3011)} = 4.38$$

$$PB = 4 \text{ years} + \frac{0 - (-\$3011)}{\$4933 - (-\$3011)} = 4.38$$

9.2.3.3 Since the payback period is less than the period over which the project earns positive net benefits (seven years), and since a shorter MAPP has not been specified, the project is considered acceptable.

9.2.4 *Net Cash Flows Escalating at a Constant Rate:*

9.2.4.1 To determine the payback period when net cash flows escalate at a constant rate, find the minimum solution of PB in Eq-7-5.

$$(B - C)^* \sum_{t=1}^{PB} [(1 + e)/(1 + i)]^t = C_o \tag{7}$$

$$(B - C)^* \sum_{t=1}^{PB} [(1 + e)/(1 + i)]^t = C_o \tag{5}$$

where:

$(B - C)^*$ = initial value of an annual, uniformly escalating, net cash flow, and

e = constant price escalation rate per period t applicable to net cash flows.

9.2.4.2 When e is not equal to i , the payback period can be calculated by using Eq-8-6.

$$PB = \frac{\log[1 + (SPB)(1 - (1 + i)/(1 + e))]}{\log[(1 + e)/(1 + i)]} \tag{6}$$

where $SPB = C_o / (B - C)^*$.

When e

When e is equal to i ,

$$PB = SPB \tag{7}$$

However, PB is undefined and the project will never pay for itself at discount rate i if

$$SPB(1 - (1 + i)/(1 + e)) \leq -1 \tag{8}$$

$$SPB(1 - (1 + i)/(1 + e)) \leq -1 \tag{8}$$

9.2.4.3 If the payback period is less than the period over which the project yields returns, the project is considered to be economically acceptable.

9.2.4.4 Eq-8-6 can be illustrated with the following problem. An energy conservation investment of \$40 000 yielding energy savings initially worth \$8000 annually is to be evaluated with an 8 % energy price escalation and a 12 % discount rate. Applying Eq-8-6 yields the following:

$$PB = \frac{\log[1 + (\$40\,000/\$8000)(1 - (1.12/1.08))]}{\log(1.08/1.12)}$$

TABLE 1 Payback Problem With Unequal Annual Cash Flows

| (1) | (2) | (3) | (4) | (5) | (6) = (4) - (5) |
|---------------------|-----------------------------------------|---------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------|---------------------------------------|--------------------------------------------------------------------------------------------|
| Years (t, s) | Net Cash Flows (\$) $(B_t - C_t)$ | Discounted Net Cash Flows ^A (\$) $\left[\frac{B_t - C_t}{(1 + i)^t} \right]$ | Cumulative Discounted Net Cash Flows (\$) $\sum_{t=1}^s \left[\frac{B_t - C_t}{(1 + i)^t} \right]$ | Investment Cost (\$) (C_o) | Cumulative PVNB (\$) $\sum_{t=1}^s \left[\frac{B_t - C_t}{(1 + i)^t} \right] - C_o$ |
| 0 | 0 | 0 | 0 | 50 000 | -50 000 |
| 1 | 10 000 | 8 929 | 8 929 | | -41 071 |
| 2 | 20 000 | 15 944 | 24 873 | | -25 127 |
| 3 | 15 000 | 10 677 | 35 550 | | -14 450 |
| 4 | 18 000 | 11 439 | 46 989 | | -3 011 |
| 5 | 14 000 | 7 944 | 54 933 | | +4 933 |
| 6 | 12 000 | 6 080 | 61 013 | | +11 013 |
| 7 | 8 000 | 3 619 | 64 632 | | +14 632 |

^A The discount rate = 12 %.

$$\begin{aligned}
 &= \frac{\log[1 + 5(-0.0370)]}{\log 0.9643} \\
 &= \frac{\log[1 + 5(-0.0370)]}{\log 0.9643} \\
 &= \frac{\log 0.8150}{\log 0.9643} \\
 &= 5.63 \text{ years}
 \end{aligned}$$

9.3 Estimating Payback Periods with Present-Value Tables:

9.3.1 Present-value tables, such as those found in *Discount Factor Tables*, Adjunct to Practice E 917, can be used in certain cases to estimate payback periods without a calculator.

9.3.2 Uniform Net Cash Flows:

9.3.2.1 The payback period for a project with uniform annual net cash flows $(B - C)$ can be estimated by first finding, in a table of Uniform Present Value (UPV) factors for the given discount rate, that UPV factor closest to the ratio of

$$\text{Initial Investment}/(B - C)^* \tag{9}$$

The appropriate payback period is the number of periods (n) corresponding to that UPV factor. Interpolation can be used to more closely approximate the payback period.

9.3.2.2 As an example, when the discount rate is 12 %, the payback period for an initial investment of \$100 which returns \$15 per year is found as follows: The ratio of \$100/\$15 = 6.67. This ratio corresponds to a time period (n) of approximately 14.2 years in a table of Uniform Present Value factors based on a 12 % discount rate.

9.3.3 Net Cash Flows Escalating at a Constant Rate:

9.3.3.1 The payback period for a project with annual net cash flows escalating at a constant rate can be estimated by first finding, in a table of Modified Uniform Present Value (UPWV*) factors for the given discount rate and escalation rates, that UPWV* factor closest to the ratio of:

$$\text{Initial Investment}/(B - C)^* \tag{10}$$

The appropriate payback period is the number of periods (n) corresponding to that UPWV* factor. Interpolation can be used to more closely approximate the payback period.

9.3.3.2 As an example, when the discount rate is 12 %, the payback period for an investment of \$100 that returns net cash flows initially valued at \$15 per year and increasing at 6 % per year is found as follows: The ratio of \$100/\$15 = 6.67. This ratio corresponds to a time period (n) of approximately 8.6 years in a table of Modified Uniform Present Value factors based on a 12 % discount rate and 6 % escalation.

9.4 Graphical Solutions:

9.4.1 The payback period for projects with uniform annual net cash flows or flows that increase at a constant rate can be found using graphs. The payback graphs described below present discounted payback as a function of SPB.

9.4.2 Uniform Net Cash Flows:

9.4.2.1 Fig. 1 plots payback periods up to ten years as a function of SPB values from zero to four years and discount rates from 1 to 25 %, in 2 % increments. Fig. 2 is similar to Fig. 1 except that payback periods are plotted for even values of the discount rate, 2 to 24 %. Figs. 3 and 4 are the same respectively as Figs. 1 and 2, except that SPB values range from 4 to 12 years and payback values range from 4 to 24 years. All of the curves are derived from Eq 2. The procedure for finding the discounted payback period is to solve first for SPB using Eq 3, and then to find the corresponding payback value on the curve for the given discount rate.

9.4.2.2 Taking the payback problem from 9.2.2.2, use the graphical approach to find the payback period for a \$12 000 investment earning uniform annual net cash flows of \$4500 for six years. Use 10 % discount rate. SPB is 2.7 (that is, \$12 000 ÷ \$4500). Therefore, use Fig. 2. Finding the value 2.7 on the horizontal SPB axis, draw a vertical line from that point to find its intersection with the payback curve for a discount rate of 10 %. Extending a line horizontally from that intersection to the vertical axis indicates a payback period of approximately 3.3 corresponding to the SPB value 2.7.

9.4.2.3 When the payback period is greater than the limit of the vertical axis, such as is the case for SPB = 9 and $i = 11 %$ in Fig. 3, then the payback period cannot be read from the graph and must be computed from Eq 2.

9.4.2.4 Any project for which $(SPB \cdot i) \geq 1$ will have an undefined payback. That is, the project never pays off. For example, in Fig. 3, a project evaluated with SPB = 4.8 and a discount rate of 21 % would never pay off, and consequently the payback curve is truncated before it reaches a payback value corresponding to an SPB of 4.8 on the horizontal axis.

9.4.3 Net Cash Flows Escalating At a Constant Rate:

9.4.3.1 Figs. 5-8 present a family of payback curves plotted as a function of their k values, where:

$$k = (1 + e)/(1 + i) \tag{11}$$

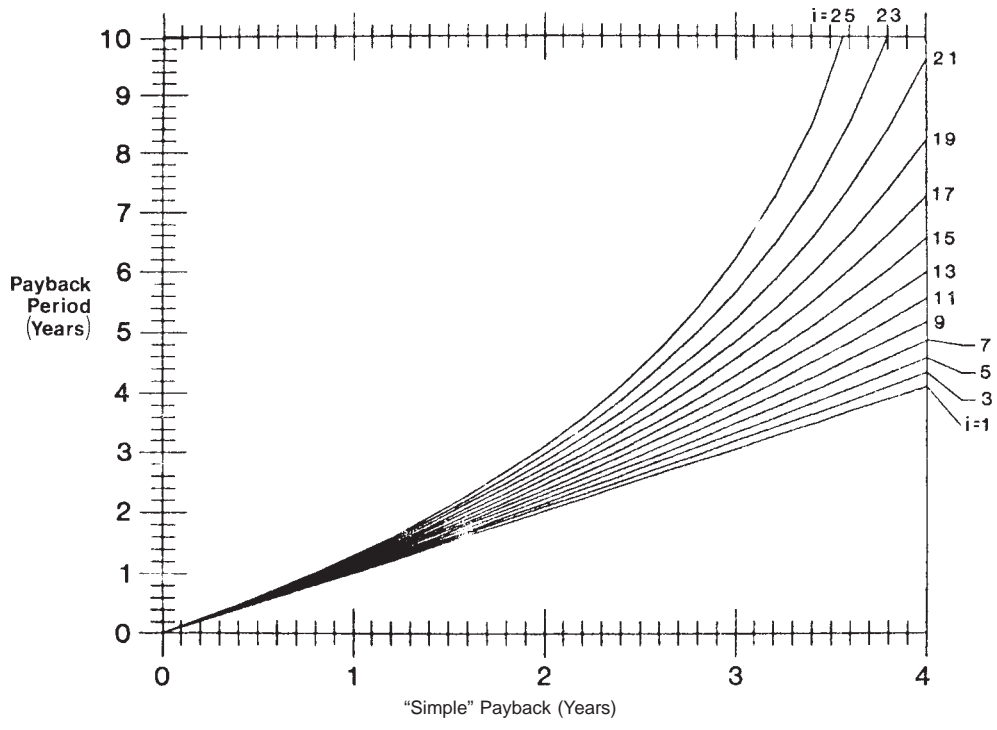


FIG. 1 Graphical-S

SOLUTION TO PAYBACK PERIOD: SPB = 0 TO 4 YEARS, $i = 1$ TO 25 % (odd)

FIG. 1 Graphical Solution to Payback Period: SPB = 0 to 4 Years, $i = 1$ to 25 % (odd)

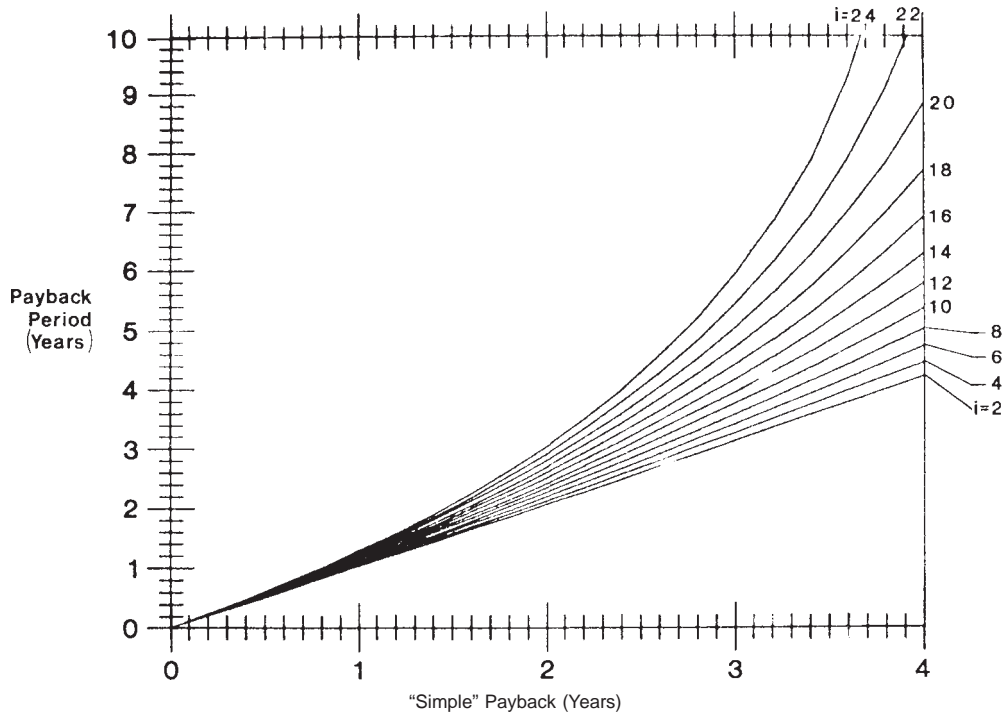


FIG. 2 Graphical-S

SOLUTION TO PAYBACK PERIOD: SPB = 0 TO 4 YEARS, $i = 2$ TO 24 % (even)

FIG. 2 Graphical Solution to Payback Period: SPB = 0 to 4 Years, $i = 2$ to 24 % (even)

$$k = (1 + e)/(1 + i) \tag{11}$$

Each curve is derived from Eq-8: 6. Figs. 5 and 6 present respectively payback periods corresponding to odd and even k values over the range $k = 0.77$ through 1.17, for SPB values up to four years. Figs. 7 and 8, respectively are the same as Figs. 5 and 6, except that SPB values range from four to twelve years, and k values have a lower bound of 0.81.

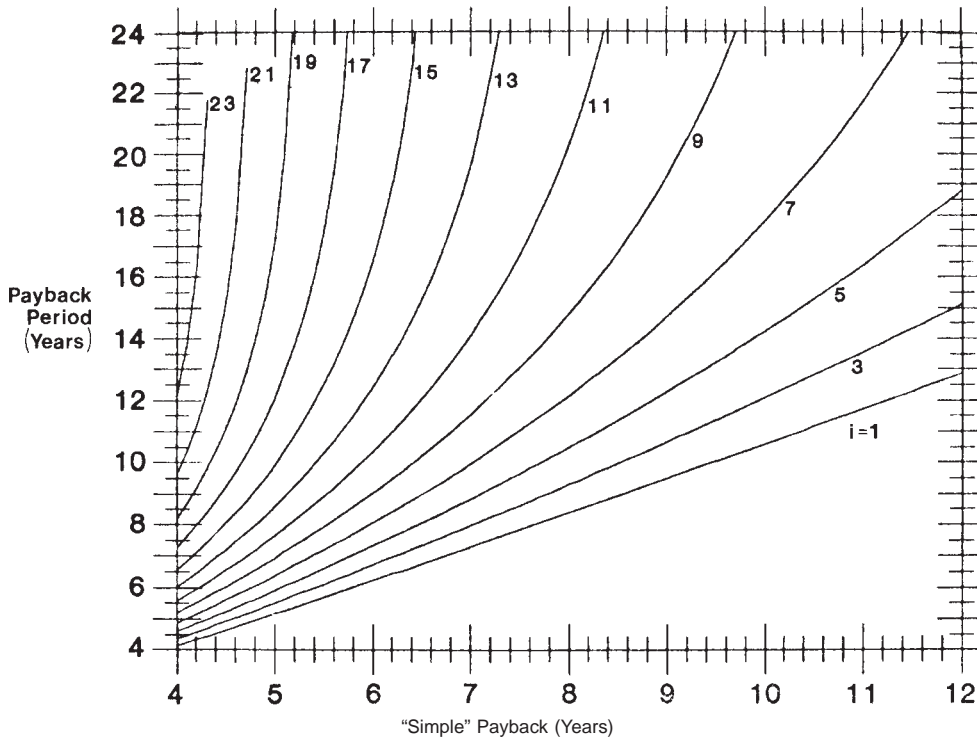


FIG. 3 Graphical-S

OLUTION TO PAYBACK PERIOD: SPB = 4 TO 12 YEARS, $i = 1$ TO 23 % (odd)
FIG. 3 Graphical Solution to Payback Period: SPB = 4 to 12 Years, $i = 1$ to 23 % (odd)

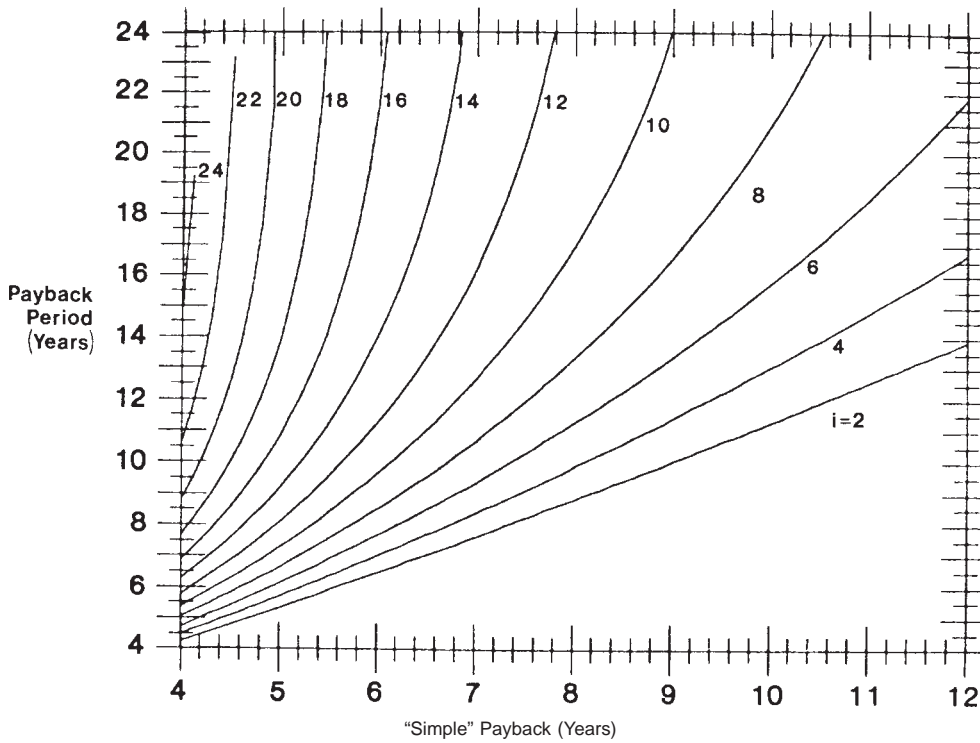


FIG. 4 Graphical-S

OLUTION TO PAYBACK PERIOD: SPB = 4 TO 12 YEARS, $i = 2$ TO 24 % (even)
FIG. 4 Graphical Solution to Payback Period: SPB = 4 to 12 Years, $i = 2$ to 24 % (even)

9.4.3.2 The major advantage of plotting payback periods for each value of k is that few graphs are required to describe many combinations of e and i . The use of Figs. 5 and Fig. 8 can be simplified by finding the value of k in Table 2, which provides

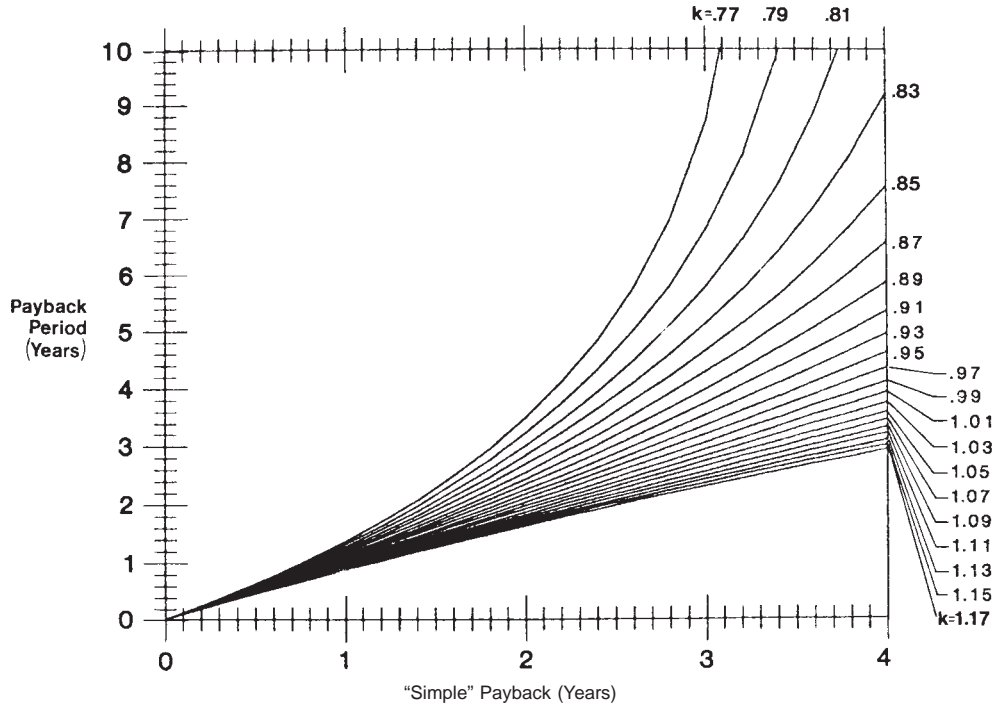


FIG-5 Graphical-S

SOLUTION TO PAYBACK PERIOD WITH ESCALATION: SPB = 0 TO 4 YEARS, $k = 0.77$ TO 1.17 (odd), $k = (1 + e)/(1 + i)$

i)

FIG. 5 Graphical Solution to Payback Period with Escalation: SPB = 0 to 4 Years, $k = 0.77$ to 1.17 (odd), $k = (1 + e)/(1 + i)$

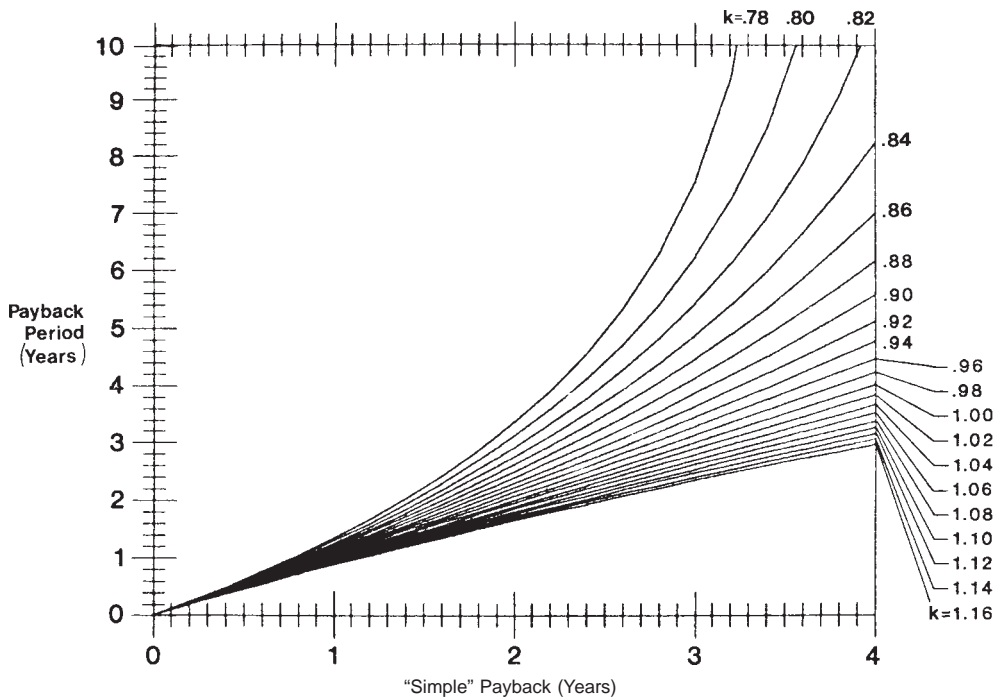


FIG-6 Graphical-S

SOLUTION TO PAYBACK PERIOD WITH ESCALATION: SPB = 0 TO 4 YEARS, $k = .78$ TO 1.16 (even), $k = (1 + e)/(1 + i)$

FIG. 6 Graphical Solution to Payback Period with Escalation: SPB = 0 to 4 Years, $k = .78$ to 1.16 (even), $k = (1 + e)/(1 + i)$

a matrix of k values for all likely combinations of e and i .

9.4.3.3 Taking again the problem example from 9.2.4.4, the graphical approach is used to find the payback period for a \$40 000 investment initially yielding annual energy savings of \$8000, with an energy price escalation rate of 8 % and a discount rate of 12 %. Since SPB is 5 (that is, $\$40\,000 \div \8000), it is known that the payback period will be found either in Fig. 7 or Fig. 8, which

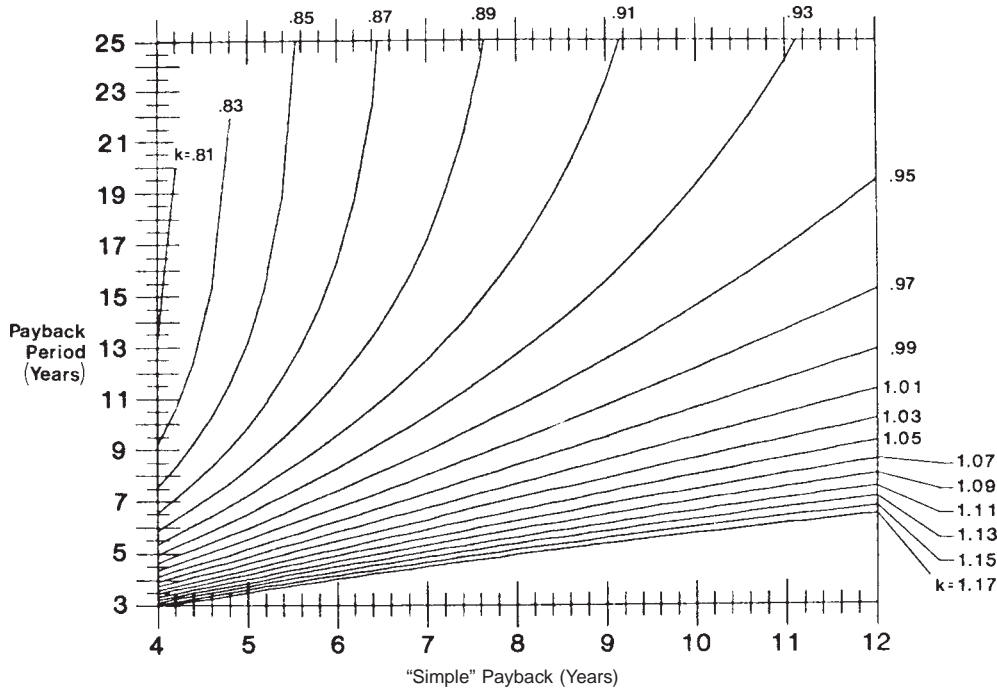


FIG. 7 Graphical-S

SOLUTION TO PAYBACK PERIOD WITH ESCALATION: SPB = 4 TO 12 YEARS, $k = .81$ TO 1.17 (odd), $k = (1 + e)/(1 + i)$

FIG. 7 Graphical Solution to Payback Period with Escalation: SPB = 4 to 12 Years, $k = .81$ to 1.17 (odd), $k = (1 + e)/(1 + i)$

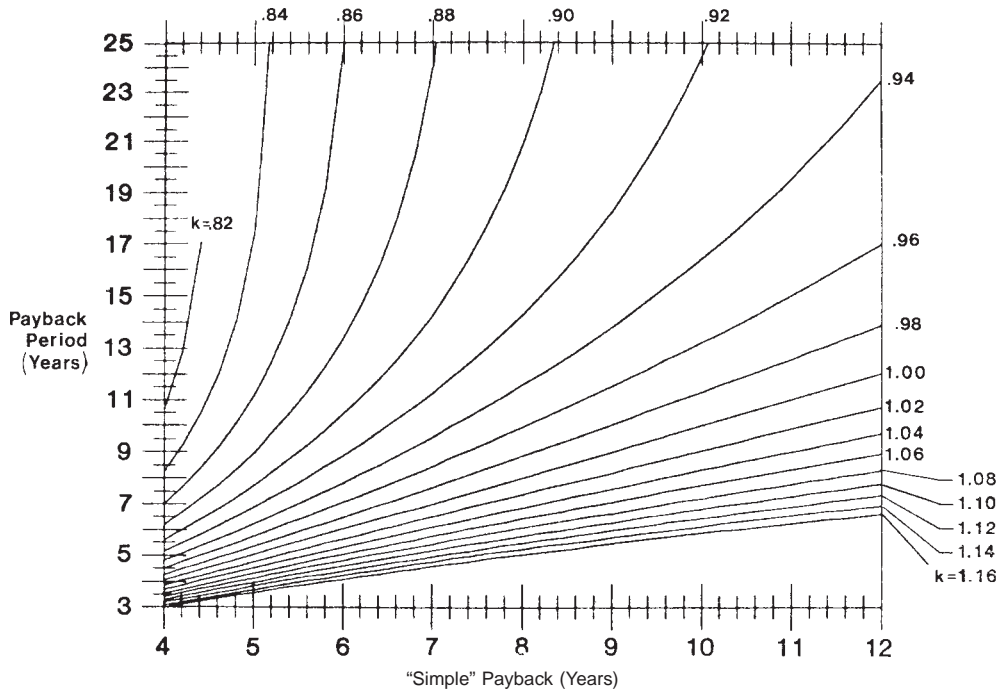


FIG. 8 Graphical Solution to Payback Period with Escalation: SPB = 4 to 12 Years, $k = .82$ to 1.16 (even), $k = (1 + e)/(1 + i)$

cover the SPB range of four to twelve years. By consulting the matrix of Table 2, we find a k value of 0.96 in the cell intersection for $e = 8$ and $i = 12$. Since the last digit of k is an even number, look to Fig. 8 (even) for the payback period corresponding to SPB = five years and $k = 0.96$. The answer is approximately 5.7.

9.4.3.4 The payback period = SPB whenever $k = 1$, since the escalation and discounting effects cancel each other.

9.4.3.5 When the payback period is greater than the limit of the vertical axis, such as would be the case for SPB = 8.4 and $k = 0.90$ in Fig. 8, then the payback period cannot be read from the graph and would have to be computed from Eq-8-6.

9.4.3.6 When the payback period is undefined, that is, when the term (SPB) $(1 - 1/k) \leq -1$, the project never pays off, so there will be no reading from the graph and there will be no solution to Eq-8-6.

TABLE 2 Matrix of k Values for Combinations of e and i^A

| $e \%$ $i \%$ | -4 | -3 | -2 | -1 | 0 | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 |
|------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| -2 | 0.98 | 0.99 | 1.00 | 1.01 | 1.02 | 1.03 | 1.04 | 1.05 | 1.06 | 1.07 | 1.08 | 1.09 | 1.10 | 1.11 | 1.12 | 1.13 | 1.14 | 1.15 | 1.16 | 1.17 |
| -1 | 0.97 | 0.98 | 0.99 | 1.00 | 1.01 | 1.02 | 1.03 | 1.04 | 1.05 | 1.06 | 1.07 | 1.08 | 1.09 | 1.10 | 1.11 | 1.12 | 1.13 | 1.14 | 1.15 | 1.16 |
| 0 | 0.96 | 0.97 | 0.98 | 0.99 | 1.00 | 1.01 | 1.02 | 1.03 | 1.04 | 1.05 | 1.06 | 1.07 | 1.08 | 1.09 | 1.10 | 1.11 | 1.12 | 1.13 | 1.14 | 1.15 |
| 1 | 0.95 | 0.96 | 0.97 | 0.98 | 0.99 | 1.00 | 1.01 | 1.02 | 1.03 | 1.04 | 1.05 | 1.06 | 1.07 | 1.08 | 1.09 | 1.10 | 1.11 | 1.12 | 1.13 | 1.14 |
| 2 | 0.94 | 0.95 | 0.96 | 0.97 | 0.98 | 0.99 | 1.00 | 1.01 | 1.02 | 1.03 | 1.04 | 1.05 | 1.06 | 1.07 | 1.08 | 1.09 | 1.10 | 1.11 | 1.12 | 1.13 |
| 3 | 0.93 | 0.94 | 0.95 | 0.96 | 0.97 | 0.98 | 0.99 | 1.00 | 1.01 | 1.02 | 1.03 | 1.04 | 1.05 | 1.06 | 1.07 | 1.08 | 1.09 | 1.10 | 1.11 | 1.12 |
| 4 | 0.92 | 0.93 | 0.94 | 0.95 | 0.96 | 0.97 | 0.98 | 0.99 | 1.00 | 1.01 | 1.02 | 1.03 | 1.04 | 1.05 | 1.06 | 1.07 | 1.08 | 1.09 | 1.10 | 1.11 |
| 5 | 0.91 | 0.92 | 0.93 | 0.94 | 0.95 | 0.96 | 0.97 | 0.98 | 0.99 | 1.00 | 1.01 | 1.02 | 1.03 | 1.04 | 1.05 | 1.06 | 1.07 | 1.08 | 1.09 | 1.10 |
| 6 | 0.91 | 0.92 | 0.92 | 0.93 | 0.94 | 0.95 | 0.96 | 0.97 | 0.98 | 0.99 | 1.00 | 1.01 | 1.02 | 1.03 | 1.04 | 1.05 | 1.06 | 1.07 | 1.08 | 1.08 |
| 7 | 0.90 | 0.91 | 0.92 | 0.93 | 0.93 | 0.94 | 0.95 | 0.96 | 0.97 | 0.98 | 0.99 | 1.00 | 1.01 | 1.02 | 1.03 | 1.04 | 1.05 | 1.06 | 1.07 | 1.07 |
| 8 | 0.89 | 0.90 | 0.91 | 0.92 | 0.93 | 0.94 | 0.95 | 0.96 | 0.97 | 0.98 | 0.99 | 1.00 | 1.01 | 1.02 | 1.03 | 1.04 | 1.05 | 1.06 | 1.06 | 1.06 |
| 9 | 0.88 | 0.89 | 0.90 | 0.91 | 0.92 | 0.93 | 0.94 | 0.95 | 0.96 | 0.97 | 0.98 | 0.99 | 1.00 | 1.01 | 1.02 | 1.03 | 1.04 | 1.05 | 1.05 | 1.05 |
| 10 | 0.87 | 0.88 | 0.89 | 0.90 | 0.91 | 0.92 | 0.93 | 0.94 | 0.95 | 0.96 | 0.97 | 0.98 | 0.99 | 1.00 | 1.01 | 1.02 | 1.03 | 1.04 | 1.04 | 1.04 |
| 11 | 0.86 | 0.87 | 0.88 | 0.89 | 0.90 | 0.91 | 0.92 | 0.93 | 0.94 | 0.95 | 0.96 | 0.97 | 0.98 | 0.99 | 1.00 | 1.01 | 1.02 | 1.03 | 1.03 | 1.03 |
| 12 | 0.86 | 0.87 | 0.88 | 0.88 | 0.89 | 0.90 | 0.91 | 0.92 | 0.93 | 0.94 | 0.95 | 0.96 | 0.97 | 0.98 | 0.99 | 1.00 | 1.01 | 1.02 | 1.02 | 1.02 |
| 13 | 0.85 | 0.86 | 0.87 | 0.88 | 0.88 | 0.89 | 0.90 | 0.91 | 0.92 | 0.93 | 0.94 | 0.95 | 0.96 | 0.97 | 0.98 | 0.99 | 1.00 | 1.01 | 1.01 | 1.01 |
| 14 | 0.84 | 0.85 | 0.86 | 0.87 | 0.88 | 0.89 | 0.89 | 0.90 | 0.91 | 0.92 | 0.93 | 0.94 | 0.95 | 0.96 | 0.97 | 0.98 | 0.99 | 1.00 | 1.01 | 1.01 |
| 15 | 0.83 | 0.84 | 0.85 | 0.86 | 0.87 | 0.88 | 0.89 | 0.90 | 0.90 | 0.91 | 0.92 | 0.93 | 0.94 | 0.95 | 0.96 | 0.97 | 0.98 | 0.99 | 1.00 | 1.00 |
| 16 | 0.83 | 0.84 | 0.84 | 0.85 | 0.86 | 0.87 | 0.88 | 0.89 | 0.90 | 0.91 | 0.91 | 0.92 | 0.93 | 0.94 | 0.95 | 0.96 | 0.97 | 0.98 | 0.99 | 0.99 |
| 17 | 0.82 | 0.83 | 0.84 | 0.85 | 0.85 | 0.86 | 0.87 | 0.88 | 0.89 | 0.90 | 0.91 | 0.91 | 0.92 | 0.93 | 0.94 | 0.95 | 0.96 | 0.97 | 0.98 | 0.98 |
| 18 | 0.81 | 0.82 | 0.83 | 0.84 | 0.85 | 0.86 | 0.87 | 0.88 | 0.89 | 0.90 | 0.91 | 0.92 | 0.92 | 0.93 | 0.94 | 0.95 | 0.96 | 0.97 | 0.97 | 0.97 |
| 19 | 0.81 | 0.82 | 0.82 | 0.83 | 0.84 | 0.85 | 0.86 | 0.87 | 0.88 | 0.89 | 0.90 | 0.91 | 0.92 | 0.92 | 0.93 | 0.94 | 0.95 | 0.96 | 0.96 | 0.96 |
| 20 | 0.80 | 0.81 | 0.82 | 0.82 | 0.83 | 0.84 | 0.85 | 0.86 | 0.87 | 0.88 | 0.88 | 0.89 | 0.90 | 0.91 | 0.92 | 0.93 | 0.93 | 0.94 | 0.95 | 0.96 |
| 21 | 0.79 | 0.80 | 0.81 | 0.82 | 0.83 | 0.83 | 0.84 | 0.85 | 0.86 | 0.87 | 0.88 | 0.88 | 0.89 | 0.90 | 0.91 | 0.92 | 0.93 | 0.93 | 0.94 | 0.95 |
| 22 | 0.79 | 0.80 | 0.80 | 0.81 | 0.82 | 0.83 | 0.84 | 0.85 | 0.86 | 0.87 | 0.88 | 0.88 | 0.89 | 0.89 | 0.90 | 0.91 | 0.92 | 0.93 | 0.93 | 0.94 |
| 23 | 0.78 | 0.79 | 0.80 | 0.80 | 0.81 | 0.82 | 0.83 | 0.84 | 0.85 | 0.85 | 0.86 | 0.87 | 0.88 | 0.89 | 0.89 | 0.90 | 0.91 | 0.92 | 0.93 | 0.93 |
| 24 | 0.77 | 0.78 | 0.79 | 0.80 | 0.81 | 0.81 | 0.82 | 0.83 | 0.84 | 0.85 | 0.85 | 0.86 | 0.87 | 0.88 | 0.89 | 0.90 | 0.90 | 0.91 | 0.92 | 0.93 |
| 25 | 0.77 | 0.78 | 0.78 | 0.79 | 0.80 | 0.81 | 0.82 | 0.82 | 0.83 | 0.84 | 0.85 | 0.86 | 0.86 | 0.87 | 0.88 | 0.89 | 0.90 | 0.90 | 0.91 | 0.92 |

^A $k = (1 + e)/(1 + i)$; e = escalation rate; i = discount rate.

10. Applications

10.1 Payback Versus Other Methods:

10.1.1 The primary contribution of the payback method lies not in its use for making major decisions, but in its use as a supplementary method of economic evaluation. That is, it gives one kind of information that, in conjunction with other economic measures, helps determine the economic desirability of one or more projects.

10.1.2 As a supplementary method, payback helps as a screening tool for evaluating investment candidates that have limited lives beyond which potential returns become irrelevant. The payback measure helps define the feasible set of projects to which additional economic methods can be applied. For example, an investor who is considering investments in a foreign country might establish a minimum acceptable payback of two years if nationalization, revolution, political instability, or other conditions that would diminish returns on the investment were likely to occur within several years. A manufacturer of building components, for example, might establish a minimum acceptable payback of only three or four years for a product line that would potentially yield profits for ten years, if factors such as obsolescence, competitive products, and shifting market conditions threaten the product line's profit potential after three or four years.

10.1.3 There are numerous reasons for the widespread applications of the payback method. It is easy to determine and to understand intuitively. It tells how long an investor's capital is at risk in terms of how many years are required before payoff. It serves as an index to short-run earnings per share of stock. It helps to identify projects that will be unusually profitable or unprofitable early in their life. And finally, with tight capital conditions, investors often want to be assured of short paybacks, in addition to high rates of return or high PVNB, before they will part with their capital.

11. Limitations

11.1 A major limitation of the payback method is that it ignores benefits and costs over the remaining service life of the project beyond the payback year. This imposes a bias against long-term projects with relatively long paybacks in favor of short-lived projects with quick paybacks. For example, a project that pays back in two years and dies in its third may have a much lower return than one that does not pay back until the fifth year but lasts for ten. Another limitation is that payback computed on total project investment does not indicate the economically efficient design or size of a project. Therefore, to make economically efficient

choices among competing projects and among alternative designs/sizes for a single project, payback as an evaluation method is appropriate only when used as a supplementary method with other economic evaluation methods.

12. Keywords

12.1 benefit-cost analysis; building economics; economic evaluation methods; engineering economics; investment analysis; life-cycle cost analysis; maximum acceptable payback period; net benefits; net savings; payback; simple payback

ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.

This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org).