



Standard Test Method for Proof-Voltage Testing of Thin Solid Electrical Insulating Materials¹

This standard is issued under the fixed designation D 1389; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 This test method covers a general procedure for proof-voltage testing of thin solid electrical insulating materials at commercial power frequencies. It is intended to apply principally to flat materials but is applicable, with modification, to any form that permits continuously passing the material between suitable electrodes.^{2,3}

1.2 On extremely thin materials (usually less than 0.05 mm (0.002 in.)) the test results may be influenced more by mechanical damage caused by conditions of test than by dielectric defects. Consequently, this test method is not recommended for use with extremely thin materials, unless prior determination has established that the test results are not influenced by mechanical damage.

1.3 While the equipment and procedures described in this test method relate specifically to tests made with power frequency ac voltages, similar equipment and procedures are used for proof-voltage tests using dc voltages. To the extent that it applies to dc tests, this test method can serve as a guide for persons making such tests. However, only tests made with power frequency ac voltages can be said to be in accordance with this test method.

1.4 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.* For specific hazard statements, see Section 7.

2. Referenced Documents

2.1 ASTM Standards:

¹This test method is under the jurisdiction of ASTM Committee D-9 on Electrical and Electronic Insulating Materials and is the direct responsibility of Subcommittee D09.12 on Electrical Tests.

Current edition approved Sept. 10, 1997. Published January 1998. Originally published as D 1389 – 56 T. Last previous edition D 1389 – 97.

²Bartnikas, R., Chapter 3, "High Voltage Measurements," *Electrical Properties of Solid Insulating Materials, Measurement Techniques*, Vol. IIB, *Engineering Dielectrics*, R. Bartnikas, Editor, ASTM STP 926, ASTM, Philadelphia, 1987.

³Nelson, J. K., Chapter 5, "Dielectric Breakdown of Solids," *Electrical Properties of Solid Insulating Materials: Molecular Structure and Electrical Behavior*, Vol. IIA, *Engineering Dielectrics*, R. Bartnikas and R. M. Eichorn, Editors, ASTM STP 783, ASTM, Philadelphia, 1983.

D 149 Test Method for Dielectric Breakdown Voltage and Dielectric Strength of Solid Electrical Insulating Materials at Commercial Power Frequencies⁴

3. Terminology

3.1 Definitions:

3.1.1 *proof voltage test, n*—a test during which a specified voltage is applied to a specimen to determine whether breakdown will occur at that voltage. Fixed electrodes may be used, in which case the voltage is held for a specified time; or large area specimens may pass between roller, brush, or blade electrodes, in which case the speed is specified.

4. Summary of Test Method

4.1 In this test method, sheet insulating material is passed at a specified speed between roller electrodes with a specified ac voltage applied, so that all, or nearly all, of the area of the material is subjected to the specified voltage. The number of electrical breakdowns and their locations are determined.

4.2 The applied proof voltage may be selected as a percentage of the dielectric breakdown voltage, as determined in accordance with Test Method D 149, or as a multiple of the breakdown voltage for an air gap of equal thickness.

4.3 Unless the material being tested is known to have high resistance to partial discharges, the proof voltage is ordinarily selected to be below the visible corona level. If it is necessary to test at a voltage at which visible corona will be present, the degradation of the material resulting from exposure to corona should be weighed against the advantages of testing at the high voltage level.

4.4 Two values for the rate of movement of the material between the electrodes are given to facilitate handling of different types of materials. The results obtained with the different speeds are not equivalent.

5. Significance and Use

5.1 Occasional dielectric defects may be found in commercially available and acceptable thin electric insulating materials. More often than not, these materials are used in multiple layers. The probability that occasional dielectric weak spots

⁴Annual Book of ASTM Standards, Vol 10.01.

will coincide from layer to layer is very small but increases with the frequency of occurrence of these defects. The proof-voltage test serves to indicate the frequency of occurrence of dielectric defects and facilitates the isolation of areas where the defects are excessive.

5.2 Some uses of thin electrical insulating materials require the complete absence of any dielectric defects. The proof-voltage test serves to locate dielectric defects, making possible repair or replacement of the area involved as may be desirable.

5.3 In the absence of detected faults, this test method is nondestructive to the material being evaluated, except as discussed in 1.2 and 4.3.

5.4 A critical part of the apparatus and procedure is the sensitivity and speed of response of the fault detection device, usually a circuit breaker. The results obtained using different sets of apparatus may differ greatly, depending upon the characteristics of this component.

5.5 It is essential that the fault detector respond only to fault currents, and that fault currents above a predefined value should always make the fault detector respond. The design, adjustment, and operation of the apparatus should be such as to avoid both erroneous functioning and erroneous nonfunctioning of the detector resulting from charging currents, magnetizing currents, corona currents, imbalance of circuit impedances, or component malfunction.

5.6 The proof-voltage test may be used as a manufacturing control test and as an acceptance test to guarantee a minimum level of dielectric defects.

5.7 If this test method is used as an acceptance test, take care that the factors discussed in 5.4 and 5.5 have been considered, and, if more than one set of apparatus is to be used, that comparable results are obtained from them.

6. Apparatus


6.1 *General Requirements*—The test voltage must conform to the requirements of Test Method D 149, relative to its variation from nominal value, wave-shape, and accuracy and

method of measurement. As related to this specific test method, some design details that are useful are described in 6.2-6.5, and in Fig. 1.

6.2 *System Considerations*—Departure from a sinusoidal wave form may arise either at the voltage source or in the load circuit. Excessive distortion due to load current can usually be avoided if the overall impedance drop through the apparatus at rated current and voltage is less than 10 % of the rated voltage, and provided the ratio of test voltage to rated voltage is not too small; the lower limit of this ratio can be determined by test. The apparatus should be of such size and design that fault currents at breakdown produce visually observable ruptures. The magnitude of the fault current required will depend on the material being tested.

6.3 *Transformer*—The desired test voltage is readily obtained from a step-up transformer energized from an adjustable voltage source. The transformer must be of such size and design that its continuous duty rating is consistent with the requirements as specified in 6.1. Standard 5 kVA or larger distribution transformers 14400/13200 to 120/240 or 240/480 V with less than 5 % impedance drop are readily available and their use is suggested.

6.4 *Fault Detector*—Fault detection shall be provided by an automatic circuit-breaking device with non-automatic reset. In order to provide detection of the smallest defects, to prevent pitting of the electrodes, and to provide maximum protection of the other electrical elements, the fault detector should be as sensitive and as fast-acting as possible. On the other hand, the task of visually locating dielectric punctures in some types of materials may be difficult if the fault current is interrupted too quickly. Therefore, the current setting and the response time of the fault detector must be related to the material being tested. CR₁, CR₂, and CR₃, shown in Fig. 1, may be separate fixed devices having differing characteristics, or may be a single device which can be set to different current and time values as needed. The circuit breaker (CB) of Fig. 1 should have a response time appropriate to the material being tested.

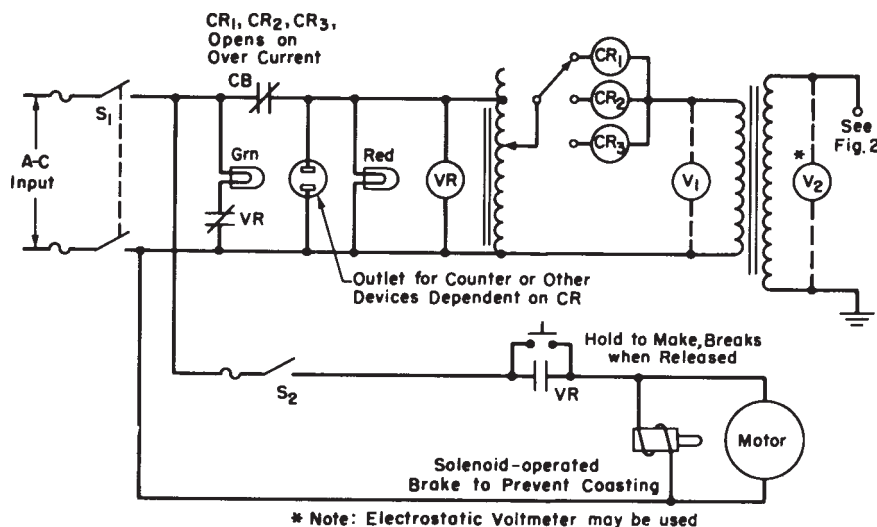

Symbols: CB-Circuit Breaker; CR-Current Relay; VR-Voltage Relay.

FIG. 1 Elementary Schematic Diagram of Typical Electrical Test Apparatus

6.5 *Voltage Control*—Control of voltage may be secured by: (1) variable-ratio auto-transformer, (2) generator-field regulation, or (3) induction regulator. Preference should be given to the variable-ratio auto-transformer or generator-field regulation. The design of the voltage control shall be such that when used with the associated transformer the requirements of 6.1 are met.

6.6 *Voltmeter*—The voltage shall be continuously measured during the test, using instruments meeting the requirements specified in Test Method D 149.

6.7 *Electrodes:*

6.7.1 The upper electrode is a hollow metal cylinder, 38 mm (1.5 in.) to 50 mm (2.0 in.) in diameter, of such length that as much of the width of the material is covered as is feasible without obtaining flash-over, and weighing no more than 2.5 g/mm (0.14 lb/in.) plus 225 g (0.5 lb). The ends are rounded to a radius of at least 13 mm (0.5 in.).

6.7.2 The lower electrode is constructed of a suitable metal, 150 mm (6 in.) in diameter, and is coupled to the drive. The ends shall be rounded to a radius of at least 13 mm (0.5 in.), unless the electrode extends at least 50 mm (2 in.) beyond both edges of the material being tested.

6.7.3 Both of the electrodes are circular and straight to within 0.025 mm (0.001 in.), and have a smooth satin or mirror finish. No sharp surface irregularities having a radial dimension greater than 0.10 times the thickness of the material being tested are permitted.

6.8 *Test Assembly:*

6.8.1 The test assembly, Fig. 2, consists of the upper and lower cylindrical electrodes mounted in suitable apparatus with provision being made for a drive to move the material at the specified speed.

6.8.2 It is desirable to mount the upper electrode for convenient removal so that electrodes of various lengths can be used to test materials of different widths. The upper electrode shall rest on the material to be tested, and shall be free to rotate about its axis and move only in a plane perpendicular to the plane of the material being tested.

6.8.3 The lower electrode shall be grounded and a protective cage at ground potential shall be provided over the upper electrode.

NOTE 1—Special electrode and test assemblies are necessary to test some types of materials. For materials which are relatively nonuniform in thickness it is desirable to use segmented electrodes of special construction. Formed parts such as channels can be tested by constructing

electrodes whose geometry is compatible with the shape of the formed material. For extremely thin materials it may be desirable to keep the material stationary and explore it by a traveling electrode. In all these cases make reference to test methods for the specific material.

6.8.4 The upper and lower electrodes shall be mounted so that the axis of neither electrode deviates more than 0.25 mm (0.010 in.) from a vertical plane through the axis of the other at any point within the width of its working surface, and the axis of each electrode shall be within 0.1 degree of being perpendicular to the direction of motion of the material being tested.


6.8.5 For the testing of cut sheet materials, provide a suitable conveyor, drive coupled, to support and move the material mounted in front of and behind and as close to the electrodes as is feasible, in a horizontal plane just slightly below the plane of intersection of the upper and lower electrodes, as shown in Fig. 2.

6.8.6 Where the material to be tested is in roll form, provide a feed and take-up roll. The core diameter of the take-up roll shall be appropriate to the material being tested, generally no smaller than the core diameter of the feed roll, and shall be driven in such a manner (for example, circumferential or slipping clutch drive) as to maintain the specified linear velocity of material passing between the electrodes. The feed roll shall not be driven. It may be necessary to provide a web tension regulator for the feed roll, or an idler roll ahead of the feed roll, to prevent coasting with reference to the drive speed. In any case only as much tension on the test material as is necessary to prevent coasting shall be used. The height of both feed and take-up rolls shall be such as not to cause lifting of the upper electrode with a resultant air gap between the test material and the lower electrode.

6.8.7 The drive shall be electrically interlocked with the fault detector so that it stops positively upon dielectric rupture of the material under test, but with provisions made so that the drive is independently operable when needed.

7. Hazards

7.1 *Lethal voltages are a potential hazard during the performance of this test. It is essential that the test apparatus, and all associated equipment electrically connected to it, be properly designed and installed for safe operation. Solidly ground all electrically conductive parts which it is possible for a person to contact during the test. Provide means for use at the completion of any test to ground any parts which were at*

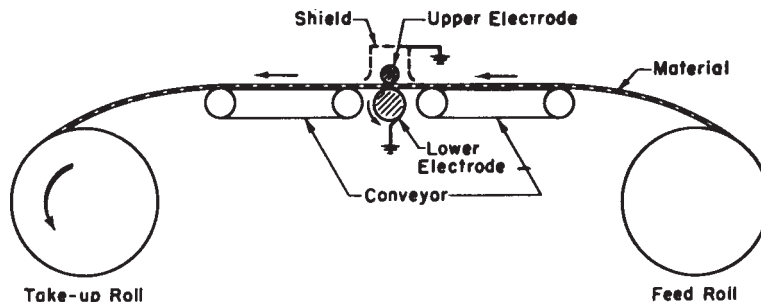

NOTE 1—Arrows indicate “driven” and direction.

FIG. 2 Typical Elementary Test Assembly for Use With Sheet and Roll-Form Materials

high voltage during the test or have the potential for acquiring an induced charge during the test or retaining a charge even after disconnection of the voltage source. Thoroughly instruct all operators as to the correct procedures for performing tests safely. When making high voltage tests, particularly in compressed gas or in oil, it is possible for the energy released at breakdown to be sufficient to result in fire, explosion, or rupture of the test chamber. Design test equipment, test chambers, and test specimens so as to minimize the possibility of such occurrences and to eliminate the possibility of personal injury. If the potential for fire exists, have fire suppression equipment available .

8. Procedure

8.1 Place the material in the apparatus and adjust the necessary drives, clutches, and web tension regulators.

8.2 Energize the electrodes within 5 % of the specified a-c proof test voltage for the material being tested.

8.3 Pass the material between the electrodes at a speed of either 2.3 m/min (7.5 ft/min) or 7.6 m/min (25 ft/min).

8.4 Record the number of dielectric faults detected, and if so specified, mark the location of each fault. If specified, for material supplied in rolls the distance from one of the ends to each fault should also be recorded.

9. Report

9.1 Unless otherwise specified, report the following:

9.1.1 Magnitude and frequency of the proof voltage,

9.1.2 Current and time characteristics of the fault detector,

9.1.3 Speed of the material passing between the electrodes,

9.1.4 Description of the material (name, grade, manufacturer, thickness, width, etc.),

9.1.5 Electrode system used, if other than that specified in this test method,

9.1.6 Proof test results obtained, and

9.1.7 Dielectric failures per unit area tested.

10. Precision and Bias

10.1 No statement is made about either the precision or bias of this test method since the result merely states whether there is conformance to the criteria for acceptability.

10.2 As mentioned in Section 5, the results obtained from tests on a given sample of material are dependent upon a number of factors, especially the sensitivity and speed of response of the fault detector and the velocity of movement of material between the electrodes. Do not directly compare results obtained on different sets of apparatus or at different times on the same apparatus unless these factors have been determined to be constant.

11. Keywords

11.1 proof-voltage testing; thin solid insulating materials

The American Society for Testing and Materials takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.

This standard is copyrighted by ASTM, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org).