



Designation: C 648 – 98

## Standard Test Method for Breaking Strength of Ceramic Tile<sup>1</sup>

This standard is issued under the fixed designation C 648; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

### 1. Scope

1.1 This test method covers the determination of the breaking strength of glazed ceramic wall tile, ceramic mosaic tile, quarry tile, and paver tile, having a facial area of at least 1 in.<sup>2</sup> (6.4 cm<sup>2</sup>).

1.2 The values stated in inch-pound units are to be regarded as the standard. The metric equivalents of inch-pound units may be approximate.

1.3 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

### 2. Referenced Documents

#### 2.1 ASTM Standards:

C 242 Terminology of Ceramic Whitewares and Related Products<sup>2</sup>

E 178 Practice for Dealing with Outlying Observations<sup>3</sup>

### 3. Terminology

#### 3.1 Definitions:

3.1.1 For definitions of the types of tile listed in Section 1, refer to Terminology C 242.

### 4. Summary of Test Method

4.1 The test method consists of supporting the tile on the ends of three cylindrical rods, or on three ball bearings for tiles having an actual facial area of 9 in.<sup>2</sup> (58 cm<sup>2</sup>) (or less), arranged in an equilateral triangle, and applying force at a definite rate to the center of the tile, which coincides with the center of the triangular support, until the specimen breaks.

NOTE 1—The size (facial dimensions) of otherwise equal tile affects the value of breaking strength obtained by this test method. For instance, a 6 by 6-in. (152 by 152-mm) tile equal in mature body properties and thickness to a 4¼ by 4¼-in. (108 by 108-mm) tile will have a breaking strength higher than the 4¼ by 4¼-in. tile.

<sup>1</sup> This test method is under the jurisdiction of ASTM Committee C-21 on Ceramic Whitewares and Related Products and is the direct responsibility of Subcommittee C21.06 on Ceramic Tile.

Current edition approved July 10, 1998. Published January 1999. Originally published as C 648 – 70. Last previous edition C 648 – 84 (1994).

<sup>2</sup> *Annual Book of ASTM Standards*, Vol 15.02.

<sup>3</sup> *Annual Book of ASTM Standards*, Vol 14.02.

### 5. Significance and Use

5.1 The test method provides means for establishing whether or not a lot of ceramic tile meets the strength requirements which may appear in tile specifications. Tile strength is the force in pounds-force (or newtons), as read from the pressure gage, necessary to cause the tile to break.

### 6. Apparatus

6.1 *Specimen-Support*, consisting of a 5½ by 5½ by 1-in. (139.7 by 139.7 by 25.4-mm) steel block. Three ¼-in. (6.4-mm) diameter and ⅜-in. (9.5-mm) deep tapped holes are arranged in an equilateral triangle having 3-in. (76.2-mm) sides and whose circumscribed circle has a radius of 1.732 in. (44.0 mm). The equilateral triangle is located on the steel block so that its center coincides with that of the steel block and one side of the triangle runs parallel to one side of the steel block. Three ⅜-in. diameter steel rods, 1⅜ in. with (34.9 mm) long, one end threaded for a distance of ⅜ in. with the same ¼-in. thread as the tapped holes, and the other end ground flat, fit into the three holes. In a similar manner, a second set of three ⅜-in. diameter steel rods, but ¾ in. (19.0 mm) long only, are threaded on one end for a distance of ⅜-in., are ground flat on the other end and fit three other ¼-in. tapped holes. The three ¼-in. holes, tapped for a distance of ⅜ in. to receive this second set of steel rods are located at the apexes of an equilateral triangle having 1½-in. (38.1-mm) long sides and whose circumscribed circle has a radius of 0.866 in. (22.0 mm). This second equilateral triangle is located within the first one in such a manner that its circumscribed circle is identical with the inscribed circle of the first triangle, and its sides are parallel to those of the larger triangle. The ball bearing support consists of three ⅛-in. (3.2-mm) ball bearings arranged in an equilateral triangle, with sides of 14 mm concentric and parallel with the other triangles. The bearings are embedded in the block to the extent of half their volume. The steel block has four more ¼-in. tapped holes to receive socket head cap screws for holding four registry stops. One of these holes is located in the center of one side, ¼ in. in from the edge. Another of these is located in the center of an adjacent side ¼ in. from the edge. The other two are located on an adjacent side, ¼ in. in from the edge, spaced 2 in. (50.8 mm) apart, with one located 1¾ in. (44.4 mm) from one of the corners of the first side. The two single hole registry

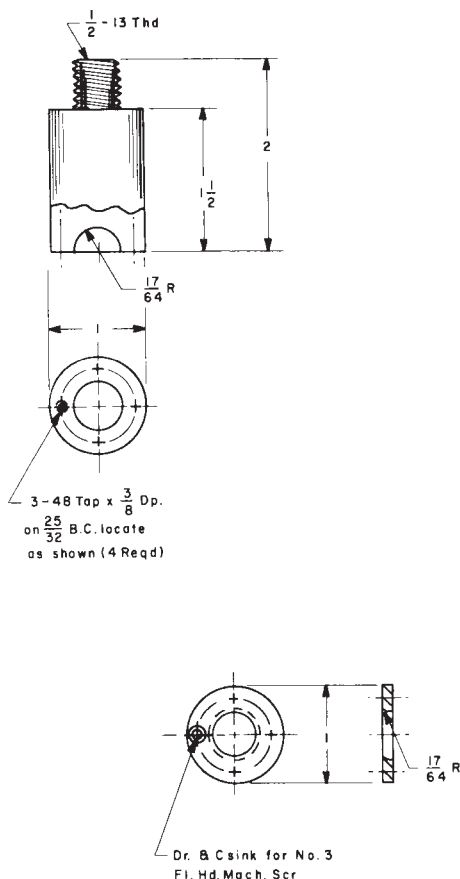


**TABLE 1 Conversion of Dimensions Appearing in Figs. 1 and 2**

in.	mm	in.	mm
1/8	3.2	1 3/8	34.9
1/4	6.4	1 1/2	38.1
1 7/64	6.7	1 47/64	44.1
3/8	9.5	1 3/4	44.4
1/2	12.7	2	50.8
0.645	16.4	2 1/2	63.5
3/4	19.0	2 3/4	69.8
25/32	19.8	3 15/32	88.1
0.866	22.0	5 1/2	139.7
1	25.4		

the steel rod is reduced in diameter for the proper distance and threaded to fit its female counterpart of the testing machine (see Fig. 2).

**6.3 Testing Machine**— Any apparatus, preferably motor driven, capable of maintaining a uniform load application rate of 800 to 1100 lbf (3600 to 4900 N)/min and large enough to accommodate the steel support block, shall be considered suitable testing equipment. The machine must be equipped with an interchangeable gage, which has a special peakload indicator that will remain at the highest reading reached during the test, until reset by hand to the zero point. The scale of the gage used shall have such a range that the breaking load of the test specimens falls between 10 and 90 % of the scale capacity. The scale shall be graduated into 100 or more equal increments.


**FIG. 2 Force Applicator Details (See Table 1)**

**6.4 Oven**—An oven large enough to hold the required number of the tile specimens which, when empty, can be heated to a temperature of 200°F (93°C) in 1/2 h or less. It must be able to recover its temperature, after being loaded with tile, in 1 h or less and capable of maintaining temperature to within ±10°F (±5°C).

## 7. Test Specimen

**7.1 Size of Sample**— Select tile specimens at random from the lot to be tested and in the quantities designated in the specification. However, the number of tile per sample shall never be less than 10.

**7.2 Preparation of Specimens**—Remove any loosely adhering clay particles from the back of each tile with a stiff brush. Bring the empty oven to a temperature of 200°F (93°C), place the required number of tile into it, and heat for a period of 1 h at 200°F (93°C), counted from the time the oven has recovered its original temperature. Let the tile cool to room temperature in the closed oven. Tile treated in this manner may be tested at any time up to 26 h after heating began. If the tile must be removed from the oven after the heating cycle and stored in the laboratory, they must be tested no later than 3 h after they have reached room temperature. These precautions are necessary to prevent absorption of moisture from the atmosphere and because it is impractical to store the specimens in a desiccator after heating, in view of the large number of tile normally involved.

## 8. Procedure

**8.1** Place the steel support block into the testing machine so that the load applicator is directly above the center of the steel block. For tile having actual facial area greater than or equal to 62 in.<sup>2</sup> (400 cm<sup>2</sup>), use the support and rods represented by the larger triangle. For tile with actual facial areas greater than to 9 in.<sup>2</sup> and less than 62 in.<sup>2</sup> (58 cm<sup>2</sup> and 400 cm<sup>2</sup>) use the smaller triangle and rod supports. For actual facial area greater than 1 in.<sup>2</sup> and less than or equal to 9 in.<sup>2</sup> (6.4 cm<sup>2</sup> and 58 cm<sup>2</sup>) use the ball bearing support.

**8.2** Find the exact center of one tile of the sample by drawing lines across the face of the tile, connecting diagonally opposite corners, and place this tile on the proper three-point support. The face of any tile to be broken must always be in an upward position. In the case of reversible tile, such as unglazed ceramic mosaic tile, it is immaterial which side of the tile is up. Tile with directional back designs must be placed on the triangular support so that any ribs or grooves run parallel to those support rods which are arranged parallel to one side of the steel block.

**8.3** Lower the load applicator and move the tile with the diagonal lines so that its center is directly below the center of the load applicator ball. With the tile in this position, move the three adjustable registry stops so that their vertical projections are in contact with two adjacent sides of the tile and fasten them in that position. It may be necessary to remove one of the support rods, by unscrewing it from the 5 1/2-in. (140-mm) square steel block, in order to position all the registry stops without interference. If the tile is a size such that the vertical projections on the registry stops will interfere with the force application, use the slot ends of the registry stops to fix the

position of the tile. Except for minor size variations, the registry stops will now locate every tile of the sample in the relatively same spot on the support, so that force is applied in the approximate center of each tile.

8.4 Position a safety shield around the apparatus so that no person or property will be injured from possible contact with broken tile. The use of a safety shield is mandatory in testing the breaking strength of ceramic mosaic tile, which can break into shrapnel-like fragments.

8.5 Whenever the approximate force required to break the particular type of tile is not known, it is necessary to break several tile prior to starting the test in order to establish the range of the gage to be used. Install the proper gage and set the peak-load indicator to zero.

8.6 Apply force at the rate of 800 to 1100 lbf (3600 to 4900 N)/min until the tile actually breaks into two or more pieces. Read the force on the gage by interpolation to the nearest 1 lbf (4 N). Record this pressure and reset the gage to zero.

8.7 Remove any debris from the surface of the steel block with a brush. Place the next tile on the triangular support with two adjacent sides in contact with the registry stops and repeat the operation until all of the tile in the sample have been broken.

## 9. Calculation

9.1 Average the breaking forces for all of the tile in the sample.

9.2 If any one individual breaking force appears to deviate markedly from the others of the sample, it may be eliminated

before the average is calculated only after the criteria in Practice E 178 have been applied and justify elimination.

9.3 Should it become necessary to eliminate more than 20 % of the individual values in a sample in accordance with 9.2, repeat the test on sample containing twice the number of specimens in the original one. In that case, only breaking forces from the repeat test shall be used to arrive at the average strength of the sample.

## 10. Report

10.1 Report the following information:

10.1.1 Name and model number of the testing machine,

10.1.2 Range of the gage used,

10.1.3 Identification of the triangular support used in testing, by stating the length of its sides,

10.1.4 Type of tile tested, whether glazed or unglazed.

10.1.5 Number of specimens in the sample; also state whether it is a repeat test, and

10.1.6 Average strength in pounds-force (or newtons) of the sample.

## 11. Precision and Bias

11.1 The maximum difference between breaking strengths determined by laboratories testing tile from the same lots was 20 % of the lower value, and the difference was less than 5 % for 50 % of the lots tested. An overall difference of 7½ % existed between laboratories in a test series of 19 lots of wall tile.

## 12. Keywords

12.1 breaking strength; ceramic tile

*The American Society for Testing and Materials takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.*

*This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.*

*This standard is copyrighted by ASTM, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org).*