



Designation: D 3739 – 94 (Reapproved 1998)

Standard Practice for Calculation and Adjustment of the Langelier Saturation Index for Reverse Osmosis¹

This standard is issued under the fixed designation D 3739; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 This practice covers the calculation and adjustment of the Langelier saturation index for the concentrate stream of a reverse osmosis device. This index is used to determine the need for calcium carbonate scale control in the operation and design of reverse osmosis installations. This practice is applicable for concentrate streams containing up to 10 000 mg/L of total dissolved solids.

1.2 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

2. Referenced Documents

2.1 ASTM Standards:

- D 511 Test Methods for Calcium and Magnesium in Water²
- D 1067 Test Methods for Acidity or Alkalinity of Water²
- D 1129 Terminology Relating to Water²
- D 1293 Test Method for pH of Water²
- D 1888 Test Methods for Particulate and Dissolved Matter in Water³
- D 4194 Test Methods for Operating Characteristics of Reverse Osmosis Devices⁴

3. Terminology

3.1 For definitions of terms used in this practice, refer to Terminology D 1129.

3.2 Definitions of Terms Specific to This Standard:

3.2.1 For descriptions of terms relating to reverse osmosis, refer to Test Methods D 4194.

3.2.2 *Langelier saturation index*—an index calculated from total dissolved solids, calcium concentration, total alkalinity, pH, and solution temperature that shows the tendency of a water solution to precipitate or dissolve calcium carbonate.

¹ This practice is under the jurisdiction of ASTM Committee D-19 on Water and is the direct responsibility of Subcommittee D19.08 on Membranes and Ion Exchange Materials.

Current edition approved Sept. 15, 1994. Published November 1994. Originally published as D 3739 – 78. Last previous edition D 3739 – 88 (1993).

² *Annual Book of ASTM Standards*, Vol 11.01.

³ Discontinued—See 1989 *Annual Book of ASTM Standards*, Vol 11.01.

⁴ *Annual Book of ASTM Standards*, Vol 11.02.

4. Summary of Practice

4.1 This practice consists of calculating the Langelier saturation index for a reverse osmosis concentrate stream from the total dissolved solids, calcium ion content, total alkalinity, pH, and temperature of the feed solution, and the recovery of the reverse osmosis system.

4.2 This practice also presents techniques to lower the Langelier saturation index by decreasing the recovery, by decreasing the calcium content of the feedwater, or by changing the ratio of total alkalinity to free carbon dioxide in the feedwater.

5. Significance and Use

5.1 In the design and operation of reverse osmosis installations, it is important to predict the calcium carbonate scaling properties of the concentrate stream. Because of the increase in total dissolved solids in the concentrate stream and the difference in passages for calcium ion, bicarbonate ion, and free CO₂, the calcium carbonate scaling properties of the concentrate stream will generally be quite different from those of the feed solution. This practice permits the calculation of the Langelier saturation index for the concentrate stream from the feed water analyses and the reverse osmosis operating parameters.

5.2 A positive Langelier saturation index indicates the tendency to form a calcium carbonate scale, which can be damaging to reverse osmosis performance. This practice gives various procedures for the adjustment of the Langelier saturation index.

5.3 The tendency to form CaCO₃ scale can be suppressed by the addition of antisealents or crystal modifiers. Suppliers of antisealents and crystal modifiers can provide information on the scale inhibition performance of these types of chemical. Their use may be appropriate for reducing scale formation in RO systems. The RO system supplier should be consulted prior to the use of antisealents and crystal modifiers to ensure they will not have a negative impact on the RO system.

6. Procedure

6.1 Determine the calcium concentration in the feed solution in accordance with Test Methods D 511 and express as CaCO₃.

6.2 Determine the total dissolved solids of the feed solution

using Test Methods D 1888.

6.3 Determine the total alkalinity of the feed solution using Test Methods D 1067, and express as CaCO₃.

6.4 Measure the pH of the feed solution using Test Method D 1293.

6.5 Measure the temperature of the feed solution.

7. Calculation

7.1 Calculate the calcium concentration in the concentrate stream from the calcium concentration in the feed solution, the recovery of the reverse osmosis system, and the calcium ion passage as follows:

$$Ca_c = Ca_f \times \frac{1 - Y(SP_{Ca})}{1 - Y} \quad (1)$$

where:

Ca_c = calcium concentration in concentrate, as CaCO₃, mg/L,

Ca_f = calcium concentration in feed, as CaCO₃, mg/L,

Y = recovery of the reverse osmosis system, expressed as a decimal, and

SP_{Ca} = calcium ion passage, expressed as a decimal.

NOTE 1—SP_{Ca} can be obtained from the supplier of the specific reverse osmosis system. For most reverse osmosis devices SP_{Ca} can be considered to be zero, in which case the equation simplifies to:

$$Ca_c = Ca_f \times (1/1 - Y) \quad (2)$$

This assumption will introduce only a small error.

7.2 Calculate the total dissolved solids (TDS) in the concentrate stream from the total dissolved solids in the feed solution, the recovery of the reverse osmosis system, and the passage of total dissolved solids as follows:

$$TDS_c = TDS_f \times \frac{1 - Y(SP_{TDS})}{1 - Y} \quad (3)$$

where:

TDS_c = concentration of total dissolved solids in concentrate, mg/L,

TDS_f = concentration of total dissolved solids in the feed, mg/L,

Y = recovery of the reverse osmosis system, expressed as a decimal, and

SP_{TDS} = passage of total dissolved solids, expressed as a decimal.

NOTE 2—SPTDS can be obtained from the supplier of the specific reverse osmosis system. For most reverse osmosis devices SPTDS can be assumed to be zero, in which case the equation simplifies to:

$$TDS_c = TDS_f \times (1/1 - Y) \quad (4)$$

The error introduced will usually be negligible.

7.3 Calculate the alkalinity in the concentrate stream from the alkalinity in the feed solution, the recovery of the reverse

osmosis system, and the passage of alkalinity, by:

$$Alk_c = Alk_f \times \frac{1 - Y(SP_{alk})}{1 - Y} \quad (5)$$

where:

Alk_c = alkalinity in concentrate, as CaCO₃, mg/L,

Alk_f = alkalinity in feed, as CaCO₃, mg/L,

Y = recovery of the reverse osmosis system, expressed as a decimal, and

SP_{alk} = alkalinity passage, expressed as a decimal.

NOTE 3—SP_{alk} is dependent on the pH of the feed solution and its value should be obtained from the supplier of the specific reverse osmosis system.

7.4 Calculate the free carbon dioxide content (C) in the concentrate stream by assuming that the CO₂ concentration in the concentrate is equal to the CO₂ concentration in the feed: C_c = C_f. The concentration of free carbon dioxide in the feed solution is obtained from Fig. 1 as a function of the alkalinity and the pH of the feed solution.

7.5 Calculate the pH of the concentrate stream (pH_c) using the ratio of alkalinity (from 7.3) to free CO₂ in the concentrate (from 7.4), Fig. 1.

7.6 From Fig. 2 obtain: pCa as a function of Ca_c, pAlk as a function of Alk_c, "C" as a function of TDS_c and temperature.

NOTE 4—Temperature of concentrate is assumed equal to temperature of feed solution.

7.7 Calculate pH at which concentrate stream is saturated with CaCO₃ (pH_s) as follows:

$$pH_s = pCa + pAlk + "C" \quad (6)$$

7.8 Calculate the Langelier saturation index of the concentrate (LSI_c) as follows:

$$LSI_c = pH_c - pH_s \quad (7)$$

8. Adjustments of LSI_c

8.1 If the LSI_c is unacceptable based on the supplier's recommendation, adjustments can be made by one of the following means. A new LSI_c can then be calculated.

8.1.1 The recovery (Y) can be lowered and the LSI_c can be calculated as above by substituting a new value for the recovery.

8.1.2 Decreasing the calcium concentration in the feed solution by means of sodium cycle ion exchange (softening) will increase the pCa and will therefore decrease the LSI_c. Softening will not change the alkalinity or pH of the feed solution and the slight change in TDS_f may be considered negligible. After softening, the LSI_c can be calculated as above using the lower value for calcium concentration.

8.1.3 Adding acid (HCl, CO₂, H₂SO₄, etc.) to the feed solution changes the Alk_f, C_f, pH, and SP_{alk}. The slight change

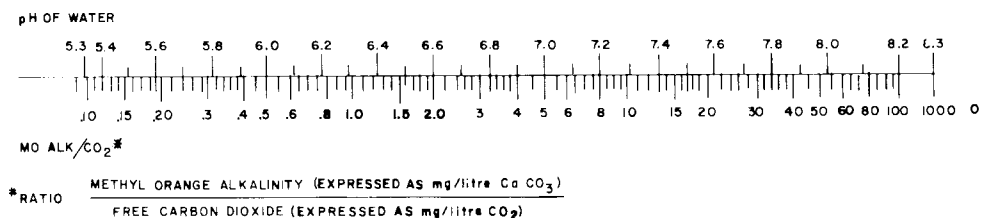


FIG. 1 pH Versus Methyl Orange Alkalinity/Free CO₂

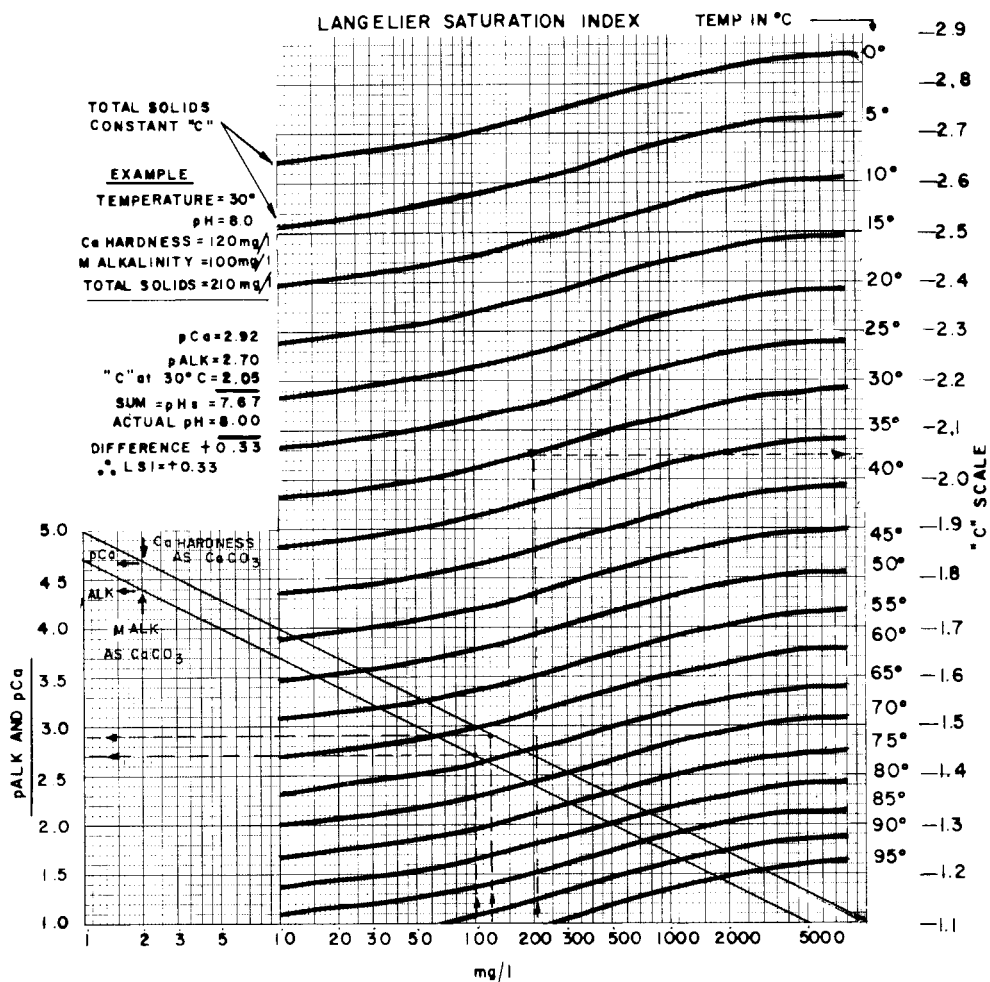


FIG. 2 Langelier Saturation Index

in TDS_f can usually be neglected. Acid addition will decrease the LSI_c ; however, since many variables change with acidification, trial and error computations are required to determine the amount of acid needed to obtain the desired LSI_c . The number of trial and error computations required to determine the amount of acid needed can be reduced greatly by using the pH_s calculated in 7.7. Since pH_c will usually be 0.5 units higher than the pH_f , the first computation can be made with an acidified feed solution which is 0.5 unit lower than the pH_s calculated in 7.7.

8.1.3.1 For an assumed pH (pH_{acid}), obtained from addition of acid to the feed solution, obtain the ratio of Alk_{acid}/C_{acid} from Fig. 1. From this ratio, Alk_f , and C_f calculate the milligrams per litre of acid used (x). For example, for H_2SO_4 addition (100 %):

$$\frac{Alk_{acid}}{C_{acid}} = \frac{Alk_f - 1.02x}{C_f + 0.90x} \quad (8)$$

8.1.3.2 Calculate the total alkalinity of the acidified feedwater (Alk_{acid}) and the CO_2 content in the acidified feedwater (C_{acid}) as follows:

$$Alk_{acid} = Alk_f - 1.02x \quad (9)$$

$$C_{acid} = C_f + 0.90x \quad (10)$$

8.1.3.3 Using Alk_{acid} , C_{acid} , and the supplier's value for SP_{alk} for the new pH, calculate the LSI_c in accordance with Section 7.

8.1.3.4 If HCl (100 %) is used for acidification, the Eq 8 is:

$$\frac{Alk_{acid}}{C_{acid}} = \frac{Alk_f - 1.37y}{C_f + 1.21y} \quad (11)$$

where:

y = HCl (100%), mg/L.

9. Reverse Osmosis in Operation

9.1 Once a reverse osmosis system is operating, the Langelier saturation index can be directly calculated from the analysis of Alk_c , Ca_c , TDS_c , and pH_c of the concentrate stream and compared with the projected LSI_c calculated in Section 7.

10. Use of Computers for the Determination of LSI_c

10.1 The calculations given in Sections 7 and 8 are adaptable to simple computer analysis.

11. Keywords

11.1 $CaCO_3$ scale; Langelier saturation index; LSI; reverse osmosis; scaling

**NOTICE: This standard has either been superseded and replaced by a new version or discontinued.
Contact ASTM International (www.astm.org) for the latest information.**



The American Society for Testing and Materials takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.

This standard is copyrighted by ASTM, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org).