PANEL SCHEDULE

PANEL: MCC
LOCATION: CORRIDOR 109
FEEDER SOURCE: ENTERGY

VOLTAGE: 208/120V, 400A, 3Ø, 4W (W/MB; 22KIC
ENCLOSURE: FLUSH MOUNTED W/ EQUIPMENT GND
BAR SQ D TYPE QO LOAD CENTER

CKT NO	THHN WIRE SIZE	LOAD DESCRIPTION LOCATION	BREAKER AMP	BREAKER POLE	LOAD (kva)	AØ	BØ	CØ	LOAD (kva)	BREAKER POLE	BREAKER AMP	LOAD DESCRIPTION LOCATION	THHN WIRE SIZE	CKT NO
1	2/0	AHU-1 (20 TON) **	150	3	17.9				12.3	3	110	** CU-1 (20 TON)	#1	2
3					17.9				12.3					4
5					17.9				12.3					6
7	#12	AHU-2 (2 TON) **	15	2	1.0				1.1	2	15	** CU-2 (2 TON)	#12	8
9					1.0				1.1					10
11	#12	AHU-3 (2-1/2 TON) **	15	2	1.0				1.7	2	25	** CU-3 (2-1/2 TON)	#10	12
13					1.0				1.7					14
15	#12	AHU-5 (5 TON) **	15	2	1.0				3.4	2	50	** CU-5 (5 TON)	#6	16
17					1.0				3.4					18
19	#10	5.5 kw BAPTISTRY HEATER **	30	2	2.7				0.8	1	15	** HOOD CONTROLLER	#12	20
21					2.7				1.8	1	25	** KSF-1; SHUNT TRIP; ROUTE THRU HOOD CONTROLLER	#12	22
23	#10	BAPTISTRY HEATER CIRCULATION PUMP **	20	1	1.6				1.3	1	20	** KEF-1; SHUNT TRIP; ROUTE THRU HOOD CONTROLLER	#12	24
25	#10	CLOTHES DRYER	30	2	2.5				0.5	1	20	WASHING MACHINE	#12	26
27					2.5				-	1	20	SPARE	-	28
29	-	SPARE	20	1	-				-	1	20	SPARE	-	30
31	-	SPARE	20	1	-				-	1	20	SPARE	-	32
33	-	SPARE	20	1	-				-	1	20	SPARE	-	34
35	-	SPARE	20	1	-				-	1	20	SPARE	-	36
37	-	SPARE	20	1	-				6.5	3	100	LP2	-	38
39	-	SPARE	20	1	-				3.2					40
41	-	SPARE	20	1	-				5.4					42

SOLID NEUTRAL NEUTRAL WIRE (N)

TOTAL CONNECTED LOAD (kva) = 140.1

AØ = 47.8 BØ = 46.9 CØ = 45.6

GROUND BUS GROUND WIRE (G)

** INSTALL BREAKER TO MATCH EQUIPMENT INSTALLED

PANEL SCHEDULE

PANEL: LP2
LOCATION: CORRIDOR 109
FEEDER SOURCE: MCC

VOLTAGE: 208/120V, 100A, 3Ø, 4W (W/MLO; 10KIC
ENCLOSURE: FLUSH MOUNTED W/ EQUIPMENT GND
BAR SQ D TYPE QO LOAD CENTER

CKT NO	THHN WIRE SIZE	LOAD DESCRIPTION LOCATION	BREAKER AMP	BREAKER POLE	LOAD (kva)	AØ	BØ	CØ	LOAD (kva)	BREAKER POLE	BREAKER AMP	LOAD DESCRIPTION LOCATION	THHN WIRE SIZE	CKT NO
1	#12	ADMIN OFFICE 110	20	1	1.1				0.5	1	20	SOUND CLOSET 114; DEDICATED	#12	2
3	#12	PASTOR OFFICE 117	20	1	0.7				0.5	1	20	SOUND CLOSET 114; DEDICATED	#12	4
5	#12	KITCHEN, MICROWAVE	20	1	1.5				0.5	1	20	SOUND CLOSET 114; DEDICATED	#12	6
7	#12	KITCHEN, ICE MACHINE	20	1	1.5				1.5	1	20	KITCHEN OUTLETS	#12	8
9	#12	SPARE	20	1	-				1.5	1	20	KITCHEN REFRIGERATOR	#12	10
11	#12	KITCHEN, FREEZER	20	1	1.5				0.5	1	20	CHOIR	#12	12
13	#12	STAGE RIGHT	20	1	0.2				0.2	1	20	PULPIT	#12	14
15	#12	STAGE LEFT	20	1	0.2				0.5	1	20	MULTI-PURPOSE RM OUTLETS	#12	16
17	#12	2ND FLR & ATTIC OUTLETS	20	1	0.7				0.7	1	20	MULTI-PURPOSE RM OUTLETS	#12	18
19	#12	LIGHTS	20	1	1.0				1.5	1	20	LIGHTS	#12	20
21	-	SPARE	20	1	-				-	1	20	SPARE	-	22
23	-	SPARE	20	1	-				-	1	20	SPARE	-	24
25		SPACE										SPACE		26
27		SPACE										SPACE		28
29		SPACE										SPACE		30
31		SPACE										SPACE		32
33		SPACE										SPACE		34
35		SPACE										SPACE		36
37		SPACE										SPACE		38
39		SPACE										SPACE		40
41		SPACE										SPACE		42

SOLID NEUTRAL NEUTRAL WIRE (N)

TOTAL CONNECTED LOAD (kva) = 15.0

AØ = 6.5 BØ = 3.2 CØ = 5.4

GROUND BUS GROUND WIRE (G)

PANEL SCHEDULE

PANEL: LP1
LOCATION: STORAGE RM 105
FEEDER SOURCE: MDP

VOLTAGE: 208/120V, 100A, 3Ø, 4W (W/MLO; 22KIC
ENCLOSURE: FLUSH MOUNTED W/ EQUIPMENT GND
BAR SQ D TYPE QO LOAD CENTER

CKT NO	THHN WIRE SIZE	LOAD DESCRIPTION LOCATION	BREAKER AMP	BREAKER POLE	LOAD (kva)	AØ	BØ	CØ	LOAD (kva)	BREAKER POLE	BREAKER AMP	LOAD DESCRIPTION LOCATION	THHN WIRE SIZE	CKT NO
1	#12	AHU-4 (3 TON) **	15	2	1.0				2.0	2	30	** CU-4 (3 TON)	#10	2
3					1.0				2.0					4
5	#10	INSTANT WATER HEATER, WOMENS RESTROOM	30	1	3.4				0.7	1	20	VESTIBULE WATER FOUNTAIN	#12	6
7	#10	INSTANT WATER HEATER, MENS RESTROOM	30	1	3.4				1.3	1	20	OUTLETS	#12	8
9	#12	RESTROOM OUTLETS	20	1	0.7				0.4	1	20	ATTIC & LOFT OUTLETS	#12	10
11	#12	PENDANT LIGHTS IN WORSHIP & 2ND FLR	20	1	1.4				1.0	1	20	LIGHTS	#12	12
13	-	SPARE	20	1	-				-	1	20	SPARE	-	14
15	-	SPARE	20	1	-				-	1	20	SPARE	-	16
17	-	SPARE	20	1	-				-	1	20	SPARE	-	18

SOLID NEUTRAL NEUTRAL WIRE (N)

TOTAL CONNECTED LOAD (kva) = 18.3

AØ = 7.7 BØ = 4.1 BØ = 6.5

GROUND BUS GROUND WIRE (G)

** INSTALL BREAKER TO MATCH EQUIPMENT INSTALLED

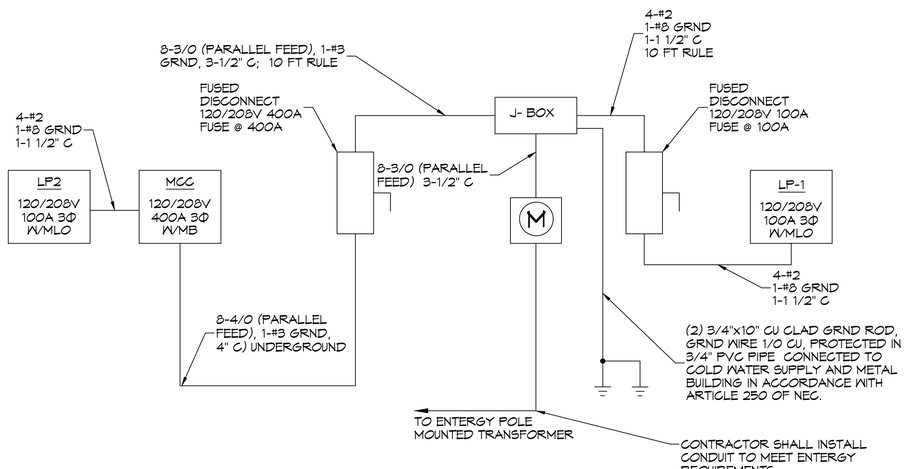

ONE LINE DIAGRAM
SCALE: NTS

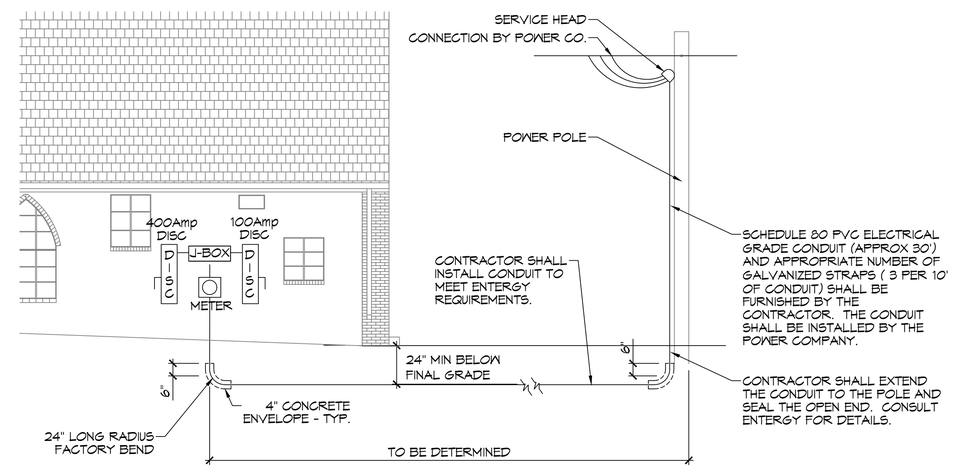

ELECTRICAL SERVICE DETAIL
SCALE: NTS

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
www@dammonengineering.com
PH: 985-649-5832 F: 985-641-5950
Chief Engineer: Brian Mestich, PE
554 Old Spanish Trail
Slidell, LA 70458

#	DESCRIPTION	DATE

REVISIONS

STATE OF LOUISIANA
RICKEY DALE STINER JR
License No. 37664
PROFESSIONAL ENGINEER
08/26/2025

THE SIXTH CHURCH
BAPTIST CONVENTION
BROADMOOR

This drawing, plans and specifications, regardless of form or medium, are and shall remain the property of Dammon Engineering, and shall not be reproduced or used for other projects or extensions to this project, even if the author has been compensated, except for which the plans were prepared and provided without written consent of Dammon Engineering. Visual contact with these documents shall constitute proof of this restriction.

JOB No:	24-70	DATE:	08-20-2025
DRAWN BY:	CKD	CHECKED BY:	BAM

629 FELICITY STREET
NEW ORLEANS LA 70130

SHEET TITLE:
CIRCUIT PANELS AND ONE-LINE DIAGRAM

DRAWING NUMBER:
E104

SHEET No: 15 of 15

FILE NAME: J:\- CHURCHES\24-70 - Sixth Baptist Church Fabrication\Drawings\Working Current Dwgs\E104 - Electric Circuit Panels & One-Line.dwg PLOT DATE & TIME: Tuesday, August 26, 2025 8:53:43 AM