



Hwy 433

Building
Parking Lot

Customer will be installing the collisions bollards around the tank.

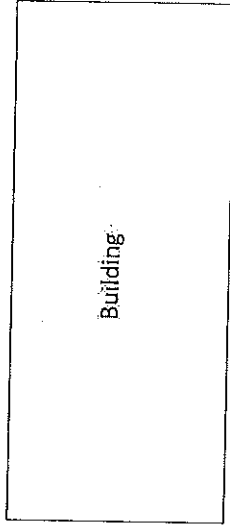


THE INSTALLATION WILL BE IN ACCORDANCE WITH NFPA 30 & 30A.
 THERE WILL BE AN EMERGENCY STOP BUTTON WITHIN 50' OF DISPENSER.
 THE ELECTRICAL WILL BE INSTALLED IN ACCORDANCE WITH NEC CODES.
 CLASS 40-BC FIRE EXTINGUISHER.
 THE DISPENSERS WILL HAVE EMERGENCY VALVES. THE PRODUCT LINES WILL
 HAVE EMERGENCY VALVES AND ANTI-SYPHON VALVES.
 THE TANKS WILL HAVE OVERFILL VALVES/DROP TUBES AND VENT ALARMS.



SCALE: None	APPROVED BY:	DRAWN BY: CPM
DATE: 8-1-24		REVISED:
Foggy Waters Marina 58047 Hwy 433 Slidell, La. 70460		


2305 L&A Rd.
 Metairie, LA 70001
 Ph: 504-367-5586 Fax: 504-367-5800

Foggy Waters Marina

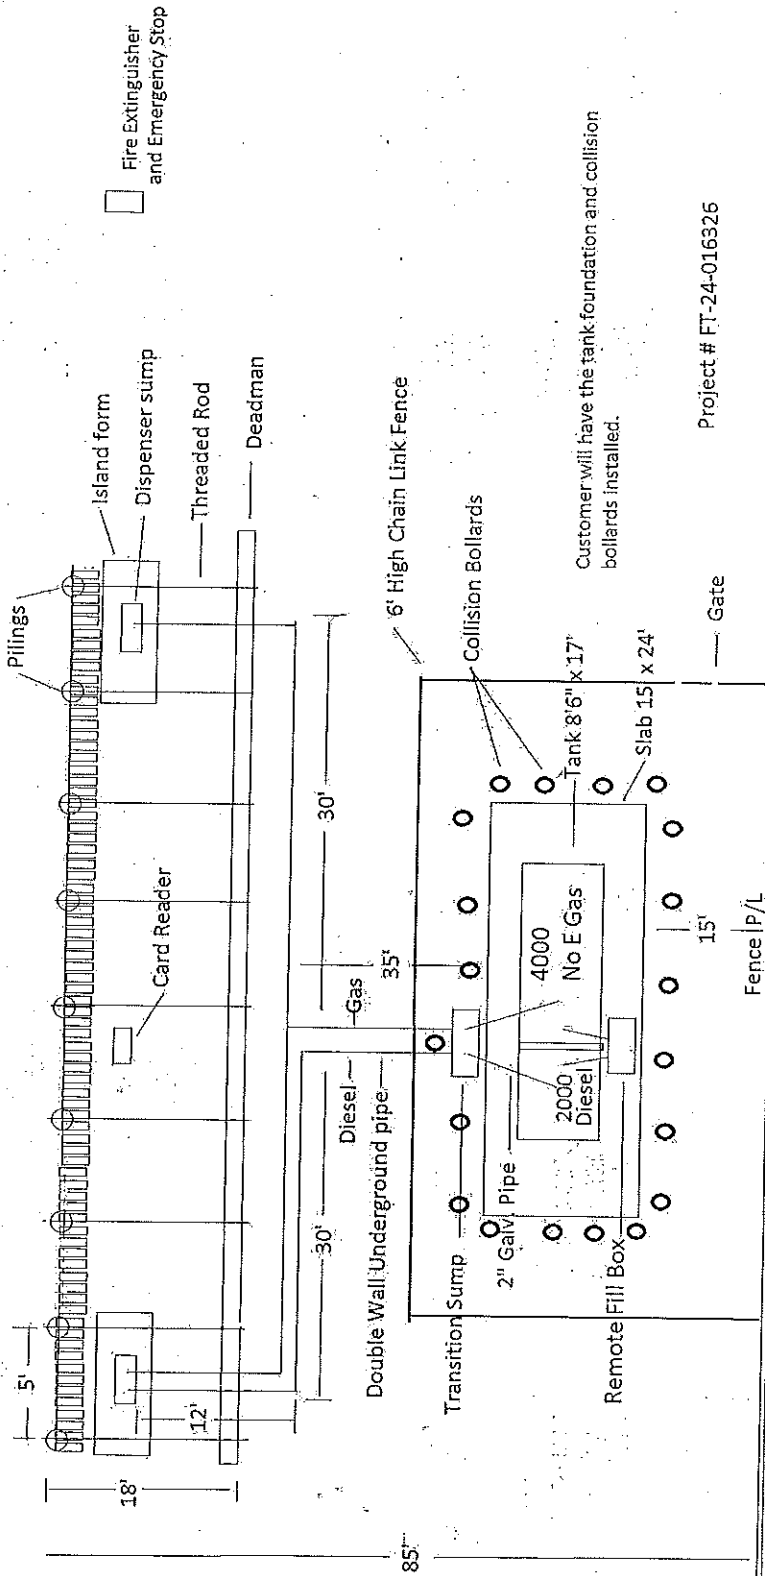

Customer will have the tank foundation and collision bollards installed.

Project # FT-24-016326



SCALE: None	APPROVED BY:	DRAWN BY CPM
DATE: 8-1-24		REVISED
Foggy Waters Marina 58047 Hwy 433 Slidell, La. 70460		
2305 L&A Rd Metairie, LA 70001 Ph: 504-867-5886 Fax: 504-867-5800		

THE INSTALLATION WILL BE IN ACCORDANCE WITH NFPA 30 & 30A. THERE WILL BE AN EMERGENCY STOP BUTTON WITHIN 50' OF DISPENSER. THE ELECTRICAL WILL BE INSTALLED IN ACCORDANCE WITH NEC CODES. CLASS 40-BC FIRE EXTINGUISHER. THE DISPENSERS WILL HAVE EMERGENCY VALVES. THE PRODUCT LINES WILL HAVE EMERGENCY VALVES AND ANTI-SYPHON VALVES. THE TANKS WILL HAVE OVERFILL VALVES/DROP TUBES AND VENT ALARMS.



58047 LA-488

Twin Gas
Dispenser

Gas/Diesel
Dispenser

6000 Gallon Fireguard AST
2 Compartment 2/4K