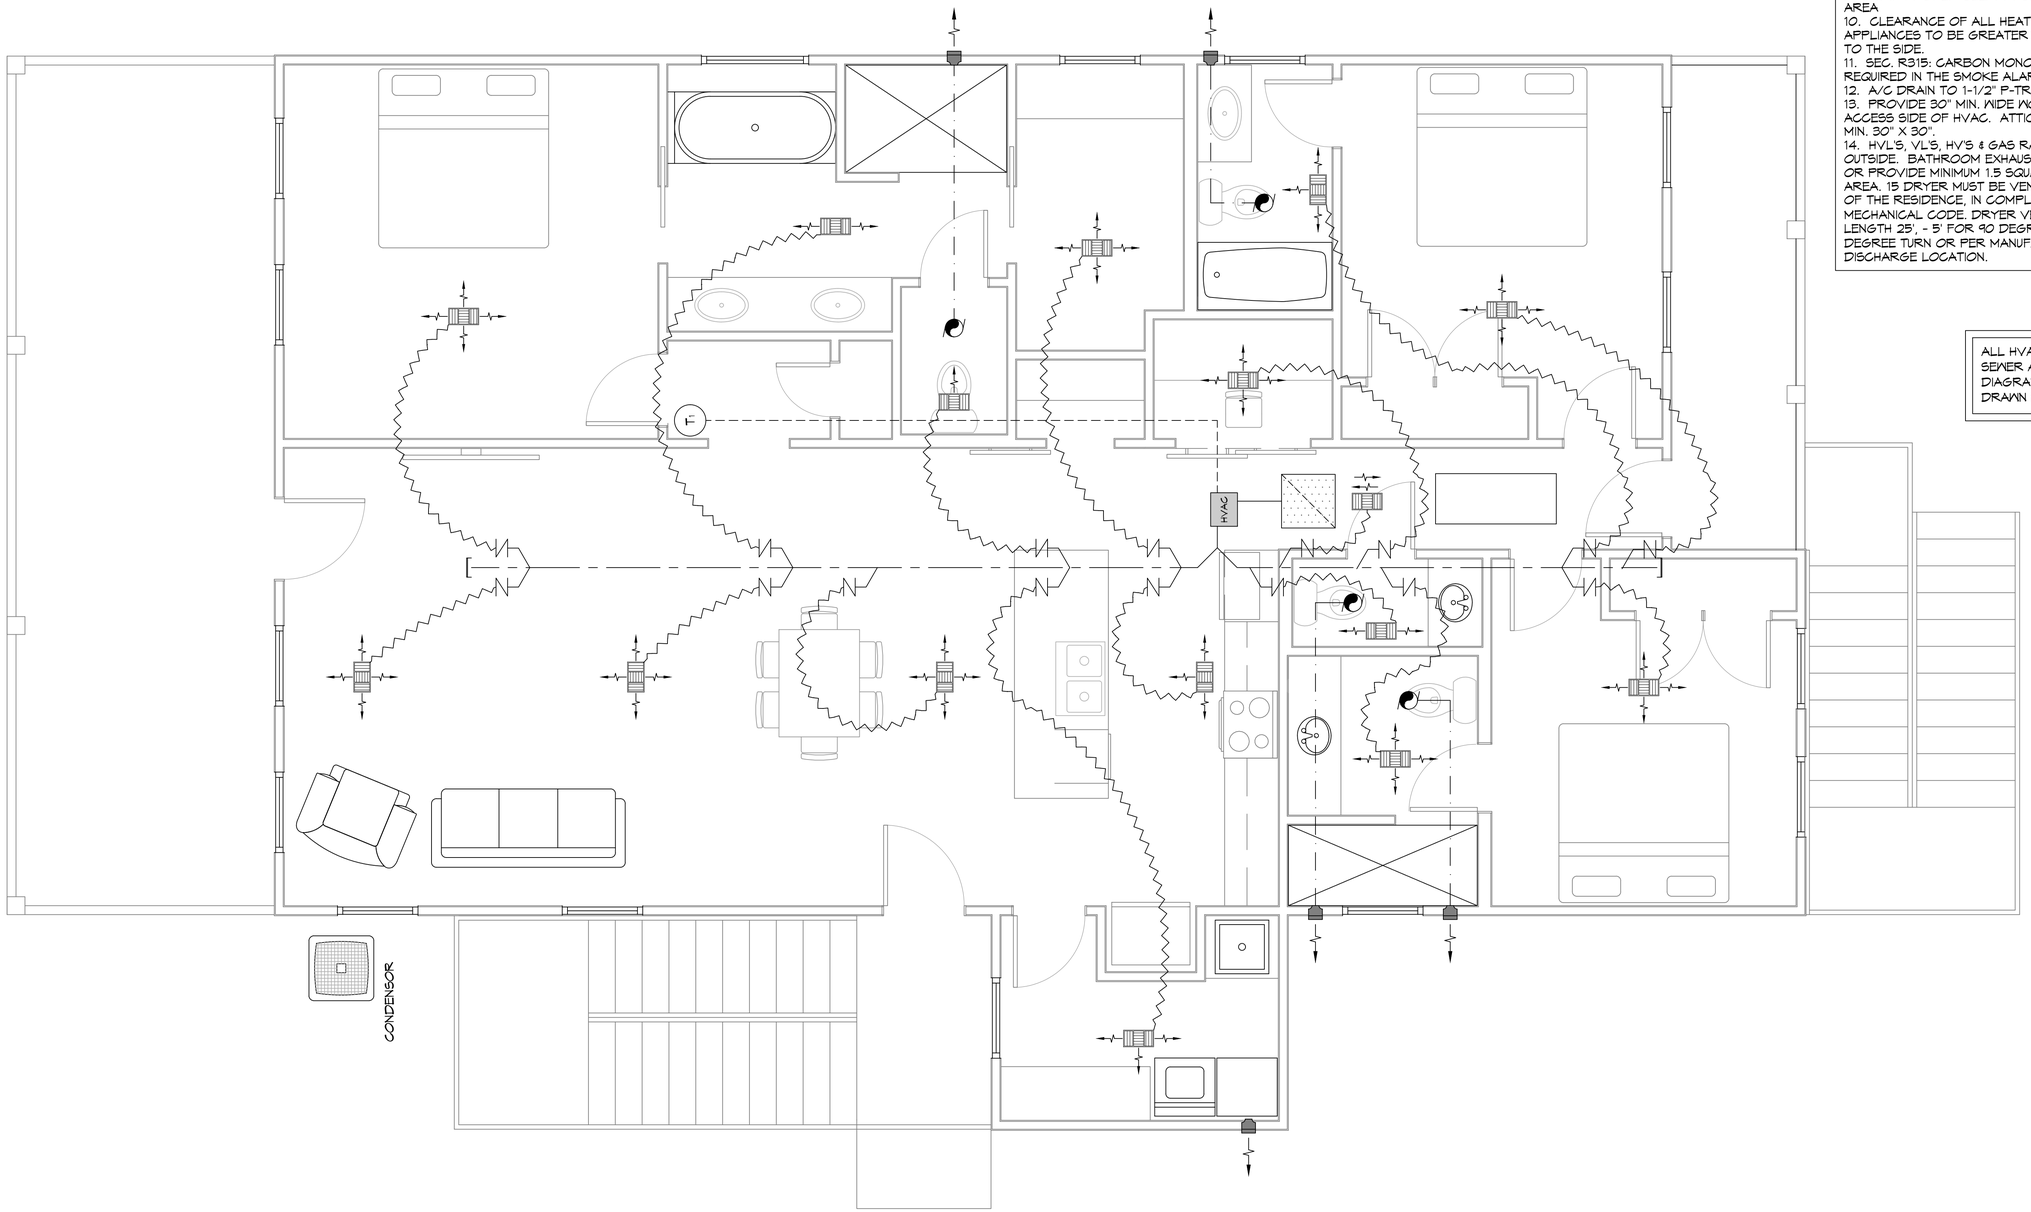

15 MECHANICAL PLAN
SCALE: 1/4" = 1'-0"

MECHANICAL LEGEND

- SUPPLY AIR GRILLE
- WALL LOUVER
- EXHAUST FAN
- RETURN AIR GRILLE

MECHANICAL NOTES

1. MECHANICAL SUBCONTRACTOR TO INSTALL HVAC SYSTEM, ACCORDING TO NATIONAL, STATE AND CITY CODE.
2. MECHANICAL SUBCONTRACTOR TO VERIFY HVAC DESIGN LOADS.
3. OWNER TO SELECT PLUMBING FIXTURES WITH CONTRACTOR.
4. DRAWINGS OF SYSTEM ARE SCHEMATIC AND SHOULD BE CONFIRMED BY SUBCONTRACTOR.
5. DUCTS AS SHOWN 26 GAUGE 6.1 INSULATE W/ 2" FIBERGLASS INSULATION. * MIN. DUCT SIZE 8" DIAMETER * MIN. DIFF. SIZE 10" DIAMETER WITH AIR VOLUME REG.
6. PLACE DAMPER CONTROLS IN ALL DUCT RUNS.
7. THERMOSTAT MIN. HONEYWELL. - WALL MOUNTED
8. MIN. CLEARANCE AT UNIT TO BE 4'-0".
9. PROVIDE 3/4" PLYWOOD, 24" MIN. WIDE CATWALK TO ALL MECHANICALS IN ATTIC. CATWALK - GREATER THAN 20' NEED 6' HEADROOM - MAX. 50' LENGTH. MAINTAIN PROPER CLEARANCE AT UNITS SERVICE AREA
10. CLEARANCE OF ALL HEAT PRODUCING APPLIANCES TO BE GREATER THAN 18" ABOVE OR 6" TO THE SIDE.
11. SEC. R315: CARBON MONOXIDE ALARMS - REQUIRED IN THE SMOKE ALARMS
12. A/C DRAIN TO 1-1/2" P-TRAP
13. PROVIDE 30" MIN. WIDE WORKING PLATFORM TO ACCESS SIDE OF HVAC. ATTIC DECKED WORK AREA MIN. 30" X 30".
14. HVL'S, VL'S, HV'S & GAS RANGE HOODS MUST VENT OUTSIDE. BATHROOM EXHAUST VENTS TO THE OUTSIDE OR PROVIDE MINIMUM 1.5 SQUARE FEET OPENABLE AREA. 15 DRYER MUST BE VENTED TO THE EXTERIOR OF THE RESIDENCE, IN COMPLIANCE WITH THE MECHANICAL CODE. DRYER VENT, LENGTH (MAX. LENGTH 25', - 5' FOR 90 DEGREE TURN, - 2.5' FOR 45 DEGREE TURN OR PER MANUFACTURER) AND DISCHARGE LOCATION.

ALL HVAC & SANITARY SEWER ARE DIAGRAMMATICALLY DRAWN FOR CLARITY.

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832
Chief Engineer: Brian Mistich, PE
554 Madisonville Trail
Slidell, LA 70458

#	DESCRIPTION	DATE

REVISIONS

SEAL:
STATE OF LOUISIANA
BRIAN A. MISTICH
License No. 30187
PROFESSIONAL ENGINEER

NEW HOUSE PLAN
JASON GUY
LOT 228
MONGA DRIVE, LAZY RIVER ESTATES,
COVINGTON, LOUISIANA 70433

JOB No:
DATE: 08-07-2025
DRAWN BY: GKD
CHECKED BY: BAM

These plans remain the property of Dammon Engineering, Inc. and are not to be used for any other project than that for which they have been prepared and developed without written consent of Dammon Engineering, Inc. Copyright 2025 Dammon Engineering, Inc. All rights reserved.

SHEET TITLE:
MECHANICAL & PLUMBING PLAN

DRAWING NUMBER:
M101

SHEET No: 11 of 12

FILE NAME: J:\-Foundations or Structural Only\Jason Guy\Current Drawings\M101 - Mechanical Plan.dwg PLOT DATE & TIME: Thursday, August 7, 2025 10:50:28 AM