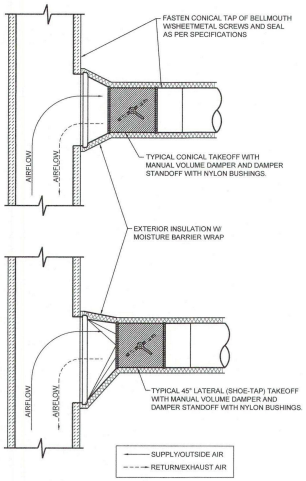

TYPICAL LOW PRESSURE RECTANGULAR TO ROUND DUCT TAKEOFF DETAIL

N.T.S.

NOTE:
TAKE-OFF FITTINGS SHALL BE FACTORY FABRICATED SPIN-IN TYPE. NO DOVETAIL FIELD JOINTS OR FITTINGS ARE ALLOWED.

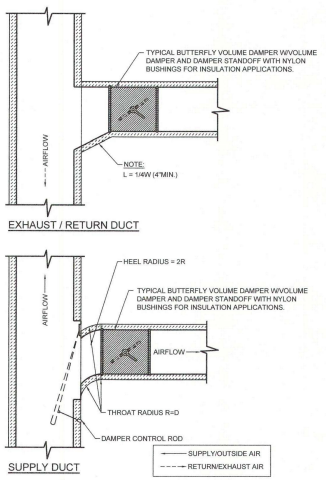

TYPICAL LOW PRESSURE RECTANGULAR TO RECTANGULAR DUCT TAKEOFF DETAIL

N.T.S.

NOTE:
TAKE-OFF FITTINGS SHALL BE FACTORY FABRICATED SPIN-IN TYPE. NO DOVETAIL FIELD JOINTS OR FITTINGS ARE ALLOWED.

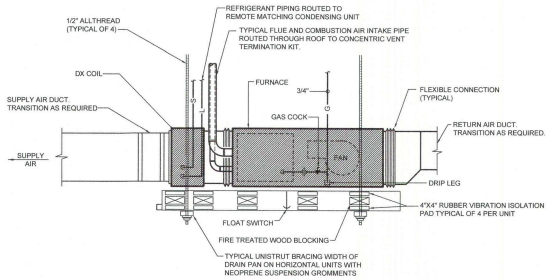

HORIZONTAL GAS FURNACE W/ DX COOLING DETAIL

N.T.S.

NOTES:
1. CONTRACTOR SHALL PROVIDE FLOAT SWITCH INSIDE DRAIN PAN TO DE-ENERGIZE UNIT WHEN ACTIVATED.

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
Ph: 985.649.5832
Chief Engineer: Brian Wolfolk, PE
LA# 44644 Board Certified
Slidell, LA 70458

REVISIONS

#	DESCRIPTION	DATE

SEAL:

NEW MEDICAL OFFICE
DIANA OAK HARBOR REAL ESTATE LLC
540 OAK HARBOR BLVD
SLIDELL, LA 70458

JOB No:	2513
DRAWN BY:	CKD
DATE:	05-16-2025
CHECKED BY:	BAM

The concepts and designs shown and described in these plans and specifications, including but not limited to, the layout of rooms, spaces and arrangement of buildings on the site, are the property of Dammon Engineering, Inc. and shall not be used in whole or in part for any other project without the written permission of Dammon Engineering, Inc. Any use of these plans and specifications for any other project, without the written permission of Dammon Engineering, Inc., shall be at the user's sole risk and without liability to Dammon Engineering, Inc. The user shall indemnify and hold Dammon Engineering, Inc. harmless from all claims, damages, losses, expenses, including attorney's fees arising out of or resulting therefrom.

SHEET TITLE:
MECHANICAL DETAILS

DRAWING NUMBER:
M4.1

SHEET No: 42 of 52