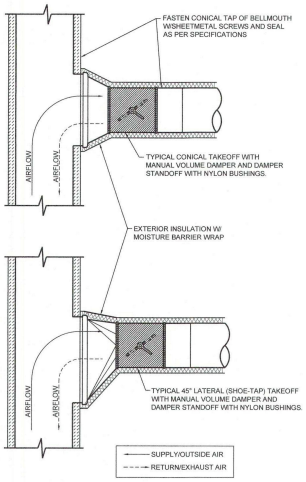

TYPICAL LOW PRESSURE RECTANGULAR TO ROUND DUCT TAKEOFF DETAIL

N.T.S.

NOTE:
TAKE-OFF FITTINGS SHALL BE FACTORY FABRICATED SPIN-IN TYPE. NO DOVETAIL FIELD JOINTS OR FITTINGS ARE ALLOWED.

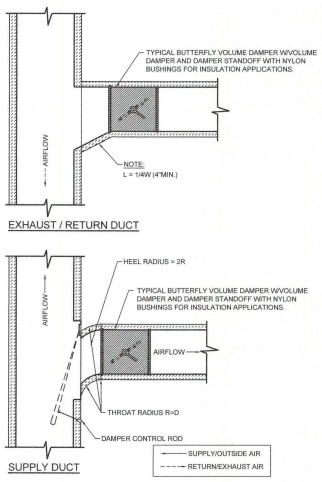

TYPICAL LOW PRESSURE RECTANGULAR TO RECTANGULAR DUCT TAKEOFF DETAIL

N.T.S.

NOTE:
TAKE-OFF FITTINGS SHALL BE FACTORY FABRICATED SPIN-IN TYPE. NO DOVETAIL FIELD JOINTS OR FITTINGS ARE ALLOWED.

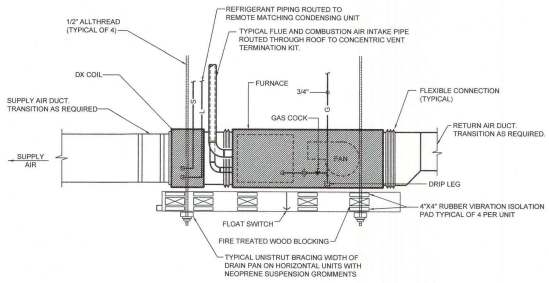

HORIZONTAL GAS FURNACE W/ DX COOLING DETAIL

N.T.S.

NOTES:
1. CONTRACTOR SHALL PROVIDE FLOAT SWITCH INSIDE DRAIN PAN TO DE-ENERGIZE UNIT WHEN ACTIVATED.

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
mike@dammonengineering.com
Ph: 985.649.5832
Chief Engineer: Brian Wistich, PE
Civil / MEP Engineer: Brian Wistich
Slidell, LA 70458

#	DESCRIPTION	DATE

REVISIONS

SEAL:

PROGRESS SET

NEW MEDICAL OFFICE
DIANA OAK HARBOR REAL ESTATE LLC
540 OAK HARBOR BLVD
SLIDELL, LA 70458

JOB No:	2513	DATE:	06-03-2025
DRAWN BY:	CKD	CHECKED BY:	BAM

These drawings are property of Dammon Engineering & are not to be reproduced or used for other projects without written permission. Dammon Engineering shall not be liable for any modifications made to these drawings without the written consent of Dammon Engineering.

SHEET TITLE:
MECHANICAL DETAILS

DRAWING NUMBER:

M4.1