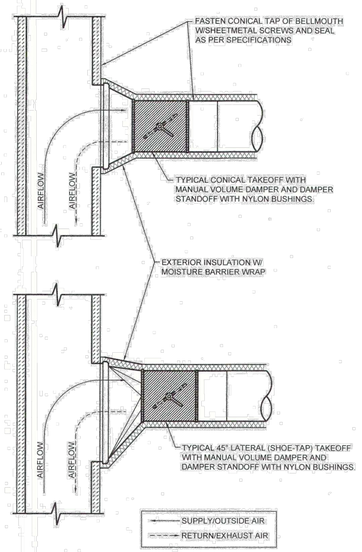

TYPICAL LOW PRESSURE RECTANGULAR TO ROUND DUCT TAKEOFF DETAIL

N.T.S.

NOTE:
TAKE-OFF FITTINGS SHALL BE FACTORY FABRICATED SPIN-IN TYPE. NO DOVETAIL FIELD JOINTS OR FITTINGS ARE ALLOWED.

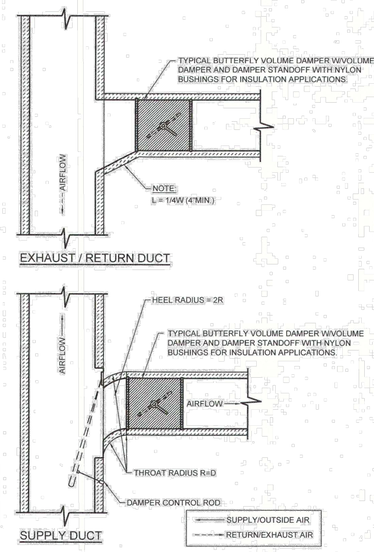

TYPICAL LOW PRESSURE RECTANGULAR TO RECTANGULAR DUCT TAKEOFF DETAIL

N.T.S.

NOTE:
TAKE-OFF FITTINGS SHALL BE FACTORY FABRICATED SPIN-IN TYPE. NO DOVETAIL FIELD JOINTS OR FITTINGS ARE ALLOWED.

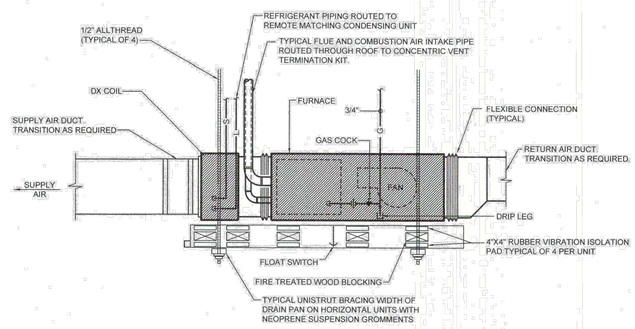

HORIZONTAL GAS FURNACE W/ DX COOLING DETAIL

N.T.S.

NOTES:
1. CONTRACTOR SHALL PROVIDE FLOAT SWITCH INSIDE DRAIN PAN TO DE-ENERGIZE UNIT WHEN ACTIVATED.

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammon-engineering.com
PH: 985.649.5832
Chief Engineer: Brian Mistich, PE
5540 Oak Harbor Trail
Slidell, LA 70458

#	DESCRIPTION	DATE
	REVISIONS	

SEAL:

NEW MEDICAL OFFICE
DIANA OAK HARBOR REAL ESTATE LLC
540 OAK HARBOR BLVD
SLIDELL, LA 70458

JOB No:	2513
DATE:	05-16-2025
DRAWN BY:	CKD
CHECKED BY:	BAM

THIS DRAWING IS AN INSTRUMENT OF SERVICE AND IS THE PROPERTY OF DAMMON ENGINEERING, INC. ALL RIGHTS ARE RESERVED. THE REPRODUCTION, ALTERATION OR USE OF THIS DRAWING FOR ANY PURPOSE NOT SPECIFICALLY AUTHORIZED BY DAMMON ENGINEERING, INC. IS PROHIBITED. THIS DRAWING IS PROVIDED FOR THE EXCLUSIVE USE OF THE CLIENT FOR THE PROJECT FOR WHICH IT WAS PREPARED AND BY ACCEPTANCE THEREOF THE CLIENT AGREES TO RETURN IT UPON REQUEST OF DAMMON ENGINEERING, INC. AND NOT TO REPRODUCE OR TRANSFER IT TO OTHERS FOR ANY OTHER PURPOSE OR PROJECT.

SHEET TITLE:
MECHANICAL DETAILS

DRAWING NUMBER:
M4.1