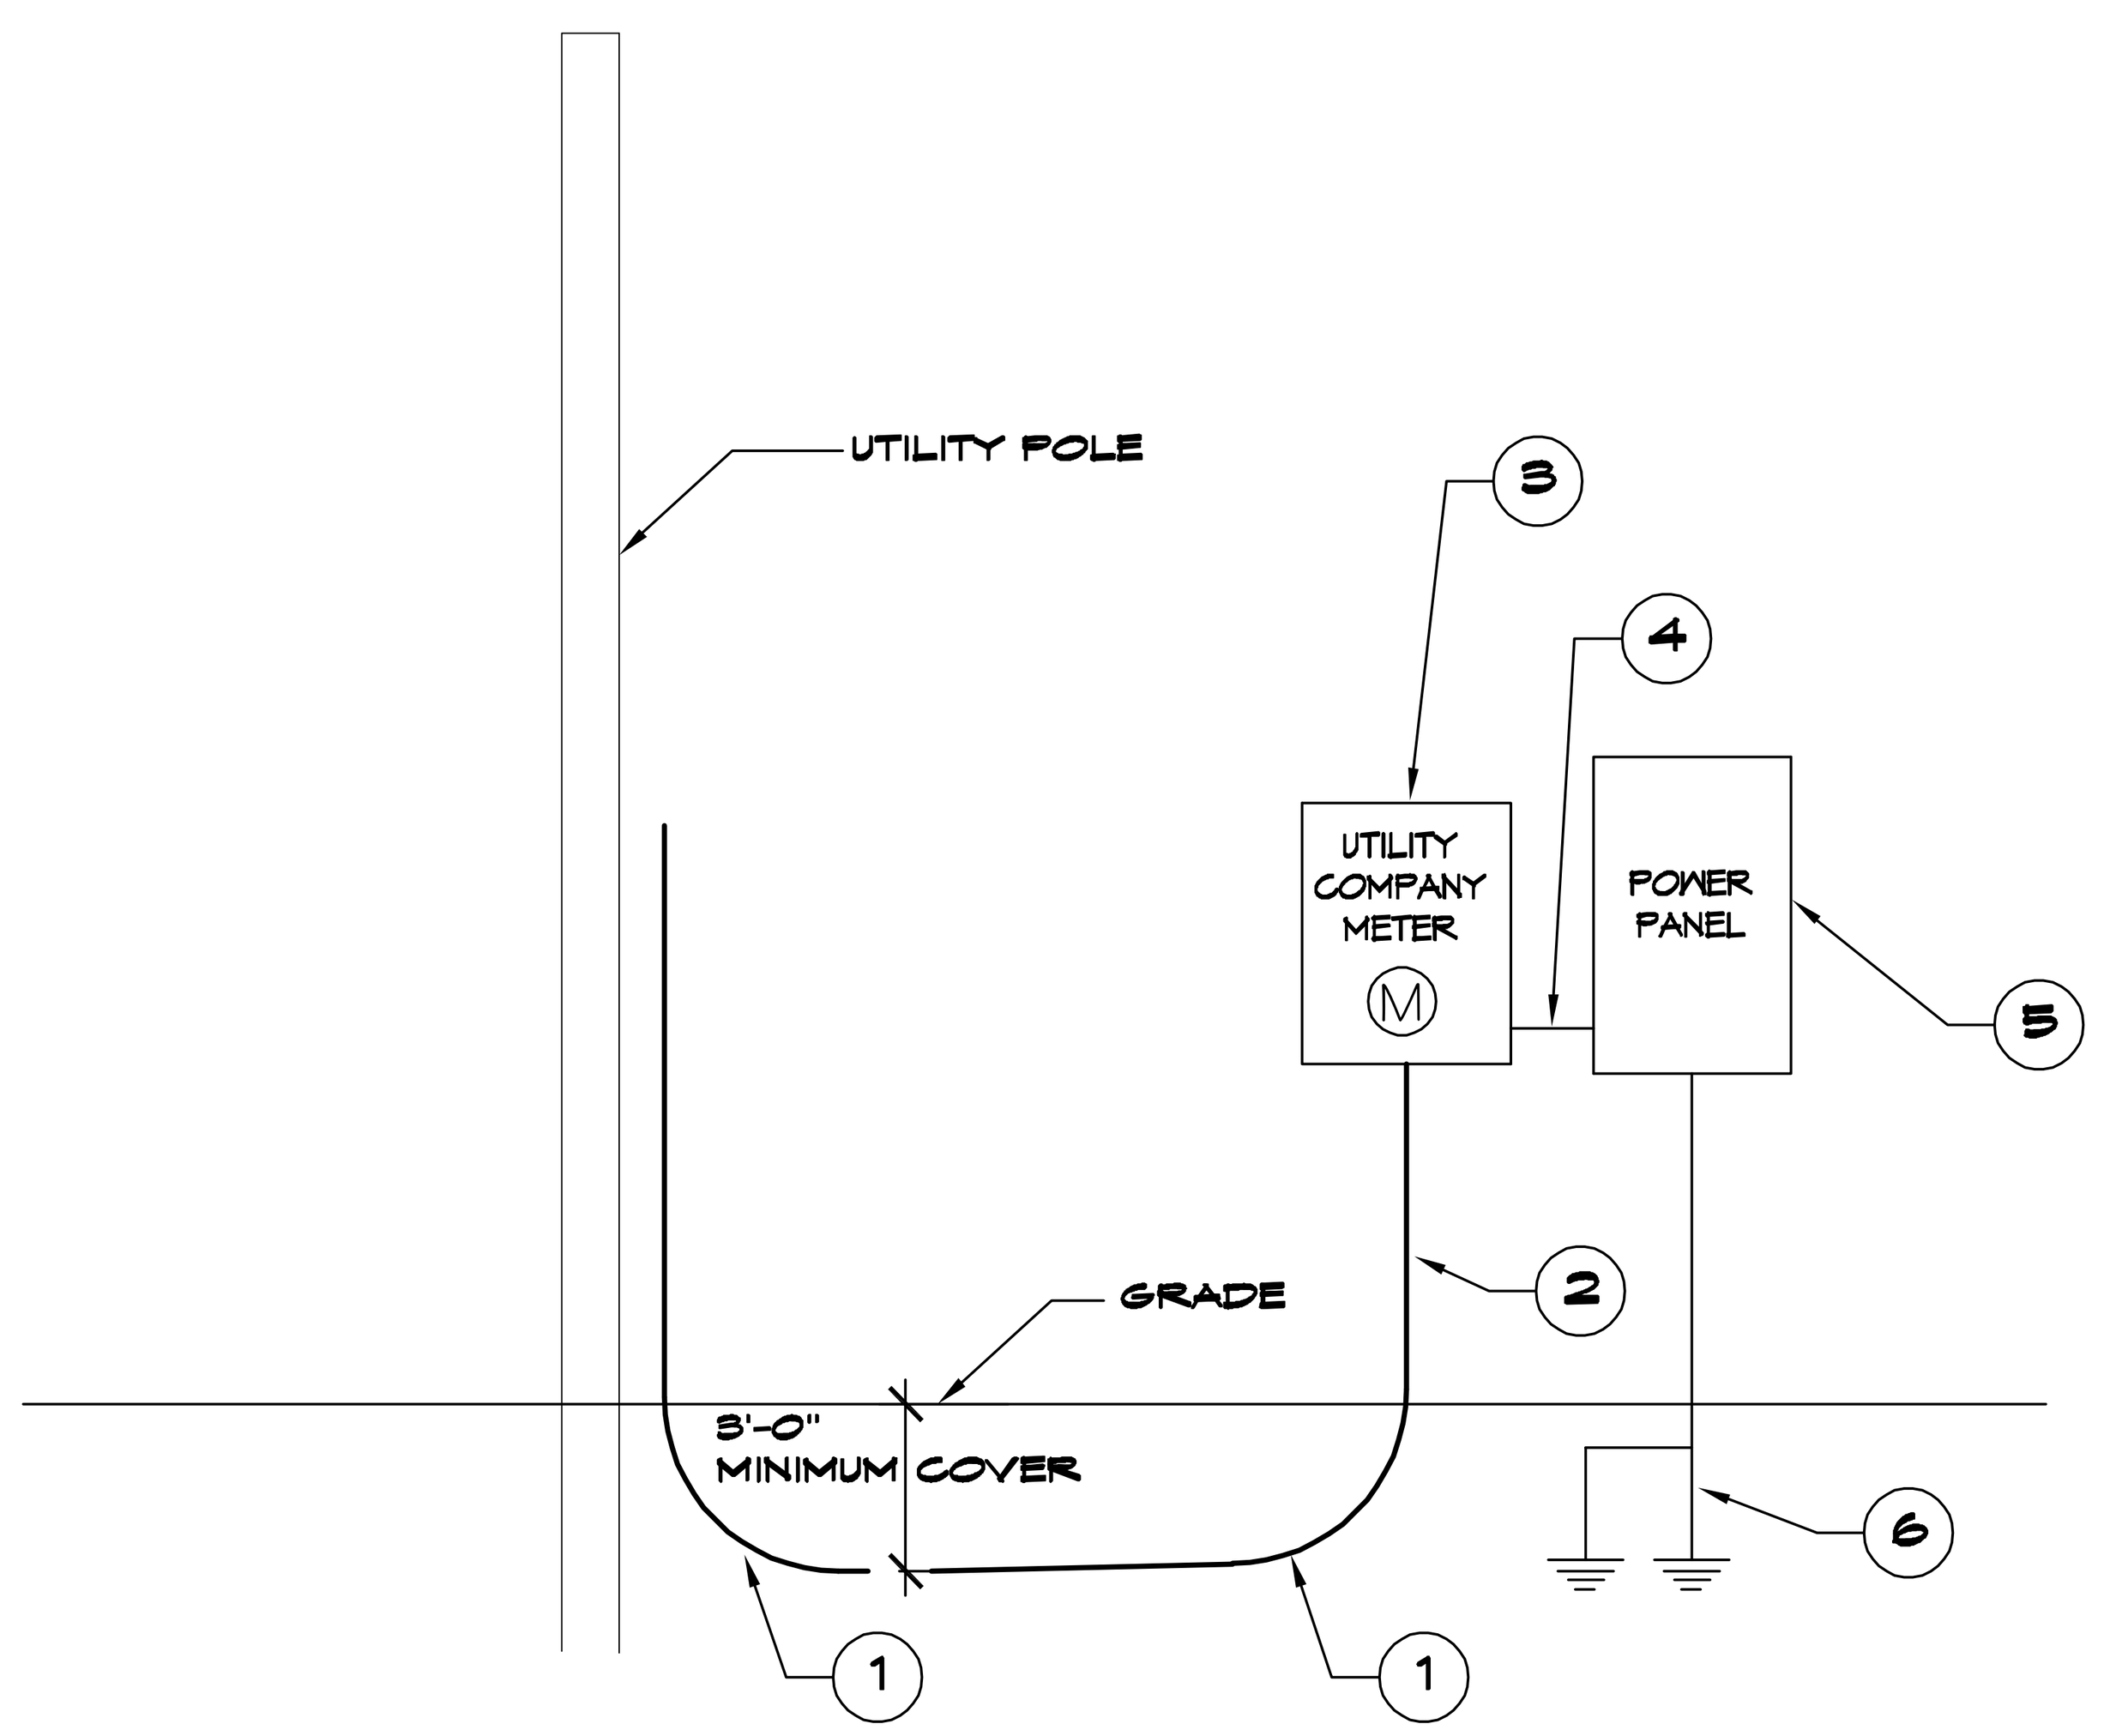

ONE LINE NOTES:

1. 36" LONG SWEEP ELBOW
2. PROVIDE TWO (2) 2 1/2" SCHEDULE 40 PVC CONDUIT BELOW GRADE AND SCH 80 PVC CONDUIT ABOVE GRADE WITH SUITABLE FISH WIRE.
3. 120/208V 3Φ 200 AMP METER PAN.
4. 4-4/0 THHN, 1-#2 GND, 2 1/2" C
5. 120/208V 3Φ 200A PANELBOARD WITH MAIN BREAKER.
6. 2-3/4" x 10' CU CLAD GND ROD, #2 CU GND WIRE. PROTECT IN PVC PIPE. CONNECT TO METAL BLDG, COLD WATER SUPPLY & GAS LINE. CAD WELD ALL CONNECTIONS.

35 ONE LINE DIAGRAM - NEW BUILDING
SCALE: N.T.S.

ELECTRICAL LOAD SUMMARY

POWER COMPANY: CLECO
PROJECT NAME: SEC - SPECIALTY ENHANCED IMAGING LARGE BUILDING
PROJECT ADDRESS: 429 SOUTH STREET
CITY TOWN: SLIDELL, LOUISIANA 70460
INTENDED USER: WAREHOUSE

REQUIRED SERVICE: 208/120 VOLTS 3 PHASE 4 WIRE
SERV ENTR SIZE: 400 AMPS
HVAC TONNAGE: 30 TONS
LARGEST MOTOR: HP
NOTE: MOTORS ABOVE 20 HP MAY REQUIRE REDUCED VOLTAGE STARTING AND ARE NEVER RECOMMENDED FOR USE WITH 240/120V, 1 PH, 3 W SERVICE

TOTAL BUILDING SQUARE FOOTAGE: 10250 S.F.
INDIVIDUAL UNIT SQUARE FOOTAGE: 0 S.F.
INDIVIDUAL UNIT DESIGNATION: (MULT OCCUPANCY)

LOAD SOURCE	1Φ KVA	3Φ KVA	OR	1Φ KW	3Φ KW
BUILDING LIGHTING				3.0	
ELECTRIC WATER HEATING				2.0	
HEAT PUMPS				4.4	
SUPPLEMENTAL HEAT SYSTEMS					0.0
AIR COND CONDENSING UNITS					31.0
ELEC HEATING (PRIMARY) AHU'S					20.0
COOKING				0.0	
REFRIGERATION				0.0	
RECEPTACLES (STANDARD)				9.0	
RECEPTACLES (COMPUTER)				0.0	
TOTAL MOTORS (EXCLUDE HVAC)				0.0	
EXTERIOR LIGHTING				1.0	
MISCELLANEOUS - CEILING FANS				6.0	
OTHER				65.0	22.5
TOTAL CONNECTED LOAD	0.0	0.0		90.4	73.5

ELECTRICAL LOAD SUMMARY

POWER COMPANY: CLECO
PROJECT NAME: SEC - SPECIALTY ENHANCED IMAGING SMALL BUILDING
PROJECT ADDRESS: 429 SOUTH STREET
CITY TOWN: SLIDELL, LOUISIANA 70460
INTENDED USER: WAREHOUSE

REQUIRED SERVICE: 208/120 VOLTS 1 PHASE 3 WIRE
SERV ENTR SIZE: 100 AMPS
HVAC TONNAGE: 6 TONS
LARGEST MOTOR: HP
NOTE: MOTORS ABOVE 20 HP MAY REQUIRE REDUCED VOLTAGE STARTING AND ARE NEVER RECOMMENDED FOR USE WITH 240/120V, 1 PH, 3 W SERVICE

TOTAL BUILDING SQUARE FOOTAGE: 2375 S.F.
INDIVIDUAL UNIT SQUARE FOOTAGE: 0 S.F.
INDIVIDUAL UNIT DESIGNATION: (MULT OCCUPANCY)

LOAD SOURCE	1Φ KVA	3Φ KVA	OR	1Φ KW	3Φ KW
BUILDING LIGHTING				0.8	
ELECTRIC WATER HEATING				0.0	
HEAT PUMPS				0.0	
SUPPLEMENTAL HEAT SYSTEMS				0.0	
AIR COND CONDENSING UNITS				5.6	
ELEC HEATING (PRIMARY) AHU'S				7.2	
COOKING				0.0	
REFRIGERATION				0.0	
RECEPTACLES (STANDARD)				2.2	
RECEPTACLES (COMPUTER)				0.0	
TOTAL MOTORS (EXCLUDE HVAC)				0.0	
EXTERIOR LIGHTING				0.0	
MISCELLANEOUS - CEILING FANS				0.0	
OTHER				0.0	
TOTAL CONNECTED LOAD	0.0	0.0		15.8	0.0

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832

REVISIONS
#	DESCRIPTION	DATE

SEAL:
STATE OF LOUISIANA
BRIAN A. MISTICH
License No. 30187
PROFESSIONAL ENGINEER

NEW WAREHOUSES
SEC-SPECIALITY ENHANCED IMAGING
429 SOUTH STREET
SLIDELL, LA 70460

JOB No: 2449 DATE: 08-21-2025
DRAWN BY: DD/JTL CHECKED BY: BAM

SHEET TITLE:
SERVICE ENTRANCE DIAGRAM & LOAD SUMMARIES

DRAWING NUMBER:
E106

SHEET No: 16 of 16