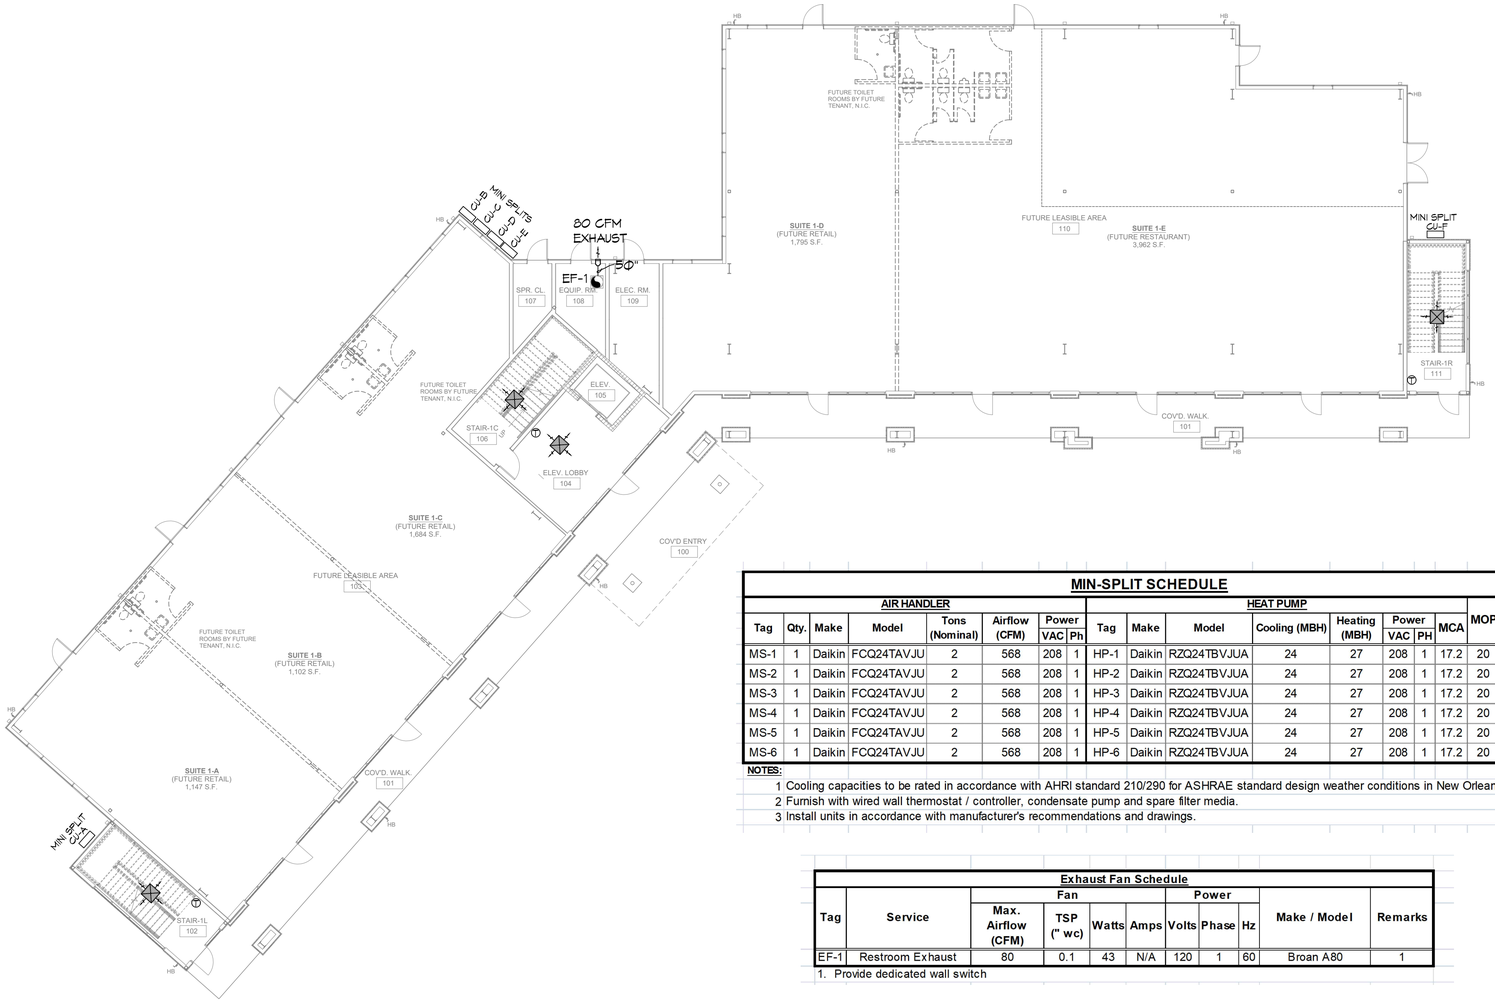

20 FIRST FLOOR MECHANICAL PLAN

SCALE: 3/32"=1'-0"

MIN-SPLIT SCHEDULE

AIR HANDLER								HEAT PUMP										
Tag	Qty.	Make	Model	Tons (Nominal)	Airflow (CFM)	Power VAC	Power Ph	Tag	Make	Model	Cooling (MBH)	Heating (MBH)	Power VAC	Power PH	MCA	MOP	Remarks
MS-1	1	Daikin	FCQ24TAVJU	2	568	208	1	HP-1	Daikin	RZQ24TBVJUA	24	27	208	1	17.2	20	1, 2, 3
MS-2	1	Daikin	FCQ24TAVJU	2	568	208	1	HP-2	Daikin	RZQ24TBVJUA	24	27	208	1	17.2	20	1, 2, 3
MS-3	1	Daikin	FCQ24TAVJU	2	568	208	1	HP-3	Daikin	RZQ24TBVJUA	24	27	208	1	17.2	20	1, 2, 3
MS-4	1	Daikin	FCQ24TAVJU	2	568	208	1	HP-4	Daikin	RZQ24TBVJUA	24	27	208	1	17.2	20	1, 2, 3
MS-5	1	Daikin	FCQ24TAVJU	2	568	208	1	HP-5	Daikin	RZQ24TBVJUA	24	27	208	1	17.2	20	1, 2, 3
MS-6	1	Daikin	FCQ24TAVJU	2	568	208	1	HP-6	Daikin	RZQ24TBVJUA	24	27	208	1	17.2	20	1, 2, 3

NOTES:

1 Cooling capacities to be rated in accordance with AHRI standard 210/290 for ASHRAE standard design weather conditions in New Orleans, LA.
2 Furnish with wired wall thermostat / controller, condensate pump and spare filter media.
3 Install units in accordance with manufacturer's recommendations and drawings.

Exhaust Fan Schedule

Tag	Service	Fan: Max. Airflow (CFM)	Fan: TSP (" wc)	Fan: Watts	Fan: Amps	Power: Volts	Power: Phase	Power: Hz	Make / Model	Remarks
EF-1	Restroom Exhaust	80	0.1	43	N/A	120	1	60	Broan A80	1

1. Provide dedicated wall switch

GENERAL HVAC NOTES

1. CONCEALED DUCTWORK TO BE GALVANIZED SHEET METAL WRAPED WITH FIBROUS GLASS DUCT WRAP WITH FSK VAPOR BARRIER, MIN R-6. INSTALLED PER SMACNA STANDARDS. DUCT WORK IMMEDIATELY DOWNSTREAM FROM RTU SHALL BE LINED FOR SOUND ATTENUATION.
2. EXPOSED DUCTWORK TO BE GALVANIZED SHEET METAL LINED WITH FIBROUS GLASS DUCT LINER, MIN R-6. INSTALLED PER SMACNA STANDARDS.
3. ROUND FLEXIBLE DUCT TO BE UL-181, CLASS 1, AIR DUCT MATERIALS.
4. DUCT SIZES SHOWN ARE CLEAR INSIDE DIMENSIONS.
5. IN ALL SYSTEMS OVER 2000 CFM AND LESS THAN 15,000 CFM, SMOKE DETECTORS SHALL BE INSTALLED IN ACCORDANCE WITH NFPA 72E IN THE RETURN DUCT DOWNSTREAM OF THE AIR HANDLING UNIT AND ALL FILTERS TO AUTOMATICALLY STOP THE FAN.
6. PROVIDE UL LISTED 125 °F FIRESTAT IN RETURN AIR OF EACH SYSTEM UNDER 2000 CFM TO SHUT DOWN THE FAN IN THE EVENT OF FIRE.
7. PROVIDE UL RATED FIRE DAMPERS WHERE REQUIRED AT ALL DUCT PENETRATIONS OF FIRE-RATED ASSEMBLIES AND WHERE REQUIRED BY CODE, INCLUDING OUTSIDE AIR INTAKES AND EXHAUST FANS.
8. CONDENSATE DRAINS TO BE PVC PIPE RUN TO PLUMBERS P-TRAP WITHIN FIVE FEET OF AIR HANDLING UNITS.
9. ALL AIR HANDLING SYSTEMS TO BE BALANCED TO ASSURE PROPER AIR FLOWS PER PLANS.
10. ALL THERMOSTATS TO BE AUTOMATIC CHANGEOVER WITH HEAT SWITCH.
11. EXHAUST FAN SHALL BE CONTROLLED BY A SWITCH ON THE WALL IN THE SAME LOCATION AS LIGHT SWITCH(S). PROVIDE BACK DRAFT DAMPER.
12. PROVIDE AND INSTALL WATER PROOF GRILLE VENT IN PROPER ROOF LOCATION FOR PLUMBING FIXTURE EXHAUST.
13. ALL SUPPLY AIR VENTS SHALL BE EQUIPPED WITH AIR CONTROL DAMPERS AT THE REGISTER.
14. LOCATE OUTDOOR UNITS AS SHOWN ON ARCHITECTURAL DRAWINGS.
15. REFRIGERANT LINES SHALL BE SIZED BY UNIT MANUFACTURER AND INSTALLED ACCORDING TO MANUFACTURER'S INSTRUCTIONS.
16. FRESH AIR SHALL BE SUPPLIED TO EACH AIR HANDLER THROUGH EXTERIOR WALL DUCT SUPPLIED WITH A CONTROL DAMPER.
17. ALL ELECTRICAL, MECHANICAL, AND PLUMBING PENETRATING FIRE WALLS SHALL BE FIRE CAULKED. (PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM-E8-14).
18. ALL MECHANICAL SYMBOLS ARE DRAWN DIAGRAMMATICALLY, CONTRACTOR TO VERIFY WITH OWNER LOCATIONS OF VENTS, DAMPERS, REGISTERS, ETC.
19. FLEXIBLE DUCTWORK LENGTH NOT TO EXCEED 12'-0", SUPPORT FLEX DUCT TO PREVENT SAGGING
20. REFER TO REFLECTED CEILING PLAN FOR FINAL GRILLE AND DIFFUSER LOCATIONS AND COORDINATE AS REQUIRED.
21. FINAL LOCATION OF TEMPERATURE CONTROLS TO BE COORDINATED WITH OWNER AT JOB SITE.
22. PROVIDE AND INSTALL SMOKE DETECTORS AS APPROVED BY LOCAL AHJS. PLACE NEAR R/A AND S/A OPENINGS OF AHU AND PROVIDE, WITH ACCESS PANEL, WIRING BY ELECTRICAL CONTRACTOR.
23. FRESH AIR INTAKES ARE REQUIRED TO HAVE MOTORIZED OR GRAVITY DAMPERS TO SHUT OFF WHEN SYSTEM IS NOT RUNNING.
24. PROVIDE BIRD SCREENS AT ALL EXTERIOR MECHANICAL PENETRATIONS.
25. COORDINATE WALL MOUNTED THERMOSTAT LOCATIONS WITH ALL OWNER FURNISHED ITEMS EITHER WALL MOUNTED OR FLOOR MOUNTED AGAINST PARTITIONS. REFER TO ARCHITECTURAL DRAWINGS.
26. SEE ROOF PLAN FOR ALL ROOF PENETRATIONS.
27. PROVIDE MIN 18 GA GALVANIZED SHEET METAL TO BLANK-OFF GABLE VENTS WHERE INTAKE/EXHAUST DUCTS OCCUR.

MECHANICAL LEGEND

24"X24" 4-WAY SUPPLY AIR CASSETTE

T THERMOSTAT

MINI SPLIT

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832
Chief Engineer: Brian Mistich, PE
15476 Crossroads Trail
Slidell, LA 70458

REVISIONS

#	DESCRIPTION	DATE

SEAL:

MIXED USE DEVELOPMENT
1-10 SOUTH SERVICE ROAD
METAIRIE LOUISIANA

DATE: 01-08-2025
JOB No:
DRAWN BY: CKD
CHECKED BY: BAM

THESE DRAWINGS ARE AN INSTRUMENT OF SERVICE AND ARE THE PROPERTY OF DAMMON ENGINEERING, INC. AND SHALL REMAIN THE PROPERTY OF DAMMON ENGINEERING, INC. AND SHALL NOT BE USED, REPRODUCED OR PUBLISHED WITHOUT WRITTEN CONSENT OF DAMMON ENGINEERING, INC. THE REPRODUCTION OF THESE DRAWINGS, IN WHOLE OR IN PART, WITHOUT WRITTEN CONSENT OF DAMMON ENGINEERING, INC. IS PROHIBITED. THE DRAWINGS AND SPECIFICATIONS CONTAINED HEREIN ARE THE PROPERTY OF DAMMON ENGINEERING, INC. AND SHALL BE RETURNED UPON REQUEST. THE WORK SHOWN HERE WAS PREPARED AND SUPERVISED WITHOUT AN ACTUAL CHANGE OF OWNERSHIP OF THE PROPERTY. THE PLANS HAVE BEEN PREPARED AND SUPERVISED WITHOUT AN ACTUAL CHANGE OF OWNERSHIP OF THE PROPERTY.

SHEET TITLE:
FIRST FLOOR MECHANICAL PLAN

DRAWING NUMBER:
M101

SHEET No: 4 of 15

FILE NAME: J:\- Offices\Dwng Bases Stds\Current Drawings\M101 - First Floor Mechanical Plan.dwg PLOT DATE & TIME: Wednesday, January 8, 2025 12:48:22 PM