
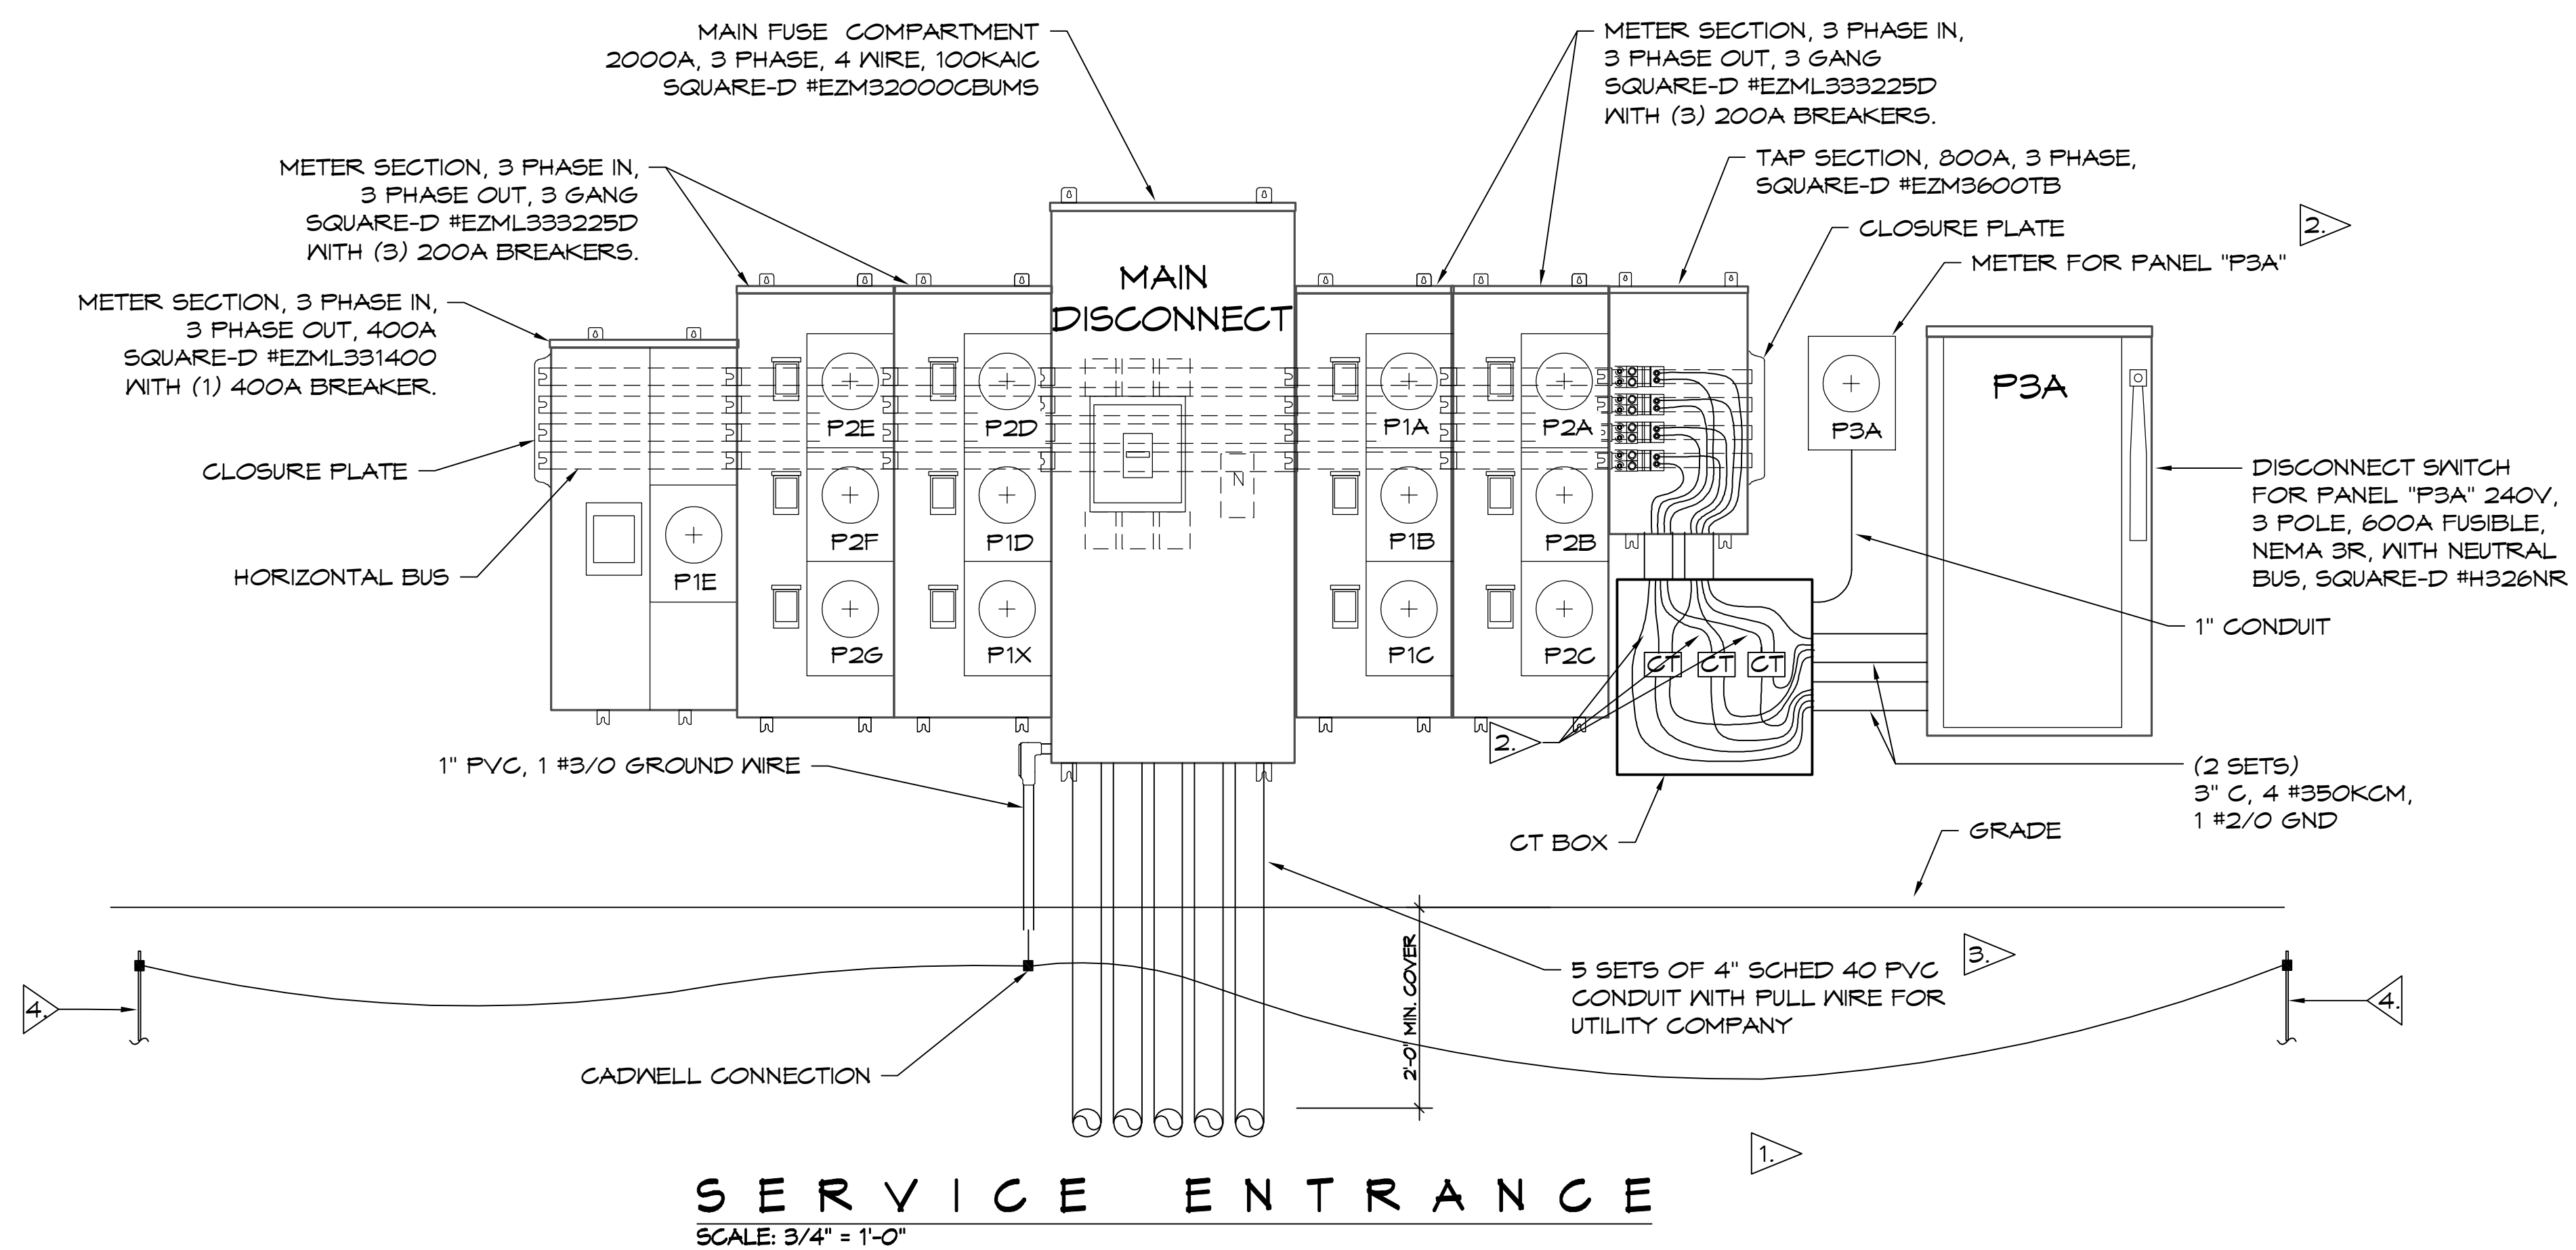


DATE: 01/09/2025, 11:23 AM, PROJECT: 2025-01-09, DRAWING: E109, SHEET: 15 OF 15, SCALE: 3/4" = 1'-0", TITLE: RISER DIAGRAM SERVICE ENTRANCE

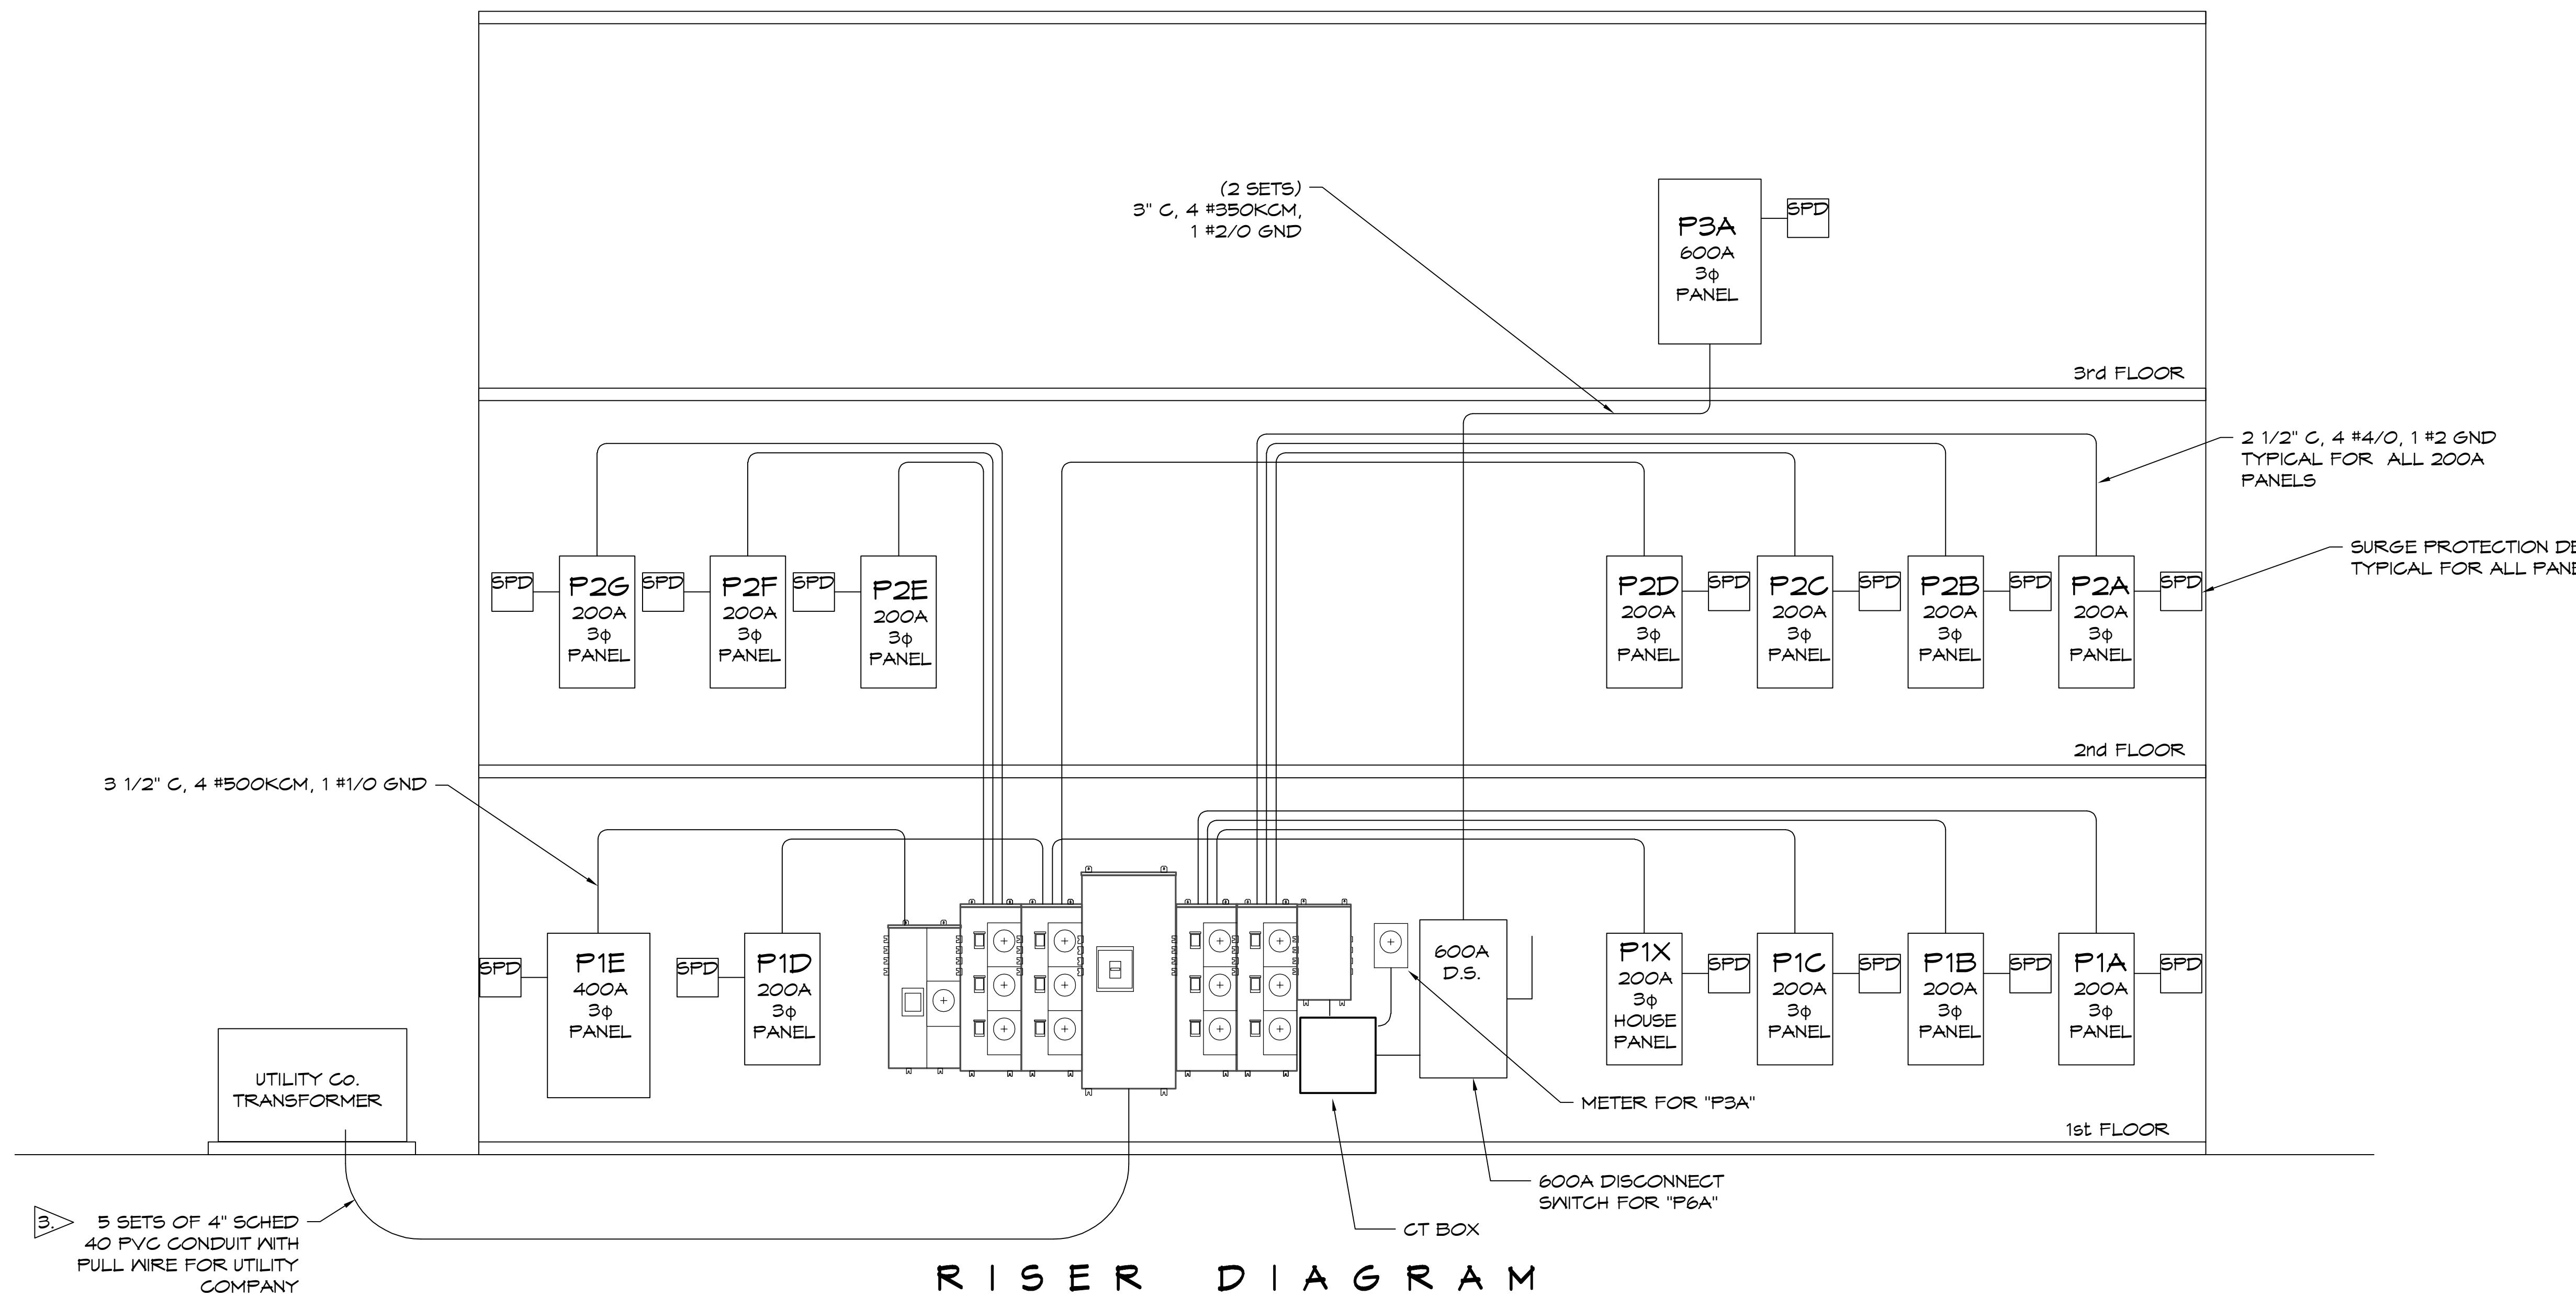

- NOTES:**
1. BEFORE PURCHASING EQUIPMENT AND STARTING WORK, THE CONTRACTOR SHALL CONTACT ENTERGY TO COORDINATE THE INSTALLATION. ALL WORK SHALL CONFORM TO THE LATEST EDITION OF THE ENTERGY CUSTOMER SERVICES STANDARDS AND THE NATIONAL ELECTRIC CODE.
 2. UTILITY COMPANY TO PROVIDE CURRENT TRANSFORMERS, METER AND METER ENCLOSURE. CONTRACTOR TO PROVIDE METER ENCLOSURE AND INSTALL EQUIPMENT.
 3. VERIFY CONDUIT SIZE AND QUANTITY WITH UTILITY COMPANY BEFORE PURCHASING MATERIAL.
 4. 3/4" X 10' LONG COPPER CLAD GROUND ROD. CONNECT TO COLD WATER PIPE, AND BUILDING STEEL PER NEC 250.
 5. SIDE MOUNTED SURGE PROTECTION DEVICE (SPD), 208/120V Y EATON #SP1-208Y. INSTALL PER NEC 242.

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI

Chief Engineer: Brian Metch, PE
554 Old Spanish Trail
Slidell, LA 70468
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.3822

#	DESCRIPTION	DATE

REVISIONS

SEAL:

MIXED USE DEVELOPMENT

110 SOUTH SERVICE ROAD
METAIRIE LOUISIANA

DATE: 01-09-2025
JOB NO:
DRAWN BY:
CHECKED BY:

E109

SHEET No: 15 of 15