

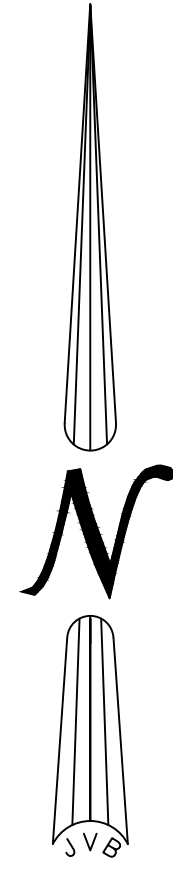


PLOT MAP - 11-1-2023 (2023) - 11-1-2023 (2023) - 11-1-2023 (2023) - 11-1-2023 (2023) - 11-1-2023 (2023) - 11-1-2023 (2023) - 11-1-2023 (2023) - 11-1-2023 (2023) - 11-1-2023 (2023) - 11-1-2023 (2023)

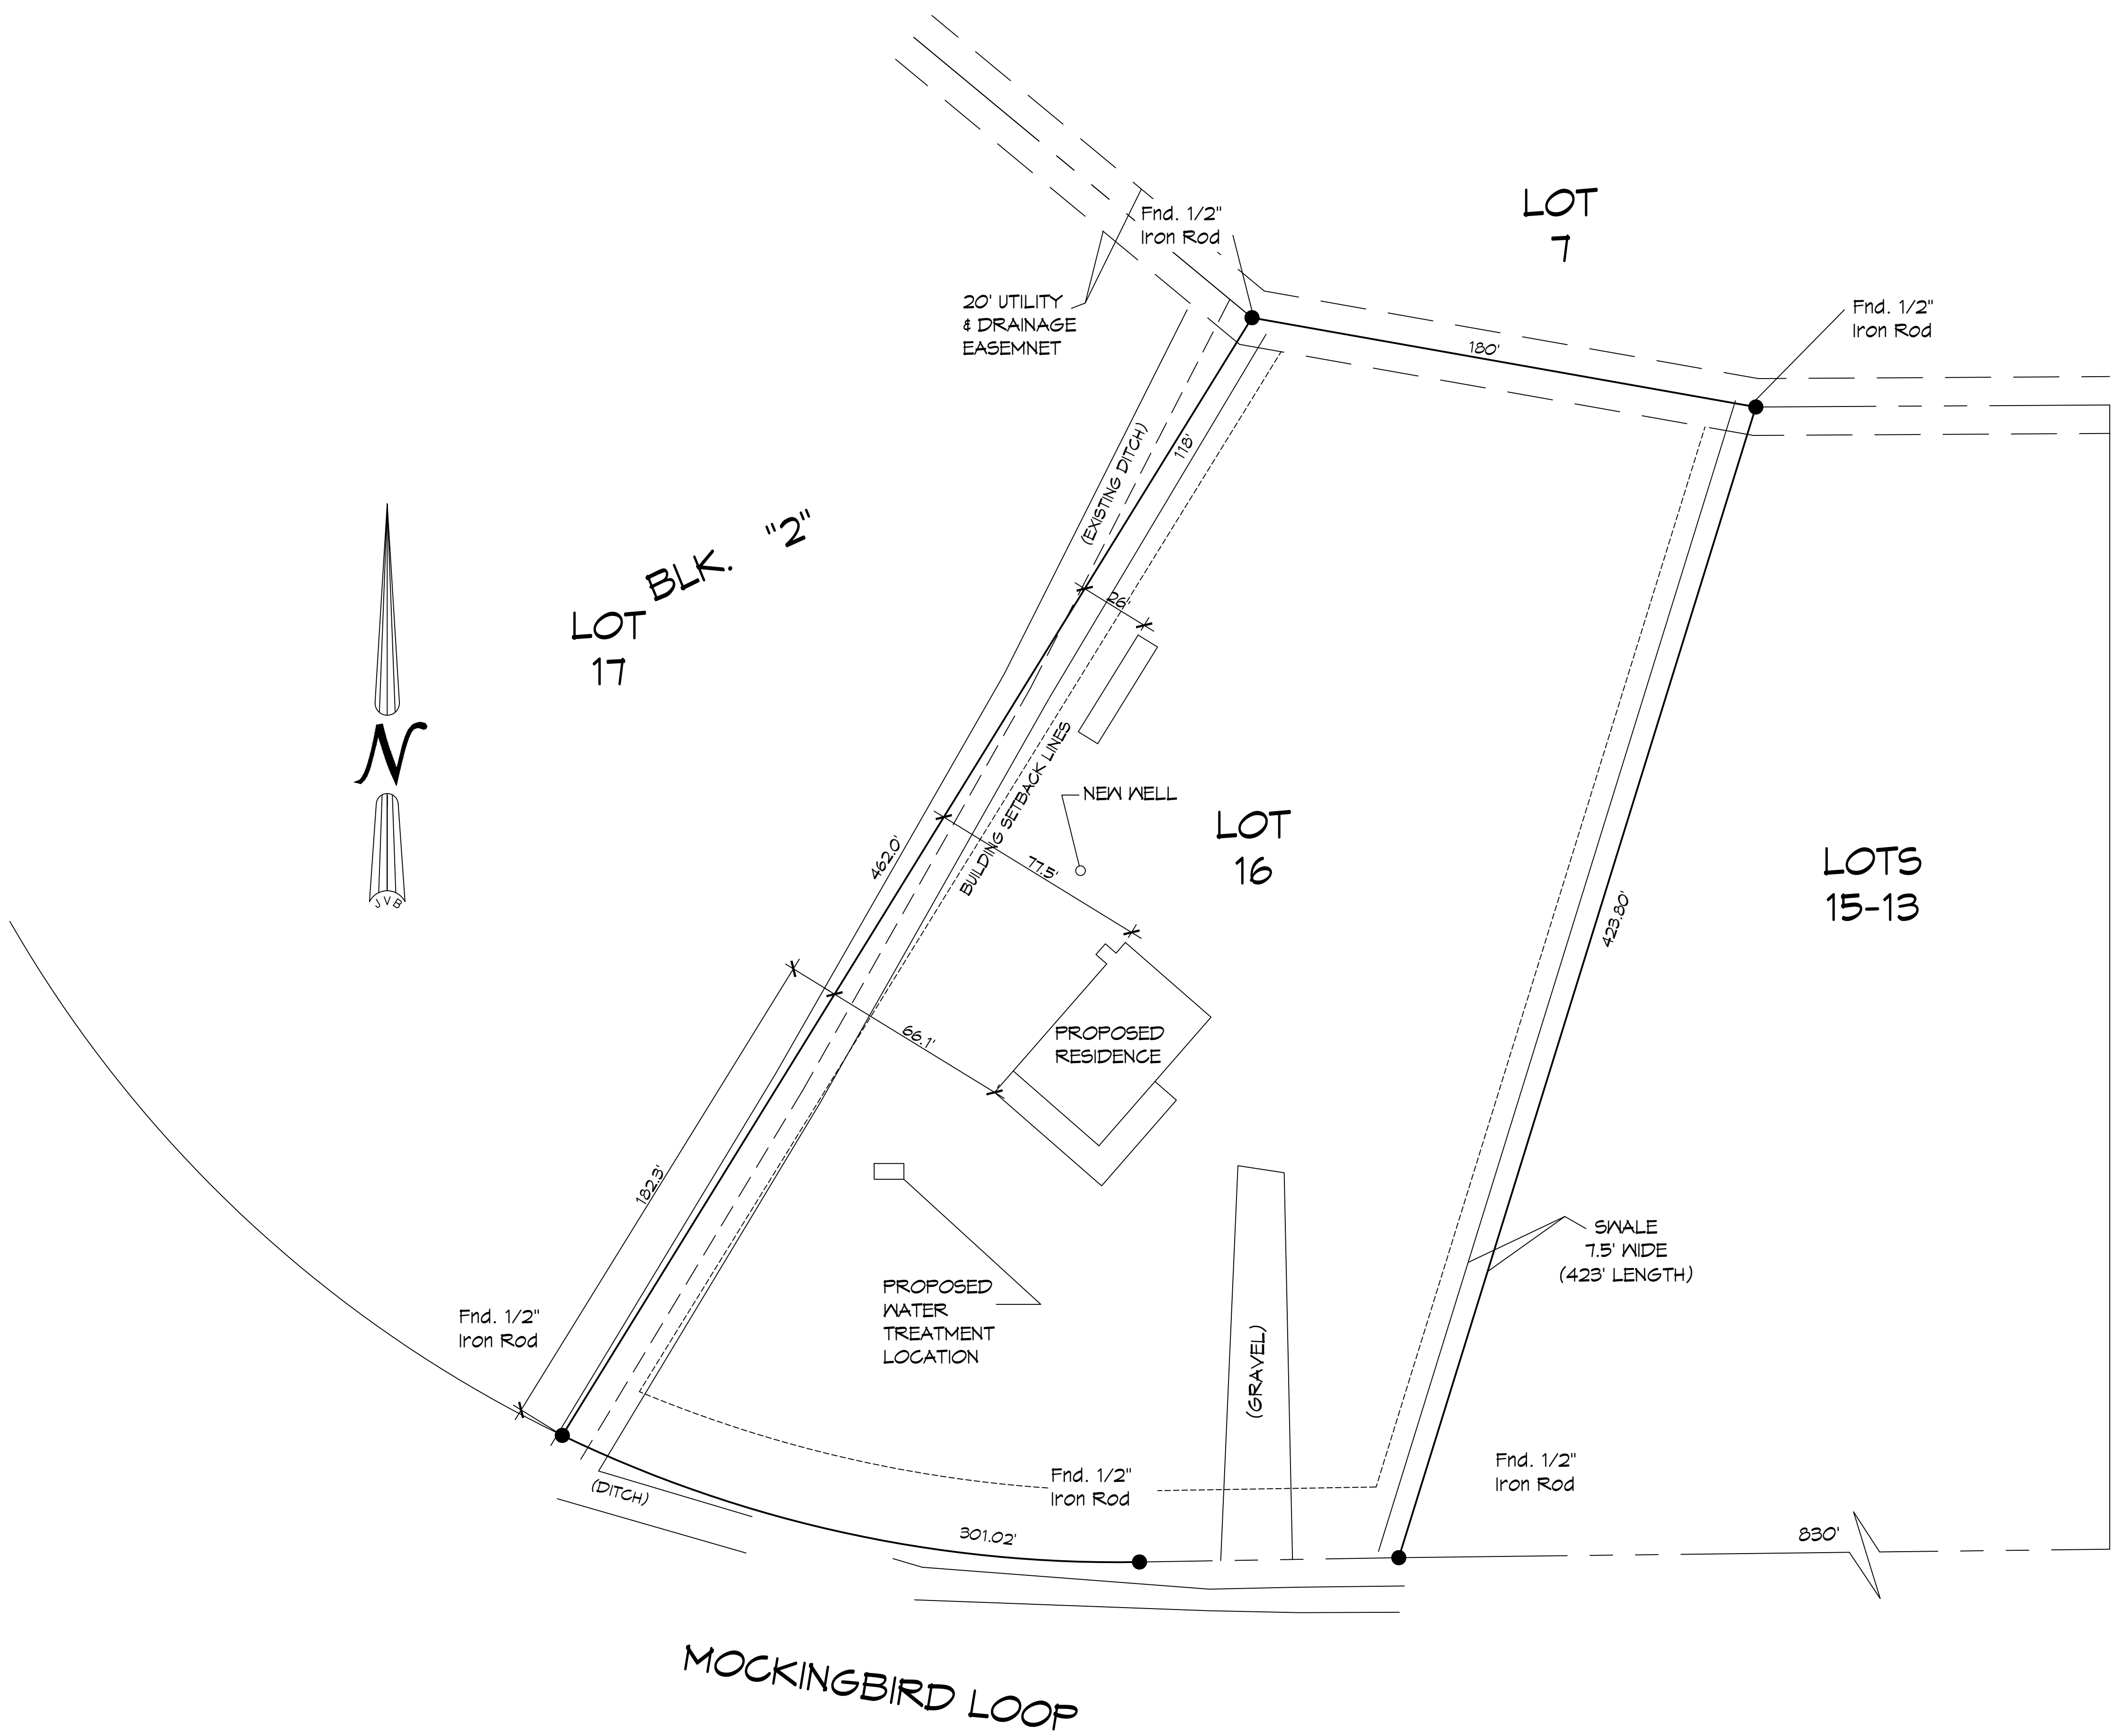

1 PROPOSED SITE PLAN

SCALE: 1/32" = 1'-0"

ZONING	
RESIDENTIAL DISTRICT	
FLOOD ZONE	
ZONE: A	
BUILDING ELEVATION	
FINISHED FLOOR ELEVATION - 46'	
SQUARE FEET	
LIVING	1320
PORCH	825
GARAGE	1080
TOTAL SQ. FT.	3225

LEGEND	
—————	PROPERTY LINE
- - - - -	SETBACK LINE

DESIGN CRITERIA
 THE CONSTRUCTION FOR SAID RESIDENCE, WHERE WIND SPEED IS 140 MILES PER HOUR, WIND EXPOSURE ZONE B, IS DESIGNED IN ACCORDANCE WITH: AMERICAN FOREST AND PAPER ASSOCIATION (AF&PA) WOOD FRAME CONSTRUCTION MANUAL FOR ONE AND TWO FAMILY DWELLINGS (WFCM) 2001 EDITION AS WELL AS THE INTERNATIONAL RESIDENTIAL CODE (IRC) 2021 EDITION

NOTES
 BUILDING SETBACKS (* VERIFY PRIOR TO CONSTRUCTION)
 FRONT SETBACK.....25'
 SIDE SETBACK.....15'
 REAR SETBACK.....*

SHEET INDEX	
SHEET #	SHEET TITLE
C101	SITE PLAN
S101	FRAMING SECTION
S102	TYPICAL CONNECTION DETAILS, SCHEDULES, AND NOTES
A101	FLOOR PLAN
A102	ELEVATION PLAN
P101	PLUMBING PLAN & PLUMBING RISER
M101	MECHANICAL PLAN
E101	ELECTRICAL LIGHTING PLAN
E102	ELECTRICAL POWER PLAN

DAMMON ENGINEERING, INC.
 LOUISIANA & MISSISSIPPI
 Chief Engineer: Brian Mistich, PE
 554 Old Spanish Trail
 Slidell, LA 70458
 www.dammonengineering.com
 info@dammonengineering.com
 PH: 985-649-5832

REVISIONS	DATE	DESCRIPTION



HOUSE PLAN
SARGELA AFENH
 35165 MOCKINGBIRD LOOP
 PEARL RIVER, LA, 70452
 JOB No: _____
 DATE: 10-29-2023
 DRAWN BY: LJP
 CHECKED BY: CKD

SHEET TITLE:
 PROPOSED SITE PLAN
 DRAWING NUMBER:
C101
 SHEET No: 1 of 1

TABLE S601.7 - UPLIFT CONNECTIONS - 140 MPH WINDS EXP "B"
NFCM 2015 TABLE 3.2

CONNECTION	FRAMING SPACING (INCHES)	ROOF SPAN (FEET)	UPLIFT	LATERAL	SHEAR	NUMBER OF 8d COMMON NAILS OR 10d BOX NAILS IN EACH END OF 1-1/4" X 20 GAGE STRAP
ROOF ASSEMBLY TO WALL ASSEMBLY	16" OC	16	401	292	152R	4
WALL ASSEMBLY TO FOUNDATION	16" OC	16	224	219	436	4

TABLE S601.8 - SILL OR BOTTOM PLATE TO FOUNDATION CONNECTIONS RESISTING UPLIFT LOADS - 140 MPH WIND EXP "B"
NFCM 2015 TABLE 3.2C

BOTTOM PLATE TO FOUNDATION ANCHOR BOLT CONNECTION RESISTING	FOUNDATION SUPPORTING	MAXIMUM ANCHOR BOLT SPACING (INCHES)	
		8' END ZONES	INTERIOR ZONES
UPLIFT LOADS	1 - 3 STORIES	25 INCHES ON CENTER	30 INCHES ON CENTER


NOTE: A MINIMUM OF ONE ANCHOR BOLT SHALL BE PROVIDED WITHIN 6 TO 12 INCHES OF EACH END OF EACH PLATE

TABLE S601.9 - SILL OR BOTTOM PLATE TO FOUNDATION CONNECTIONS RESISTING SHEAR LOADS - 140 MPH WIND EXP "B"
NFCM 2015 TABLE 3.2B

BOTTOM PLATE TO FOUNDATION ANCHOR BOLT CONNECTION RESISTING	FOUNDATION SUPPORTING	MAXIMUM ANCHOR BOLT SPACING (INCHES)	
		5/8" Ø ANCHOR BOLTS	48 INCHES ON CENTER W/3X3X1/4" WASHER
UPLIFT LOADS	4 STORY		

TABLE S601.10 - FULL HEIGHT STUD REQUIREMENT FOR HEADERS OR WINDOW SILL PLATES IN EXTERIOR WALLS EXPOSURE "B"
NFCM 2015 TABLE 3.23C

HEADER SPAN (FEET)	WALL SPACING (INCHES)		
	12" O.C.	16" O.C.	24" O.C.
2	1	1	1
4	2	2	1
6	3	3	2
8	4	3	2

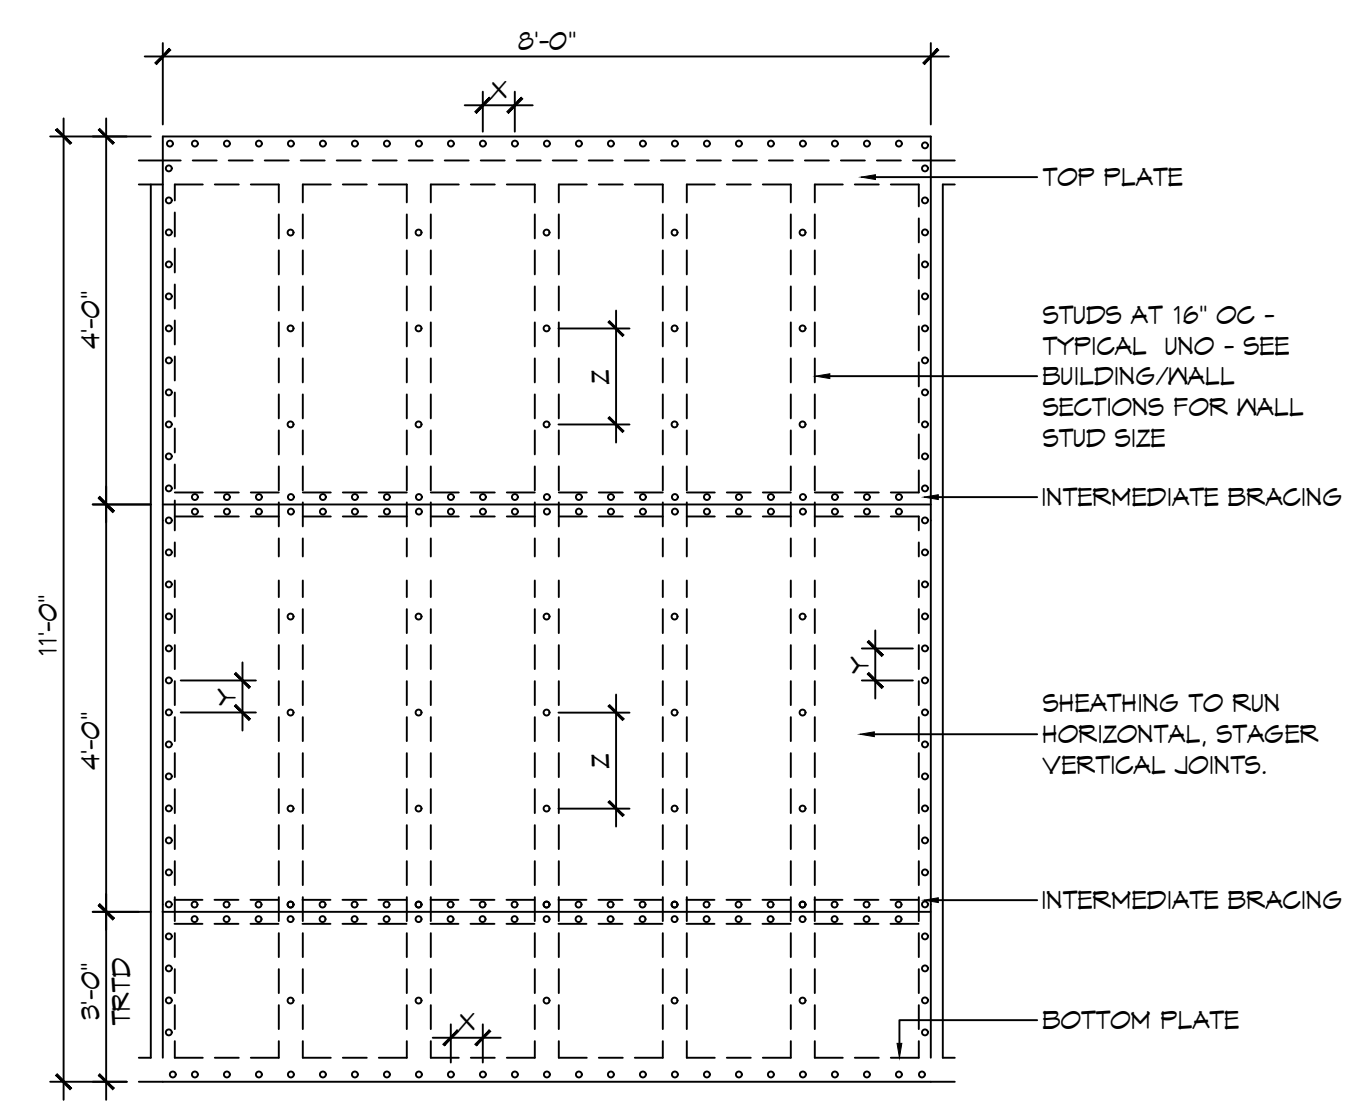

NAIL SPACING
X = 4" OC
Y = 4" OC
Z = 12" OC

X = PLATE EDGE NAIL SPACING
Y = LONG EDGE NAIL SPACING
Z = FIELD NAIL SPACING

INTERIOR SHEATHING
1/2" PLYWOOD EACH FACE STAGGERED 48" OC. W/8d NAILS @ 4" O.C. FASTENING @ PANEL EDGES 8d NAILS @ 12" O.C. FASTENING @ INTERMEDIATE MEMBERS.

EXTERIOR SHEATHING
5/8" PLYWOOD EACH FACE STAGGERED 48" OC. W/8d NAILS @ 4" O.C. FASTENING @ PANEL EDGES 8d NAILS @ 12" O.C. FASTENING @ INTERMEDIATE MEMBERS.

H SHEAR WALL EXTERIOR SHEATHING NAILING PATTERN

TABLE S601.5 - JACK STUD REQ - INT LOADBEARING WALLS

HEADER SUPPORTING	HEADER SPAN (FT)	ROOF SPAN (FEET)											
		12 FEET				24 FEET				36 FEET			
		3"	4.5"	5"	6.5"	3"	4.5"	5"	6.5"	3"	4.5"	5"	6"
ONE FLOOR ONLY (CENTER BEARING)	2	1	1	1	1	1	1	1	1	1	1	1	1
	4	1	1	1	1	1	1	1	1	1	1	1	1
	6	1	1	1	1	1	1	1	1	2	1	1	1
	8	1	1	1	1	2	1	1	1	2	2	2	1
	10	1	1	1	1	2	2	1	1	3	2	2	2
	12	1	1	1	1	2	2	2	1	3	2	2	2
	14	2	1	1	1	3	2	2	2	4	3	3	2
TWO FLOORS (CENTER BEARING)	2	1	1	1	1	1	1	1	1	2	1	1	1
	4	1	1	1	1	2	1	1	1	3	2	2	2
	6	2	1	1	1	3	2	2	2	4	3	2	2
	8	2	2	1	1	3	2	2	2	5	3	3	3
	10	2	2	2	1	4	3	3	2	6	4	4	3
	12	3	2	2	2	5	3	3	3	7	5	4	4
	14	3	2	2	2	6	4	4	3	8	5	5	4
16	4	3	2	2	6	4	4	3	9	6	6	5	

HEADER WIDTH - 3" (2-2x), 4.5" (3-2x), 5" (3-2x), 6.5" (4-2x) EACH 1/2" PLYWOOD SPACER BETWEEN

TABLE S601.6 - JACK STUD REQ - EXTERIOR LOADBEARING WALLS
NFCM 2021 TABLE 3.22F

ROOF AND CEILING	HEADER SPAN (FT)	ROOF LIVE LOAD 20 PSF				ROOF LIVE LOAD 30 PSF				
		3"	4.5"	5"	6.5"	3"	4.5"	5"	6.5"	
		NUMBER OF JACK STUDS REQUIRED								
ROOF AND CEILING	2	1	1	1	1	1	1	1	1	1
	4	1	1	1	1	1	1	1	1	1
	6	2	1	1	1	2	1	1	1	1
	8	2	2	2	1	2	2	2	1	1
	10	3	2	2	2	3	2	2	2	2
	12	3	2	2	2	3	2	2	2	2
	14	4	3	2	2	4	3	2	2	2
ROOF, CEILING, AND ONE CENTER BEARING FLOOR	2	1	1	1	1	1	1	1	1	1
	4	2	1	1	1	2	1	1	1	1
	6	2	2	2	1	3	2	2	2	2
	8	3	2	2	2	3	2	2	2	2
	10	4	3	2	2	4	3	3	2	2
	12	4	3	3	2	5	3	3	3	3
	14	5	4	3	3	5	4	3	3	3
16	6	4	4	3	6	4	4	3	3	

HEADER WIDTH - 3" (2-2x), 4.5" (3-2x), 5" (3-2x), 6.5" (4-2x) EACH 1/2" PLYWOOD SPACER BETWEEN




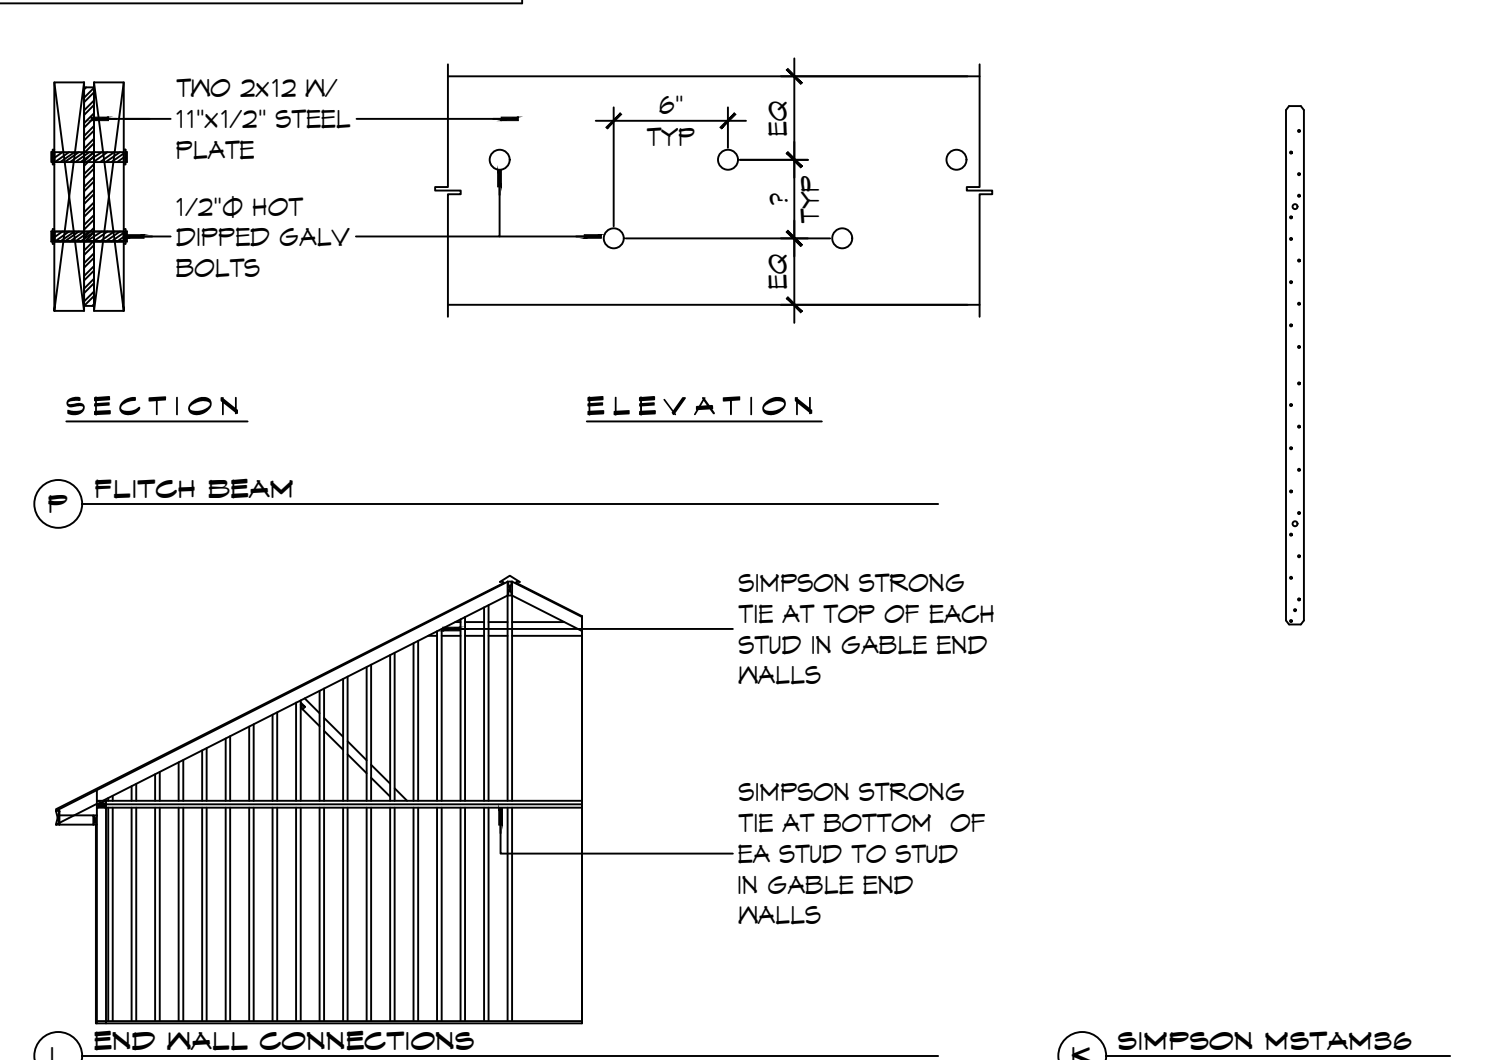


TABLE S601.3 - NAILING SCHEDULE
NFCM 2015 TABLE 3.1

DESCRIPTION	NUMBER OF COMMON NAILS	NUMBER OF BOX NAILS	SPACING
HEADER TO HEADER (FACE NAILED)	16d	16d	16" OC EDGES

TABLE S601.4 - BUILDING ENVELOPE REQUIREMENTS

ROOFS	OPAQUE ELEMENTS	ASSEMBLY MAXIMUM	INSULATION MIN. R-VALUE
METAL BUILDING	INSULATION ENTIRELY ABOVE DECK	U-0.048	R-20.0 c.i.
ATTIC AND OTHER		U-0.027	R-30
MASS		U-0.151	R-5.7 c.i.
METAL BUILDING		U-0.113	R-19.0
STEEL-FRAMED		U-0.124	R-19.0
WOOD-FRAMED AND OTHER		U-0.089	R-19.0
MASS		U-0.107	R-8.3 c.i.
STEEL JOIST		U-0.052	R-19.0
WOOD FRAMED AND OTHER		U-0.051	R-19.0
SLAB-ON-GRADE	UN-HEATED	F-0.150	NR
OPAQUE DOORS	SWINGING	U-0.700	NR
	NON-SWINGING	U-1.450	NR

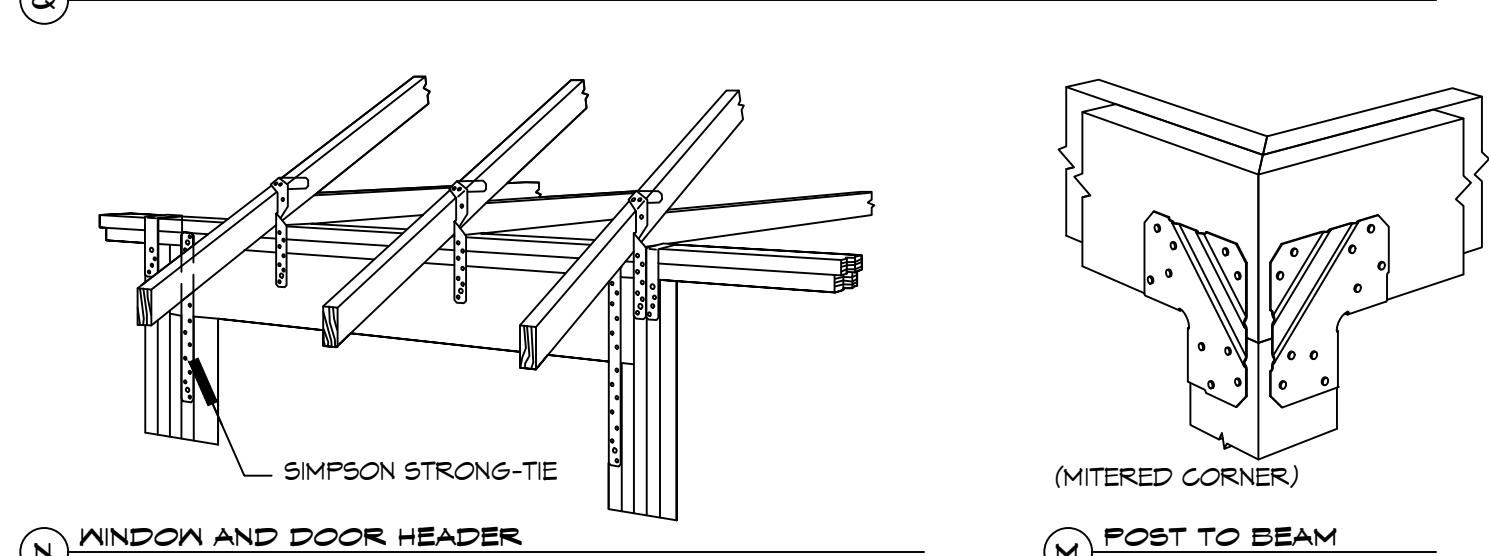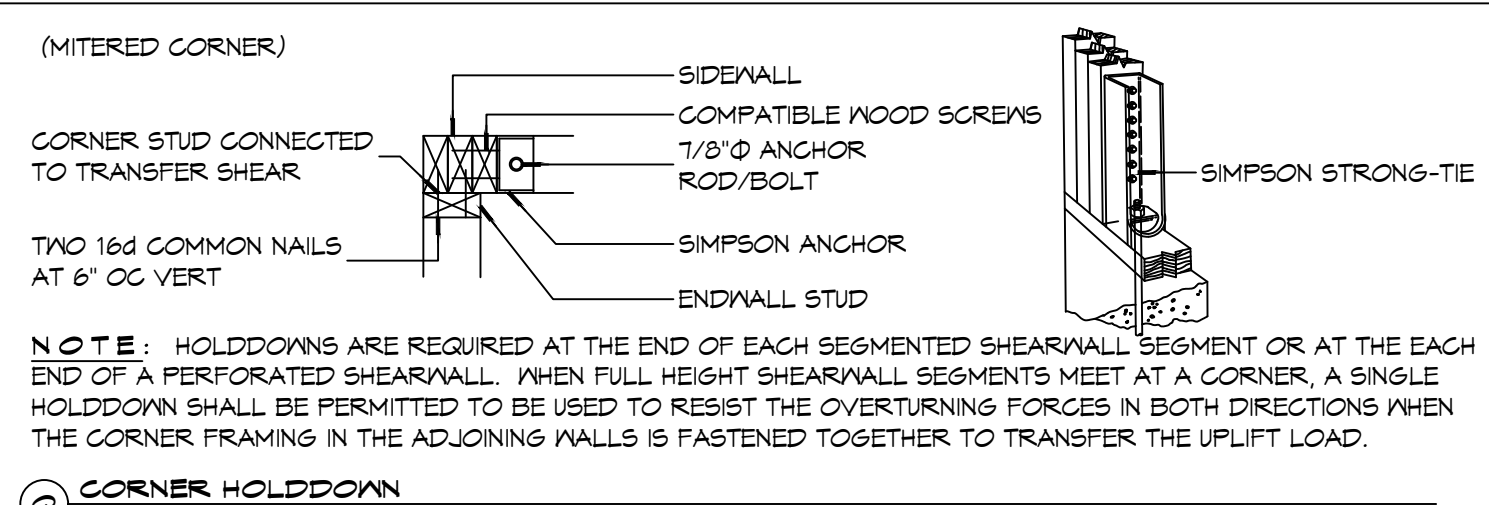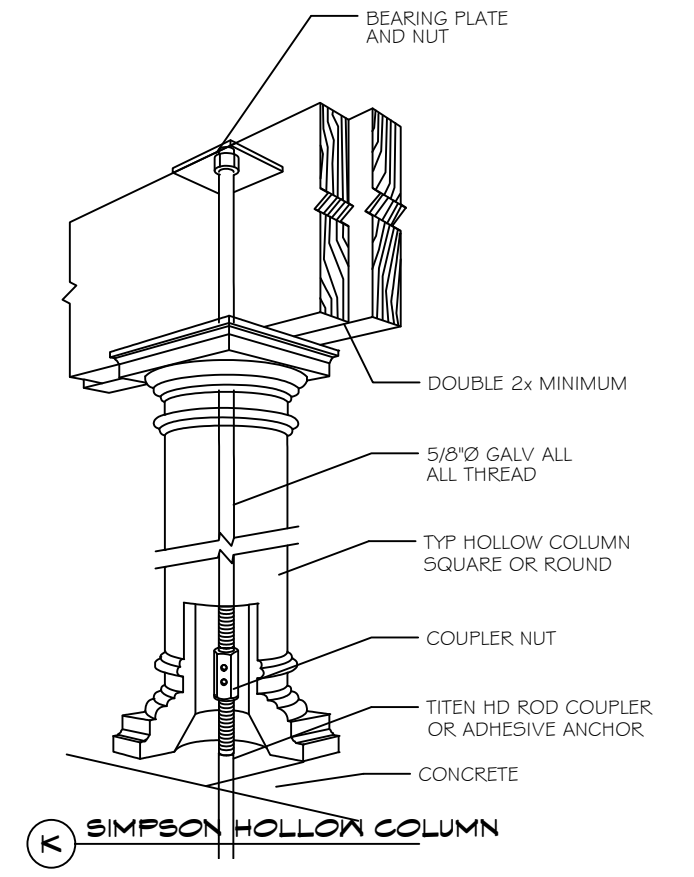

METAL ROOF APPLICATION & FASTENING NOTES

1. INSTALL 26 GAUGE METAL ROOF PER MANUFACTURER'S RECOMMENDATIONS FOR 140 MPH WIND SPEED.

GENERAL UPLIFT CONNECTION NOTES

ROOF ASSEMBLY TO WALL ASSEMBLY:
UPLIFT CONNECTIONS SHALL BE FROM RAFTER OR TRUSS TO WALL STUD. WHEN RAFTERS OR TRUSSES ARE NOT LOCATED DIRECTLY ABOVE STUDS, RAFTERS SHALL BE ATTACHED TO THE WALL PLATE AND THE WALL TOP PLATE SHALL BE ATTACHED TO THE WALL STUD WITH UPLIFT CONNECTIONS. UPLIFT CONNECTIONS SHALL BE IN ACCORDANCE WITH TABLE S601.10.

WALL ASSEMBLY TO WALL ASSEMBLY:
STORY TO STORY UPLIFT CONNECTIONS FROM UPPER STORY WALL STUD TO LOWER STORY WALL STUD. WHEN UPPER STORY WALL STUDS ARE NOT LOCATED DIRECTLY ABOVE LOWER WALL STUDS, THE STUDS SHALL BE ATTACHED TO A COMMON MEMBER IN THE WALL FLOOR ASSEMBLY BY UPLIFT CONNECTIONS. UPLIFT CONNECTIONS SHALL BE IN ACCORDANCE WITH TABLE S601.11.

WALL ASSEMBLY TO FOUNDATION:
FIRST FLOOR WALL STUDS SHALL BE CONNECTED TO THE FOUNDATION, SILL PLATE, OR BOTTOM PLATE. A MINIMUM OF A 1-1/4" X 20 GA. ASTM A653 GRADE 33 STEEL STRAP SHALL BE NAILED TO THE WALL STUD. WALL STUDS HAVE A MINIMUM EMBEDMENT OF 1 INCHES IN CONCRETE FOUNDATIONS AND SLABS-ON-GRADE, 15 INCHES IN MASONRY BLOCK FOUNDATIONS, OR BE LAPPED UNDER THE BOTTOM PLATE, 3 INCH SQUARE WASHERS SHALL BE USED ON THE ANCHOR BOLTS AND ANCHOR BOLT SPACINGS SHALL NOT EXCEED THE REQUIREMENTS. STEEL STRAPS EMBEDDED IN OR IN CONTACT WITH SLAB-ON-GRADE OR MASONRY BLOCK FOUNDATIONS SHALL BE HOT-DIPPED GALV. AFTER FABRICATION, OR MANUF. FROM G105 OR 2450 GALV. STL. CONNECTIONS SHALL BE IN ACCORDANCE WITH TABLE S601.12.

TABLE S601.1 - ROOF SHEATHING ATTACHMENT REQUIREMENT - WIND LOAD EXP "B"










SHEATHING LOCATION	RAFTER / TRUSS SPACING	E F	
		MAX NAIL SPACING FOR 8d COMMON NAILS OR 10d BOX NAILS (INCHES OC)	
INTERIOR ZONE	12" OC	6	12
	16" OC	6	12
	24" OC	6	12
PERIMETER EDGE ZONE	12" OC	6	6
	24" OC	4	4

140 MPH WIND - EXPOSURE "B" TYPICAL
E = NAIL SPACING AT PANEL EDGES, INCHES.
F = NAIL SPACING AT INTERMEDIATE SUPPORTS IN THE PANEL FIELD, INCHES.

TABLE S601.1 - WALL SHEATHING AND CLADDING REQUIREMENT - WIND LOAD EXP "B"

SHEATHING LOCATION	RAFTER / TRUSS SPACING	E F	
		MAX NAIL SPACING FOR 8d COMMON NAILS OR 10d BOX NAILS (INCHES OC)	
INTERIOR ZONE	12" OC	6	12
	16" OC	6	12
	24" OC	6	6
PERIMETER EDGE ZONE	12" OC	6	12
	16" OC	6	12
	24" OC	6	6

140 MPH WIND - EXPOSURE "B" TYPICAL
E = NAIL SPACING AT PANEL EDGES, INCHES.
F = NAIL SPACING AT INTERMEDIATE SUPPORTS IN THE PANEL FIELD, INCHES.

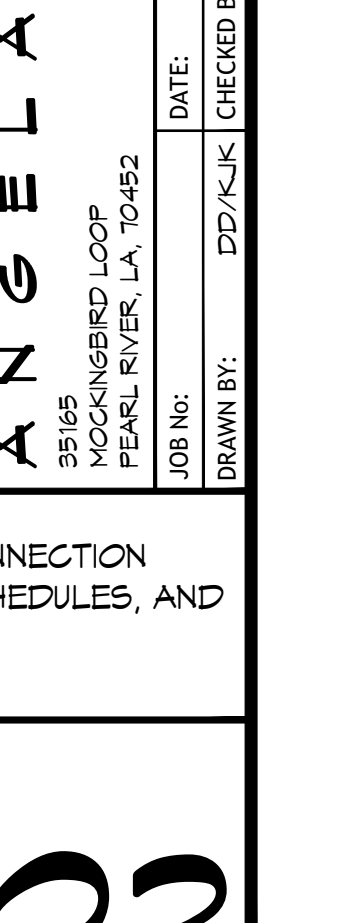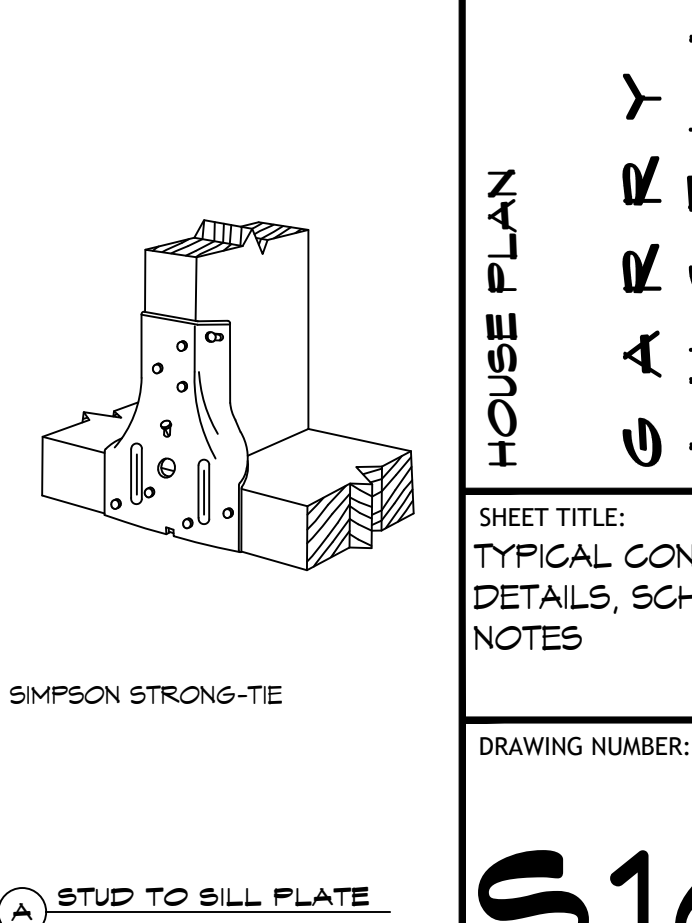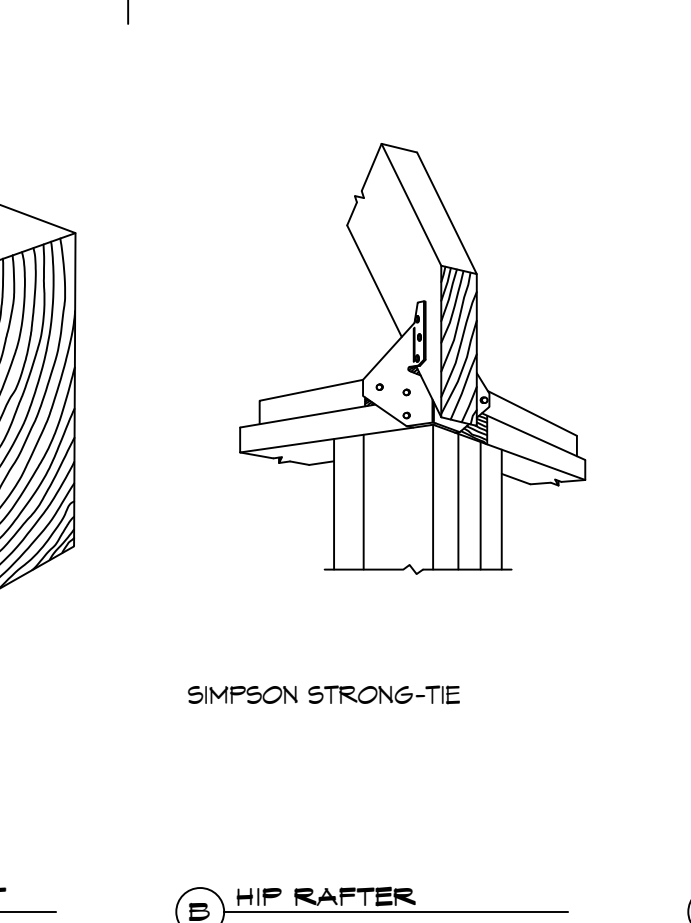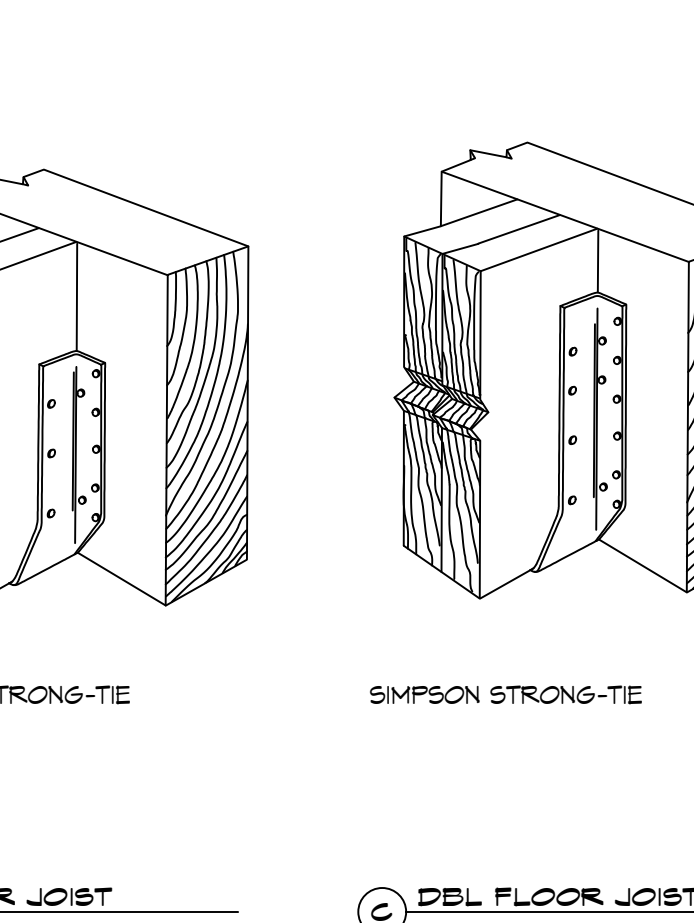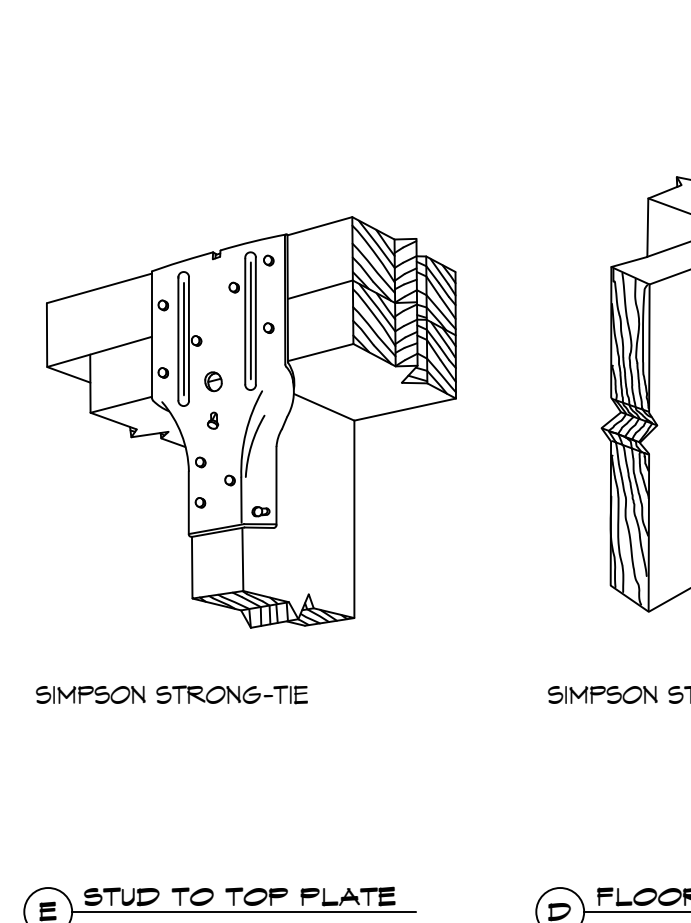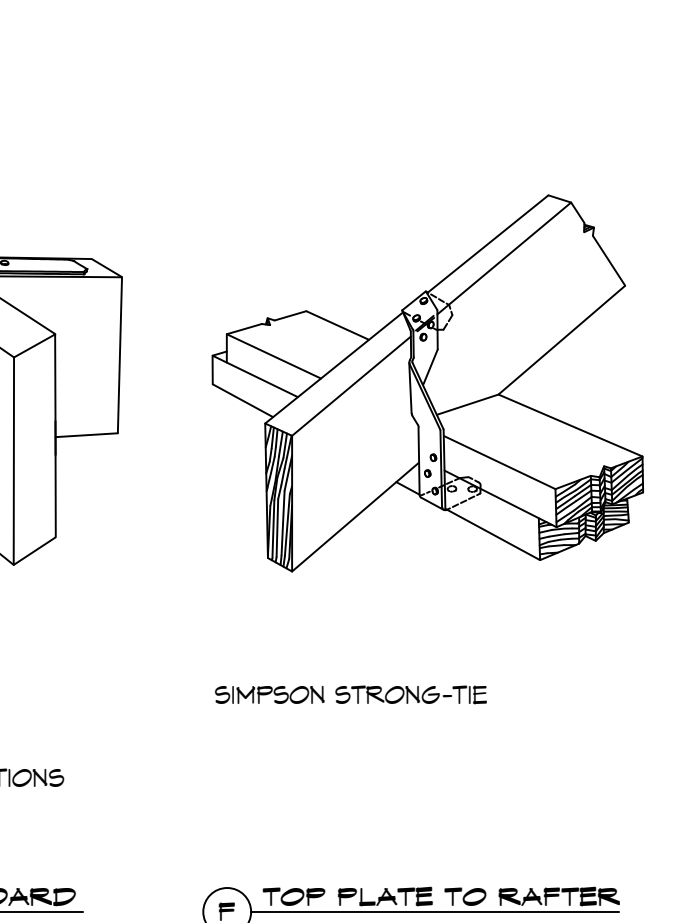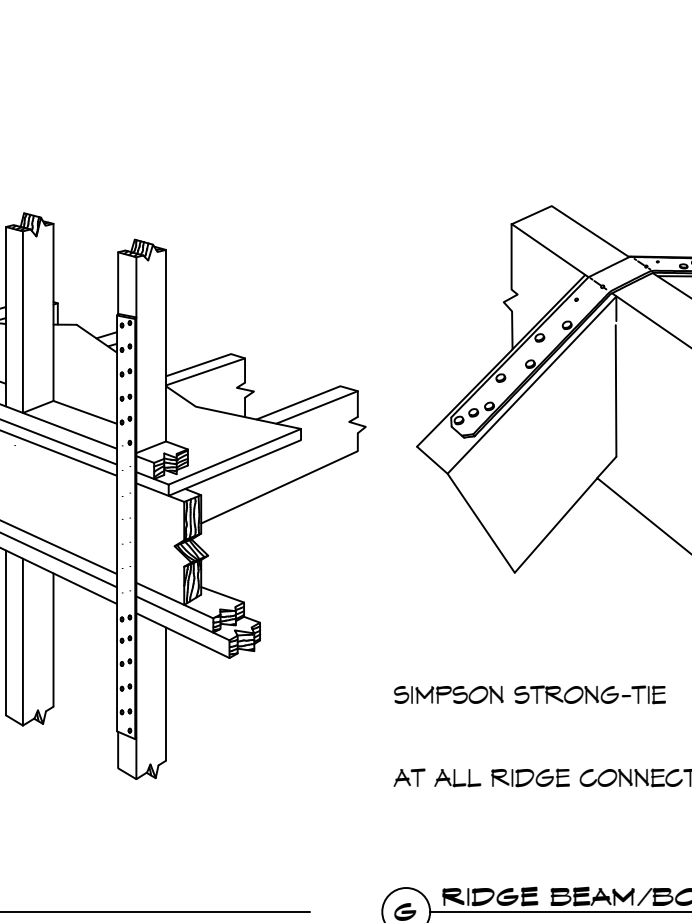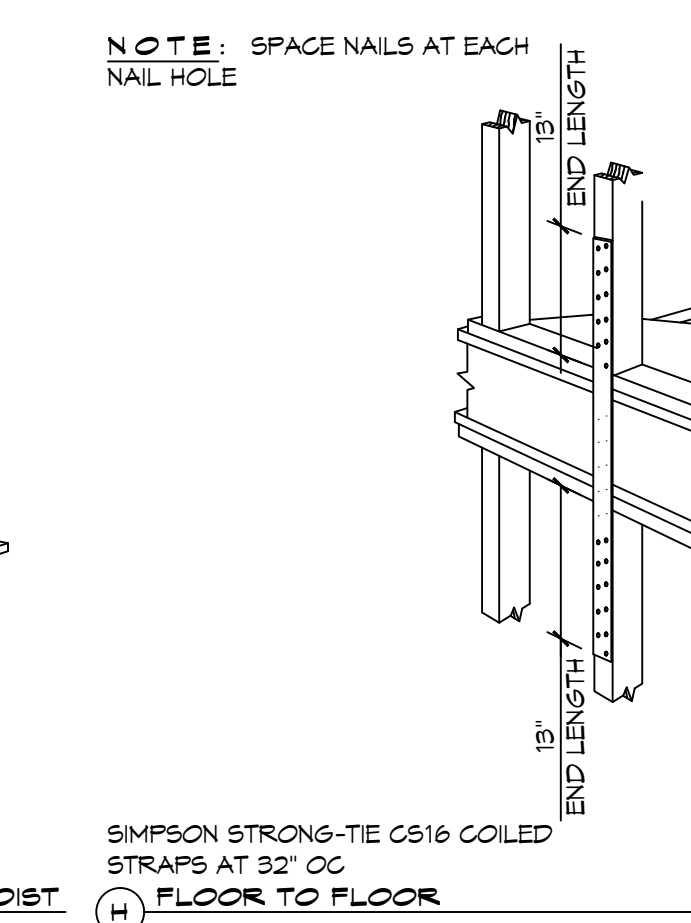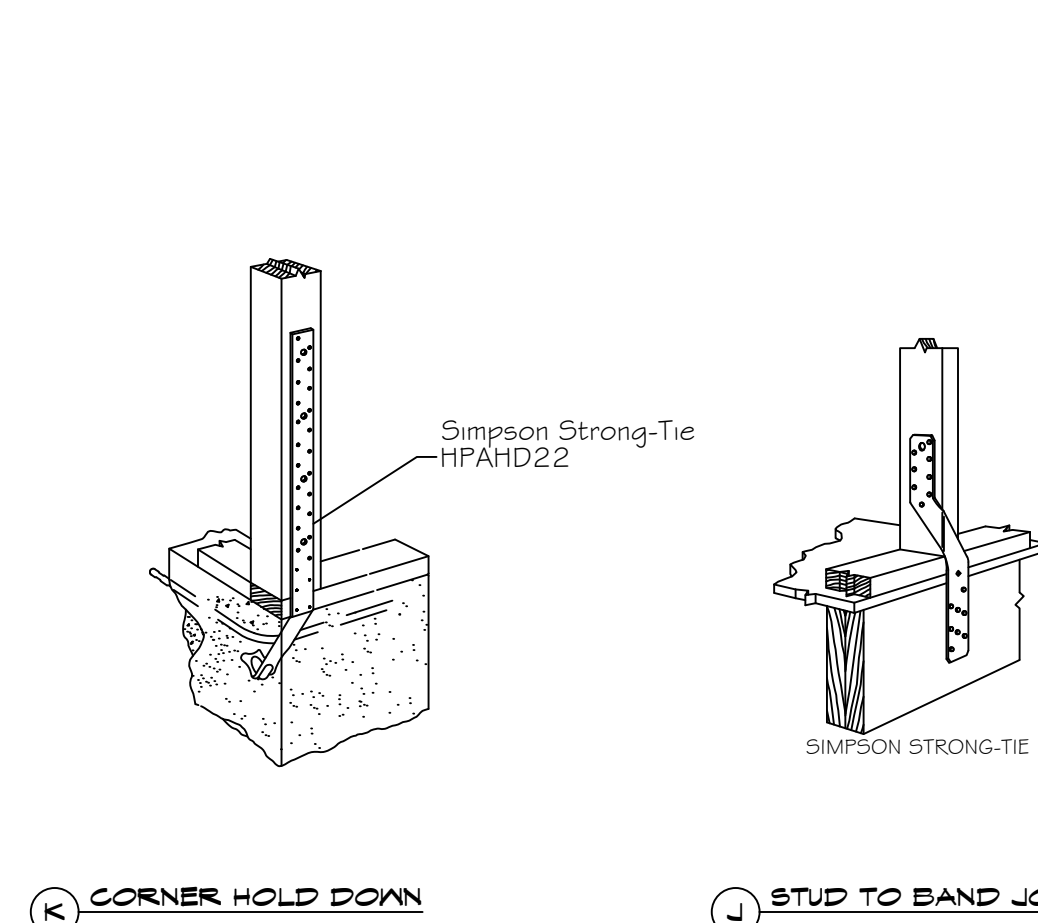

TYPICAL CONNECTION DETAILS
SCALE: NTS

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI

www.dammonengineering.com
info@dammonengineering.com
554.016 Spanish Trail
Slidell, LA 70458
Chief Engineer: Brian Mistich, PE
554.016 Spanish Trail
Slidell, LA 70458

REVISIONS

#	DESCRIPTION	DATE

STATE OF LOUISIANA
BRIAN A. MISTICH
LICENSE NO. 30187

HOUSE PLAN
SANGRE ANDEL N


SHEET TITLE:
TYPICAL CONNECTION
DETAILS, SCHEDULES, AND
NOTES

DRAWING NUMBER:
S102

SHEET No: 3 of 9

FILE NAME: A:\PROJECTS\2023\230923\230923.dwg Plot Date: 10/26/2023 10:52:00 AM Plot Path: C:\Users\adammon\OneDrive\Desktop\230923.dwg Plot Scale: 1/4" = 1'-0" Plot Size: 36" x 48"

SQUARE FEET		WINDOW SCHEDULE					DOOR SCHEDULE							
LIVING	1320	MK	WIDTH	HEIGHT	FRAME MAT	NOTES	MK	WIDTH	HEIGHT	THK	DOOR MAT	FRAME MAT	NOTES	
PORCH	825	W01	3'-0"	5'-0"	ALUM	SERIES 300 W/GRIDS SINGLE HUNG CLEAR	D01	(2)3'-0"	7'-0"	1-3/4"	WOOD	WOOD	EXTERIOR DOOR WITH GLASS PANE	
GARAGE	1080	W02	3'-0"	1'-0"	ALUM	FIXED WINDOW INSULATED TRANSOM	D02	3'-0"	7'-0"	1-3/4"	COMPOSITE	WOOD	EXTERIOR DOOR	
TOTAL SQ. FT.	3225	NOTE: OWNER TO PICK ALL WINDOW STYLES						D03	(2)3'-0"	7'-0"	1-3/4"	WOOD	WOOD	EXTERIOR FRENCH DOOR WITH GLASS PANES
		NOTE: FIELD VERIFY ALL DIMENSIONS, PAINT, FLOORING, LIGHTS, DOORS, ACCESSORIES, COLORS & STYLES WITH OWNER						D04	10'-0"	10'-0"	N/A	MTL	WOOD	GARAGE DOOR
		NOTE: FOR LOCATION OF WINDOWS, SEE P.M.I. DRAFTING & DESIGN DRAWINGS.						D05	(2)3'-0"	7'-0"	1-3/4"	WOOD	WOOD	INTERIOR FRENCH DOOR
							D06	(2)3'-0"	7'-0"	1-3/4"	WOOD	WOOD	INTERIOR FRENCH DOOR 1/2 HOUR FIRE RATED	
							D07	(2)2'-0"	7'-0"	1-3/4"	WOOD	WOOD	DOUBLE SLIDING BARN DOOR	
							D08	3'-0"	7'-0"	1-3/4"	WOOD	WOOD	INTERIOR DOOR	
							D09	4'-0"	7'-0"	-	-	-	CASED OPENING	

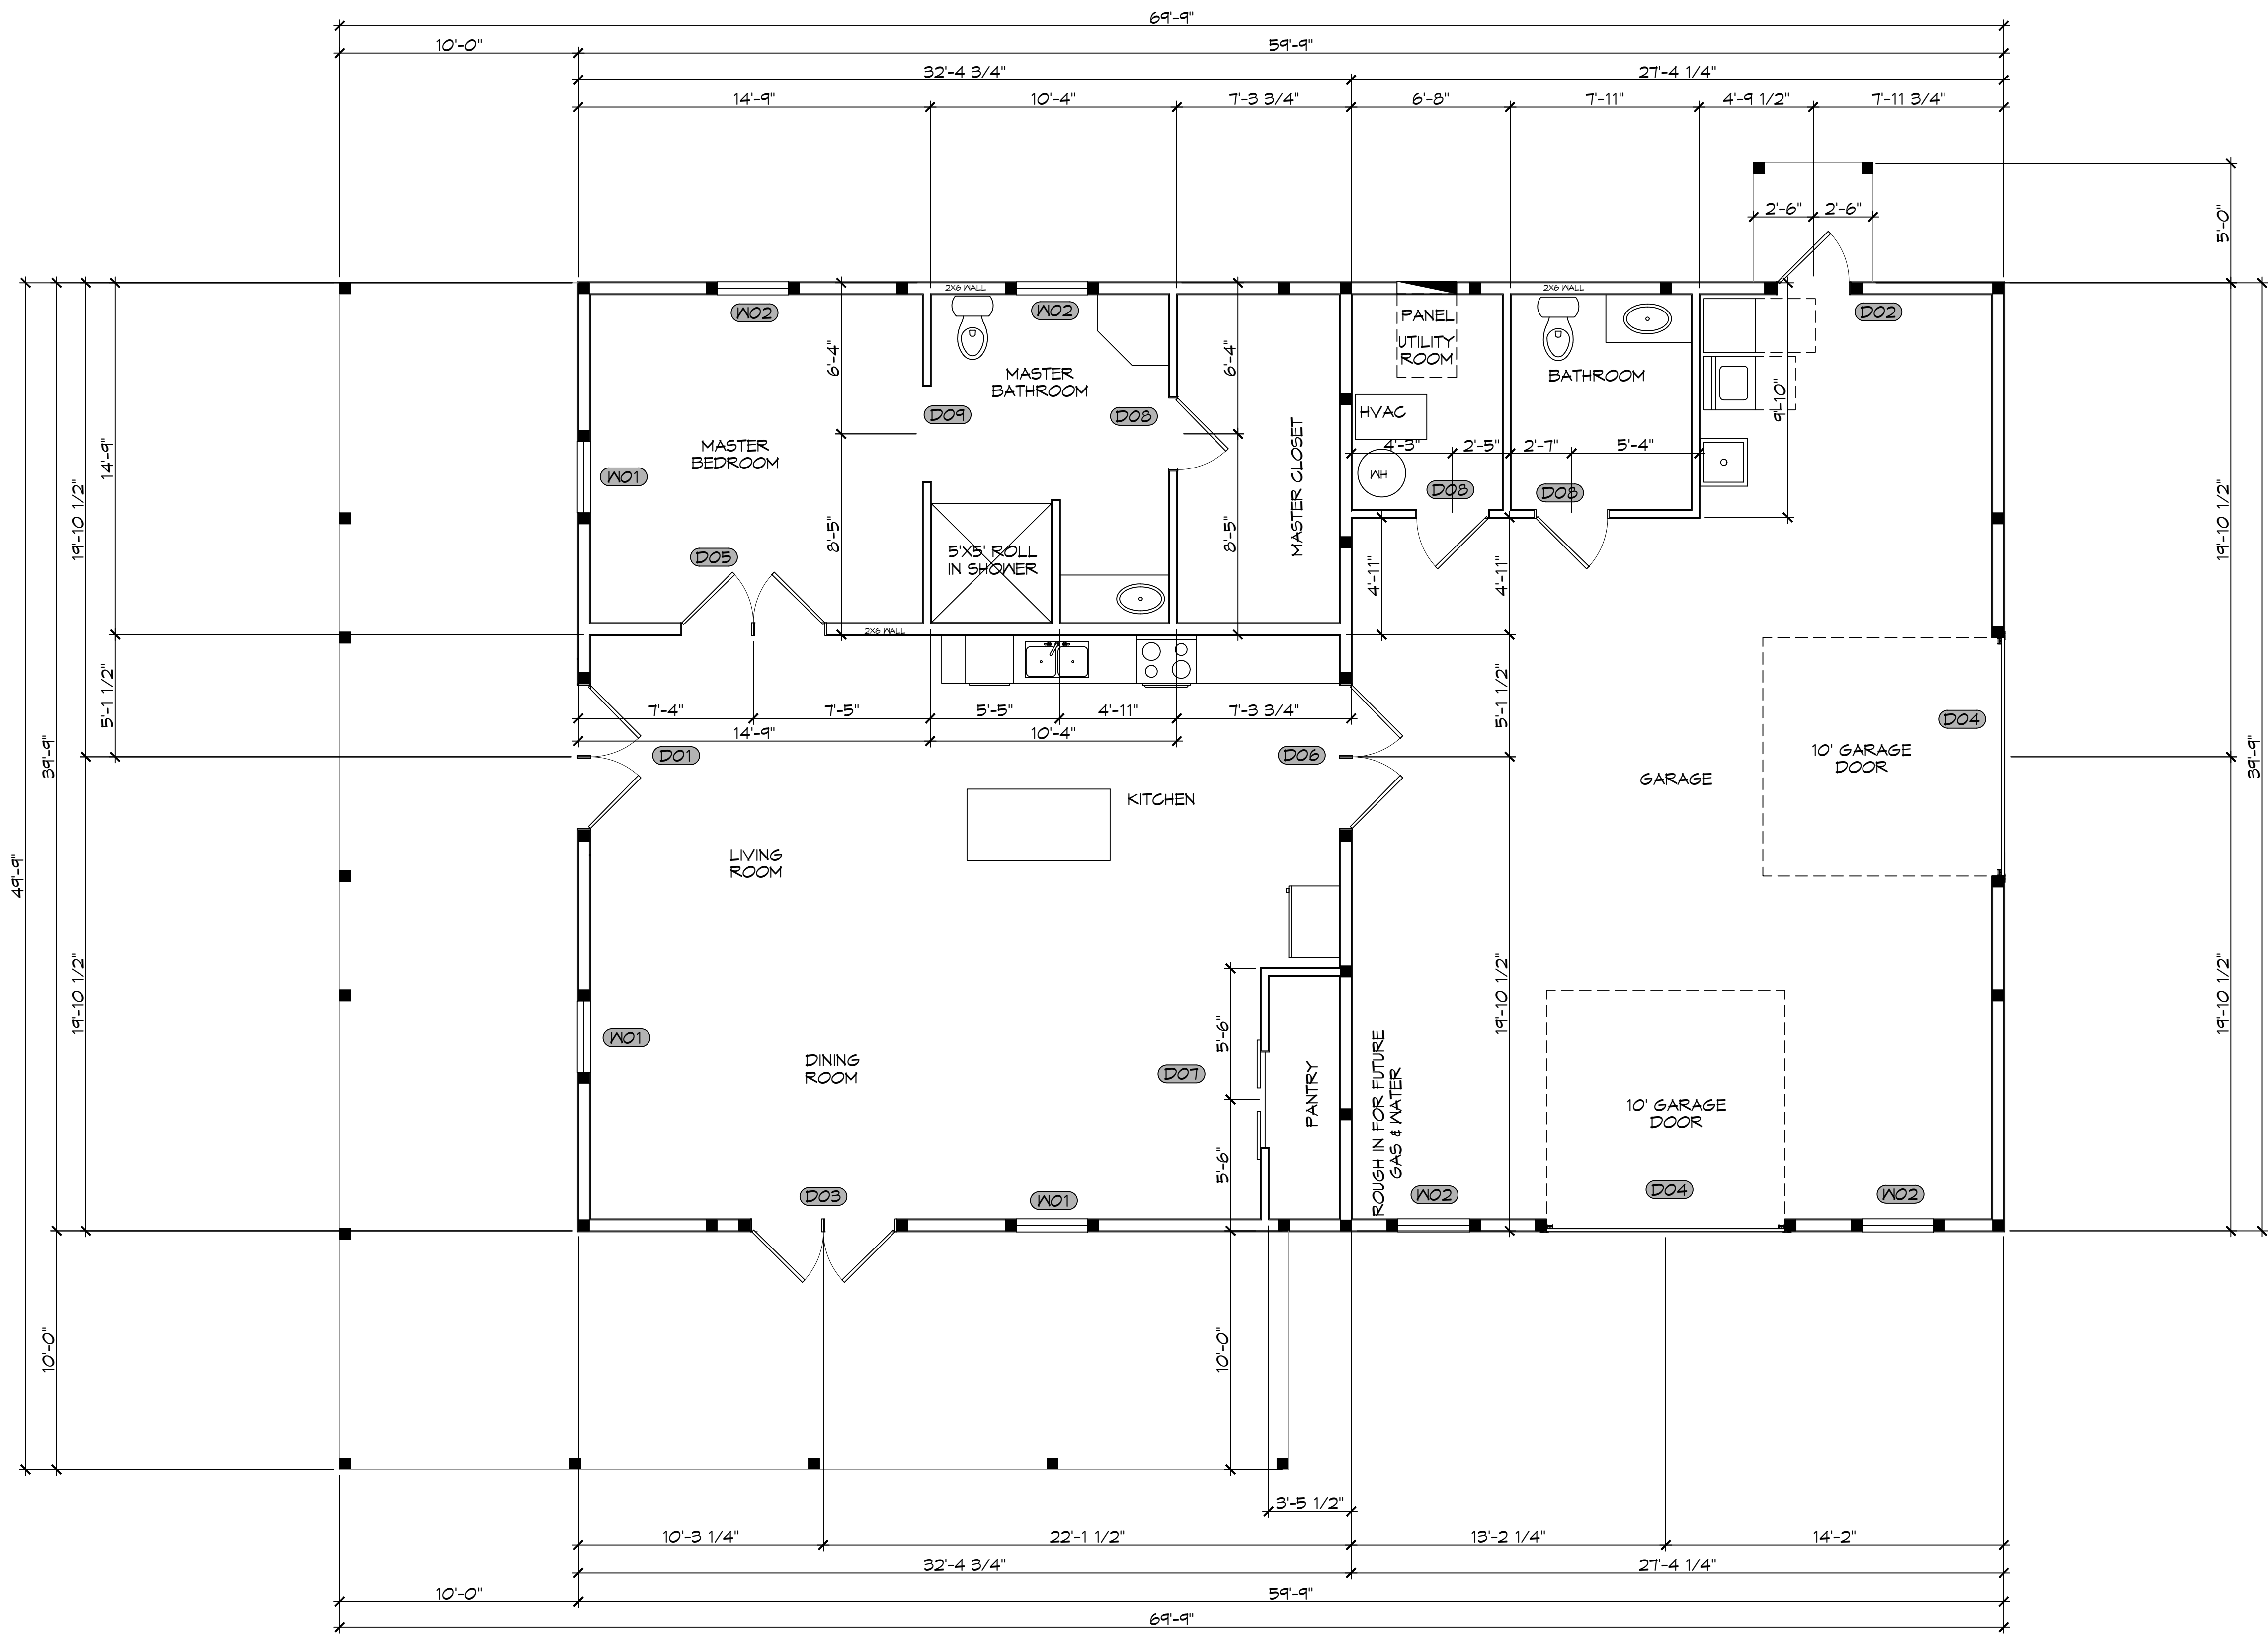

SQUARE FEET		WINDOW SCHEDULE					DOOR SCHEDULE							
LIVING	1320	MK	WIDTH	HEIGHT	FRAME MAT	NOTES	MK	WIDTH	HEIGHT	THK	DOOR MAT	FRAME MAT	NOTES	
PORCH	825	W01	3'-0"	5'-0"	ALUM	SERIES 300 W/GRIDS SINGLE HUNG CLEAR	D01	(2)3'-0"	7'-0"	1-3/4"	WOOD	WOOD	EXTERIOR DOOR WITH GLASS PANE	
GARAGE	1080	W02	3'-0"	1'-0"	ALUM	FIXED WINDOW INSULATED TRANSOM	D02	3'-0"	7'-0"	1-3/4"	COMPOSITE	WOOD	EXTERIOR DOOR	
TOTAL SQ. FT.	3225	NOTE: OWNER TO PICK ALL WINDOW STYLES						D03	(2)3'-0"	7'-0"	1-3/4"	WOOD	WOOD	EXTERIOR FRENCH DOOR WITH GLASS PANES
		NOTE: FIELD VERIFY ALL DIMENSIONS, PAINT, FLOORING, LIGHTS, DOORS, ACCESSORIES, COLORS & STYLES WITH OWNER						D04	10'-0"	10'-0"	N/A	MTL	WOOD	GARAGE DOOR
		NOTE: FOR LOCATION OF WINDOWS, SEE P.M.I. DRAFTING & DESIGN DRAWINGS.						D05	(2)3'-0"	7'-0"	1-3/4"	WOOD	WOOD	INTERIOR FRENCH DOOR
							D06	(2)3'-0"	7'-0"	1-3/4"	WOOD	WOOD	INTERIOR FRENCH DOOR 1/2 HOUR FIRE RATED	
							D07	(2)2'-0"	7'-0"	1-3/4"	WOOD	WOOD	DOUBLE SLIDING BARN DOOR	
							D08	3'-0"	7'-0"	1-3/4"	WOOD	WOOD	INTERIOR DOOR	
							D09	4'-0"	7'-0"	-	-	-	CASED OPENING	

DAMMON ENGINEERING, INC.
 LOUISIANA & MISSISSIPPI
 Chief Engineer: Brian Misch, PE
 554 Old Spanish Trail
 Slidell, LA 70458
 www.dammonengineering.com
 info@dammonengineering.com
 PH: 985-649-5832


#	DESCRIPTION	DATE



HOUSE PLAN
SARGELA AFENH
 35165 MOCKINGBIRD LOOP
 PEARL RIVER, LA, 70452
 JOB No: _____
 DRAWN BY: _____
 DATE: 10-26-2023
 CHECKED BY: CKD

SHEET TITLE:
 FLOOR PLAN
 DRAWING NUMBER:
A101
 SHEET No: 4 of 4

D:\WORK\14\MECH\1010\1010.dwg, 10/20/2018, 10:29:52 AM, 10/20/2018, 10:29:52 AM, 10/20/2018, 10:29:52 AM, 10/20/2018, 10:29:52 AM

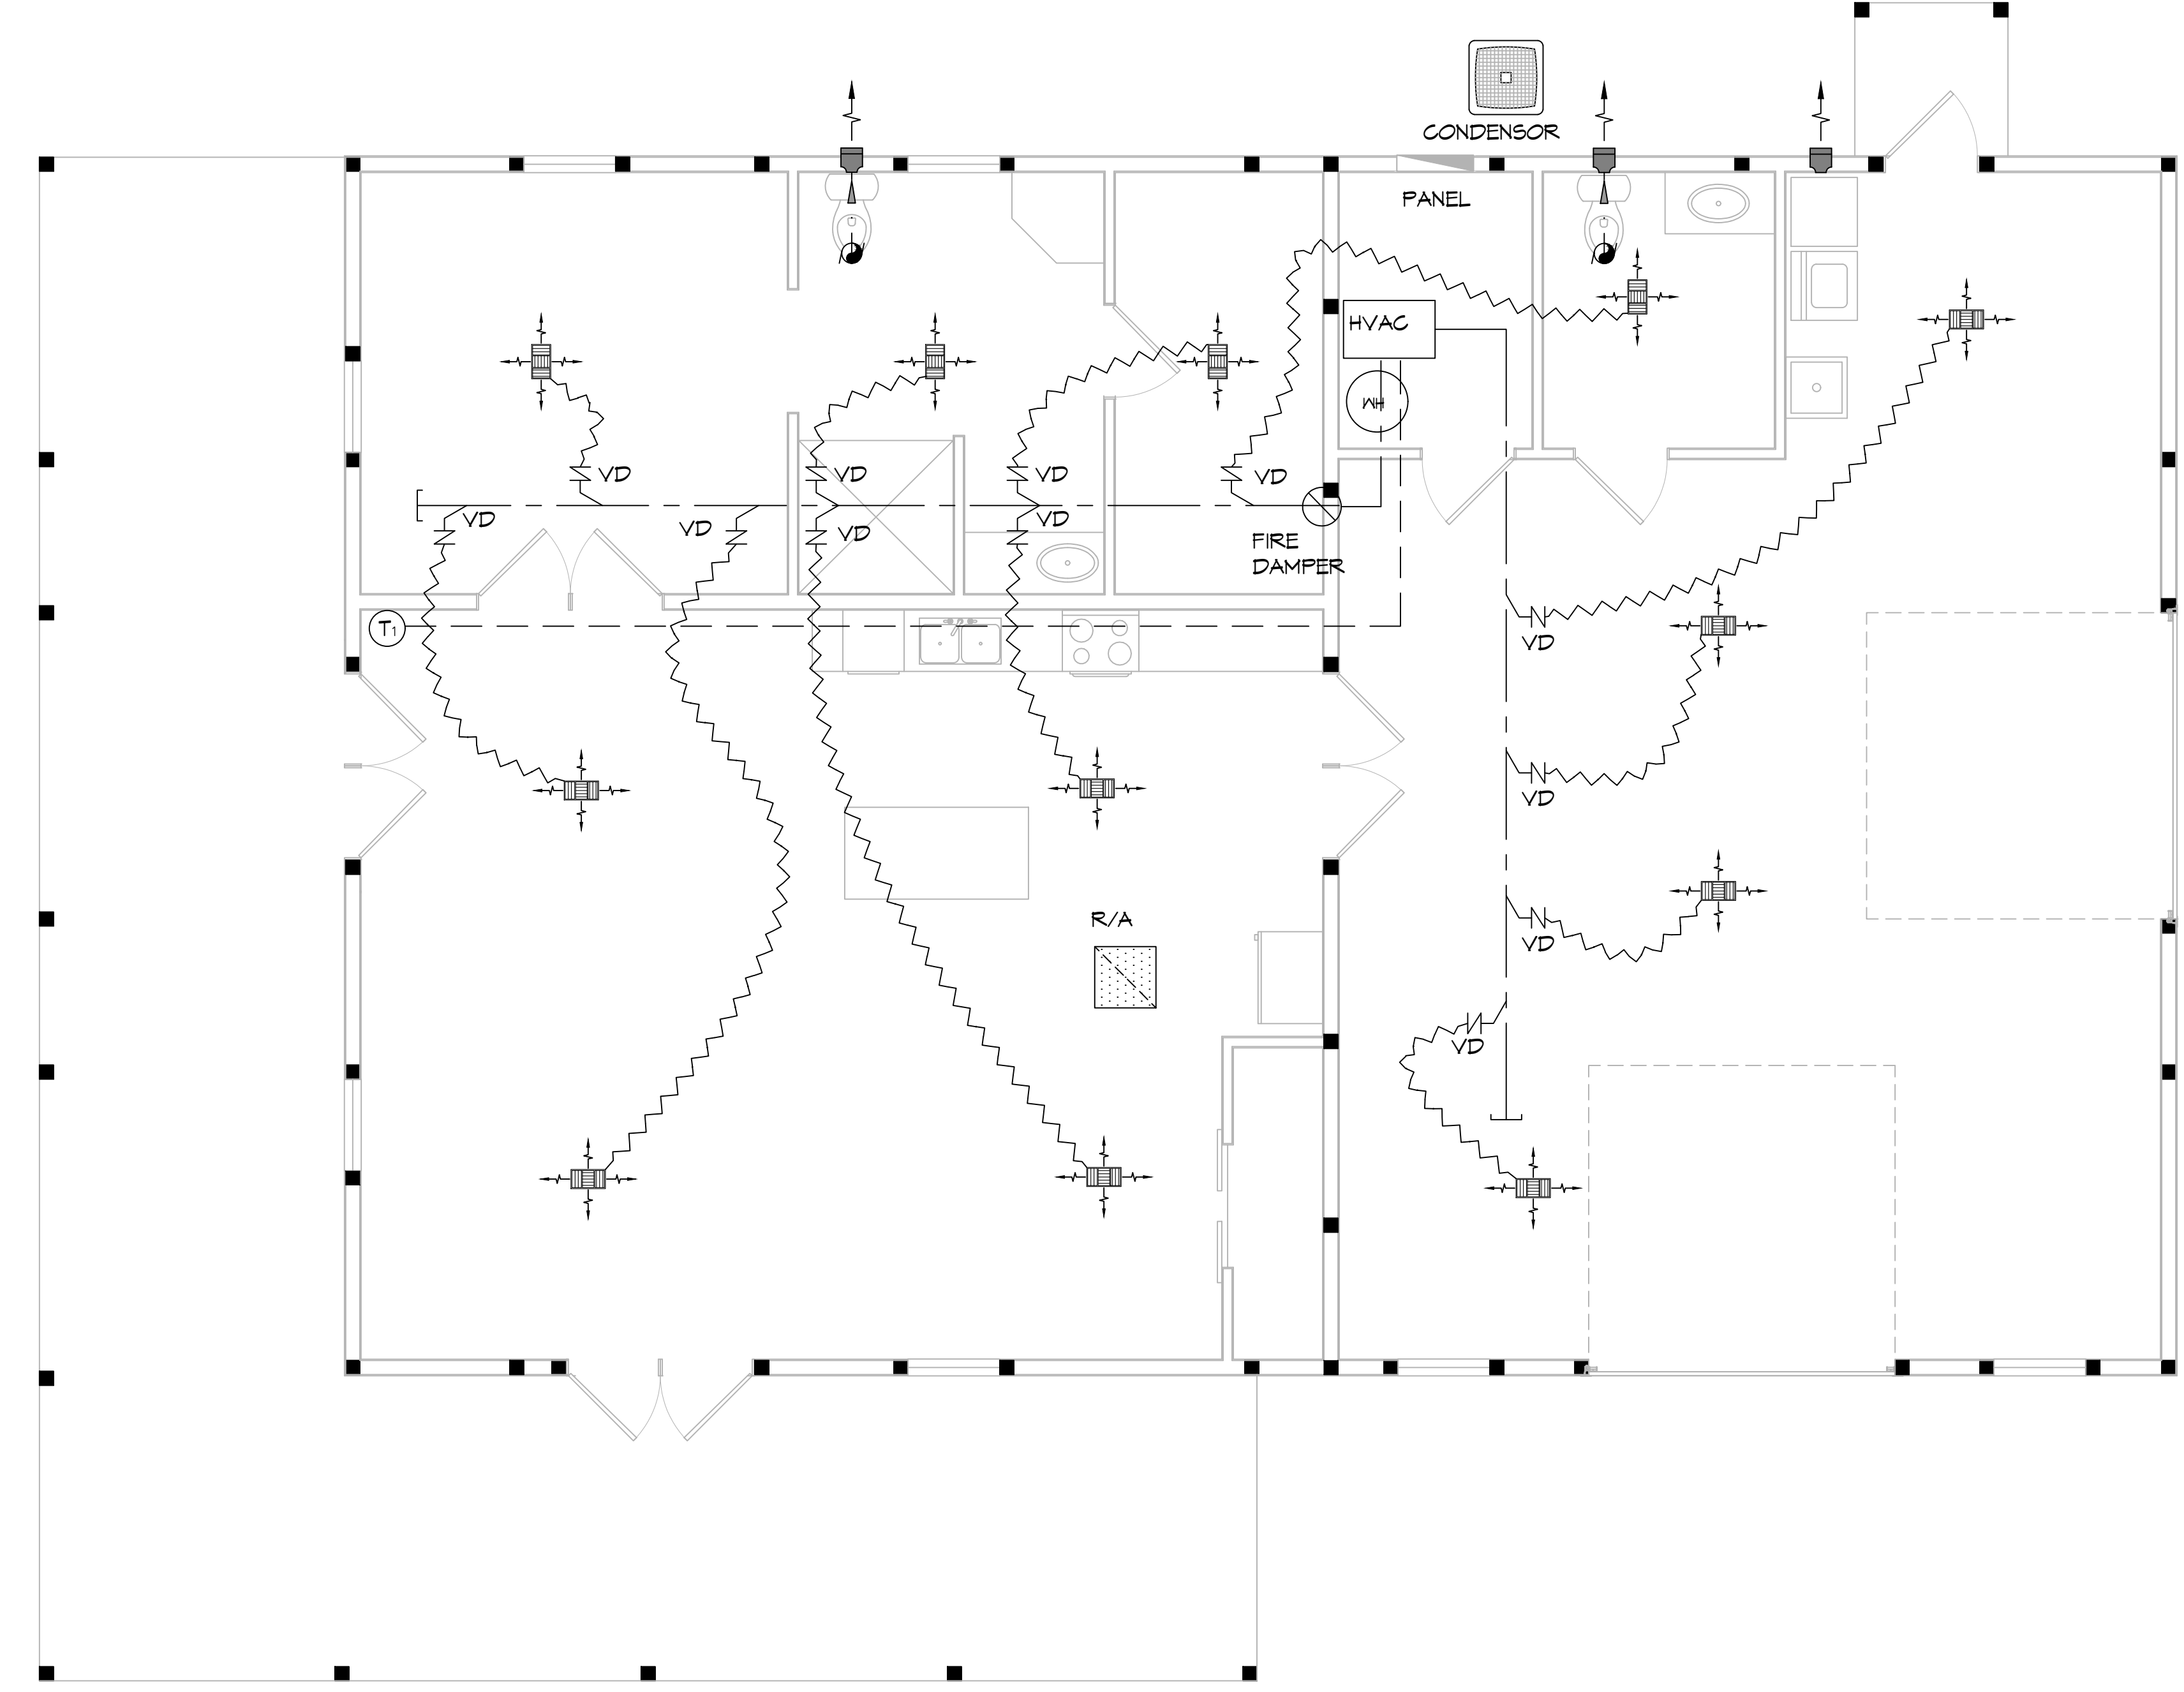


10 MECHANICAL PLAN
SCALE: 1/4" = 1'-0"

MECHANICAL NOTES

1. MECHANICAL SUBCONTRACTOR TO INSTALL HVAC SYSTEM, ACCORDING TO NATIONAL, STATE AND CITY CODE.
2. MECHANICAL SUBCONTRACTOR TO VERIFY HVAC DESIGN LOADS.
3. OWNER TO SELECT MECHANICAL EQUIPMENT WITH CONTRACTOR.
4. DRAWINGS OF SYSTEM ARE SCHEMATIC AND SHOULD BE CONFIRMED BY SUBCONTRACTOR.
5. DUCTS AS SHOWN 26 GAUGE 6.1 INSULATE 1/4" 2" FIBERGLASS INSULATION. * MIN. DUCT SIZE 8" DIAMETER * MIN. DIFF. SIZE 10" DIAMETER WITH AIR VOLUME REG.
6. DAMPER CONTROLS AND VOLUME DAMPERS TO BE LOCATED AND CONFIRMED BY CONTRACTOR.
7. THERMOSTAT MIN. HONEYWELL - WALL MOUNTED
8. MIN. CLEARANCE AT UNIT TO BE 4'-0"
9. PROVIDE 3/4" PLYWOOD, 24" MIN. WIDE CATWALK TO ALL MECHANICALS IN ATTIC. CATWALK - GREATER THAN 20' NEED 6' HEADROOM - MAX. 50' LENGTH. MAINTAIN PROPER CLEARANCE AT UNITS SERVICE AREA.
10. CLEARANCE OF ALL HEAT PRODUCING APPLIANCES TO BE GREATER THAN 18" ABOVE OR 6" TO THE SIDE.
11. SEC. 19315: CARBON MONOXIDE ALARMS - REQUIRED IN THE SMOKE ALARMS
12. A/C DRAIN TO 1-1/2" P-TRAP
13. PROVIDE 30" MIN. WIDE WORKING PLATFORM TO ACCESS SIDE OF HVAC. ATTIC DECKED WORK AREA MIN. 30" X 30"
14. DRYER MUST BE VENTED TO THE EXTERIOR OF THE RESIDENCE, IN COMPLIANCE WITH THE MECHANICAL CODE. DRYER VENT, LENGTH (MAX. LENGTH 25', - 5' FOR 90 DEGREE TURN, - 2.5' FOR 45 DEGREE TURN OR PER MANUFACTURER) AND DISCHARGE LOCATION.


NOTE: DRAWN FOR DIAGRAMMATIC PURPOSE ONLY
FIELD VERIFY ROUTING OF ALL DUCTWORK AND DIFFUSERS.

MECHANICAL LEGEND

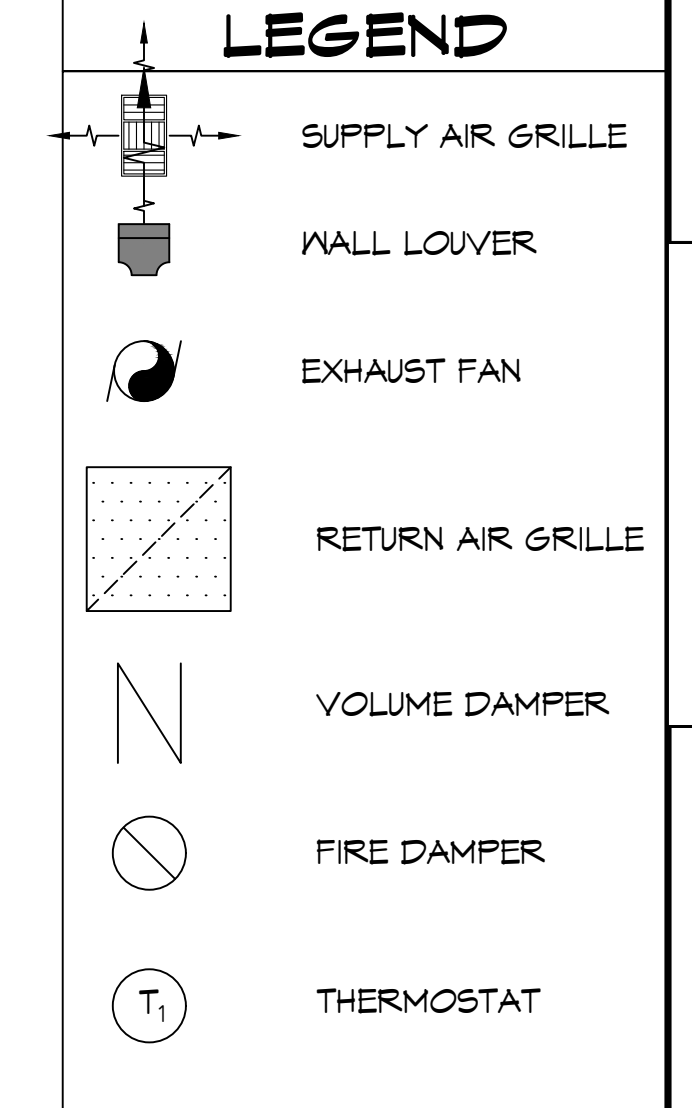

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985-649-5832

#	DESCRIPTION	DATE

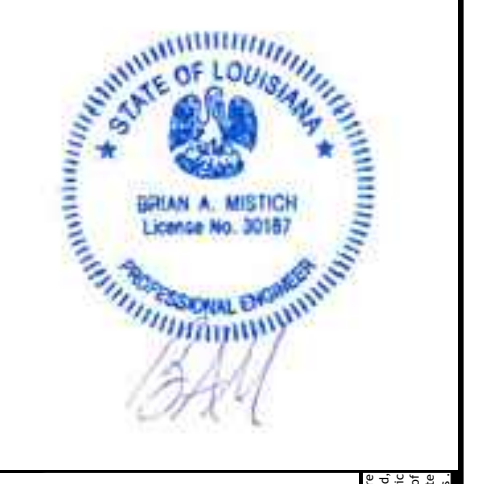

HOUSE PLAN
SARGELA ANDREH
39165 MOCKINGBIRD LOOP
PEARL RIVER, LA, 70452
JOB No: 10-29-2025
DATE: 10-29-2025
DRAWN BY: LJP
CHECKED BY: CKD

SHEET TITLE:
MECHANICAL PLAN
DRAWING NUMBER:
M101
SHEET No: 7 of 9

