FILE NAME: J:\... DRAWINGS\2425 - Sixth Baptist Church Addition & Renovation\Working Current Dwgs\Civil & Electric Circuit Panels & One-Line Dwg - PLOT DATE & TIME: Tuesday, August 26, 2025 8:55:43 AM

PANEL SCHEDULE

PANEL: MCC
LOCATION: CORRIDOR 109
FEEDER SOURCE: ENTERGY

VOLTAGE: 208/120V, 400A, 3Ø, 4W (V/MB); 22KIC
ENCLOSURE: FLUSH MOUNTED W/ EQUIPMENT GND BAR SQ D TYPE QO LOAD CENTER

CKT NO	THHN WIRE SIZE	LOAD DESCRIPTION / LOCATION	BREAKER AMP	BREAKER POLE	LOAD (kva)	AØ BØ CØ	LOAD (kva)	BREAKER POLE	BREAKER AMP	LOAD DESCRIPTION / LOCATION	THHN WIRE SIZE	CKT NO
1	2/0	AHU-1 (20 TON) **	150	3	17.9		12.3	3	110	** CU-1 (20 TON)	#1	2
3					17.9		12.3					4
5					17.9		12.3					6
7	#12	AHU-2 (2 TON) **	15	2	1.0		1.1	2	15	** CU-2 (2 TON)	#12	8
9					1.0		1.1					10
11	#12	AHU-3 (2-1/2 TON) **	15	2	1.0		1.7	2	25	** CU-3 (2-1/2 TON)	#10	12
13					1.0		1.7					14
15	#12	AHU-5 (5 TON) **	15	2	1.0		3.4	2	50	** CU-5 (5 TON)	#6	16
17					1.0		3.4					18
19	#10	5.5 kw BAPTISTRY HEATER **	30	2	2.7		0.6	1	15	** HOOD CONTROLLER	#12	20
21					2.7		1.8	1	25	** KSF-1; SHUNT TRIP; ROUTE THRU HOOD CONTROLLER	#12	22
23	#10	BAPTISTRY HEATER CIRCULATION PUMP **	20	1	1.6		1.3	1	20	** KEF-1; SHUNT TRIP; ROUTE THRU HOOD CONTROLLER	#12	24
25	#10	CLOTHES DRYER	30	2	2.5		0.5	1	20	WASHING MACHINE	#12	26
27					2.5		-	1	20	SPARE	-	28
29	-	SPARE	20	1	-		-	1	20	SPARE	-	30
31	-	SPARE	20	1	-		-	1	20	SPARE	-	32
33	-	SPARE	20	1	-		-	1	20	SPARE	-	34
35	-	SPARE	20	1	-		-	1	20	SPARE	-	36
37	-	SPARE	20	1	-		6.5					38
39	-	SPARE	20	1	-		3.2	3	100	LP2	-	40
41	-	SPARE	20	1	-		5.4					42

SOLID NEUTRAL / NEUTRAL WIRE (N)

TOTAL CONNECTED LOAD (kva) = 140.1

AØ = 47.8 | BØ = 46.9 | CØ = 45.6

GROUND BUS / GROUND WIRE (G)

** INSTALL BREAKER TO MATCH EQUIPMENT INSTALLED

PANEL SCHEDULE

PANEL: LP2
LOCATION: CORRIDOR 109
FEEDER SOURCE: MCC

VOLTAGE: 208/120V, 100A, 3Ø, 4W (V/MLO); 10KIC
ENCLOSURE: FLUSH MOUNTED W/ EQUIPMENT GND BAR SQ D TYPE QO LOAD CENTER

CKT NO	THHN WIRE SIZE	LOAD DESCRIPTION / LOCATION	BREAKER AMP	BREAKER POLE	LOAD (kva)	AØ BØ CØ	LOAD (kva)	BREAKER POLE	BREAKER AMP	LOAD DESCRIPTION / LOCATION	THHN WIRE SIZE	CKT NO
1	#12	ADMIN OFFICE 110	20	1	1.1		0.5	1	20	SOUND CLOSET 114; DEDICATED	#12	2
3	#12	PASTOR OFFICE 117	20	1	0.7		0.5	1	20	SOUND CLOSET 114; DEDICATED	#12	4
5	#12	KITCHEN, MICROWAVE	20	1	1.5		0.5	1	20	SOUND CLOSET 114; DEDICATED	#12	6
7	#12	KITCHEN, ICE MACHINE	20	1	1.5		1.5	1	20	KITCHEN OUTLETS	#12	8
9	#12	SPARE	20	1	-		1.5	1	20	KITCHEN REFRIGERATOR	#12	10
11	#12	KITCHEN, FREEZER	20	1	1.5		0.5	1	20	CHOIR	#12	12
13	#12	STAGE RIGHT	20	1	0.2		0.2	1	20	PULPIT	#12	14
15	#12	STAGE LEFT	20	1	0.2		0.5	1	20	MULTI-PURPOSE RM OUTLETS	#12	16
17	#12	2ND FLR & ATTIC OUTLETS	20	1	0.7		0.7	1	20	MULTI-PURPOSE RM OUTLETS	#12	18
19	#12	LIGHTS	20	1	1.0		1.5	1	20	LIGHTS	#12	20
21	-	SPARE	20	1	-		-	1	20	SPARE	-	22
23	-	SPARE	20	1	-		-	1	20	SPARE	-	24
25		SPACE								SPACE		26
27		SPACE								SPACE		28
29		SPACE								SPACE		30
31		SPACE								SPACE		32
33		SPACE								SPACE		34
35		SPACE								SPACE		36
37		SPACE								SPACE		38
39		SPACE								SPACE		40
41		SPACE								SPACE		42

SOLID NEUTRAL / NEUTRAL WIRE (N)

TOTAL CONNECTED LOAD (kva) = 15.0

AØ = 6.5 | BØ = 3.2 | CØ = 5.4

GROUND BUS / GROUND WIRE (G)

PANEL SCHEDULE

PANEL: LP1
LOCATION: STORAGE RM 108
FEEDER SOURCE: MDP

VOLTAGE: 208/120V, 100A, 3Ø, 4W (V/MLO); 22KIC
ENCLOSURE: FLUSH MOUNTED W/ EQUIPMENT GND BAR SQ D TYPE QO LOAD CENTER

CKT NO	THHN WIRE SIZE	LOAD DESCRIPTION / LOCATION	BREAKER AMP	BREAKER POLE	LOAD (kva)	AØ BØ CØ	LOAD (kva)	BREAKER POLE	BREAKER AMP	LOAD DESCRIPTION / LOCATION	THHN WIRE SIZE	CKT NO
1	#12	AHU-4 (3 TON) **	15	2	1.0		2.0	2	30	** CU-4 (3 TON)	#10	2
3					1.0		2.0					4
5	#10	INSTANT WATER HEATER, WOMENS RESTROOM	30	1	3.4		0.7	1	20	VESTIBULE WATER FOUNTAIN	#12	6
7	#10	INSTANT WATER HEATER, MENS RESTROOM	30	1	3.4		1.3	1	20	OUTLETS	#12	8
9	#12	RESTROOM OUTLETS	20	1	0.7		0.4	1	20	ATTIC & LOFT OUTLETS	#12	10
11	#12	PENDANT LIGHTS IN WORSHIP & 2ND FLR	20	1	1.4		1.0	1	20	LIGHTS	#12	12
13	-	SPARE	20	1	-		-	1	20	SPARE	-	14
15	-	SPARE	20	1	-		-	1	20	SPARE	-	16
17	-	SPARE	20	1	-		-	1	20	SPARE	-	18

SOLID NEUTRAL / NEUTRAL WIRE (N)

TOTAL CONNECTED LOAD (kva) = 18.3

AØ = 7.7 | BØ = 4.1 | BØ = 6.5

GROUND BUS / GROUND WIRE (G)

** INSTALL BREAKER TO MATCH EQUIPMENT INSTALLED

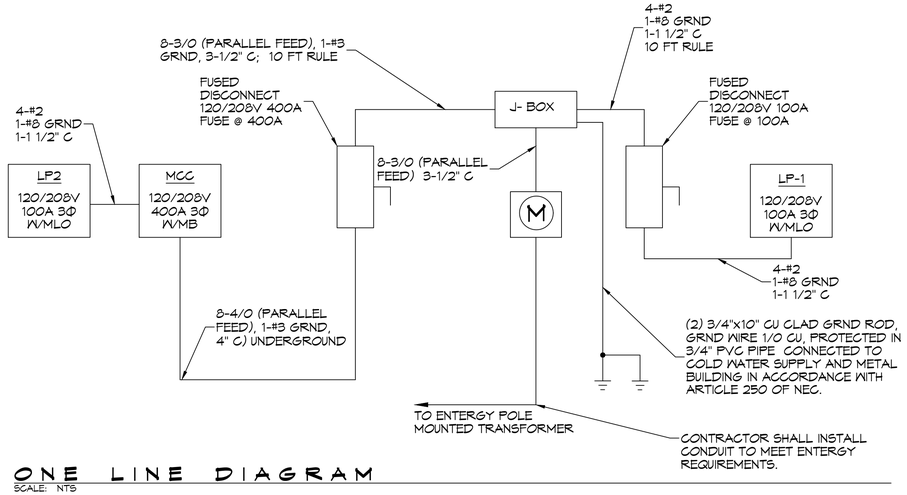

ONE LINE DIAGRAM
SCALE: NTS

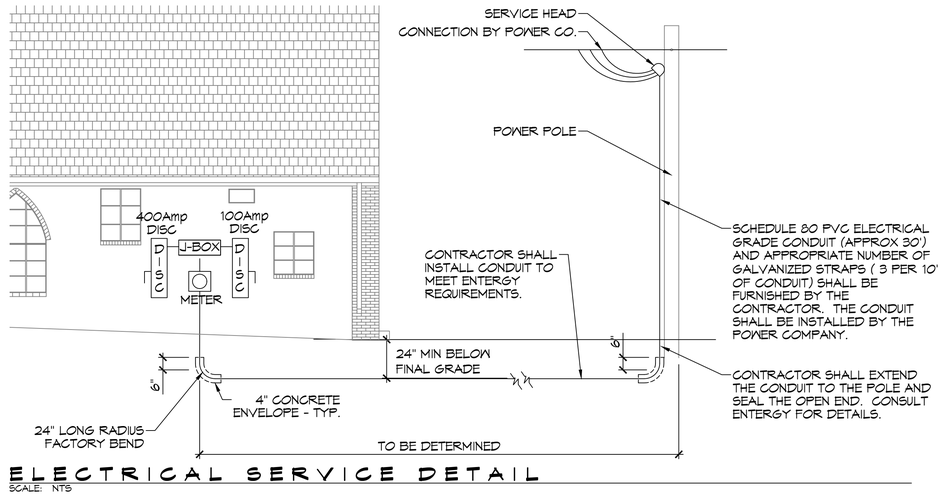

ELECTRICAL SERVICE DETAIL
SCALE: NTS

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832 F: 985.641.5950
Chief Engineer: Brian Mistich, PE
1554 Crosstown Blvd
Slidell, LA 70458

REVISIONS

#	DESCRIPTION	DATE

THE SIXTH BAPTIST CHURCH ADDITION & RENOVATION

The ideas, designs and plans shown on these drawings are and shall remain the property of Dammon Engineering, Inc. and are not to be used in whole or part for any project on which Dammon Engineering, Inc. has not been employed and developed without written consent of Dammon Engineering, Inc. © Dammon Engineering, Inc. 2025

DATE:	08-20-2025
CHECKED BY:	BAM
DRAWN BY:	CASD
JOB No:	2410

625 FELICITY STREET
NEW ORLEANS LA 70130

SHEET TITLE:
CIRCUIT PANELS AND ONE-LINE DIAGRAM

DRAWING NUMBER:
E104

SHEET No: 15 of 15