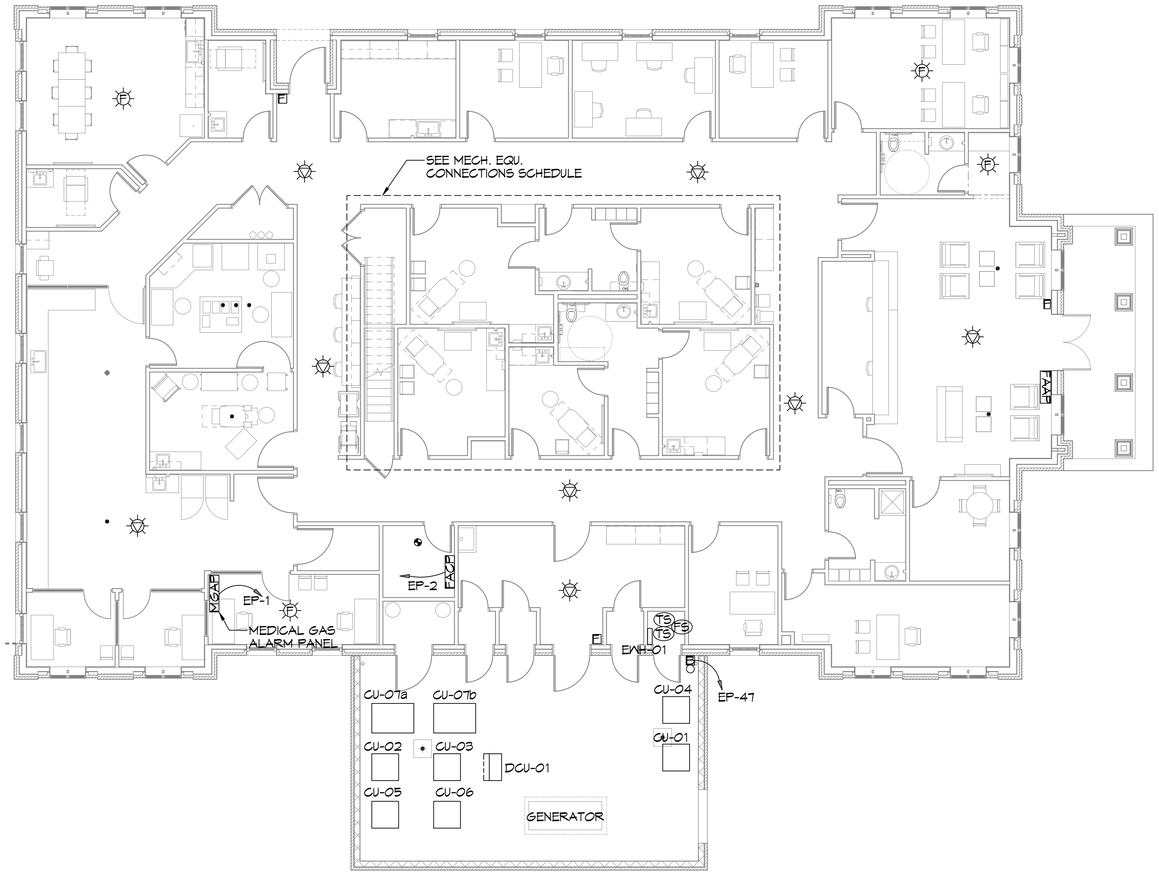

37 AUXILIARY PLAN

SCALE: 3/16"=1'-0"

FIRST FLOOR

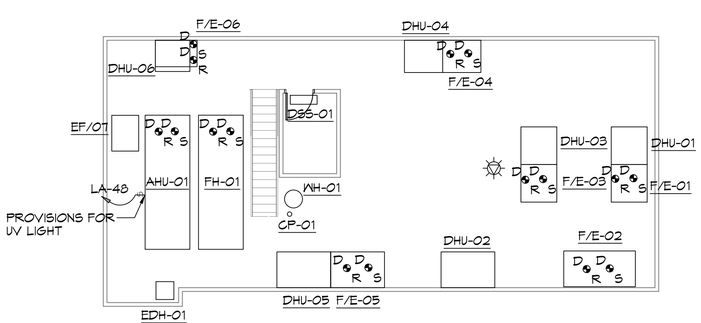

38 AUXILIARY PLAN- MEZZANINE

SCALE: 3/16"=1'-0"

SECOND FLOOR

MECHANICAL EQUIPMENT CONNECTIONS SCHEDULE

MARK	VOLTAGE	PANEL	CIRCUITRY	LOCAL DISCONNECT	REMARKS
AHU-01	208V3Φ	EP	3#12, #12(G), 1/2"C.	30/3I	
CU-01	208V1Φ	MA	2#8, #10(G), 3/4"C.	60/2/3R	
CU-02	208V1Φ	MA	2#10, #10(G), 3/4"C.	30/2/3R	
CU-03	208V1Φ	MA	2#8, #10(G), 3/4"C.	60/2/3R	
CU-04	208V1Φ	MA	2#12, #12(G), 1/2"C.	30/2/3R	
CU-05	208V1Φ	MA	2#8, #10(G), 3/4"C.	60/2/3R	
CU-06	208V1Φ	MA	2#10, #10(G), 3/4"C.	30/2/3R	
CU-07a	208V1Φ	EP	2#10, #10(G), 3/4"C.	30/2/3R	
CU-07b	208V1Φ	EP	2#10, #10(G), 3/4"C.	30/2/3R	
DCU-01	208V1Φ	MDP	2#12, #12(G), 1/2"C.	30/2/3R	INTERLOCKED WITH DSS-01
DSS-01	208V1Φ	MDP	2#12, #12(G), 1/2"C.	TWO POLE SWITCH (9[2P])	INTERLOCKED WITH DCU-01
F/E-01	120V, 1Φ	LB	2#10, #10(G), 3/4"C.	MOTOR RATED SWITCH (9[T])	
F/E-02	120V, 1Φ	LB	2#10, #10(G), 3/4"C.	MOTOR RATED SWITCH (9[T])	
F/E-03	120V, 1Φ	LB	2#10, #10(G), 3/4"C.	MOTOR RATED SWITCH (9[T])	
F/E-04	120V, 1Φ	LB	2#12, #12(G), 1/2"C.	MOTOR RATED SWITCH (9[T])	
F/E-05	120V, 1Φ	LB	2#10, #10(G), 3/4"C.	MOTOR RATED SWITCH (9[T])	
F/E-06	120V, 1Φ	LB	2#10, #10(G), 3/4"C.	MOTOR RATED SWITCH (9[T])	
DH-01	120V,1Φ	LB	2#12,#12(G), 1/2"C.	NEMA 5-20R	
DH-02	120V,1Φ	LB	2#12,#12(G), 1/2"C.	NEMA 5-20R	
DH-03	120V,1Φ	LB	2#12,#12(G), 1/2"C.	NEMA 5-20R	
DH-04	120V,1Φ	LB	2#12,#12(G), 1/2"C.	NEMA 5-20R	
DH-05	120V,1Φ	LB	2#12,#12(G), 1/2"C.	NEMA 5-20R	
DH-06	120V,1Φ	LB	2#12,#12(G), 1/2"C.	NEMA 5-20R	
EWH-01	208V, 1Φ	MA	2#12,#12(G), 1/2"C.	TWO POLE SWITCH (9[2P])	
EF-01	120V, 1Φ	LA	2#12,#12(G), 1/2"C.	PROVIDED WITH EQUIPMENT	INTERLOCKED WITH LIGHTS
EF-02	120V, 1Φ	LA	2#12,#12(G), 1/2"C.	PROVIDED WITH EQUIPMENT	INTERLOCKED WITH LIGHTS
EF-03	120V, 1Φ	LA	2#12,#12(G), 1/2"C.	PROVIDED WITH EQUIPMENT	INTERLOCKED WITH LIGHTS
EF-04	120V, 1Φ	LA	2#12,#12(G), 1/2"C.	PROVIDED WITH EQUIPMENT	INTERLOCKED WITH LIGHTS
EF-05	120V, 1Φ	EP	2#12,#12(G), 1/2"C.	PROVIDED WITH EQUIPMENT	INTERLOCKED WITH AHU-01
EF-06	120V, 1Φ	EP	2#12,#12(G), 1/2"C.	PROVIDED WITH EQUIPMENT	INTERLOCKED WITH AHU-01
EF-07	120V, 1Φ	LB	2#12,#12(G), 1/2"C.	PROVIDED WITH EQUIPMENT	INTERLOCKED WITH EMS SYSTEM
FH-01	208V, 1Φ	EP	2#12,#12(G), 1/2"C.	TWO POLE SWITCH (9[2P])	INTERLOCKED WITH EMS SYSTEM
EDH-01	208V, 1Φ	EP	2#1, #6(G), 1-1/4"C.	100/2/1	
CP-01	120V, 1Φ	LB	2#12, #12(G), 1/2"C.	30/1/1	
WH-01	120V, 1Φ	LB	2#12, #12(G), 1/2"C.	5-20R	

GENERAL NOTE 1: PRIOR TO SUBMITTING ELECTRICAL EQUIPMENT BROCHURES, THE CONTRACTOR SHALL VERIFY LOCATION, ACTUAL EQUIPMENT SUBMITTAL DATA AND ADJUST EQUIPMENT SERVICES ACCORDINGLY.

NOTE A: CORD AND PLUG PROVIDED BY MECHANICAL CONTRACTOR AND INSTALLED BY ELECTRICAL CONTRACTOR.

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5932
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458

REVISIONS

#	DESCRIPTION	DATE

SEAL:

NEW MEDICAL OFFICE

POSITIVE STEPS FERTILITY

500 OAK HARBOR BLVD
SLIDELL, LA 70450

JOB No:	24-71
DATE:	04-30-2025
DRAWN BY:	GKD
CHECKED BY:	BAM

THE DRAWINGS AND SPECIFICATIONS, INCLUDING BUT NOT LIMITED TO ELECTRONIC MEDIA, AS INSTRUMENTS OF SERVICE, ARE AND SHALL REMAIN THE PROPERTY OF DAMMON ENGINEERING, INC. THE REPRODUCTION, ALTERATION OR REPUBLICATION IN WHOLE OR IN PART, WITHOUT THE WRITTEN PERMISSION OF DAMMON ENGINEERING, INC. IS PROHIBITED. THE DRAWINGS AND SPECIFICATIONS MAY BE USED FOR THE CONSTRUCTION OF A SINGLE PROJECT BY THE OWNER AND THOSE ENGAGED IN THE CONSTRUCTION OF THE PROJECT. OTHER USE IS PROHIBITED. THE DRAWINGS AND SPECIFICATIONS MAY NOT BE USED FOR ANY OTHER PROJECT WITHOUT THE WRITTEN CONSENT OF DAMMON ENGINEERING, INC.

SHEET TITLE:
FIRST FLOOR
SECOND FLOOR
AUXILIARY PLAN

DRAWING NUMBER:

E101

SHEET No: 16 of 18