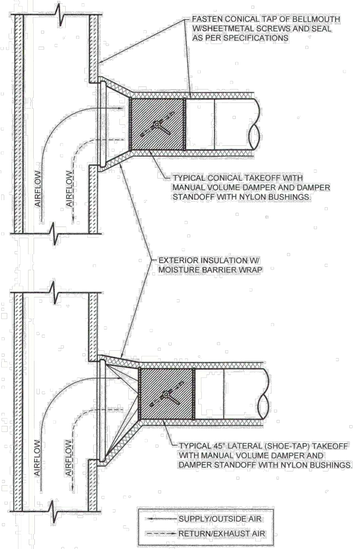

TYPICAL LOW PRESSURE RECTANGULAR TO ROUND DUCT TAKEOFF DETAIL

N.T.S.

NOTE:
TAKE-OFF FITTINGS SHALL BE FACTORY FABRICATED SPIN-IN TYPE. NO DOVETAIL FIELD JOINTS OR FITTINGS ARE ALLOWED.

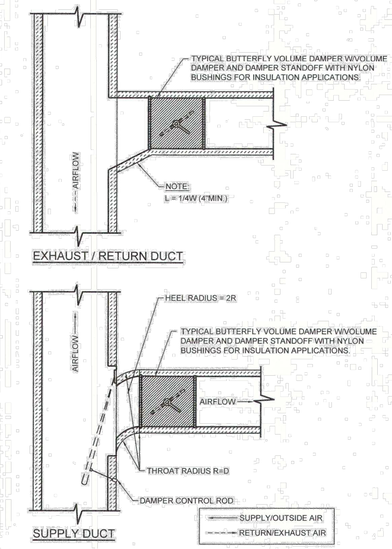

TYPICAL LOW PRESSURE RECTANGULAR TO RECTANGULAR DUCT TAKEOFF DETAIL

N.T.S.

NOTE:
TAKE-OFF FITTINGS SHALL BE FACTORY FABRICATED SPIN-IN TYPE. NO DOVETAIL FIELD JOINTS OR FITTINGS ARE ALLOWED.

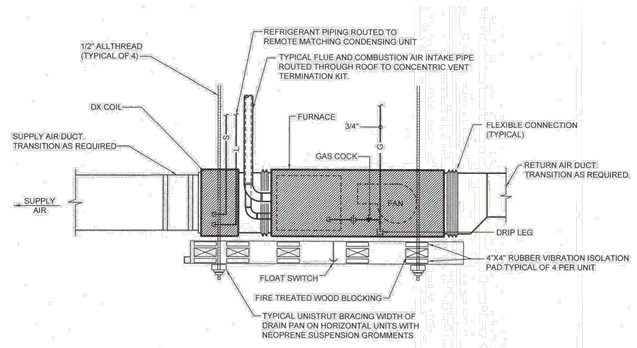

HORIZONTAL GAS FURNACE W/ DX COOLING DETAIL

N.T.S.

NOTES:
1. CONTRACTOR SHALL PROVIDE FLOAT SWITCH INSIDE DRAIN PAN TO DE-ENERGIZE UNIT WHEN ACTIVATED.

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.3832
Chief Engineer: Brian Mistich, PE
Civil/MEP
Slidell, LA 70458

#	DESCRIPTION	REVISIONS	DATE

SEAL:

PROGRESS SET

NEW MEDICAL OFFICE
DIANA OAK HARBOR REAL ESTATE LLC
540 OAK HARBOR BLVD
SLIDELL, LA 70458

JOB No:	2513
DRAWN BY:	CKD
DATE:	06-03-2025
CHECKED BY:	BAM

All drawings, plans and specifications, including all electronic versions thereof, are and shall remain the property of Dammon Engineering, and are not to be used in any way, including but not limited to reproduction, publication or distribution, without the express written consent of Dammon Engineering. Visual contact with these plans shall constitute prima facie evidence of the acceptance of these restrictions.

SHEET TITLE:
MECHANICAL DETAILS

DRAWING NUMBER:
M4.1

SHEET No: 42 of 52

FILE NAME: J:\... Houma - Medical - Demo\2513 - Diana Oaks Facility Master\Current Drawing in Use\M4.1 - Mechanical Details.dwg PLOT DATE & TIME: Tuesday, June 3, 2025 9:51:04 AM