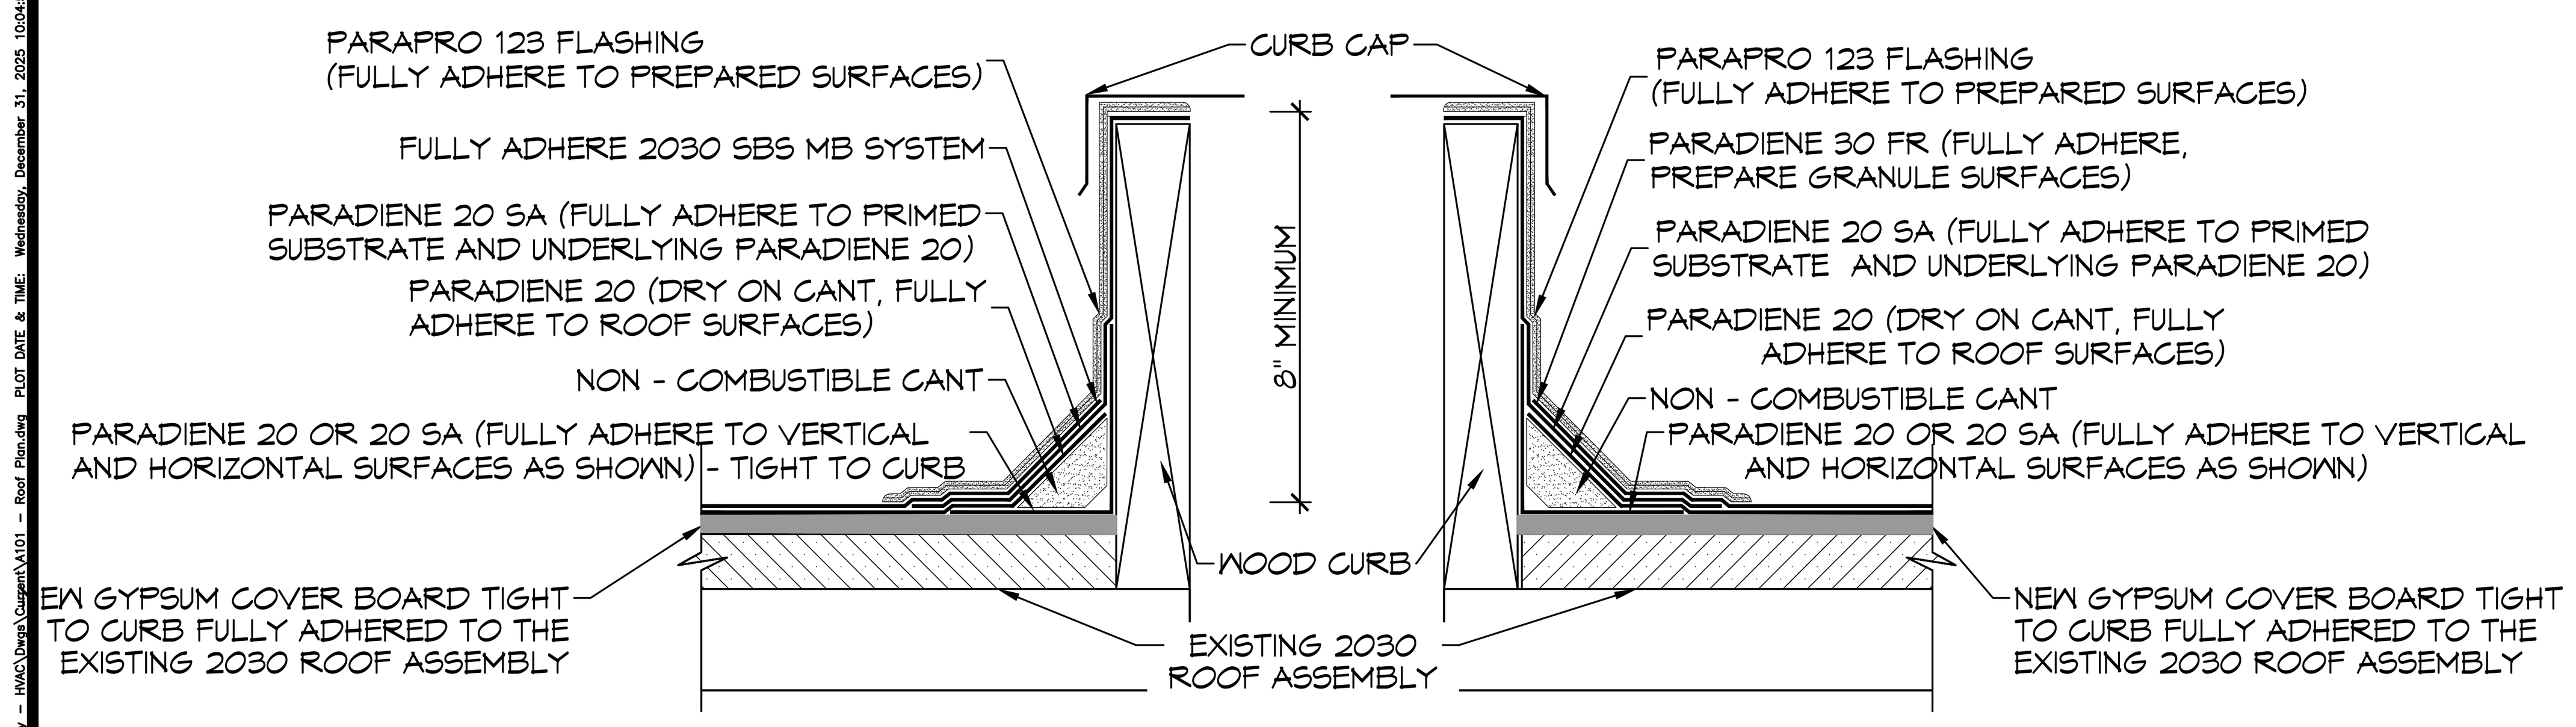

NOTES:
1. WHERE PRIMER IS INDICATED PA-1125, PA-917 LS, OR TA-119 PRIMER ARE REQUIRED TO MAINTAIN PROPER ADHESION. TA-119 IS REQUIRED FOR ALL PARADIENE 20 SA FLASHING REINFORCING AND STRIPPING PLY APPLICATIONS. CONTACT SIPLAST FOR SPECIFIC REQUIREMENTS.
2. REFER TO SIPLAST PREPARATION GUIDELINES FOR PROPER SURFACE TREATMENT OF ALL MATERIALS PRIOR TO APPLICATION OF PARAPRO MATERIAL.
3. THE PARAPRO CANNOT BE APPLIED IN THE ABOVE CONFIGURATION OVER MEMBRANES OR OTHER MATERIALS CONTAINING UNCURED, SOLVENT BASED MATERIALS. CONTACT SIPLAST FOR FURTHER INFORMATION.
4. REFER TO SIPLAST FLEECE CUTTING RECOMMENDATIONS FOR CONFIGURATIONS, CUTTING, FOLDING, AND LAPPING TECHNIQUES.
5. THE CARPENTRY AND METAL WORKS SHOWN DEPICTS SHOP FABRICATION AND JOB SITE ASSEMBLY. THESE COMPONENTS SHOULD BE DESIGNED/FABRICATED/INSTALLED ACCORDING TO GENERALLY ACCEPTED INDUSTRY PRACTICES, STANDARDS AND APPROVALS.
6. REQUIREMENTS AND RECOMMENDATIONS DETAILED IN THE CURRENT SIPLAST SPECIFICATIONS AND PARAPRO ROOF SYSTEM INSTALLER'S GUIDE SHALL APPLY IN ADDITION TO THE ABOVE DRAWING.
7. CONSULT TERANAP SPECIFICATION PLATES FOR OVERBURDEN/PROTECTION SYSTEM OPTIONS.

WOOD HVAC CURB WITH PARAPRO FLASHING
SCALE: N.T.S.

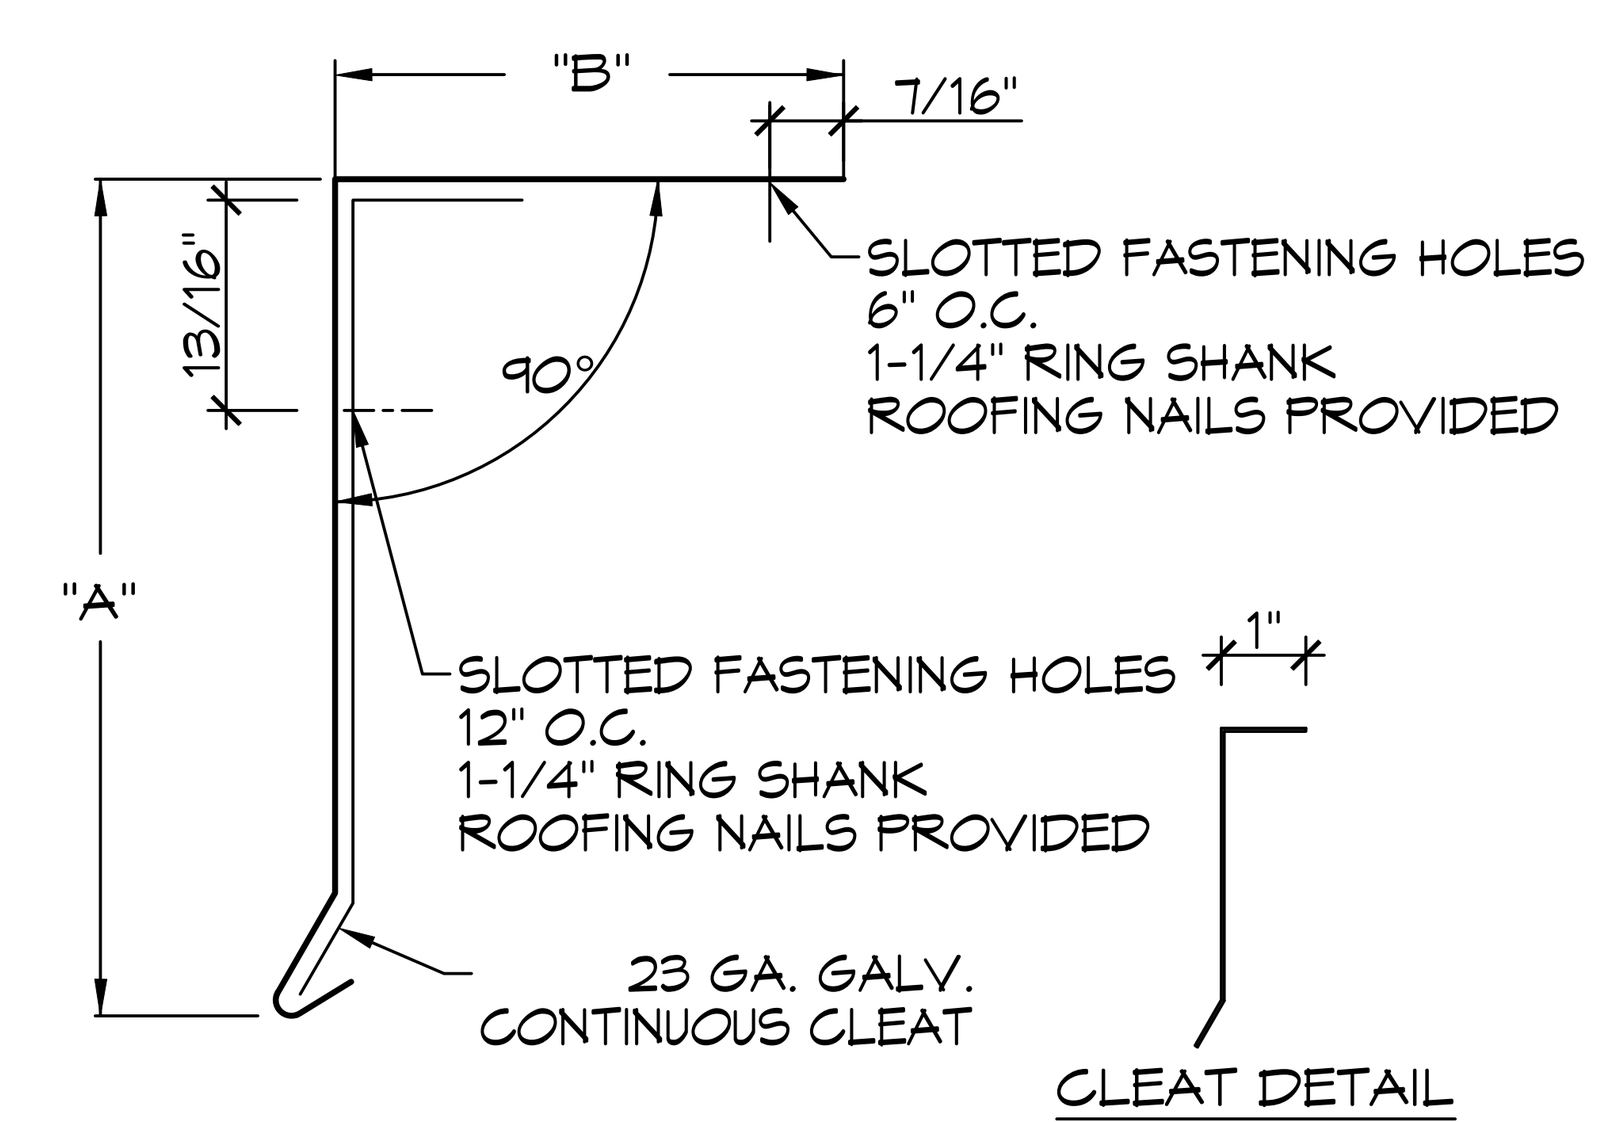

NOTES:
-INCLUDES 6" (152MM) WIDE CONCEALED SPLICE PLATES
-CONCEALED SPLICE PLATE MUST BE FIELD CAULKED TO PREVENT WATER ENTRY.
-UNLESS OTHERWISE NOTED, FABRICATION OF MITERS AND ACCESSORIES ARE FURNISHED STANDARD UTILIZING A NON PENETRATING QUICKLOCK JOINT, THEN FACTORY SEALED WATERTIGHT.

DRIP EDGE
SCALE: N.T.S.

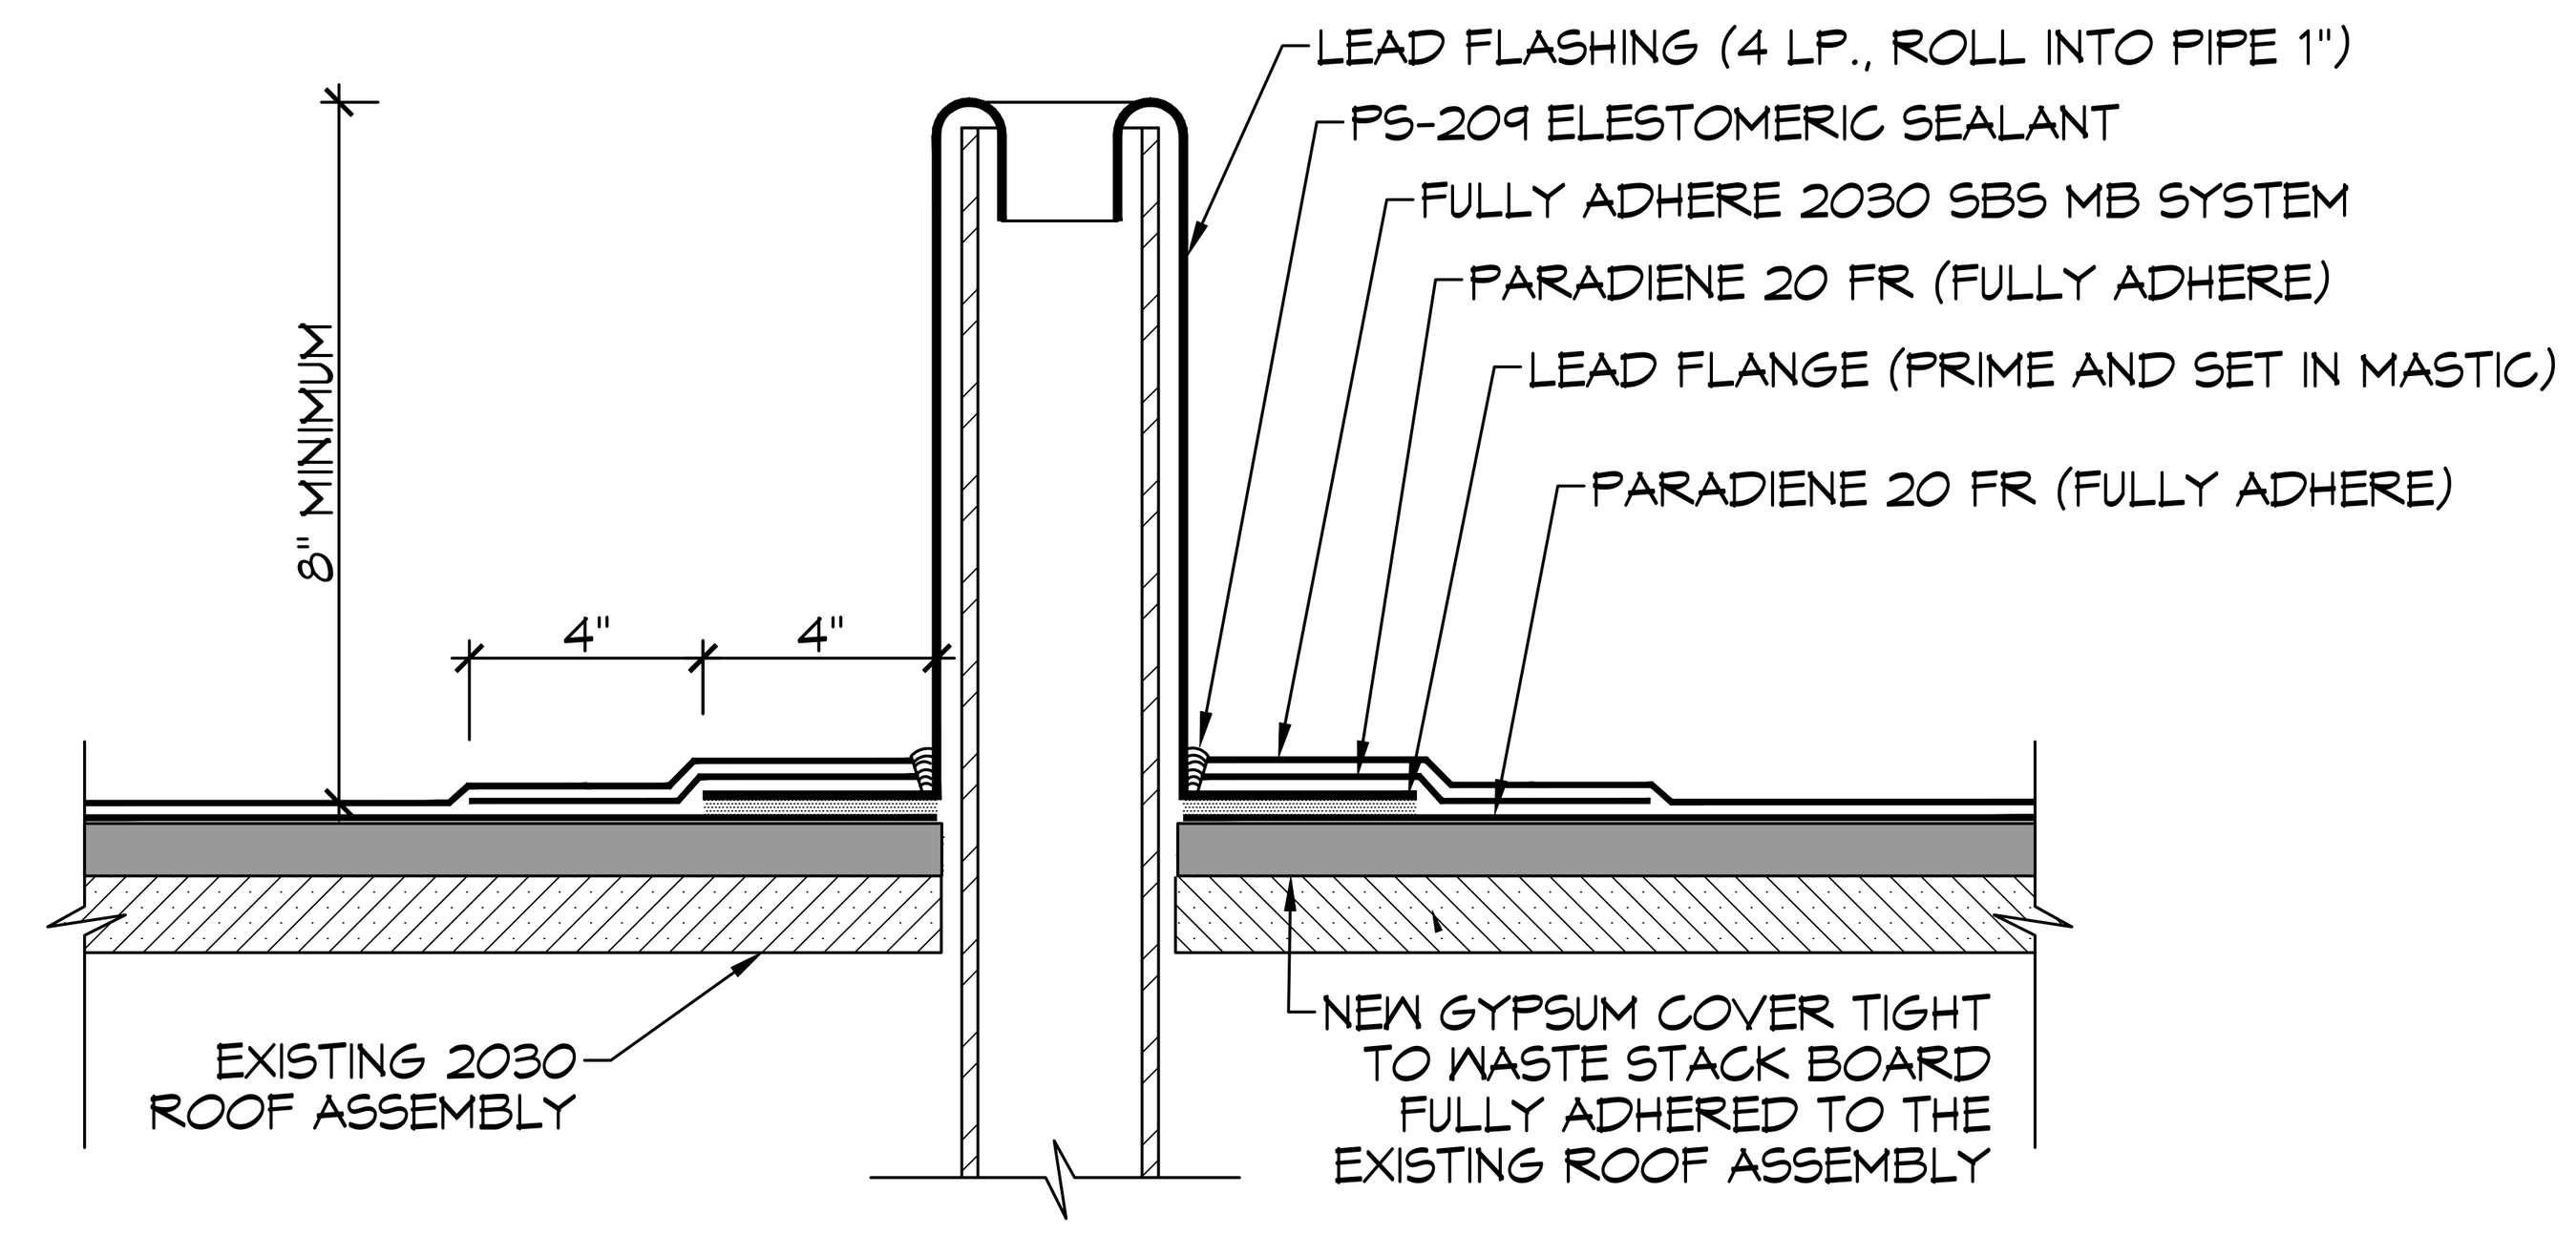

NOTES:
1. WHERE PRIMER IS INDICATED TO MAINTAIN PROPER ADHESION, USE PA-1125 OR PA-917 LS PRIMER. CONTACT SIPLAST FOR SPECIFIC REQUIREMENTS.
2. PA-1021 PLASTIC CEMENT, PA-828 FLASHING CEMENT, SFT CEMENT, OR PS-715 NS ELASTOMERIC SEALANT IS REQUIRED WHERE MASTIC IS INDICATED.
3. REQUIREMENTS AND RECOMMENDATIONS DETAILED IN CURRENT SIPLAST SPECIFICATIONS SHALL APPLY IN ADDITION TO THE ABOVE DRAWING.

WASTE STACK
SCALE: N.T.S.

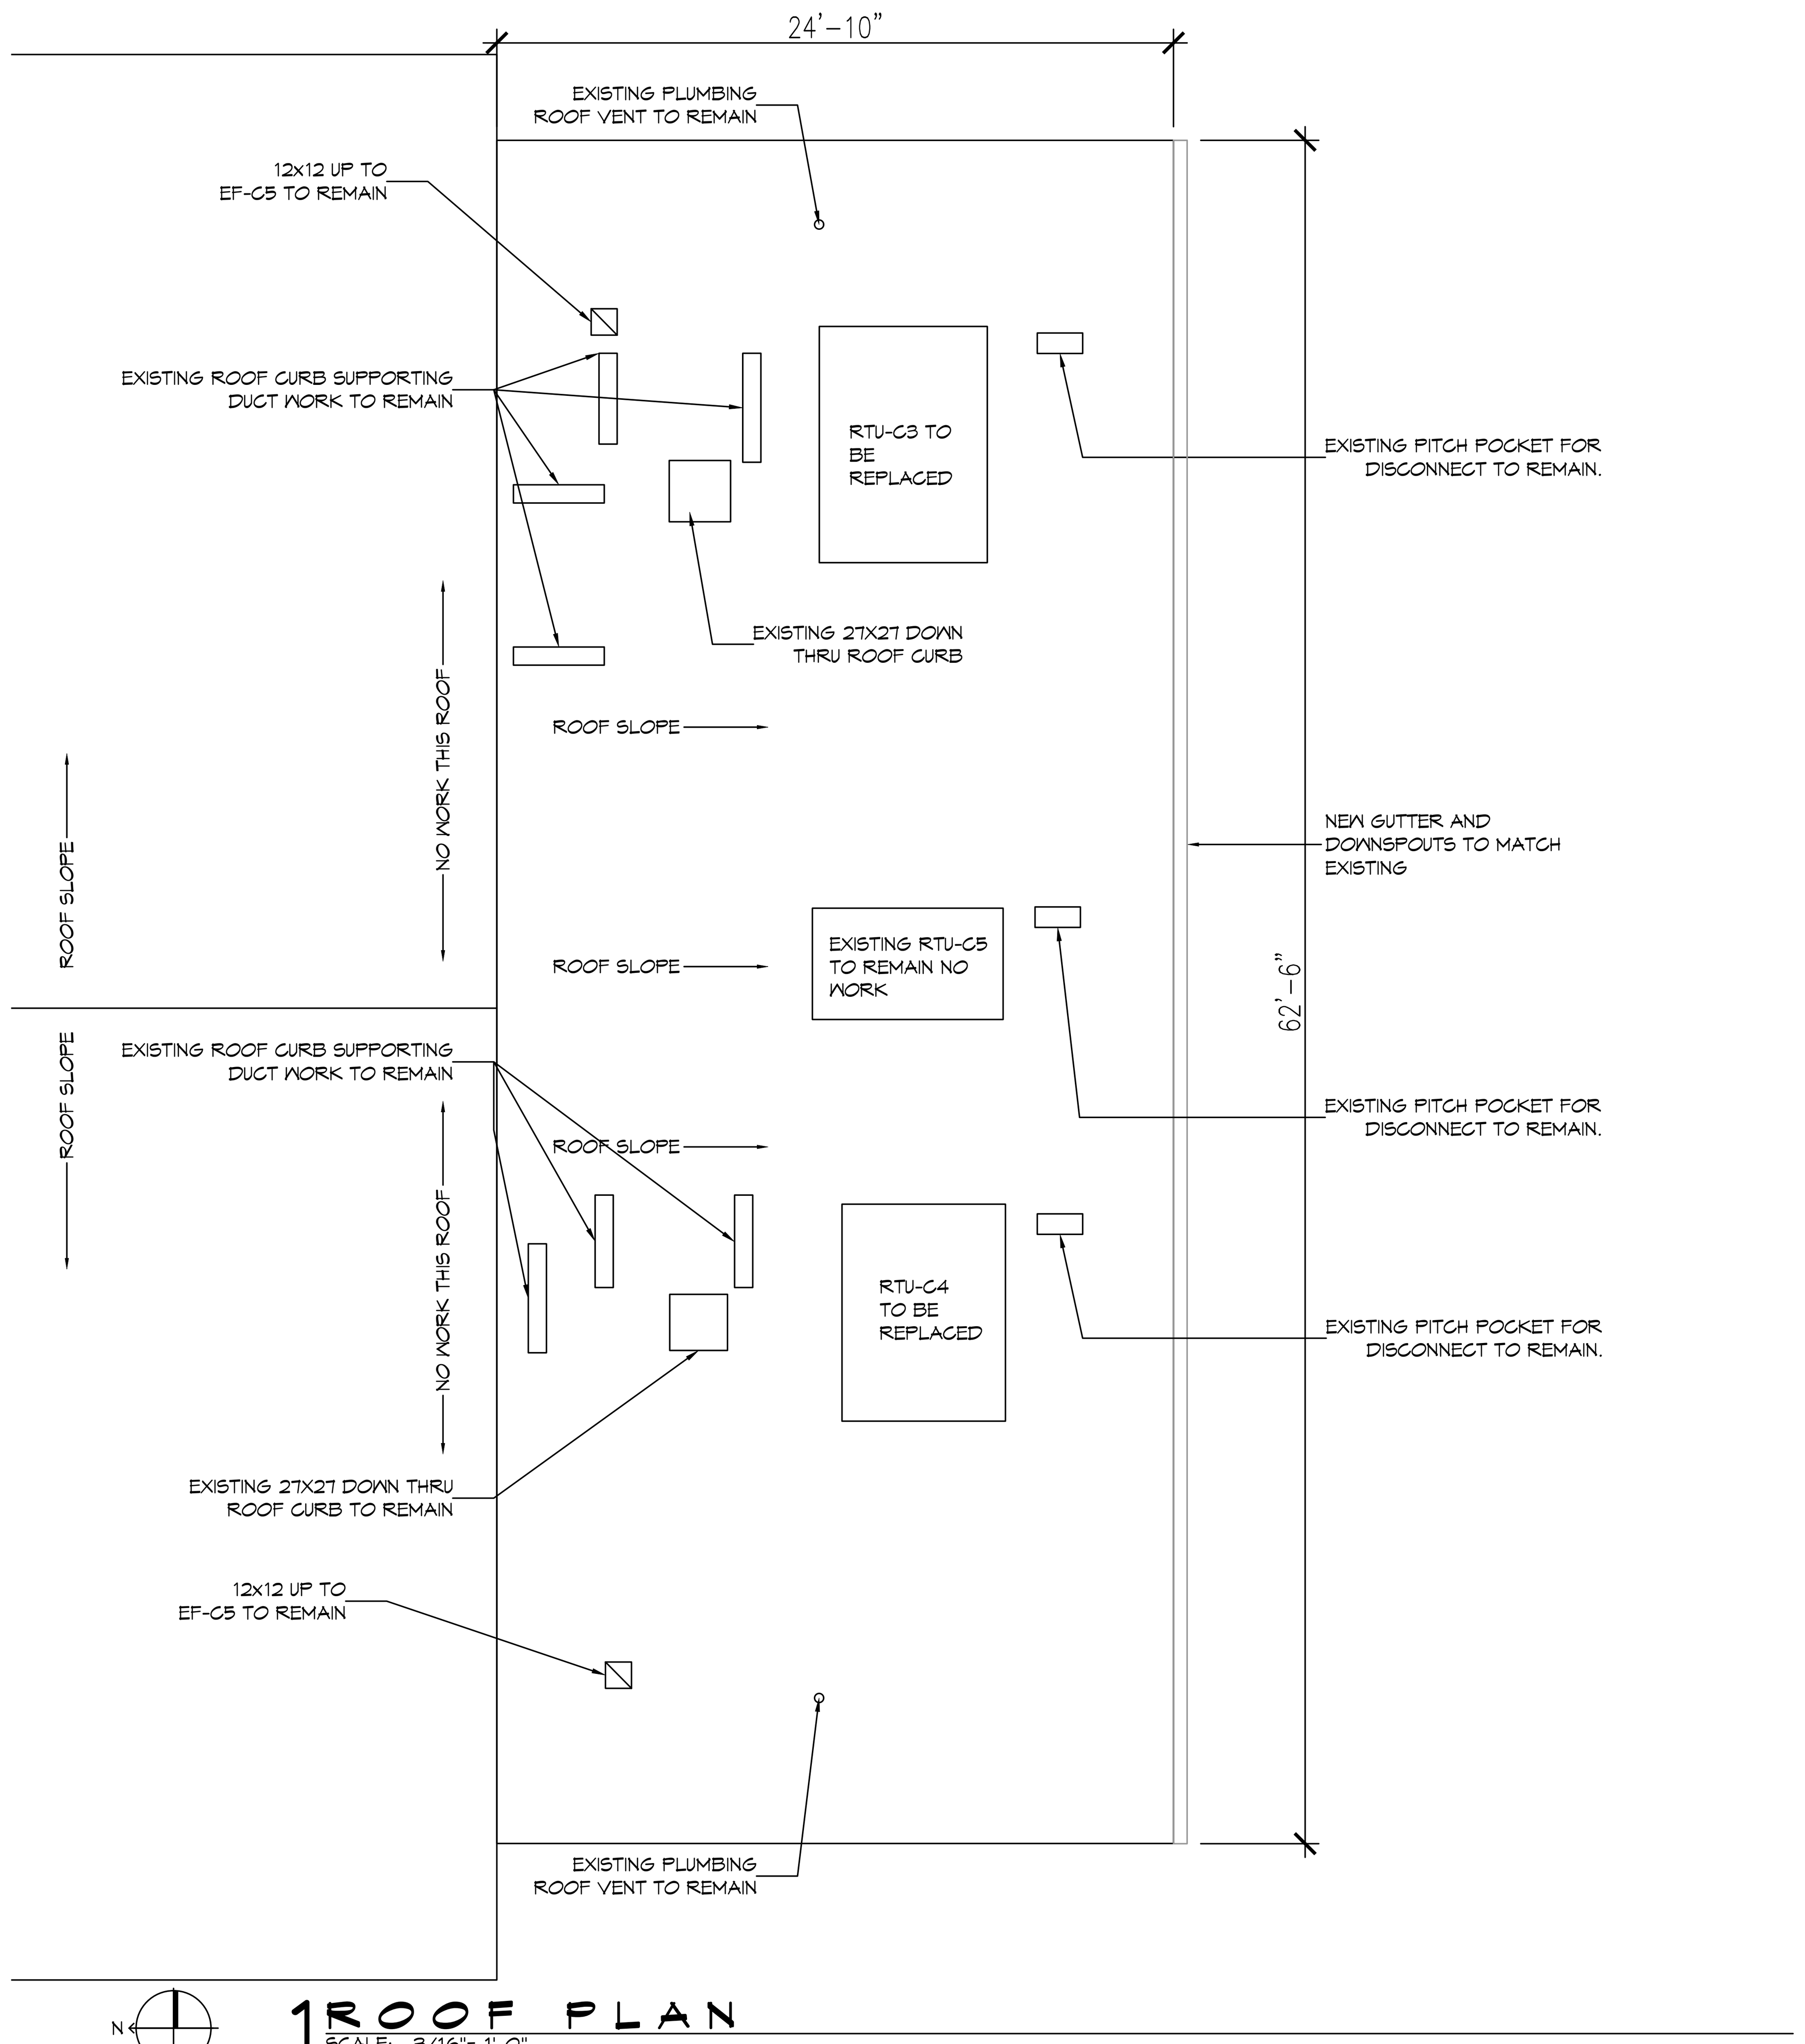

1 ROOF PLAN
SCALE: 3/16"= 1'-0"

3 PICTURES OF EXTERIOR ROOF
SCALE: N.T.S.

CONSTRUCTION NOTES

NEW ROOF SYSTEM TO CONSIST OF:
1. NEW GYPSUM COVER BOARD FULLY ADHERED TO THE EXISTING 2030 ROOF ASSEMBLY
2. FULLY ADHERE 2030 SBS MB SYSTEM
3. NEW PARAPRO RESIN FLASHING
4. SUPPLEMENTAL PARAPRO ROOF RESIN IN AREAS WITH POOL DRAINAGE
5. NEW PARAGUARD DRIP EDGE ALONG THE ROOF PERIMETER

CAUTION: ALL PRACTICES PERTAINING TO NRCA CERTA GUIDELINES SHALL BE FOLLOWED WHEN TORCHING METHODS ARE EMPLOYED. THIS INCLUDES PERFORMING A FIRE WATCH FOLLOWING ANY TORCH APPLICATIONS. ALWAYS HAVE APPROVED FIRE EXTINGUISHING EQUIPMENT NEARBY.

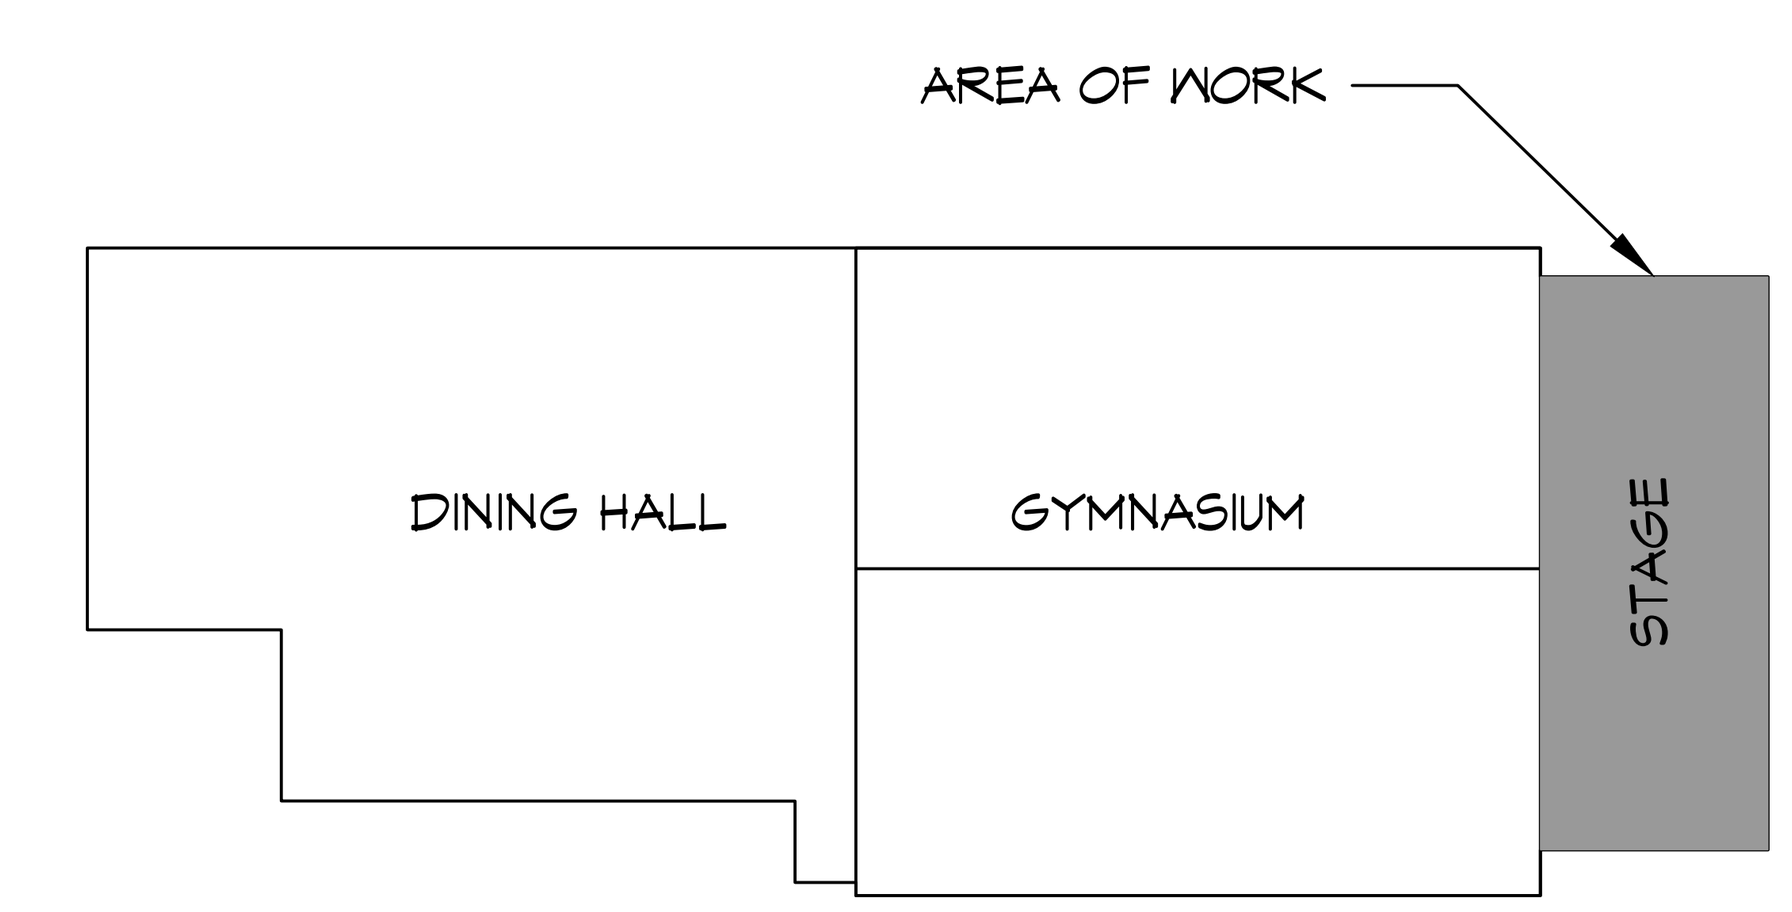

3 KEY PLAN
SCALE: N.T.S.

BLDG C

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832

REVISIONS

#	DESCRIPTION	DATE

SEAL:
STATE OF LOUISIANA
BRIAN A. MISTICH
License No. 30187
PROFESSIONAL ENGINEER
12/31/2025

HVAC REPLACEMENT & RE-ROOF
COVINGTON ELEMENTARY SCHOOL
325 S Jackson St,
Covington, LA 70433

JOB No:	2520	DATE:	12-16-2025
DRAWN BY:	CKD	CHECKED BY:	JMS

The above drawings and specifications, designs and arrangements represented thereby are and shall remain the property of Dammon Engineering, and no part thereof shall be copied, disclosed to others, or used in connection with any work or project other than the specific project for which the have been prepared and developed without written consent of Dammon Engineering. Visual contact with these drawings or specifications shall constitute conclusive evidence of acceptance of these restrictions.

SHEET TITLE:
WING 100 ROOF PLAN

DRAWING NUMBER:
A101

SHEET No: 3 of 12