

JOB NO
5844108


MODEL NUMBER SC-111110MA
JOB NAME Sixth Baptist Church

DRAWN BY
DATE 2/6/2023

SCHEMATIC TYPE
INSTALL
DWG NO
ECP #1-2

DESCRIPTION OF OPERATION:
120V 1 Phase w/ control for 1 Exhaust Fan, 1 Supply Fan, Exhaust on in Fire, Lights out in Fire, Relay On/Off with Supply Fan, Fans On/Off Thermostatically Controlled, Room temperature sensor shipped loose for field installation.

CONTROL PANEL TO FIRE SYSTEM
Responsibility: CERTIFIED INSTALLER

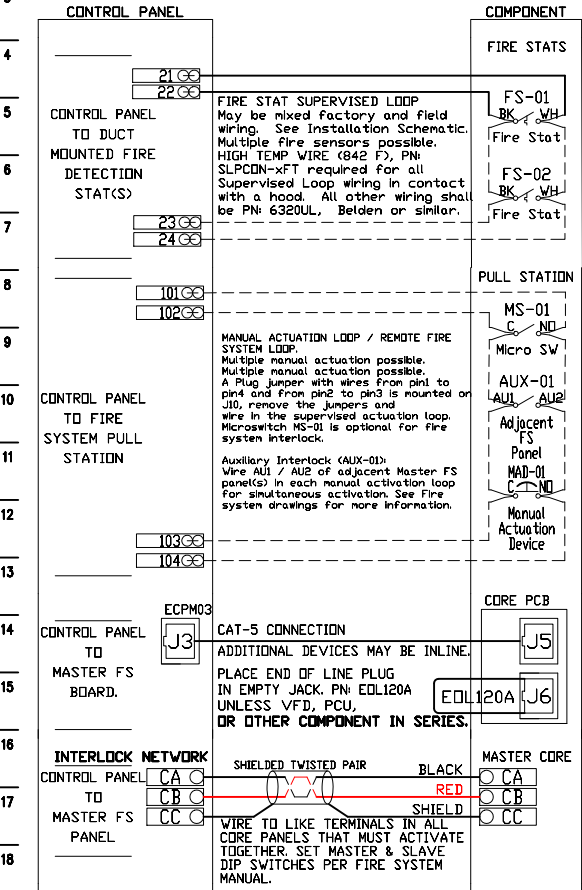

19
20
21
22
23
24