GENERAL NOTES

1. ALL LUMBER SHALL BE PRESSURE TREATED WITH A RETENTION OF .4 PER C.F.
2. ALL FASTENERS SHALL BE HOT DIPPED GALVANIZED (HDG) PER ASTM A153.
3. ALL CONNECTORS SHALL BE HDG PER ASTM A653, CLASS G185 SHEET WITH 1.85 OZ/SF ZINC COATING.

ROOF TIE-DOWNS

1. SEC. 18-10. - ROOF TIE-DOWN STRAPS.
2. FOR ALL NEW CONSTRUCTION, ROOF TIE-DOWN STRAPS WILL BE REQUIRED TO AID IN THE STRUCTURAL INTEGRITY OF A STRUCTURE TO WITHSTAND A 150 MPH WIND EVENT.
3. ONLY GALVANIZED STEEL STRAPPING SHALL BE UTILIZED. STRAPPING SHALL HAVE A MINIMUM SECTION OF ONE AND ONE-FOURTH INCH BY ONE-EIGHTH INCH AND HAVE A MINIMUM BREAKING STRENGTH OF 4,750 POUNDS. NO SPLICES WILL BE ALLOWED.
4. ROOF TIES SHALL BE INSTALLED AT EACH EXTERIOR PILING AND ALONG THE STRUCTURES SILL. THE MAXIMUM SPACING FOR ROOF TIE-DOWN STRAPS SHALL BE TEN FEET.
5. ROOF TIE-DOWN STRAPS SHALL BE ATTACHED TO THE STRUCTURES SILL OR PILING, RUN ALONG THE SIDE WALL, OVER THE ROOF STRUCTURE FRAMING AND DECKING, AND ATTACHED TO THE SILL ON THE OPPOSING SIDE OF THE STRUCTURE.
6. COMMERCIALLY AVAILABLE ADAPTERS SHALL BE UTILIZED TO PREVENT SHARP BENDS IN THE TIES AND TO KEEP THEM FROM CUTTING INTO THE STRUCTURAL FRAMING WHEN TENSION IS APPLIED.

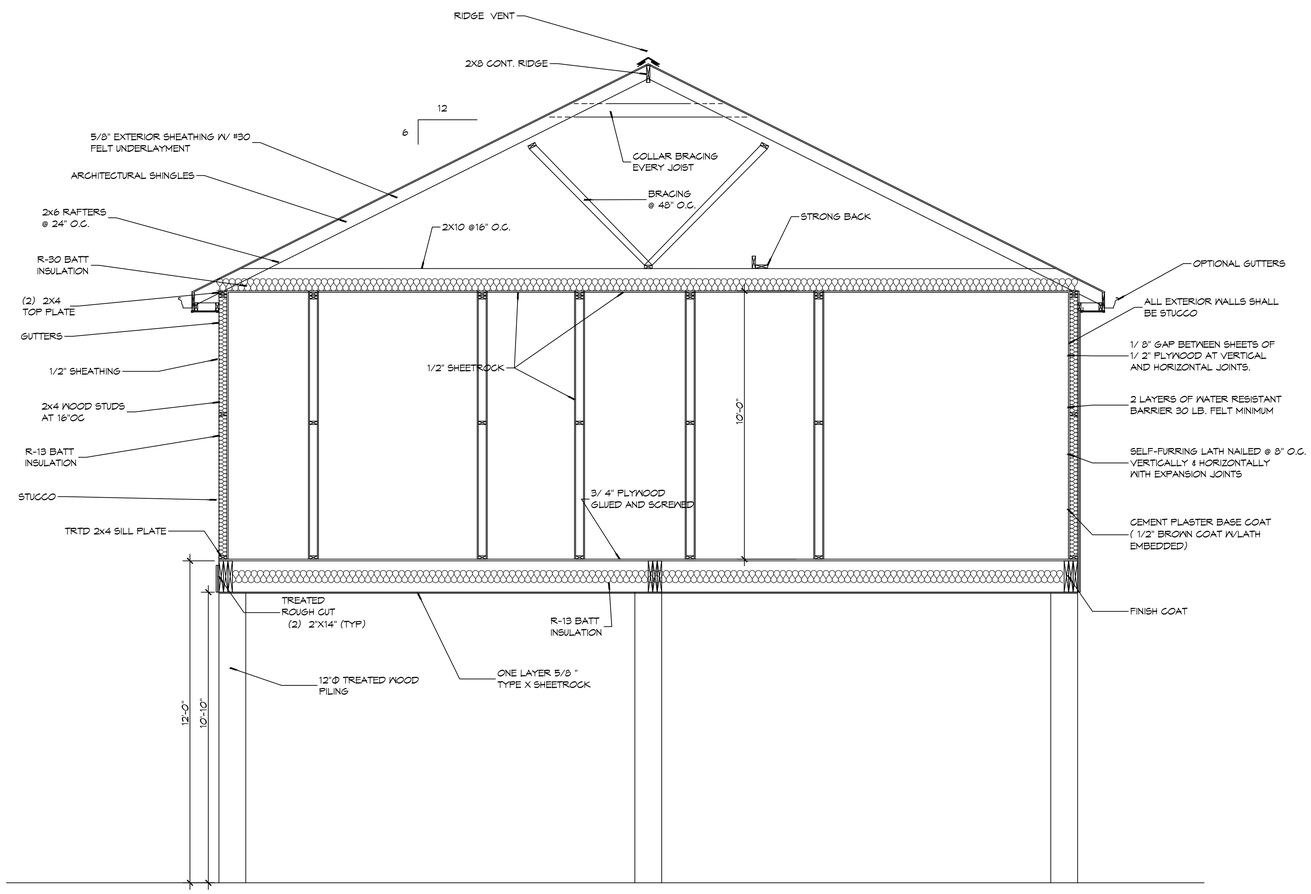

8 HOUSE SECTION
SCALE: 3/8" = 1'-0"

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832
Chief Engineer: Brian Mistich, PE
154 Lost Spur Trail
Slidell, LA 70458

#	DESCRIPTION	DATE

REVISIONS

SEAL:

NEW HOUSE PLAN
JASON GUY
LOT 22B
MONSA DRIVE
COVINGTON, LOUISIANA 70433

JOB No:	
DATE:	05-29-2025
DRAWN BY:	CKD
CHECKED BY:	BJM

THIS DRAWING IS THE PROPERTY OF DAMMON ENGINEERING, INC. AND MUST BE RETURNED ON REQUEST. THIS DRAWING MAY NOT BE REPRODUCED IN WHOLE OR IN PART, NOR MAY IT BE USED FOR ANY PURPOSE OTHER THAN THE PROJECT FOR WHICH IT WAS PREPARED WITHOUT WRITTEN CONSENT OF DAMMON ENGINEERING, INC.

SHEET TITLE:
HOUSE SECTION AND ROOF PLAN

DRAWING NUMBER:
S106

SHEET No: 8 of 13