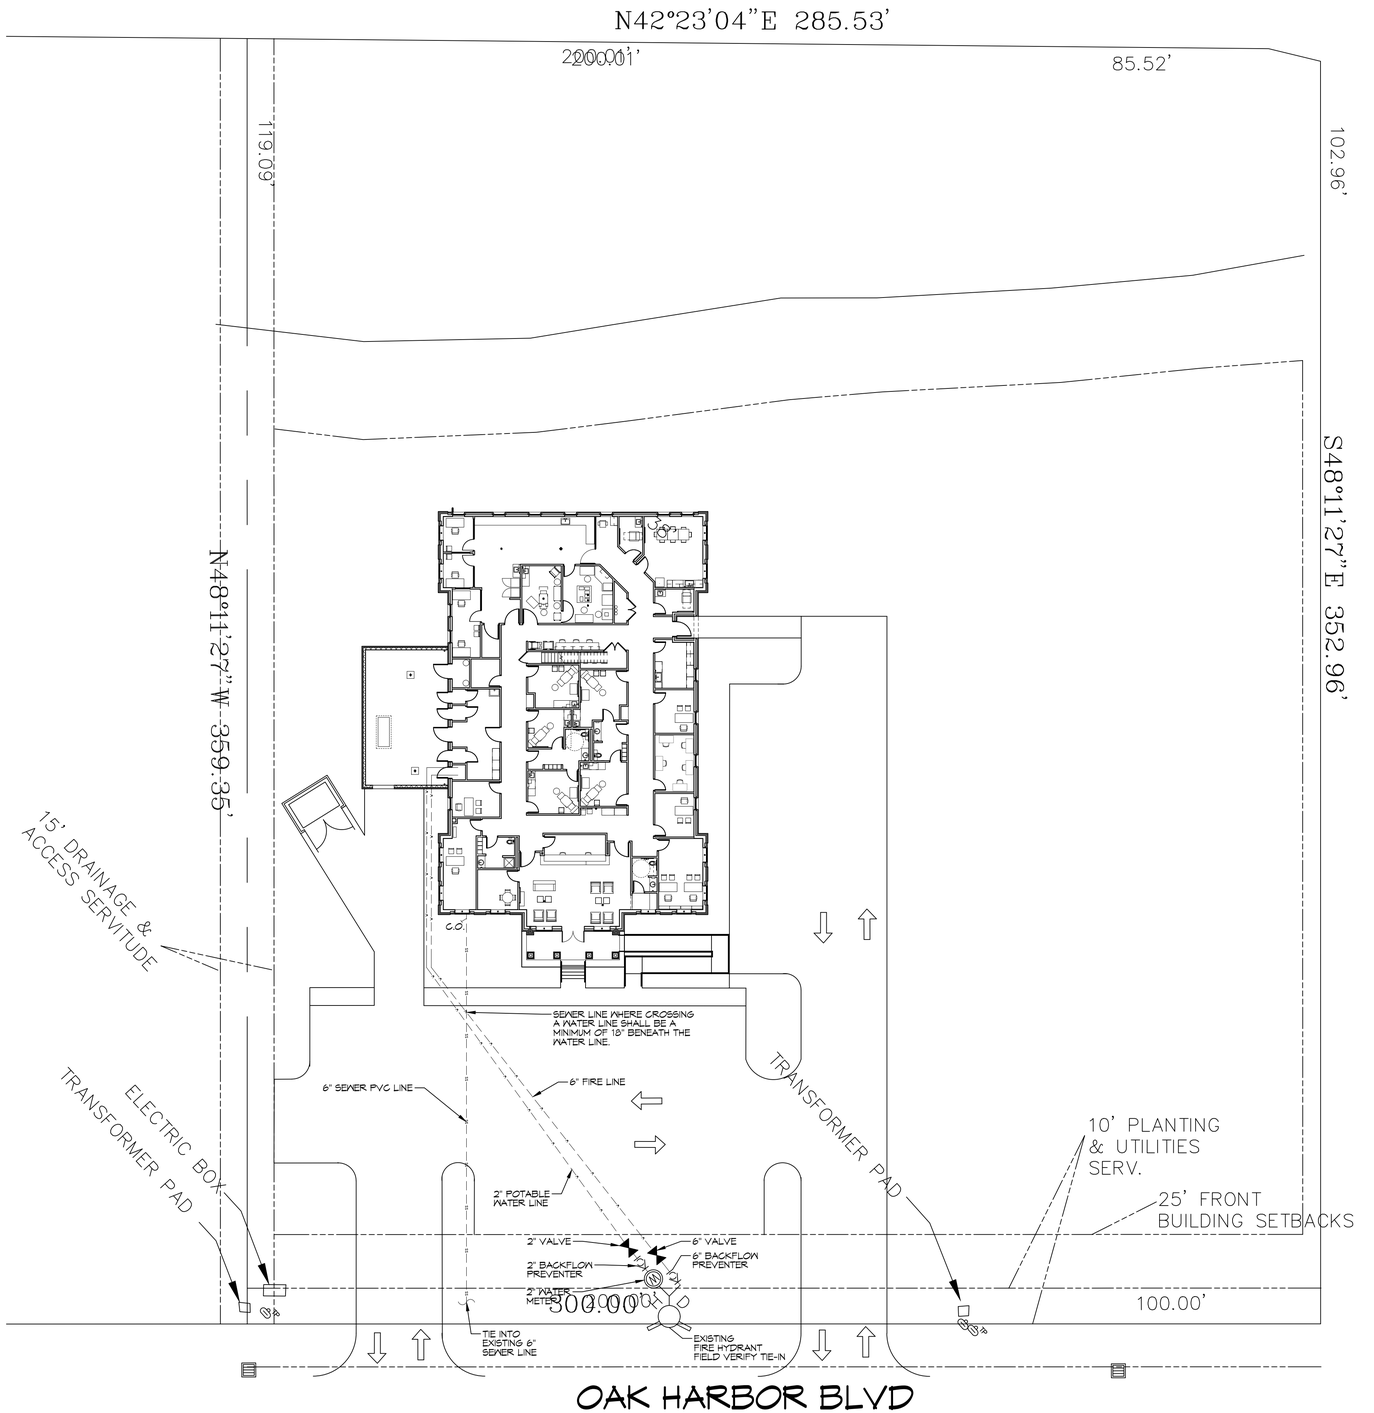

UTILITY SITE PLAN
SCALE: 1" = 20'-0"

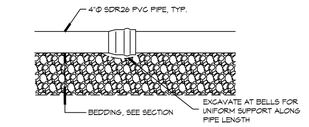

DETAIL
SCALE: N.T.S. TYPICAL PIPE BEDDING

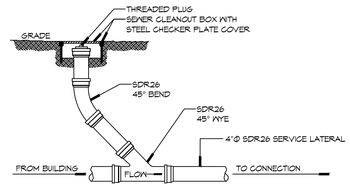

DETAIL
SCALE: N.T.S. SEWER CLEAN OUT

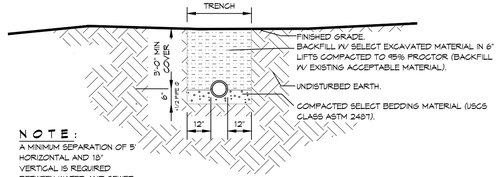

NOTE:
A MINIMUM SEPARATION OF 5' HORIZONTAL AND 18" VERTICAL IS REQUIRED BETWEEN WATER AND SEWER LINES. SEWER LINE SHALL BE A MINIMUM 18" BELOW THE WATER LINE.

DETAIL
SCALE: N.T.S. SEWER AND WATER SEPERATION

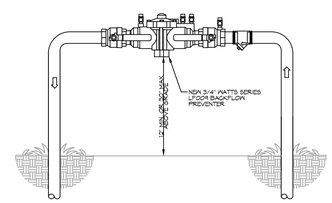

TYPICAL RISER DETAIL
SCALE: N.T.S. TYPICAL

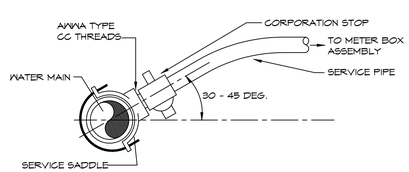

WATER SERVICE CONNECTION
SCALE: N.T.S. TYPICAL

GENERAL SITE NOTES

1. PROVIDE ALL LABOR, MATERIAL AND EQUIPMENT FOR A COMPLETE OPERATING SYSTEM. CONTRACTOR IS TO FIELD VERIFY ALL EXISTING UTILITY LOCATIONS, ELEVATIONS, AND INVERTS PRIOR TO COMMENCING ANY WORK. CONTRACTOR SHALL PAY NECESSARY FEES FOR THE UTILITIES CONNECTIONS.
2. CONTRACTOR TO BE RESPONSIBLE TO VERIFY ANY INVERTS AND SET NEW INVERTS OF SEWAGE AND DRAINAGE PIPES.
3. ALL WORK AND MATERIAL TO COMPLY STRICTLY TO THE LATEST LOCAL CITY PARISH, STATE, AND NATIONAL GOVERNING CODES.
4. SEWAGE LINES 3" AND SMALLER SHALL BE SLOPED 1/4" PER FOOT AND LINES THAT ARE 4" AND LARGER SHALL BE SLOPED 1/8" PER FOOT.
5. CONTRACTOR SHALL CONTACT LOUISIANA ONE CALL PRIOR TO COMMENCEMENT OF SITE EXCAVATION.
6. CONTACT BILLY PALMISANO WITH THE CITY OF SLIDELL PUBLIC UTILITY DEPARTMENT AT (985)646-4291 FOR TAPS.

SITE UTILITIES LEGEND

—— v —— v —— NEW WATER LINE
—— s —— s —— NEW SEWER LINE

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
infosdammonengineering.com
PH: 985.649.5832
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458

#	DESCRIPTION	DATE
	REVISIONS	

SEAL:

NEW MEDICAL OFFICE
POSITIVE STEPS FERTILITY
500 OAK HARBOR BLVD
SLIDELL, LA 70458

JOB No: 2477 | DATE: 04-30-2025
DRAWN BY: CKD | CHECKED BY: BAK

All ideas, designs and arrangements indicated or represented by these drawings are owned by and are the property of Dammon Engineering and were created, evolved and developed for use on and in connection with the specified project. None of such ideas, designs or arrangements may be used by or disclosed to any person, firm or corporation for any purpose whatsoever without the written permission of Dammon Engineering. Visual contact with these drawings or specifications shall constitute prima facie evidence of the acceptance of these restrictions.

SHEET TITLE:
UTILITY SITE PLAN

DRAWING NUMBER:
C105

SHEET No: 5 of 18