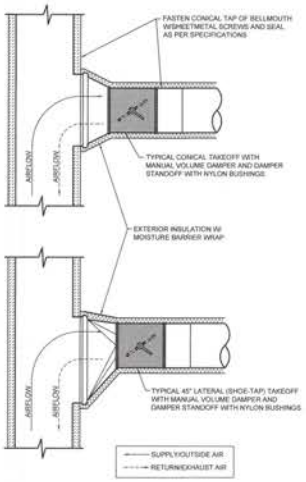

TYPICAL LOW PRESSURE RECTANGULAR TO ROUND DUCT TAKEOFF DETAIL

N.T.S.

NOTE:
TAKE-OFF FITTINGS SHALL BE FACTORY FABRICATED SPIN-IN TYPE. NO DOVETAIL FIELD JOINTS OR FITTINGS ARE ALLOWED.

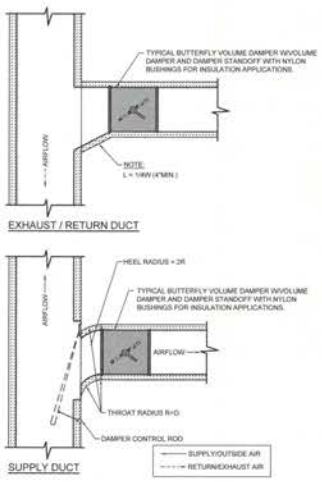

TYPICAL LOW PRESSURE RECTANGULAR TO RECTANGULAR DUCT TAKEOFF DETAIL

N.T.S.

NOTE:
TAKE-OFF FITTINGS SHALL BE FACTORY FABRICATED SPIN-IN TYPE. NO DOVETAIL FIELD JOINTS OR FITTINGS ARE ALLOWED.

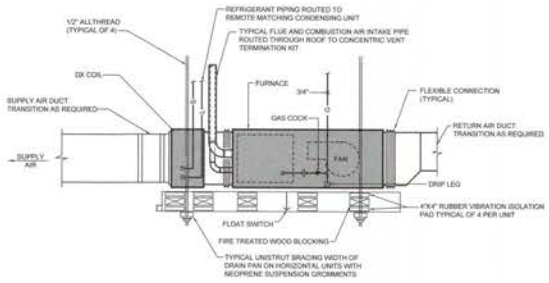

HORIZONTAL GAS FURNACE W/ DX COOLING DETAIL

N.T.S.

NOTES:
1. CONTRACTOR SHALL PROVIDE FLOAT SWITCH INSIDE DRAIN PAN TO DE-ENERGIZE UNIT WHEN ACTIVATED.

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI

www.dammonengineering.com
info@dammonengineering.com
Ph: 985.649.5832

Chief Engineer: Brian Mistich, PE
Cell: 985.649.5832
Email: bmistich@dammonengineering.com
Slidell, LA 70458

REVISIONS

#	DESCRIPTION	DATE

SEAL:

NEW MEDICAL OFFICE
DIANA OAK HARBOR REAL ESTATE LLC

342 OAK HARBOR BLVD
SLIDELL, LA 70458

JOB No:	2813	DATE:	05-16-2025
DRAWN BY:	CJD	CHECKED BY:	BAM

SHEET TITLE:
MECHANICAL DETAILS

DRAWING NUMBER:
M4.1

SHEET No: 42 of 52