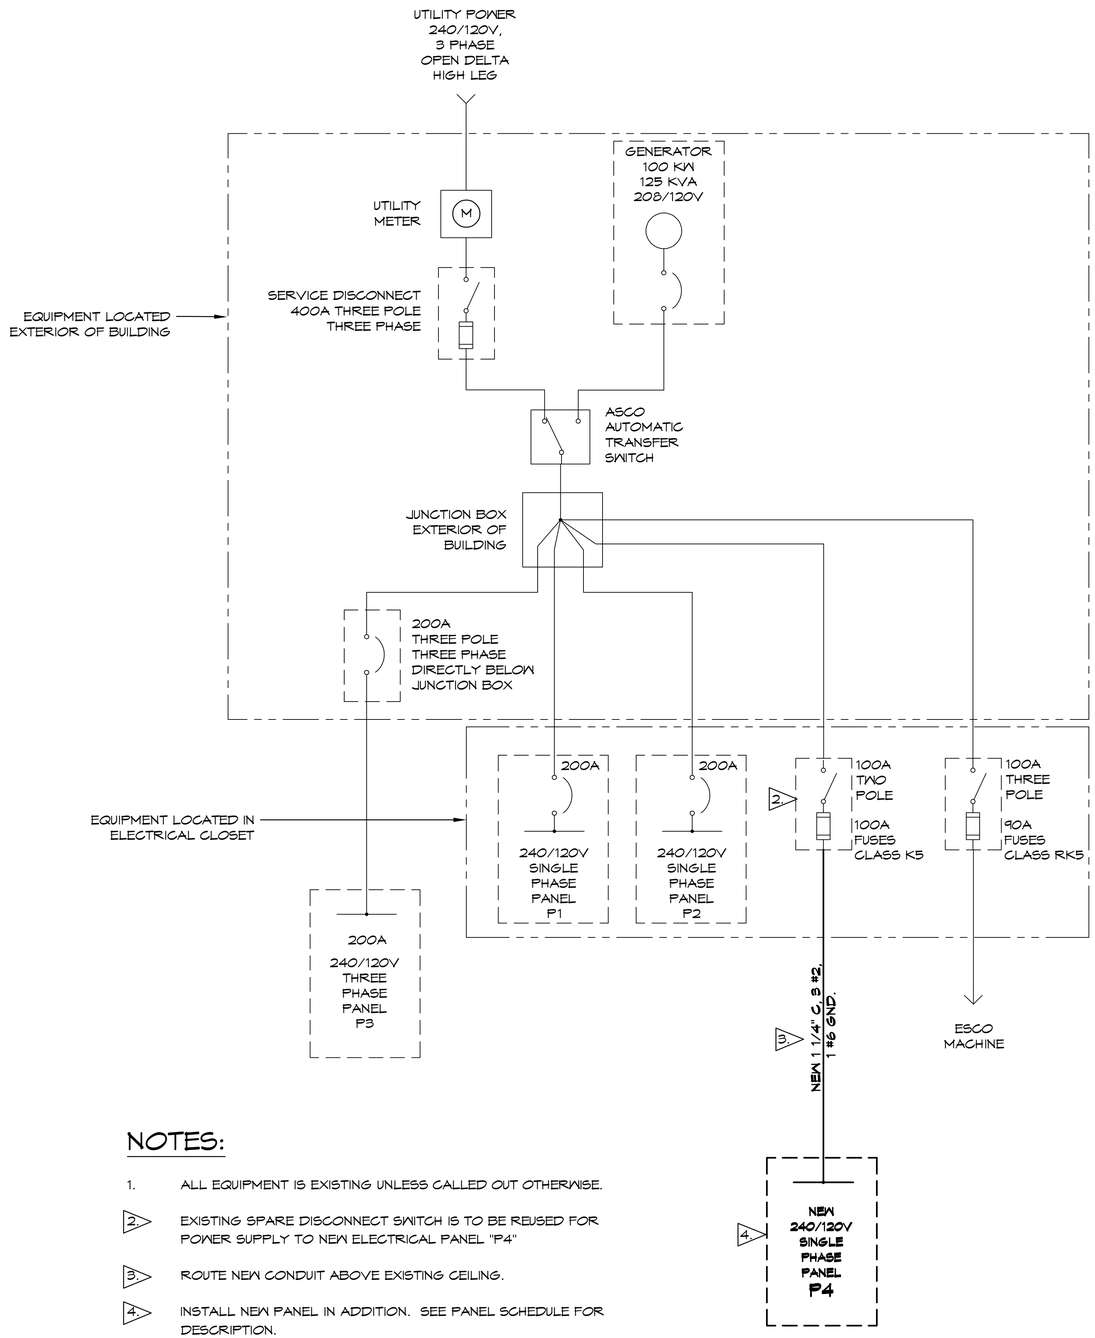

NOTES:

1. ALL EQUIPMENT IS EXISTING UNLESS CALLED OUT OTHERWISE.
2. EXISTING SPARE DISCONNECT SWITCH IS TO BE REUSED FOR POWER SUPPLY TO NEW ELECTRICAL PANEL "P4"
3. ROUTE NEW CONDUIT ABOVE EXISTING CEILING.
4. INSTALL NEW PANEL IN ADDITION. SEE PANEL SCHEDULE FOR DESCRIPTION.

ONE LINE DIAGRAM

NOTES:

1. MARK HIGH LEG WITH ORANGE TAPE PER NEC ART 230.56.
2. FIELD MARK PANEL AS FOLLOWS: "CAUTION B PHASE HAS 208 VOLTS TO GROUND" PER NEC ART 408.3 (F)

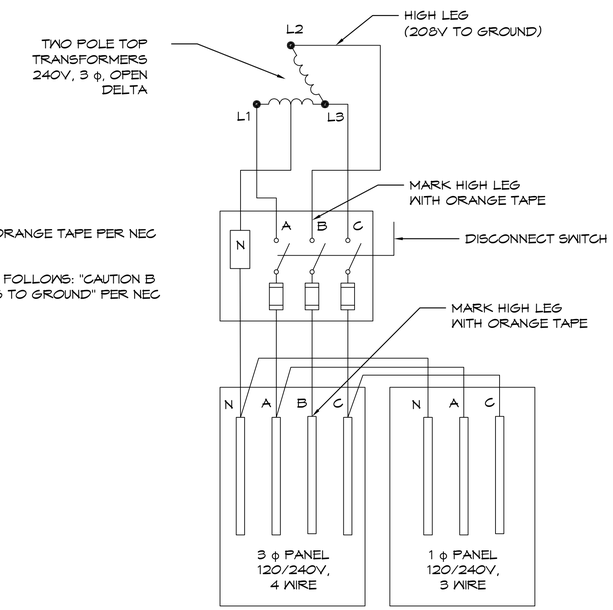

DIAGRAM DELTA HIGH LEG

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832
Chief Engineer: Brian Mistich, PE
5540 Classen Trail
Slidell, LA 70458

#	DESCRIPTION	DATE

REVISIONS

SEAL:

The ideas and designs shown on this drawing, regardless of the form or medium on which they are recorded, are the property of Dammon Engineering, and the same cannot be used for any purpose other than that for which the same were prepared and developed without written consent of Dammon Engineering. Visual contact with these drawings shall constitute conclusive evidence of acceptance of these restrictions.

NEW WAREHOUSE
SEC-SPECIALITY
ENHANCED
IMAGING

421 SOUTH STREET
SLIDELL, LA 70460

JOB No:	2448	DATE:	07-24-2025
DRAWN BY:	DD/JTL	CHECKED BY:	BAM

SHEET TITLE:
ELECTRICAL ONE LINE DIAGRAM

DRAWING NUMBER:
E105

SHEET No: 50 of 11