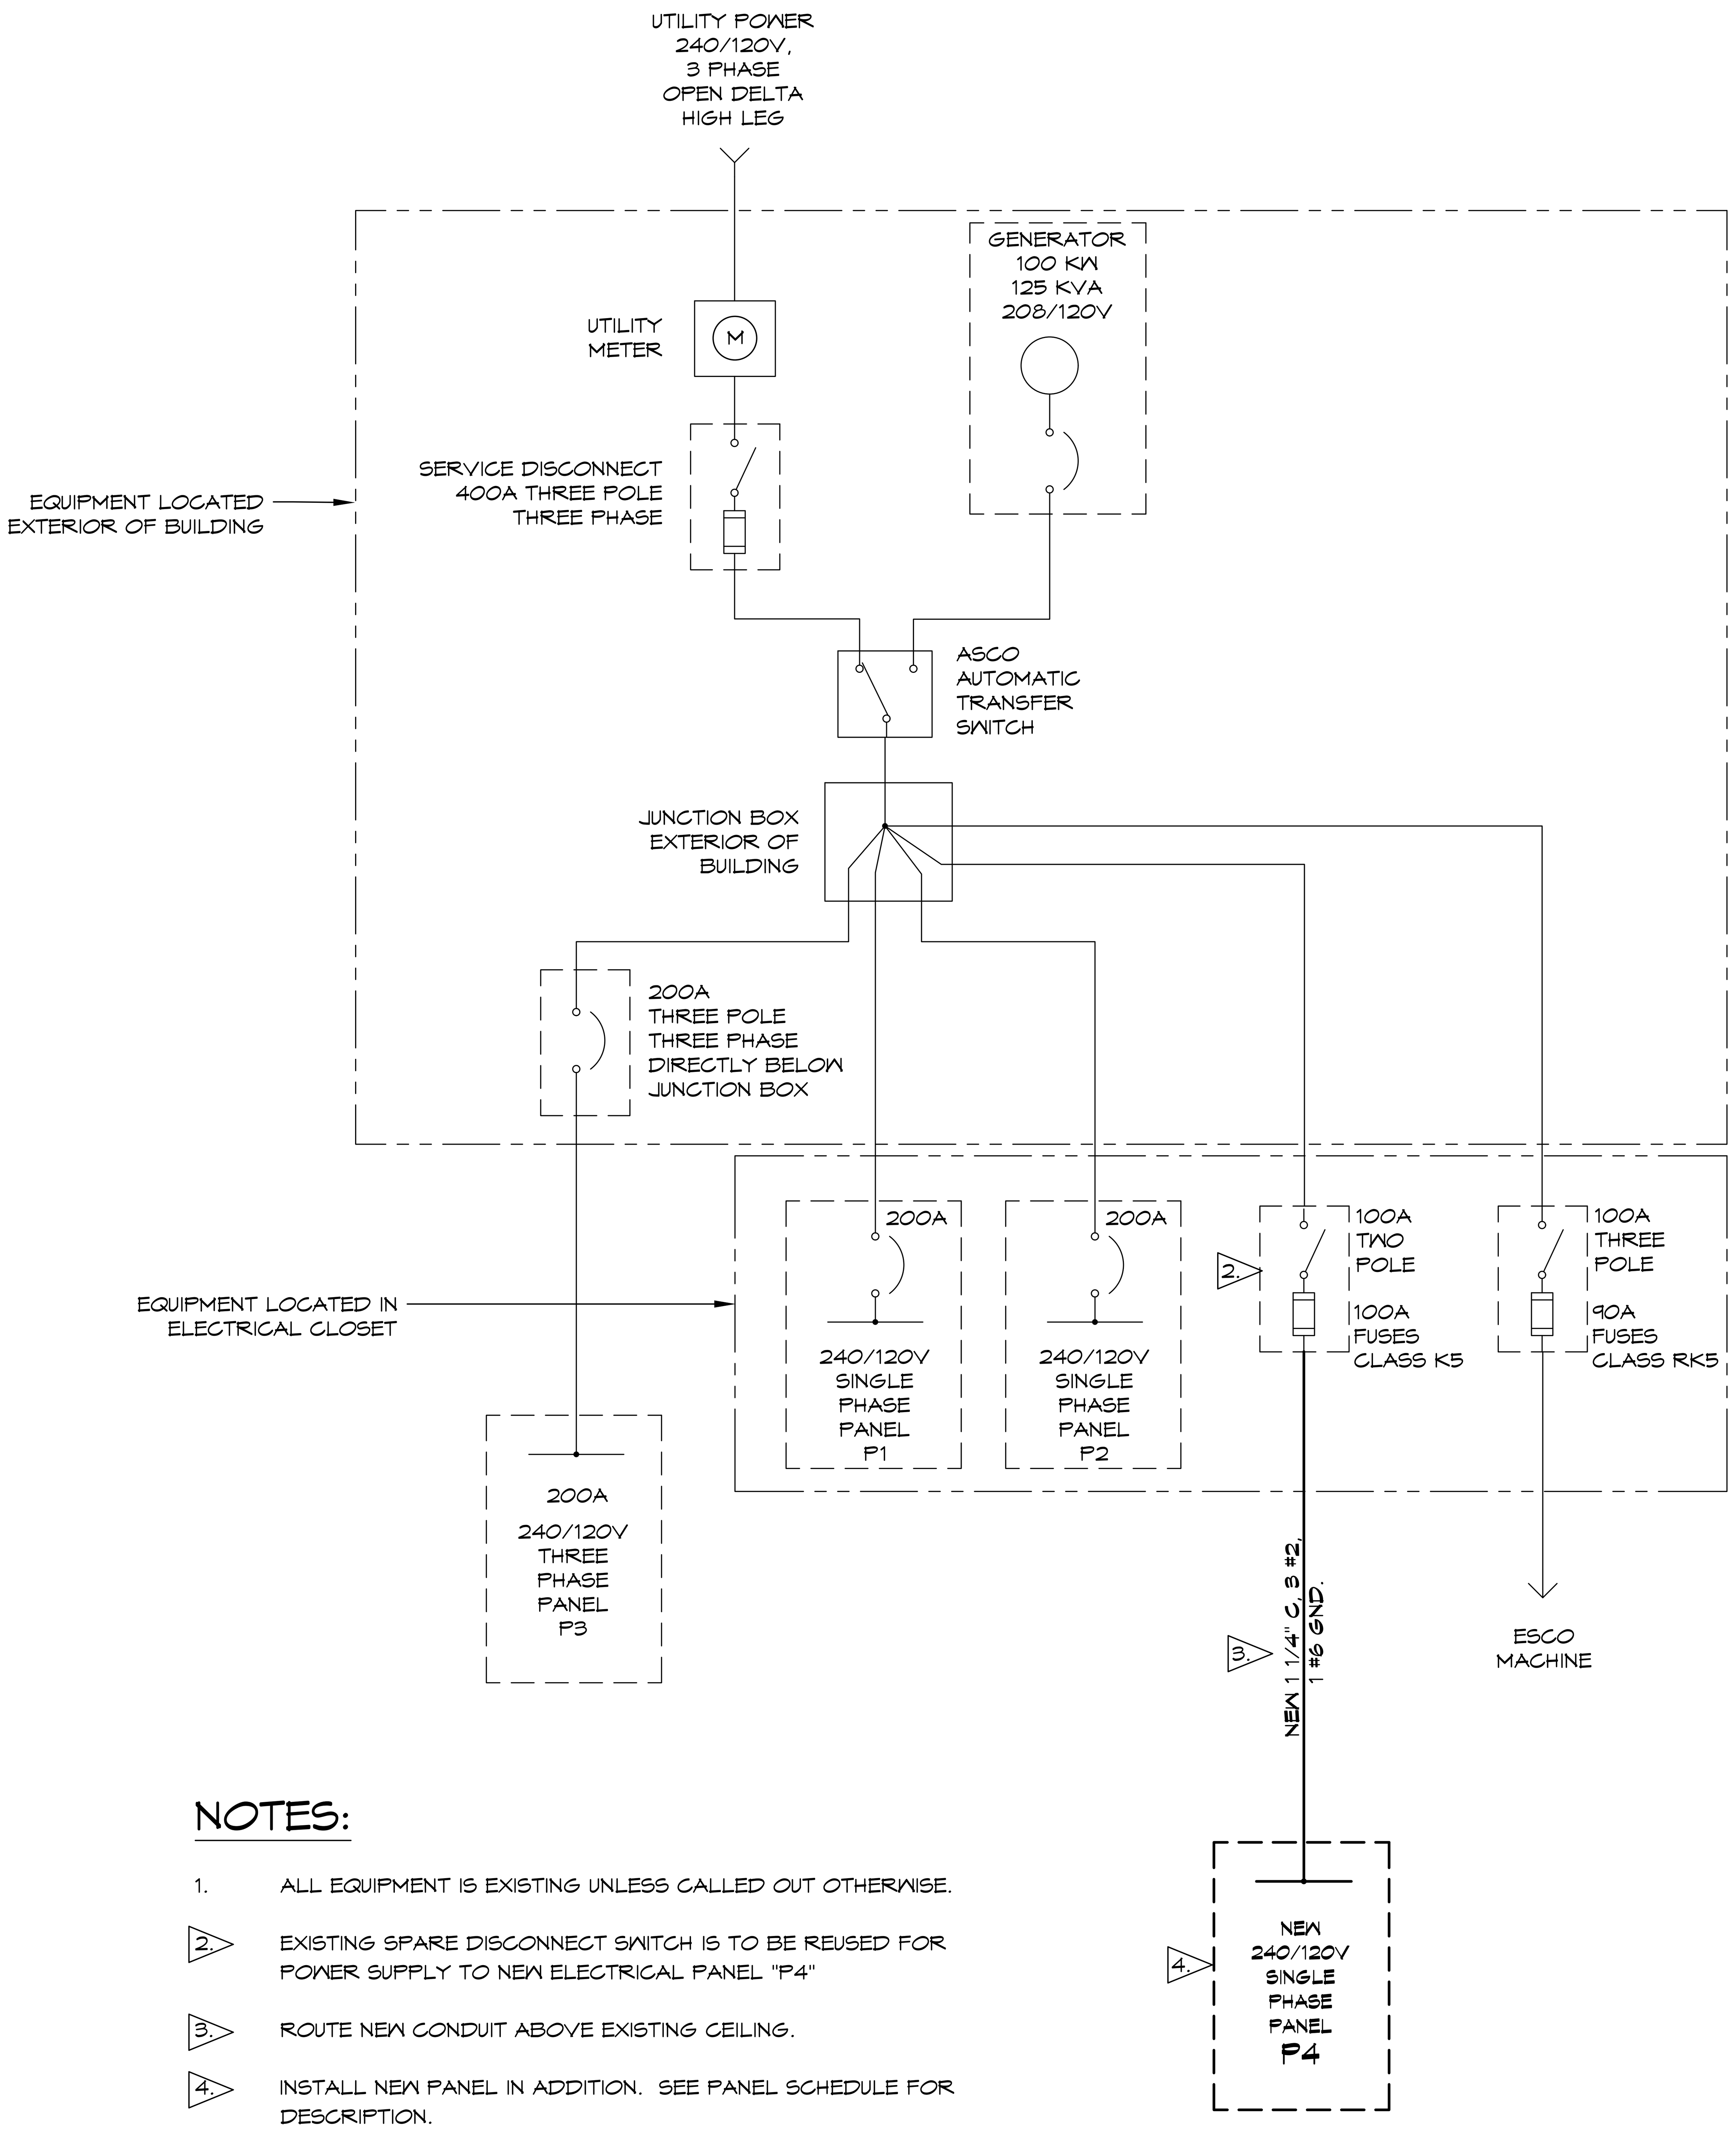


## NOTES:

1. ALL EQUIPMENT IS EXISTING UNLESS CALLED OUT OTHERWISE.
2. EXISTING SPARE DISCONNECT SWITCH IS TO BE REUSED FOR POWER SUPPLY TO NEW ELECTRICAL PANEL "P4"
3. ROUTE NEW CONDUIT ABOVE EXISTING CEILING.
4. INSTALL NEW PANEL IN ADDITION. SEE PANEL SCHEDULE FOR DESCRIPTION.

33 ONE LINE DIAGRAM (EXISTING BUILDING)
SCALE:

## NOTES:

1. MARK HIGH LEG WITH ORANGE TAPE PER NEC ART 230.56.
2. FIELD MARK PANEL AS FOLLOWS: "CAUTION B PHASE HAS 208 VOLTS TO GROUND" PER NEC ART 408.3 (F)




34 DELTA HIGH LEG DIAGRAM
SCALE:

DAMMON
ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832

| # | DESCRIPTION | REVISIONS | DATE |
|---|---|---|---|

SEAL:
STATE OF LOUISIANA
BRIAN A. MISTICH
License No. 30187
PROFESSIONAL ENGINEER

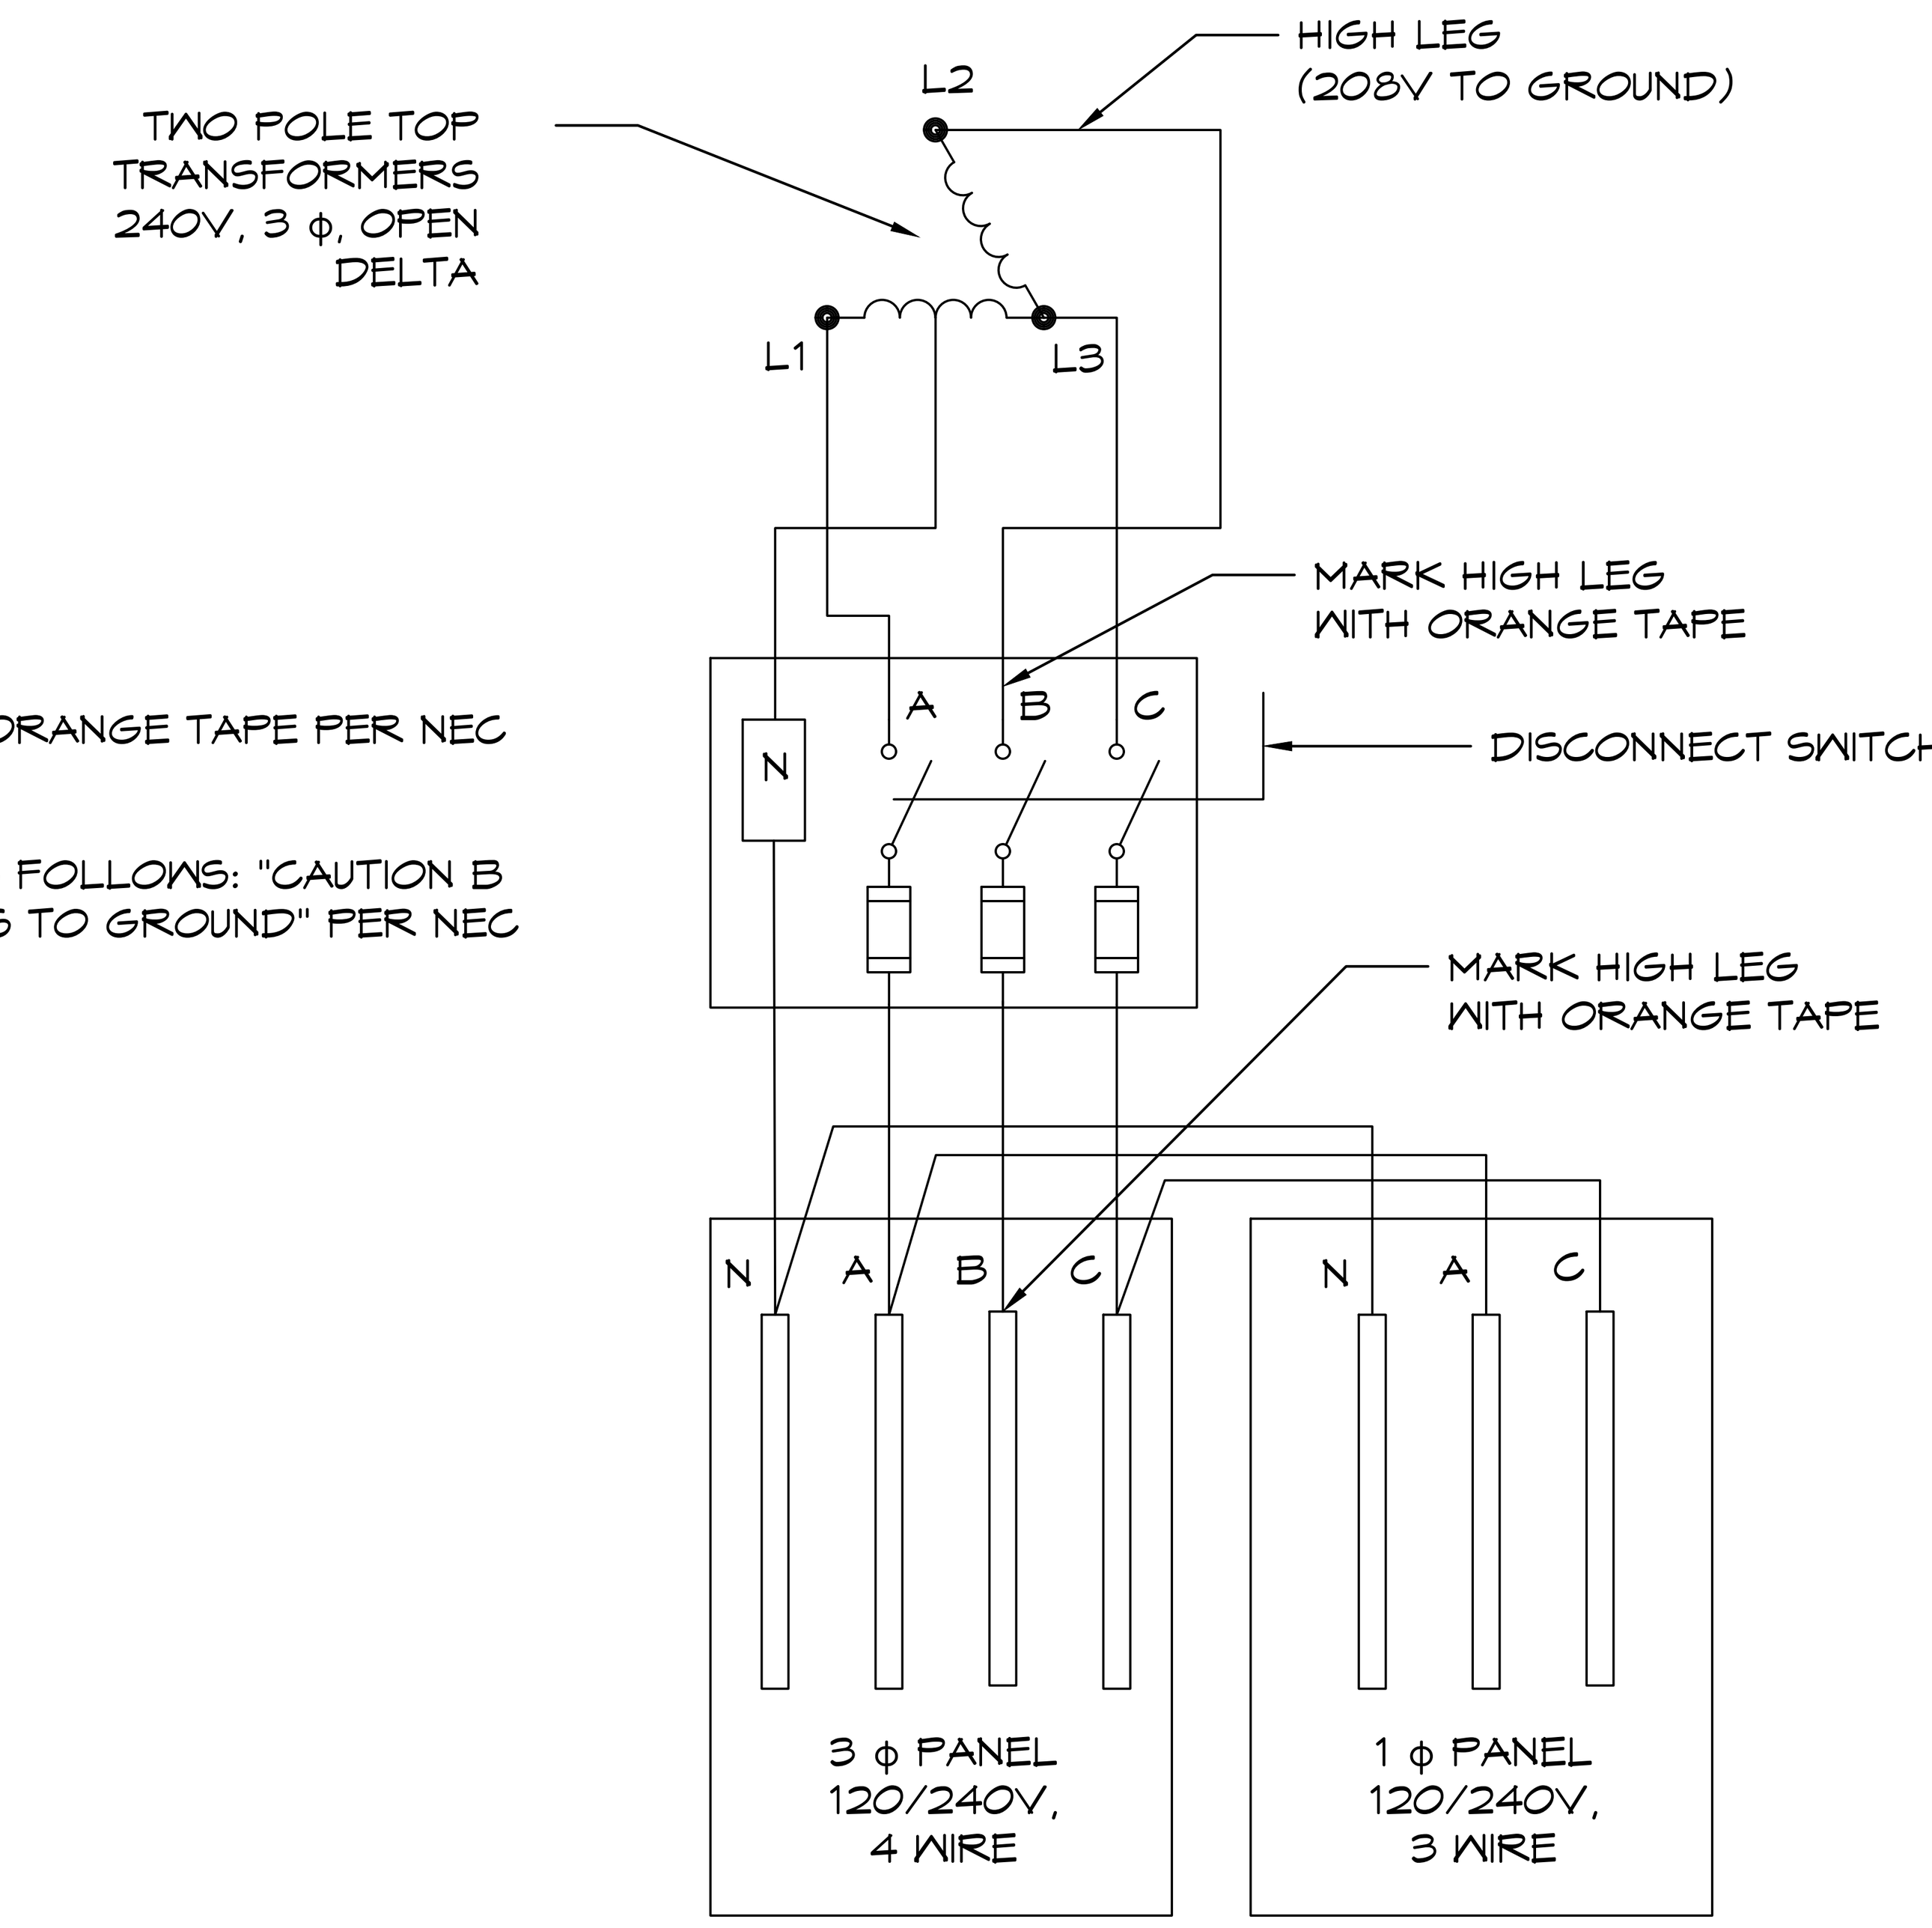NEW WAREHOUSES
J & Y INVESTMENTS LLC
429 SOUTH STREET
SLIDELL, LA 70460

JOB No: 2448 | DATE: 08-21-2025
DRAWN BY: DD/JTL | CHECKED BY: BAM

SHEET TITLE:
ELECTRICAL ONE LINE DIAGRAM

DRAWING NUMBER:
E105

SHEET No: 15 of 16