


DAMMON
ENGINEERING, INC.

CHIEF ENGINEER
EMMETT
DAMMON, P.E.
CHIEF ARCHITECT
ROBERT
WILTSE

1095 FLORIDA AVENUE
SLIDELL, LA, 70458
OFFICE: 985-649-5832
FAX: 985-641-5950

WEBSITE:
WWW.DAMMONENGINEERING.COM
EMAIL:
DAMMONENG@BELLSouth.NET


ARCHITECTURE
ENGINEERING
STUDIES
PLANNING
INVESTIGATION
EXPERT WITNESS

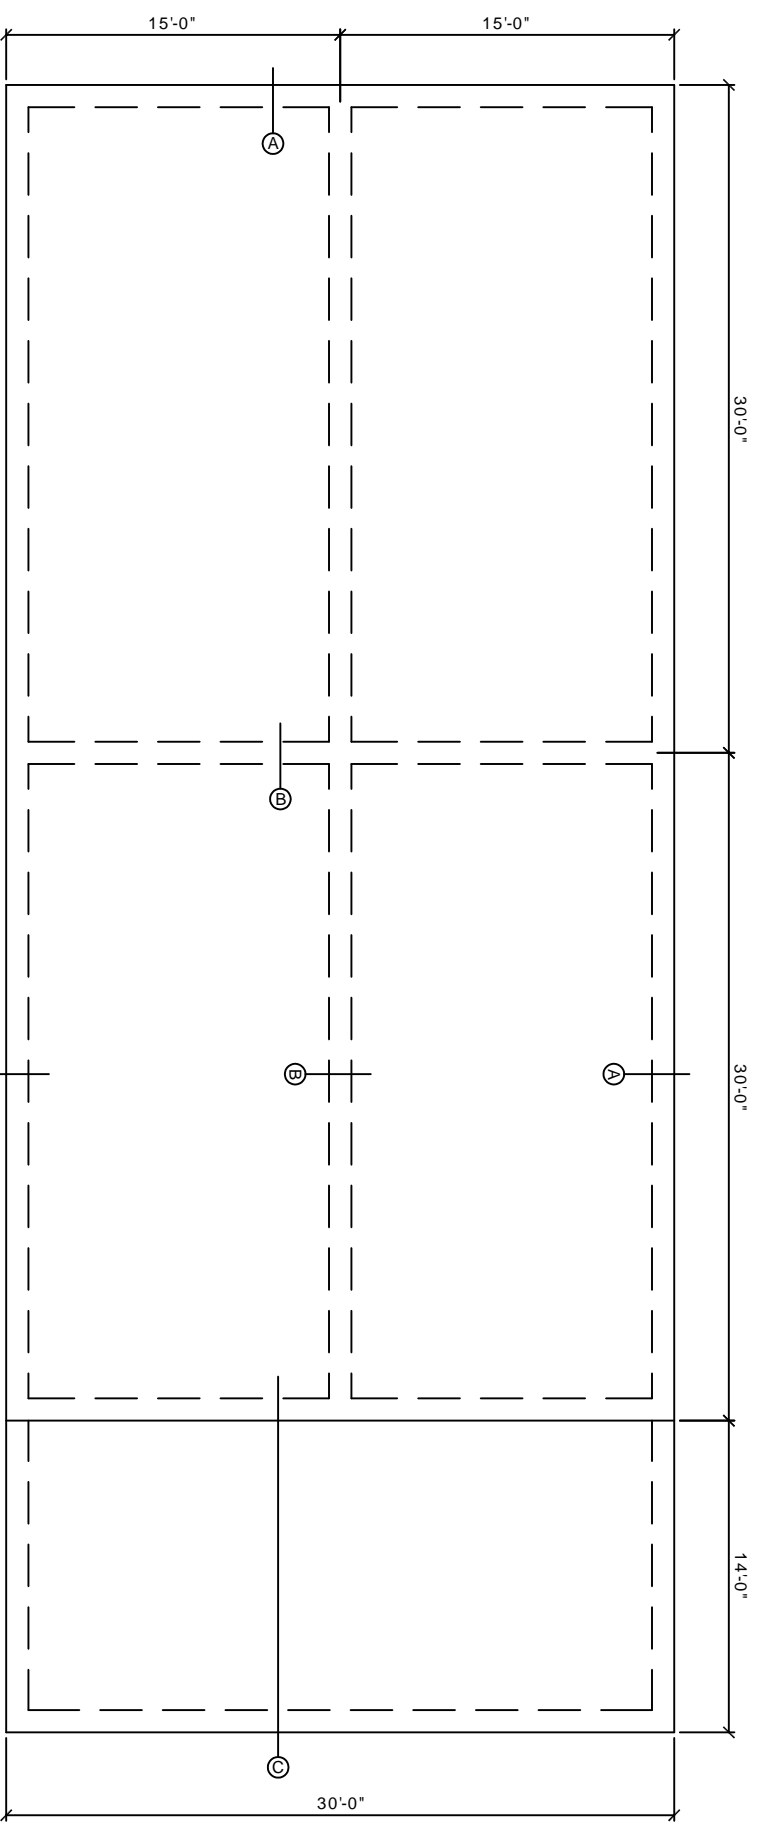


NEW GARAGE FOUNDATION PLAN
SCALE: 1/4" = 1'




- FOUNDATION GENERAL NOTES**
1. Fill under slab shall consist of 40% clay and 60% sand mixture compacted to 95% compaction, after slab area has been excavated to remove all debris and organics.
 2. 4 inch cast-in-place under the slab shall be either previous sand or granular fill.
 3. Beam dimensions shown are minimum required and shall not be reduced.
 4. Provide a vapor barrier layer of 6 MIL polyethylene under concrete.
 5. All reinforcement shall be securely supported to prevent both vertical and horizontal movement during placement of concrete.
 6. All corners shall have 90 degree reinforcement 24 inches each way.
 7. Concrete shall be well consolidated especially in the vicinity of reinforcement.
 8. Concrete shall have a minimum compression strength of 3000 PSI at 28 days. Concrete design mix shall be in accordance with ACI Building Code Requirements (ACI - 318R-89).
 9. All conventional reinforcing steel shall be ASTM Designation A 615 (Grade 60) reinforcing and shall be detailed and accessories provided in accordance with the latest ACI manual of standard practice for detailing reinforced concrete structural.
 10. Reinforcement steel shall have 3 inches cover in grade beam bottoms, 2 inches cover in beam sides, and 1 1/2 inches cover in slab tops unless otherwise shown.
 11. The contractor shall verify all drops, slopes, recesses, brick seats, block outs on architectural plans and notify the engineer of any discrepancies that may exist.
 12. Coordinate structural drawings with architectural and mechanical drawings for all openings, inserts, and any other related items.
 13. Plans for pipes, conduits, chimbels, etc. to pass through concrete slabs or beams must not conflict with reinforcing, where a conflict occurs, reinforcing location is to take precedence.
 14. Forms to be stripped no later than 6 days after placement of concrete.
- NOTE:** Slumps may be replaced with wire supports.
- Although every effort has been made to ascertain compliance with the 2006 IRC it is the contractor's responsibility to verify all setbacks, brick ledges, drops, and details.

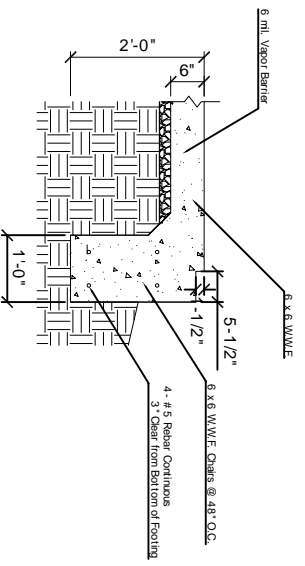

SECTION "A"

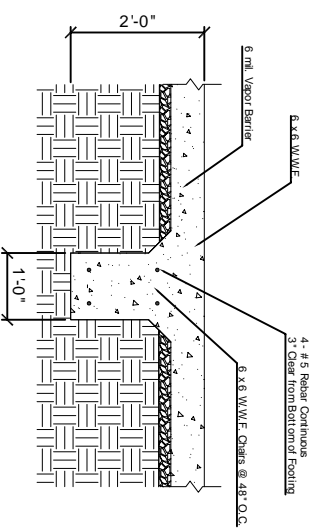

SECTION "B"

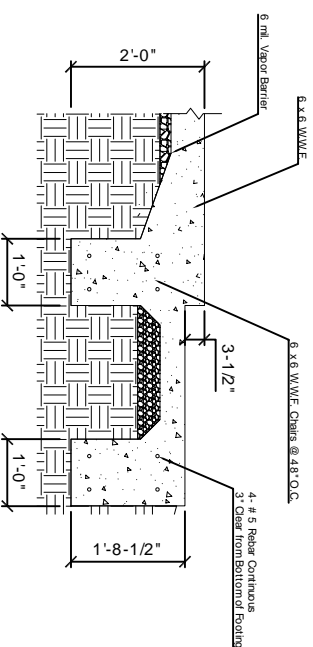

SECTION "C"

**FOUNDATION
PLAN**

DOUGLAS DEGAN
314 LANDON DR.
SLIDELL, LA
70458

REV/:

SCALE: 1/4" = 1'

JOB#: 0000

DATE: 4/28/09

SHEET 2

A-2

OF 5