


ELECTRICAL NOTES #	
1	REFER TO TYPICAL EXAM ROOM ON THIS SHEET FOR DEVICE LAYOUT.
2	COORDINATE MOUNTING OF DEVICES AND ROUTING OF CONDUIT WITH MILLWORK PROVIDER PRIOR TO INSTALLATION.
3	1" CONDUITS WITH CABLE INDICATED TO NEAREST WALL WITH ACCESSIBLE CEILING. STUB UP A MINIMUM OF 6" ABOVE CEILING.
4	DISTRESS BUTTON. VERIFY LOCATION WITH OWNER/ARCHITECT PRIOR TO INSTALLATION.
5	3/4" CONDUIT WITH CABLE TO COMMUNICATION BACKBOARD.
6	REFER TO TYPICAL OFFICE ON THIS SHEET FOR DEVICE LAYOUT.
7	CONNECT DOOR HARDWARE TO FIRE ALARM SYSTEM. DOOR TO BE RELEASED UPON ACTIVATION OF FIRE ALARM SYSTEM.

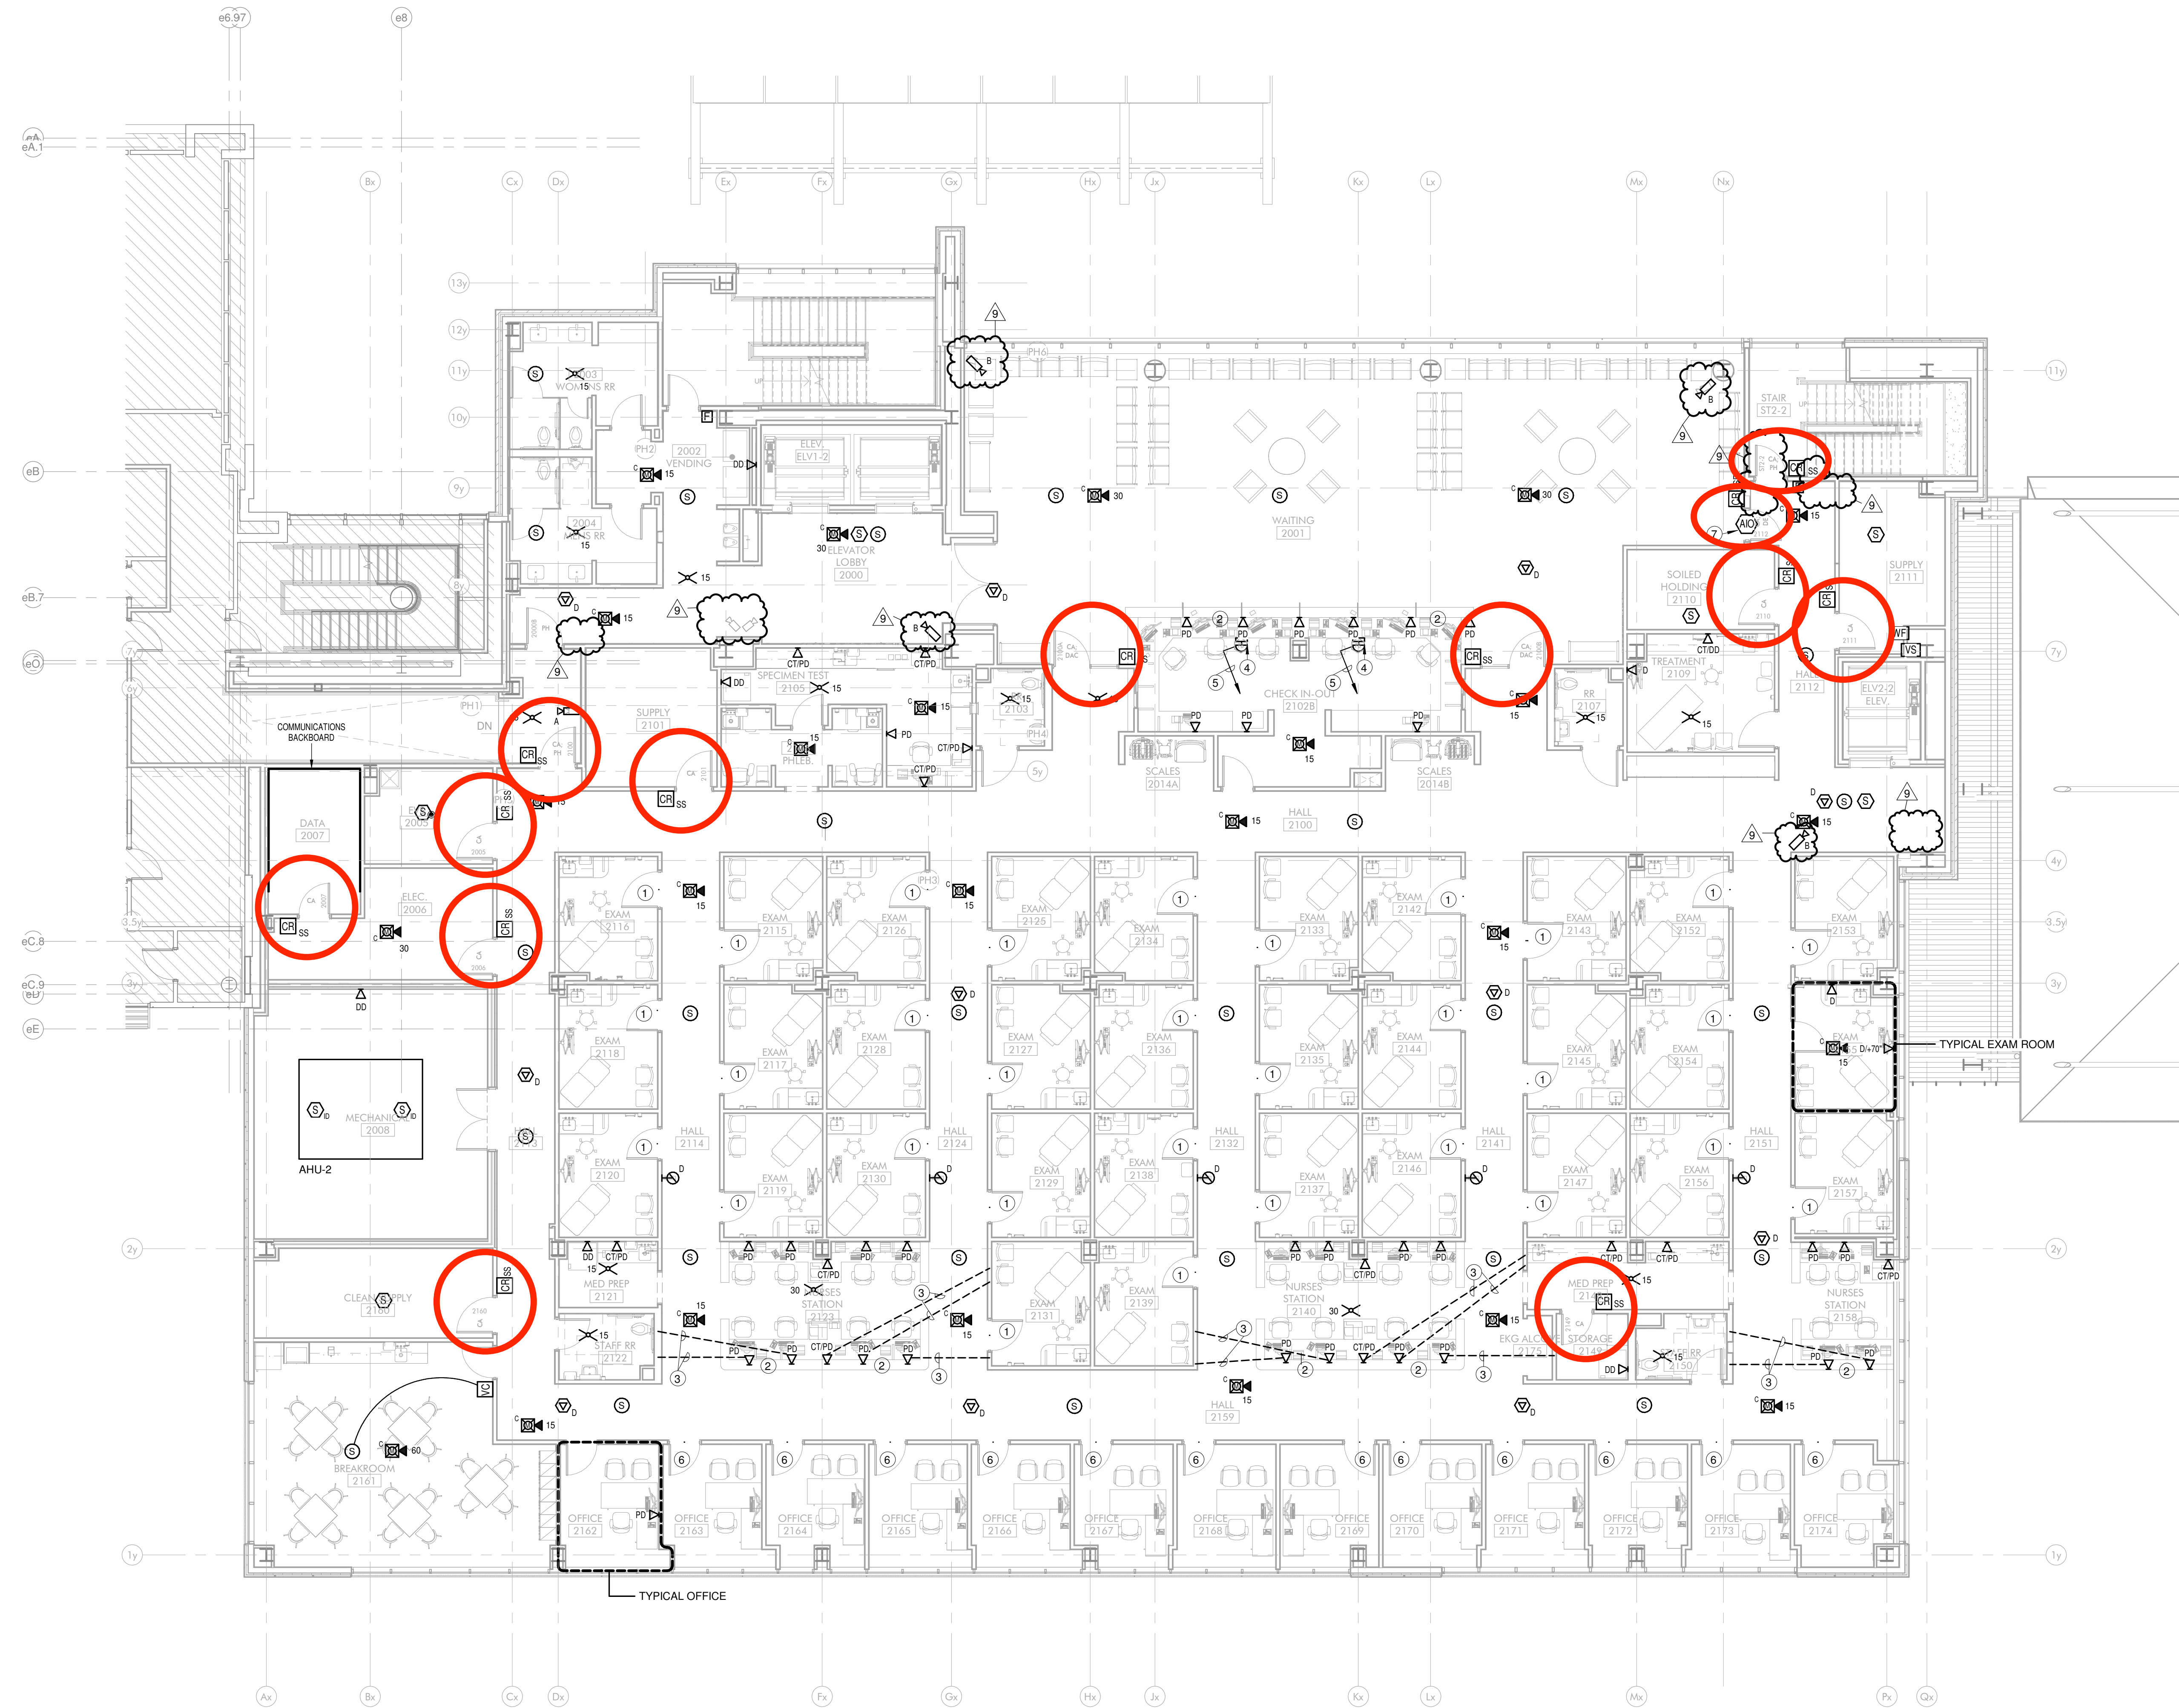

1 LEVEL 2 - SPECIAL SYSTEMS PLAN
 SCALE: 1/8" = 1'-0" (REFER TO ARCHITECTURAL DRAWINGS FOR ALL DIMENSIONS)