


NOTES:

1. LENGTHS "X" AND "Y" SHALL BE DETERMINED BY AHU BASED ON TOTAL STATIC PRESSURE.
2. "X" AND "Y" SHALL BE EQUAL TO MINIMUM 1/2 TOTAL UNIT STATIC PRESSURE.
3. ALL CONDENSATE PIPING SHALL BE SLOPED AT 1/4" PER FOOT

DRAIN LINE SHALL BE AT LEAST THE
SAME SIZE AS THE NIPPLE ON THE
DRAIN PAN

CLEAN-OUT

PITCH DOWN TOWARD
SEWER AT 1/4" PER FT

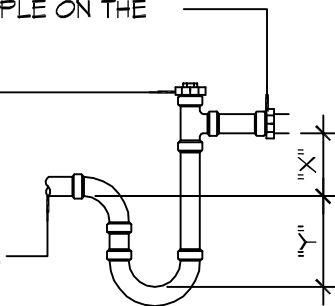

4 DETAIL

SCALE: NTS

CONDENSATE TRAP